



Level



Pressure



Flow



Temperature



Liquid
Analysis



Registration



Systems
Components



Services



Solutions


Functional Safety Manual

Micropilot M

FMR230/231, FMR240/244/245, FMR250

Level-Radar

with 4 to 20 mA Output Signal

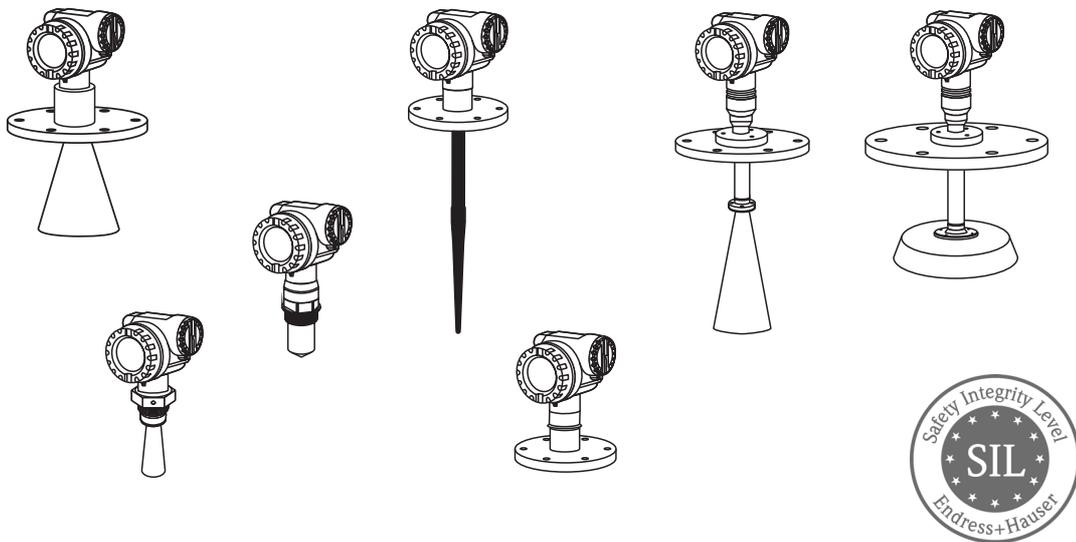

Application

Operating minimum (e.g. dry run protection) and maximum (e.g. overflow protection) detection of powdery to granular bulk solids and all types of liquids in systems to satisfy particular safety systems requirements as per IEC 61508/IEC 61511.

The measuring device fulfils the requirements concerning

- Functional safety as per IEC 61508/IEC 61511
- Explosion protection (depending on the version)
- Electromagnetic compatibility as per EN 61326 and NAMUR recommendation NE 21
- Electrical safety as per IEC/EN 61010-1


Your benefits

- Used for level monitoring (MIN, MAX) up to SIL 2
 - Independently assessed (Functional Assessment) by *exida.com* as per IEC 61508/IEC 61511
- Permanent self-monitoring
- Continuous measurement
- Non-contact measurement: measurement is virtually independent of product properties
- Easy commissioning

Table of contents

SIL Declaration of Conformity	3
Introduction	4
Structure of the measuring system	4
System components	4
Description of use as a protective system	5
Permitted device types	5
Supplementary device documentation	7
Description of the safety requirements and boundary conditions	8
Safety function	8
Restrictions for use in safety-related applications	8
Functional safety indicators	9
Behavior of device during operation and in case of error	11
Installation	11
Operation	11
Maintenance	14
Proof-test	15
Proof-test	15
Process for proof-testing	15
Repairs	16
Repairs	16
Appendix	17
Commissioning or proof test protocol	17
Exida Management Summary	18

SIL Declaration of Conformity



SIL-10084a/00/A2

SIL-Konformitätserklärung

Funktionale Sicherheit nach IEC 61508

SIL Declaration of Conformity

Functional safety according to IEC 61508

Endress+Hauser GmbH+Co. KG, Hauptstraße 1, 79689 Maulburg

erklärt als Hersteller, dass das Gerät
declares as manufacturer, that the device

Micropilot M FMR230/231, FMR240/244/245, FMR250

für den Einsatz in Schutzeinrichtungen entsprechend der IEC 61508/IEC 61511 geeignet ist, wenn das Handbuch zur Funktionalen Sicherheit und die Kenngrößen in der folgenden Tabelle beachtet werden:
is suitable for the use in safety-instrumented systems according to IEC 61508/IEC 61511, if the functional safety manual and the characteristics specified in the following table are observed:

Gerät/Product	FMR23x mit Ausgang/with output 4...20 mA		FMR24x, FMR250 mit Ausgang/with output 4...20 mA	
Handbuch zur Funktionalen Sicherheit/ Functional safety manual	SD00327F			
SIL *4	2			
HFT	0			
Gerätetyp/Device type	B			
Betriebsart/Mode of operation	Low demand mode			
MTBF *3	35 Jahre/years			
Sicherheitsfunktion/Safety function	MIN	MAX	MIN	MAX
SFF	67 %	74 %	68 %	75 %
PFD _{avg} *1 T ₁ = 1 Jahr/year	4.01 × 10 ⁻³	3.11 × 10 ⁻³	3.96 × 10 ⁻³	3.05 × 10 ⁻³
λ _{sd} [FIT] *2	392	87	356	99
λ _{su} [FIT] *2	951	1125	1031	1207
λ _{sd} [FIT] *2	541	846	621	878
λ _{su} [FIT] *2	916	710	903	697

*1 Die Werte entsprechen SIL 2 nach ISA S84.01. PFD_{avg}-Werte für andere T₁-Werte siehe Handbuch zur Funktionalen Sicherheit.
The values comply with SIL 2 according to ISA S84.01. PFD_{avg} values for other T₁-values see Functional Safety Manual.

*2 Gemäß Siemens SN29500.
According to Siemens SN29500.

*3 Gemäß Siemens SN29500, einschließlich Fehlern, die außerhalb der Sicherheitsfunktionen liegen.
According to Siemens SN29500, including faults outside the safety function.

*4 Betrachtung gemäß IEC 61511-1 Abschnitt 11.4.4.
Consideration according to IEC 61511-1 clause 11.4.4.

Das Gerät einschließlich Software, wurde auf Basis der Betriebsbewährung bewertet. Bei Geräteänderungen wird ein Modifikationsprozess nach IEC 61508 angewendet.
The device including software was assessed on the basis of proven-in-use. In case of device modifications, a modification process according to IEC 61508 is applied.

Maulburg, 26.11.2010

i.V.

(Dr. Arno Götz)
Leitung Zertifizierung/Manager Certification

i.V.

(Peter Kloefer)
Abteilungsleiter Kontinuierliche Füllstandsmessung/
Head of Department Continuous Level Measurement

Endress+Hauser
People for Process Automation

Introduction




Note!

General information on functional safety (SIL) is available at:
www.de.endress.com/SIL (German) or www.endress.com/SIL (English) and in Competence Brochure CP002Z "Functional Safety in the Process Industry - Risk Reduction with Safety Instrumented Systems".

Structure of the measuring system

System components

The measuring system's devices are displayed in the following diagram (example).

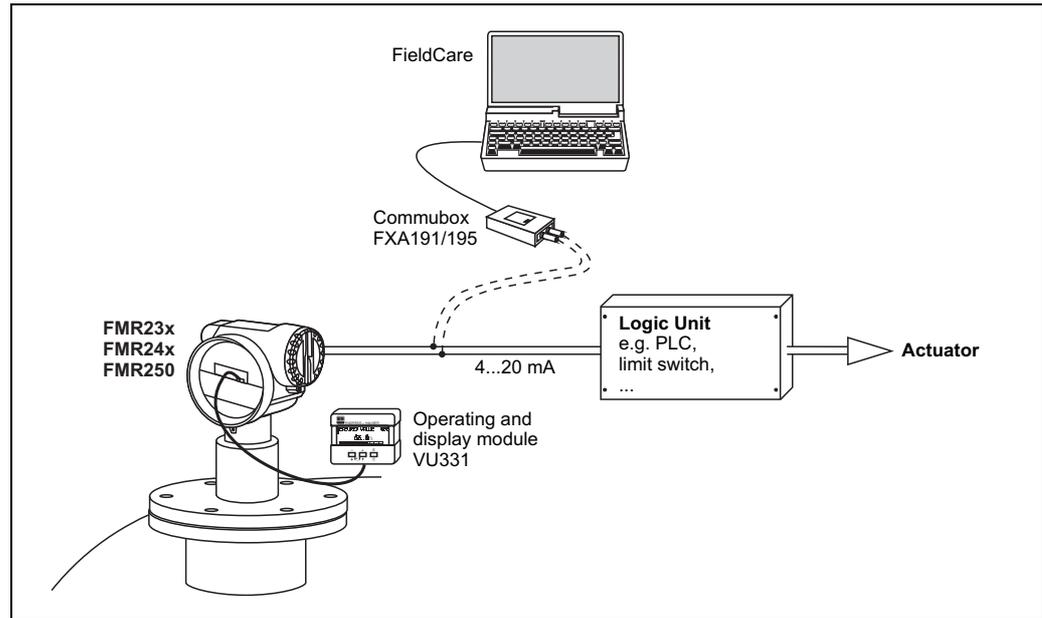

SD00327en01


An analog signal (4 to 20 mA) in proportion to the level is generated in the transmitter. This is sent to a downstream logic unit (e.g. PLC, limit signal transmitter, etc.) where it is monitored to determine whether it is below or above a specified limit value.

For fault monitoring, the logic unit must recognize both HI-alarms (≥ 21.0 mA) and LO-alarms (≤ 3.6 mA).

Description of use as a protective system

The Micropilot M is a "downward-looking" measuring system that functions according to the ToF method (ToF = Time of Flight). The distance from the reference point (process connection of the measuring device) to the product surface is measured. Radar impulses are emitted by an antenna, reflected off the product surface and received again by the radar system.

Typical measuring arrangement:

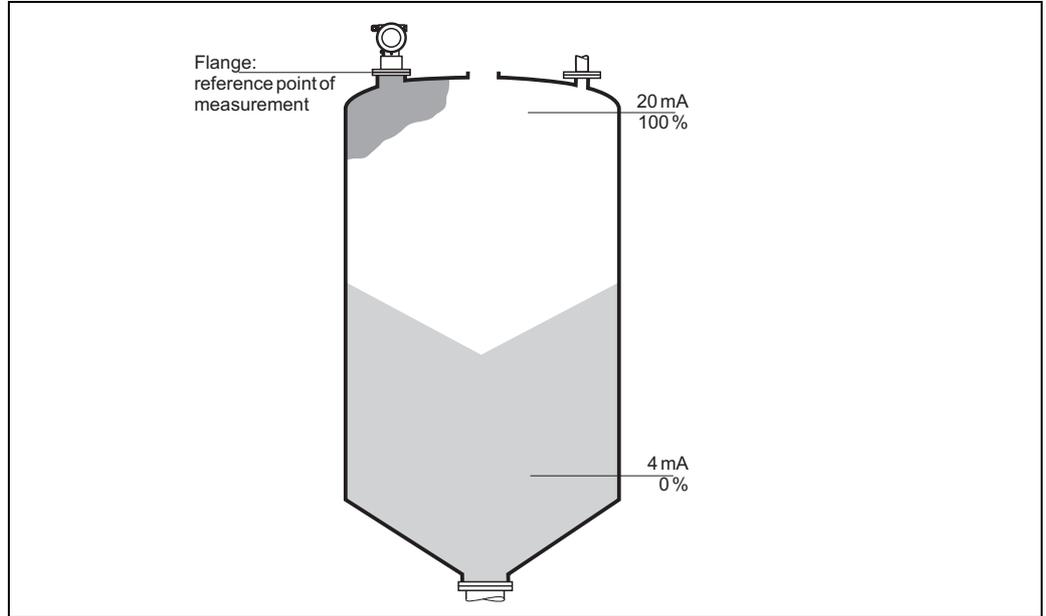

SD00327en02



Note!
Correct installation is a prerequisite for safe operation of the device.

Permitted device types

The details pertaining to functional safety in this manual relate to the device versions listed below and are valid as of the specified software and hardware version. Unless otherwise specified, all subsequent versions can also be used for safety instrumented systems.

A modification process according to IEC 61508 is applied for device changes.

Valid device versions for safety-related use:

Micropilot M FMR230, FMR244		
Feature	Designation	Version
010	Approval	all
020	Antenna	all
030	Antenna Seal; Temperature	all
040	Process Connection	all
050	Output; Operation	A, B, K
060	Housing	all
070	Cable Entry	all
080	Additional Option	all

Valid software version: FMR230: as of 01.04.00; FMR244: as of 01.05.00

Valid hardware version (electronics): as of delivery date January 2010

Micropilot M FMR231		
Feature	Designation	Version
010	Approval	all
020	Antenna; Inactive Length	all
030	Process Connection	all
040	Output; Operation	A, B, K
050	Housing	all
060	Cable Entry	all
070	Gas-Tight Feed Through	all
080	Additional Option	all

Valid software version: FMR231: as of 01.04.00

Valid hardware version (electronics): as of delivery date January 2010

Micropilot M FMR240, FMR250		
Feature	Designation	Version
010	Approval	all
020	Antenna	all
030	Antenna Seal; Temperature	all
040	Antenna Extension	all
050	Process Connection	all
060	Output; Operation	A, B, K
070	Housing	all
080	Cable Entry	all
090	Additional Option	all

Valid software version: FMR240, FMR250: as of 01.05.00

Valid hardware version (electronics): as of delivery date January 2010

Micropilot M FMR245		
Feature	Designation	Version
010	Approval	all
020	Antenna	all
030	Process Connection	all
040	Output; Operation	A, B, K
050	Housing	all
060	Cable Entry	all
070	Additional Option	all

Valid software version: FMR245: as of 01.05.00

Valid hardware version (electronics): as of delivery date January 2010

Supplementary device documentation

Documentation	Contents	Comment
Technical Information TI00345F/00 (FMR23x, FMR24x) TI00390F/00 (FMR250)	<ul style="list-style-type: none"> - Technical data - Instructions on accessories 	<ul style="list-style-type: none"> - The documentation is available on the Internet. → www.de.endress.com.
Operating Instructions (HART) BA00218F/00 (FMR230) BA00219F/00 (FMR231) BA00220F/00 (FMR240) BA00248F/00 (FMR244) BA00251F/00 (FMR245) BA00284F/00 (FMR250)	<ul style="list-style-type: none"> - Identification - Installation - Wiring - Operation - Commissioning - Maintenance - Accessories - Troubleshooting - Technical data - Appendix 	<ul style="list-style-type: none"> - The documentation is supplied with the device. - The documentation is also available on the Internet. → www.de.endress.com.
Operating Instructions (Device Functions) BA00221F/00 (FMR23x) BA00291F/00 (FMR24x, FMR250)	<ul style="list-style-type: none"> - Instructions on use - Micropilot M function menu - Function groups ... - ... - Envelope curve - Troubleshooting - Function menu index 	<ul style="list-style-type: none"> - The documentation is available on the Internet. → www.de.endress.com.
Safety instructions depending on the selected version "Approval"	<ul style="list-style-type: none"> - Safety, installation and operating instructions for devices, which are suitable for use in potentially explosive atmospheres or as overfill protection (WHG, German Water Resources Act). 	<p>Additional safety instructions (XA, XB, XC, ZE, ZD) are supplied with certified device versions. Please refer to the nameplate for the relevant safety instructions.</p>

Description of the safety requirements and boundary conditions

Safety function



The mandatory settings and safety function data emanate from the descriptions from → 11.
The measuring system's reaction time is ≤ 5 s.

Note!

MTTR is set at 8 hours.

Safety-related signal:

The Micropilot M's safety-related signal is the 4 to 20 mA analog output signal.
All safety measures refer to this signal exclusively.

The Micropilot M additionally communicates effectively via HART and contains all HART features with additional device information.

The safety-related output signal is fed to a downstream logic unit, e.g. a programmable logic controller or a limit signal transmitter where it is monitored for the following:

- Overshooting and/or undershooting a specified level limit.
- The occurrence of a fault, e.g. error current (≤ 3.6 mA, ≥ 21.0 mA, interruption or short-circuit of the signal line).

Restrictions for use in safety-related applications

The measuring system must be used correctly for the specific application, taking into account the medium properties and ambient conditions. Carefully follow instructions pertaining to critical process situations and installation conditions from the Operating Instructions.

The specifications from the Operating Instructions (→ 7, "Supplementary device documentation") must not be exceeded.

The following restriction also applies to safety-related use:

- The accuracy of the 4 to 20 mA safety-related output signal is $\pm 10\%$.

Functional safety indicators

The following tables show specific indicators for functional safety.

Characteristic as per IEC 61508	FMR23x with 4 to 20 mA output	
	MIN	MAX
Safety functions		
SIL	2	
HFT	0	
Device type	B	
Mode of operation	Low demand mode	
SFF	67 %	74 %
MTTR	8 h	
Recommended time interval for proof-testing T ₁	1 year	
λ _{sd} *2	392 FIT	87 FIT
λ _{su} *2	951 FIT	1125 FIT
λ _{dd} *2	541 FIT	846 FIT
λ _{du} *2	916 FIT	710 FIT
λ _{tot} *3	2800 FIT	2768 FIT
PF _D avg for T ₁ = 1 year *1	4,01 × 10 ⁻³	3,11 × 10 ⁻³
PF _D avg for T ₁ = 1 year *5	4,75 × 10 ⁻³	3,69 × 10 ⁻³
MTBF *3	35 years	
System reaction time *4	≤ 5 s	

*1 PF_Davg values for other T₁-values see "Proof-test interval".

Calculation formula: $PF_{D,avg} = \frac{1}{2} \cdot \lambda_{DU} \cdot T_1$


*2 According to Siemens SN29500.

*3 According to Siemens SN29500, including faults outside the safety function.

*4 Step response time as per DIN EN 61298-2.

*5 Calculated, with MTTR = 24 h, lifetime (LT) = 10 years and proof test coverage (PTC) = 98 %, using the following formula:

$$PF_{D,avg} = \frac{1}{2} \cdot PTC \cdot \lambda_{DU} \cdot T_1 + \lambda_{DD} \cdot MTTR + \frac{1}{2} \cdot (1 - PTC) \cdot \lambda_{DU} \cdot LT$$

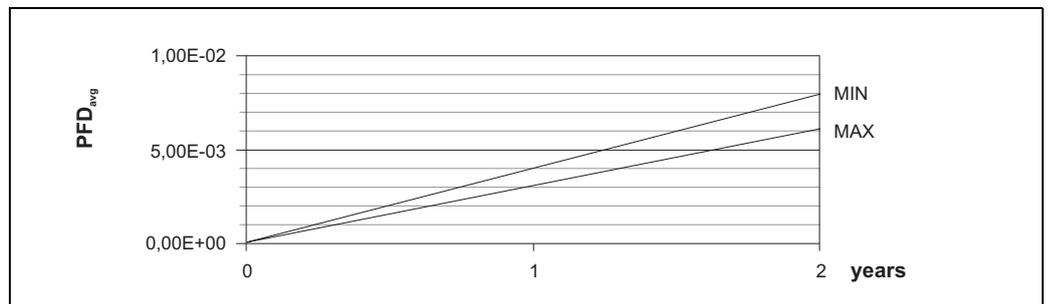

Proof-test interval

SD00327en03

Characteristic as per IEC 61508	FMR24x, FMR250 with 4...20 mA output	
Safety functions	MIN	MAX
SIL	2	
HFT	0	
Device type	B	
Mode of operation	Low demand mode	
SFF	68 %	75 %
MTTR	8 h	
Recommended time interval for proof-testing T_1	1 year	
λ_{sd} *2	356 FIT	99 FIT
λ_{su} *2	1031 FIT	1207 FIT
λ_{dd} *2	621 FIT	878 FIT
λ_{du} *2	903 FIT	697 FIT
λ_{tot} *3	2911 FIT	2881 FIT
PFD _{avg} for $T_1 = 1$ year *1	$3,96 \times 10^{-3}$	$3,05 \times 10^{-3}$
PFD _{avg} for $T_1 = 1$ year *5	$4,68 \times 10^{-3}$	$3,62 \times 10^{-3}$
MTBF *3	35 years	
System reaction time *4	≤ 5 s	

*1 PFD_{avg} values for other T_1 -values see "Proof-test interval".

$$\text{Calculation formula: } \text{PFD}_{\text{avg}} = \frac{1}{2} \cdot \lambda_{\text{DU}} \cdot T_1$$


*2 According to Siemens SN29500.

*3 According to Siemens SN29500, including faults outside the safety function.

*4 Step response time as per DIN EN 61298-2.

*5 Calculated, with MTTR = 24 h, lifetime (LT) = 10 years and proof test coverage (PTC) = 98 %, using the following formula:

$$\text{PFD}_{\text{avg}} = \frac{1}{2} \cdot \text{PTC} \cdot \lambda_{\text{DU}} \cdot T_1 + \lambda_{\text{DD}} \cdot \text{MTTR} + \frac{1}{2} \cdot (1 - \text{PTC}) \cdot \lambda_{\text{DU}} \cdot \text{LT}$$

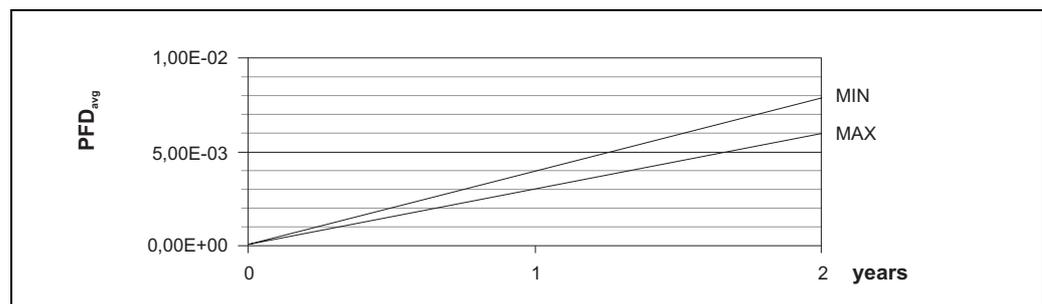

SD00327en04

Proof-test interval

Dangerous undetected failures in this scenario:

An incorrect output signal that deviates from the real measured value by more than 10%, but is still in the range of 4 to 20 mA, is considered a dangerous, undetected failure.

Useful lifetime of electrical components:

The established failure rates of electrical components apply within the useful lifetime as per IEC 61508:2000, section 7.4.7.4. note 3.

Behavior of device during operation and in case of error

Behavior of device during power-up

The safe 4 to 20 mA output signal is available after 17 s after the device is switched on or when the voltage returns.

Device response in the event of alarms or warnings

Error current

In the event of an alarm, the output current can be configured to a value of ≤ 3.6 mA or ≥ 21.0 mA.

In some cases (e.g. failure of power supply, a cable open circuit and faults in the current output itself, where the error current ≥ 21.0 mA cannot be set), output currents ≤ 3.6 mA irrespective of the configured error current can occur.

For alarm monitoring, the logic unit must therefore be able to recognize both HI-alarms (≥ 21.0 mA) and LO-alarms (≤ 3.6 mA).

Alarm and warning messages

Additional information is available in the form of fault codes on the alarm and warning messages output.

Installation

Installation, wiring and commissioning

Installation, wiring and commissioning of the device is described in the accompanying Operating Instructions (→  7, "Supplementary device documentation").

Orientation

The permitted orientations of the device are described in the Operating Instructions.

Operation

Calibration of the measuring point

Calibration of the measuring point is described in the Operating Instructions.

The method of device configuration



Note!

Altered settings (display/FieldCare) in the "extended calibr." function group (Pos. 05) such as "offset" or "curr.turn down" (Pos. 063) in the "output" function group have an effect on the output signal.

This must be taken into account when calculating the response height (see relevant Operating Instructions). We recommend that you check that the behavior of the current signal matches the expected behavior by means of level simulation (correctness of configuration).

Configuration schemata/basic calibration

FieldCare / Display - plain text display	Display VU331 Position
Media type (only FMR24x, FMR250 (software version 01.05.00))	001
↓	
Tank shape * ¹ (FMR23x, FMR24x) or Bin type (FMR250)	002
↓	
Medium property	003
↓	
Process conditions	004
↓	
Empty calibration E	005
↓	
Full calibration F	006
↓	
Pipe diameter (for bypass / stilling well)	007
↓	
Mapping	See Operating Instructions
↓	
Further settings: function group 05	See Operating Instructions
↓	
Overfill protection WHG	018
↓	
On-site locking: 3 keys on the VU331 display	Yes

*¹ For FMR 240 with wave guide antenna, stilling well must always be selected as tank shape.

The parameters are safety-oriented with the "WHG" setting in 018 (→ information in the following table). As an alternative to activating the "WHG" setting, it is also possible to make the safety-oriented setting manually. In doing so, please observe the information in the table below.



Note!

The parameters in *italics* are located on the service level, which can be opened with the code "300".

FieldCare / Display - plain text display	Value/parameter	Display VU331	Comment
Safety settings			
Output on ALARM	Max. 110 %, 22 mA	010	Parameter must be configured in this way
Output echo loss	ALARM	012	Parameter must be configured in this way
Delay time	1 s	014	→ Note 1
In safety distance SD	self holding	016	→ Note 3

FieldCare / Display - plain text display	Value/parameter	Display VU331	Comment
Filtering/averaging/delay			
Envelope statistics up	2	0D23	→ Note 2
Envelope statistics down	2	0D24	→ Note 2
MAM filter length	5	0D11	→ Note 2
MAM filter border	1	0D12	→ Note 2
Output damping	0	058	→ Note 2
Echo detection			
FEF edge (nur bei MIN)	0	0D56	Parameter must be configured in this way
FAC mode	FMC rising	0D99	Parameter must be configured in this way
FAC adder	6 dB	0D35	Parameter must be configured in this way
Tank bottom detection	OFF	0D61	Parameter must be configured in this way
First echo factor	unchanged, but if previously smaller than 30, than: 0D53	0D51	→ Note 3
FEF threshold	0	0D52	→ Note 3
FEF at near distance	30 dB	0D53	→ Note 3
FEF distance near	500 mm	0D54	→ Note 3
FEF distance far	3000 mm	0D55	Parameter must be configured in this way
Max. filling speed	0 mm/s (factory setting)	0D15	Parameter must be configured in this way
Max. drain speed	0 mm/s (factory setting)	0D16	Parameter must be configured in this way
Other			
Detection window	OFF	0A7	Parameter must be configured in this way
Hysteresis width	0 mm (factory setting)	0D14	Parameter must be configured in this way
Communication address	0	060	Parameter must be configured in this way
Current output mode	"Standard" if previously "Fixed current"	063	Parameter must be configured in this way
Simulation	Sim. / OFF	065	Parameter must be configured in this way



Note!

1. This parameter determines the reaction time of the device in the event of echo loss; a setting of less than 30 s is recommended.
2. This parameter determines the reaction time of the device; deviating settings are possible. In case of changes in "**process cond.**" (004) it is automatically adjusted. The corresponding reaction time is indicated in the documentation BA.
3. This parameter can be selected differently, depending on the application.

A measuring condition (echo) which results in an ALARM in the "Safety distance SD" area can be reset or deleted by

- confirming the ALARM in Pos. 017 locally by means of the VU331 LCD display;
- confirming the alarm via the communication protocol (HART) (FieldCare: "ackn. alarm" under safety settings).

Locking

The device must be locked once the Micropilot M has been calibrated as per the Operating Instructions.

Type of locking	Code/action	Position/VU331 display
Hardware (recommended)	3 keys together "lock"	Locally via VU331 display (keys  and  and )



Software (mandatory)	WHG (german)	018
----------------------	--------------	-----

Unlocking

The device is unlocked by firstly removing the hardware lock by locally pressing all the three keys together via the VU331 LCD display and then by setting the "Overfill protection" parameter (Position 018) to "Standard" if necessary.

Type of unlocking	Code/action	Position/VU331 display
Hardware (if locked)	3 keys together "unlock"	Locally via VU331 display (keys  and  and )



Software	Standard	018
----------	----------	-----

Maintenance

Please refer to the relevant Operating Instructions (→  7, "Supplementary device documentation") for instructions on maintenance and recalibration.

Alternative monitoring measures must be taken to ensure process safety during configuration, proof-testing and maintenance work on the device.

Proof-test

Proof-test

Check the operativeness and safety of safety functions at appropriate intervals!

The operator must determine the time intervals.

You can refer to the diagram "Proof-test interval" →  9, →  10, for this purpose.

Proof-testing of the device can be performed as follows:

- Approaching the level (→ test sequence A).
- Removing the device and measuring a medium with comparable properties (→ test sequence B).

You must also check that all cover seals and cable entries are sealing correctly.

If it is not practical to fill to the response height, a suitable simulation of the level or of the physical measuring effect must be used to make the level sensor respond.

If the operativeness of the level sensor/transmitter can be determined otherwise (exclusion of errors that impair function), the check can also be completed by simulating the corresponding output signal.

Process for proof-testing

Test sequence A

Preparation

1. Connect suitable measuring device (recommended accuracy better ± 0.1 mA) to the current output.
2. Determine the safety setting (level limit monitoring).

Procedure for level limit monitoring

1. Approach the level directly below (MAX monitoring) or directly above (MIN monitoring) the level limit to be monitored.
2. Read the output current, record it and assess for accuracy.
3. Approach the level directly above (MAX monitoring) or directly below (MIN monitoring) the level limit to be monitored.
4. Read the output current, record it and assess for accuracy.
5. The test is deemed successful if the current in step 2 does not result in activation of the safety function but the current in step 4 does.



Note!

The proof-test is deemed to have failed if the expected current value deviates for a specific level by $> \pm 10\%$. For troubleshooting, → Operating Instructions (→  7, "Supplementary device documentation"), Section 9. 98% of dangerous, undetected failures are detected using this test.

Test sequence B

Preparation

1. Prepare the test tank with the medium (dielectric constant comparable to that of the medium to be measured).
For installation instructions, → Operating Instructions (→  7, "Supplementary device documentation"), Section 3.
2. Remove the device and mount it in the test tank.
3. Perform interference echo mapping if the shape and size of the test tank is different.
4. Connect suitable measuring device (recommended accuracy better than ± 0.1 mA) to the current output.
5. Determine the safety setting (level limit monitoring).

Procedure for level limit monitoring

→ Test sequence A



Note!

The proof-test is deemed to have failed if the expected current value deviates for a specific level by $> \pm 10\%$. For troubleshooting, → Operating Instructions (→  7, "Supplementary device documentation"), Section 9. 98% of dangerous, undetected failures are detected using this test.

**Caution!**

If an interference echo mapping was performed in the test tank, a valid interference echo mapping must be performed after the device is mounted in the original tank.

**Note!**

If one of the test criteria from the test sequences described above is not fulfilled, the device may no longer be used as part of a safety instrumented system.

The purpose of proof-testing is to detect random device failures. The impact of systematic faults on the safety function is not covered by this test and must be assessed separately.

Systematic faults can be caused, for example, by process material properties, operating conditions, build-up or corrosion.

Repairs

Repairs

Repairs on the devices must always be carried out by Endress+Hauser.

Safety functions cannot be guaranteed if repairs are carried out by anybody else.

Exception:

The following components can be replaced by the customer if the person responsible for doing so has been trained beforehand by Endress+Hauser:

- Sensor
- HF module
- Electronic insert
- Terminal module

The replaced components must be sent to Endress+Hauser for the purpose of fault analysis.

Once the components have been replaced, a proof-test must be carried out as per test sequence A (→  15) or test sequence B (→  15).

In the event of failure of a SIL-labeled Endress+Hauser device, which has been operated in a protection function, the "Declaration of Contamination and Cleaning" with the corresponding note "Used as SIL device in protection system" must be enclosed when the defective device is returned.

Please refer to the Section "Return" in the Operating Instructions (→  7, "Supplementary device documentation").

Appendix

Commissioning or proof test protocol

System-specific data		
Company		
Measuring points / TAG no.		
System		
Device type / Order code		
Serial number of device		
Name		
Date		
Signature		
Device-specific commissioning parameters		
Empty calibration		
Full calibration		
Proof-test protocol		
Test stage	Set point	Actual value
1. Current value 1		
2. Current value 2		
3. If necessary current value 3		
4. If necessary current value 4		
5. If necessary current value 5		

SD305en05

Exida Management Summary



Management summary

This report summarizes the results of the hardware assessment according to IEC 61508 with proven-in-use consideration carried out on the Micropilot M family FMR 23x with software version V4.00 and FMR 24x/25x with software version V5.00 and the hardware versions as referenced in section 2.4.1 for applications with dry-run protection (MIN) and overspill protection (MAX). The statements made in this report are also valid for further software versions as long as the assessed modification process is considered. Any changes are under the responsibility of the manufacturer.

Table 1 gives an overview of the different types that belong to the considered family.

The hardware assessment consists of a Failure Modes, Effects and Diagnostics Analysis (FMEDA). A FMEDA is one of the steps taken to achieve functional safety assessment of a device per IEC 61508. From the FMEDA, failure rates are determined and consequently the Safe Failure Fraction (SFF) is calculated for the device. For full assessment purposes all requirements of IEC 61508 must be considered.

Table 1: Version overview

FMR 23x (~ 6 GHz)	FMR 24x (~ 26 GHz)	FMR 250 (~ 26 GHz)
FMR 230 (horn antenna)	FMR 240 (horn antenna)	FMR 250 (horn antenna)
FMR 231 (rod antenna)	FMR 240 (wave guide antenna)	FMR 250 (parabolic antenna)
FMR 232 (planar antenna)	FMR 244 (PTFE-enclosed horn antenna)	
FMR 233 (parabolic antenna)	FMR 245 (flush mounted PTFE-clad flange)	

For safety applications only the current output 4...20 mA was considered. All other possible output variants are not covered by this report. The different devices can be equipped with or without display.

The failure rates used in this analysis are the basic failure rates from the Siemens standard SN 29500.

Micropilot M - FMR 23x and FMR 24x/25x are considered to be Type B¹ subsystems with a hardware fault tolerance of 0. For Type B subsystems with a hardware fault tolerance of 0 the SFF shall be > 90% for SIL 2 subsystems according to table 3 of IEC 61508-2.

As Micropilot M - FMR 23x and FMR 24x/25x are supposed to be a proven-in-use devices, an assessment of the hardware with additional proven-in-use demonstration for the devices and their software was carried out. The proven-in-use investigation was based on field return data collected and analyzed by Endress+Hauser GmbH+Co. KG.

According to the requirements of IEC 61511-1 First Edition 2003-01 section 11.4.4 and the *exida* proven-in-use assessment described in section 6, Micropilot M - FMR 23x and FMR 24x/25x with a SFF of < 90% might also be used for a SIL 2 safety function. The decision on the usage of proven-in-use devices, however, is always with the end-user.

The listed SN29500 failure rates are valid for operating stress conditions typical of an industrial field environment similar to IEC 60654-1 class C (sheltered location) with an average temperature over a long period of time of 40°C (25°C ambient temperature plus internal self heating). For a higher average temperature of 60°C the failure rates should be multiplied with an experience based factor of 2,5. A similar multiplier should be used if frequent temperature fluctuation (daily fluctuation of > 15 °C) must be assumed.

¹ Type B subsystem: "Complex" subsystem (using micro controllers or programmable logic); for details see 7.4.3.1.3 of IEC 61508-2.



FMEDA and Proven-in-use Assessment

Project:
Micropilot M - FMR 23x and FMR 24x/25x
Applications with dry-run (MIN) and overspill protection (MAX)

Customer:
Endress+Hauser GmbH+Co. KG
Maulburg
Germany

Contract No.: E+H 10/08-015
Report No.: E+H 10/08-015 R052
Version V1, Revision R1; October 2010
Stephan Aschenbrenner

The document was prepared using best effort. The authors make no warranty of any kind and shall not be liable in any event for incidental or consequential damages in connection with the application of the document.
© All rights on the format of this technical report reserved.



Table 4: Summary for FMR 24x/25x for MAX applications – Failure rates per IEC 61508:2000

Failure category	Failure rates (in FIT)
Fail Safe (λ_{sp})	99
Fail safe detected	45
Fail high	54
Fail Safe (λ_{su})⁶	1207
Fail safe undetected	596
No effect	611
Fail Dangerous Detected (λ_{dp})	878
Fail dangerous detected	567
Fail low	311
Fail Dangerous Undetected (λ_{du})	697
Fail dangerous undetected	697
Annunciation	3
No part	241
Total failure rate (safety function)	2881 FIT
SFF⁷	75%
DC_b	55%

⁶ Note that the "SU" category includes failures that do not cause a spurious trip.
⁷ The complete sensor element subsystem will need to be evaluated to determine the overall Safe Failure Fraction. The number listed is for reference only.
 © exida.com GmbH
 E+H FMR23x - FMR24x-25x-10-08-015 R052 V1R1.doc; October 25, 2010
 Stephan Aschenbrenner
 Page 5 of 25



Table 5: Summary for FMR 24x/25x for MIN applications – Failure rates per IEC 61508:2000

Failure category	Failure rates (in FIT)
Fail Safe (λ_{sp})	356
Fail safe detected	45
Fail low	311
Fail Safe (λ_{su})⁸	1031
Fail safe undetected	419
No effect	612
Fail Dangerous Detected (λ_{dp})	621
Fail dangerous detected	567
Fail high	54
Fail Dangerous Undetected (λ_{du})	903
Fail dangerous undetected	903
Annunciation	3
No part	211
Total failure rate (safety function)	2911 FIT
SFF⁹	68%
DC_b	40%

The "proven-in-use information" may be used to assist an end user in completing a prior-use justification per IEC 61511-1.
 A user of the Micropilot M - FMR 23x and FMR 24x/25x can utilize these failure rates in a probabilistic model of a safety instrumented function (SIF) to determine suitability in part for safety instrumented system (SIS) usage in a particular safety integrity level (SIL). A full table of failure rates for different operating conditions is presented in section 4.4.1 to 4.4.4 along with all assumptions.
 It is important to realize that the "no effect" failures are included in the "safe" failure category according to IEC 61508:2000. Note that these failures on their own will not affect system reliability or safety, and should not be included in spurious trip calculations.
 The failure rates are valid for the useful life of Micropilot M - FMR 23x and FMR 24x/25x (see Appendix 2).

⁸ Note that the "SU" category includes failures that do not cause a spurious trip.
⁹ The complete sensor element subsystem will need to be evaluated to determine the overall Safe Failure Fraction. The number listed is for reference only.
 © exida.com GmbH
 E+H FMR23x - FMR24x-25x-10-08-015 R052 V1R1.doc; October 25, 2010
 Stephan Aschenbrenner
 Page 6 of 25



The failure rates do not include failures resulting from incorrect use of Micropilot M - FMR 23x and FMR 24x/25x, in particular humidity entering through incompletely closed housings or inadequate cable feeding through the inlets.
Assuming that a connected safety logic solver can detect both over-range (fail high) and under-range (fail low), the following tables show how the above stated requirements are fulfilled.

Table 2: Summary for FMR 23x for MAX applications – Failure rates per IEC 61508:2000

Failure category	Failure rates (in FIT)
Fail Safe (λ_{SD})	87
Fail safe detected	81
Fail high	6
Fail Safe (λ_{SU})²	1125
Fail safe undetected	572
No effect	553
Fail Dangerous Detected (λ_{DD})	846
Fail dangerous detected	535
Fail low	311
Fail Dangerous Undetected (λ_{DU})	710
Fail dangerous undetected	710
Annunciation	3
No part	155
Total failure rate (safety function)	2768 FIT
SFF³	74%
DC_b	54%

² Note that the "SU" category includes failures that do not cause a spurious trip.

³ The complete sensor element subsystem will need to be evaluated to determine the overall Safe Failure Fraction. The number listed is for reference only.



Table 3: Summary for FMR 23x for MIN applications – Failure rates per IEC 61508:2000

Failure category	Failure rates (in FIT)
Fail Safe (λ_{SD})	392
Fail safe detected	81
Fail low	311
Fail Safe (λ_{SU})⁴	951
Fail safe undetected	396
No effect	555
Fail Dangerous Detected (λ_{DD})	541
Fail dangerous detected	535
Fail high	6
Fail Dangerous Undetected (λ_{DU})	916
Fail dangerous undetected	916
Annunciation	3
No part	123
Total failure rate (safety function)	2800 FIT
SFF⁵	67%
DC_b	37%

⁴ Note that the "SU" category includes failures that do not cause a spurious trip.

⁵ The complete sensor element subsystem will need to be evaluated to determine the overall Safe Failure Fraction. The number listed is for reference only.

Instruments International

Endress+Hauser
Instruments International AG
Kaegenstrasse 2
4153 Reinach
Switzerland

Tel.+41 61 715 81 00
Fax+41 61 715 25 00
www.endress.com
info@ii.endress.com

Endress + Hauser 

People for Process Automation

