

Safety Instructions

Levelflex FMP50-FMP57

PROFIBUS PA, FOUNDATION Fieldbus

Associated Safety Instructions (XA) on page 4



Levelflex FMP50-FMP57

PROFIBUS PA, FOUNDATION Fieldbus

Table of contents

Associated documentation	4
Zone 2: Compact; 1 channel	5
Zone 2: Compact; 2 channels	15
Zone 2: Remote; 1 channel	25
Zone 2: Remote; 2 channels	26

Associated documentation

This document is an integral part of the following Safety Instructions:

ATEX, IECEX:
XA00518F/00

UK:
XA02531F/00

NEPSI:
XA00641F/00

INMETRO:
XA01193F/00

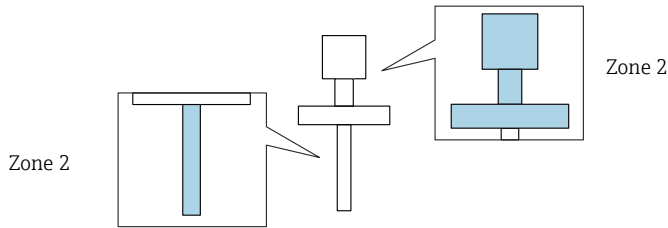
EAC:
XA01695F/00

Zone 2: Compact; 1 channel


Probe design: compact
Position 3 = E, G: 1 channel used


Page references to the temperature tables of the respective device types: See the following list.

- FMP50 → 5
- FMP51 → 6
- FMP52 → 7
- FMP53 → 8
- FMP54 → 9
- FMP55 → 12
- FMP56 → 13
- FMP57 → 14





FMP50

 = A	(1)		P1		P2		P3		P4		P5		P6	
			T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a
	E, G	T6	-20	60	60	60	80	53	80	-20	-20	-20	-	-


 = C	(1)		P1		P2		P3		P4		P5		P6	
			T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a
	E, G	T6	-20	60	60	60	80	56	80	-20	-20	-20	-	-

FMP51

 = A	(1)		P1		P2		P3		P4		P5		P6	
			T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a
	E, G	T6	-40	60	60	60	85	45	85	-40	-40	-40	-	-
		T5	-40	73	73	73	100	60	100	-40	-40	-40	-	-
		T4	-40	73	73	73	135	54	135	-40	-40	-40	-	-


 = B	(1)		P1		P2		P3		P4		P5		P6	
			T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a
	E, G	T6	-40 -50 ¹⁾	60	60	60	85	51	85	-40 -50 ¹⁾	-40 -50 ¹⁾	-40 -50 ¹⁾	-	-
		T5	-40 -50 ¹⁾	75	75	75	100	66	100	-40 -50 ¹⁾	-40 -50 ¹⁾	-40 -50 ¹⁾	-	-
		T4	-40 -50 ¹⁾	80	80	80	135	67	135	-40 -50 ¹⁾	-40 -50 ¹⁾	-40 -50 ¹⁾	-	-
		T3	-40 -50 ¹⁾	80	80	80	200	48	200	-40 -50 ¹⁾	-40 -50 ¹⁾	-40 -50 ¹⁾	-	-


1) Only in connection with Optional specification, ID Jx = JN


 = C	(1)		P1		P2		P3		P4		P5		P6	
			T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a
	E, G	T6	-40 -50 ¹⁾	60	60	60	85	53	85	-40 -50 ¹⁾	-40 -50 ¹⁾	-40 -50 ¹⁾	-	-
		T5	-40 -50 ¹⁾	75	75	75	100	68	100	-40 -50 ¹⁾	-40 -50 ¹⁾	-40 -50 ¹⁾	-	-
		T4	-40 -50 ¹⁾	80	80	80	135	69	135	-40 -50 ¹⁾	-40 -50 ¹⁾	-40 -50 ¹⁾	-	-
		T3	-40 -50 ¹⁾	80	80	80	200	56	200	-40 -50 ¹⁾	-40 -50 ¹⁾	-40 -50 ¹⁾	-	-

1) Only in connection with Optional specification, ID Jx = JN


FMP52

 = A	(1)		P1		P2		P3		P4		P5		P6	
			T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a
	E, G	T6	-50	60	60	60	85	49	85	-40	-40	-40	-50	-35
		T5	-50	73	73	73	100	64	100	-40	-40	-40	-50	-35
		T4	-50	73	73	73	135	58	135	-40	-40	-40	-50	-35
		T3	-50	73	73	73	200	37	200	-40	-40	-40	-50	-35


 = B	(1)		P1		P2		P3		P4		P5		P6	
			T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a
	E, G	T6	-50	60	60	60	85	52	85	-40	-40	-40	-50	-37
		T5	-50	75	75	75	100	67	100	-40	-40	-40	-50	-37
		T4	-50	80	80	80	135	68	135	-40	-40	-40	-50	-37
		T3	-50	80	80	80	200	52	200	-40	-40	-40	-50	-37

 = C	(1)		P1		P2		P3		P4		P5		P6	
			T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a
	E, G	T6	-50	60	60	60	85	54	85	-40	-40	-40	-50	-37
		T5	-50	75	75	75	100	69	100	-40	-40	-40	-50	-37
		T4	-50	80	80	80	135	70	135	-40	-40	-40	-50	-37
		T3	-50	80	80	80	200	58	200	-40	-40	-40	-50	-37

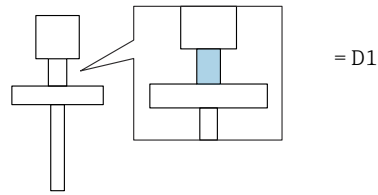
FMP53


 = A	(1)		P1		P2		P3		P4		P5		P6	
			T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a
	E, G	T6	-20	60	60	60	85	47	85	-20	-20	-20	-	-
		T5	-20	73	73	73	100	62	100	-20	-20	-20	-	-
		T4	-20	73	73	73	135	56	135	-20	-20	-20	-	-
		T3 ¹⁾	-20	73	73	73	150	52	150	-20	-20	-20	-	-

1) Functional: Maximum permissible process temperature


 = C	(1)		P1		P2		P3		P4		P5		P6	
			T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a
	E, G	T6	-20	60	60	60	85	54	85	-20	-20	-20	-	-
		T5	-20	75	75	75	100	69	100	-20	-20	-20	-	-
		T4	-20	80	80	80	135	69	135	-20	-20	-20	-	-
		T3 ¹⁾	-20	80	80	80	150	66	150	-20	-20	-20	-	-

1) Functional: Maximum permissible process temperature

FMP54



 = A	(1)		P1		P2		P3		P4		P5		P6	
			T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a
	E, G	T6	-196	58	58	58	85	53	85	-40	-40	-40	-196	-5
		T5	-196	73	73	73	100	68	100	-40	-40	-40	-196	-5
		T4	-196	73	73	73	135	64	135	-40	-40	-40	-196	-5
		T3	-196	73	73	73	200	54	200	-40	-40	-40	-196	-5
		T2 ¹⁾	-196	73	73	73	280	41	280	-40	-40	-40	-196	-5

1) Functional: Maximum permissible process temperature

 = B	(1)		P1		P2		P3		P4		P5		P6	
			T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a
	E, G	T6	-196	60	60	60	85	56	85	-40 -50 ¹⁾	-40 -50 ¹⁾	-40 -50 ¹⁾	-196	-16 -27 ¹⁾
		T5	-196	75	75	75	100	71	100	-40 -50 ¹⁾	-40 -50 ¹⁾	-40 -50 ¹⁾	-196	-16 -27 ¹⁾
		T4	-196	80	80	80	135	73	135	-40 -50 ¹⁾	-40 -50 ¹⁾	-40 -50 ¹⁾	-196	-16 -27 ¹⁾
		T3	-196	80	80	80	200	64	200	-40 -50 ¹⁾	-40 -50 ¹⁾	-40 -50 ¹⁾	-196	-16 -27 ¹⁾
		T2 ²⁾	-196	80	80	80	280	54	280	-40 -50 ¹⁾	-40 -50 ¹⁾	-40 -50 ¹⁾	-196	-16 -27 ¹⁾

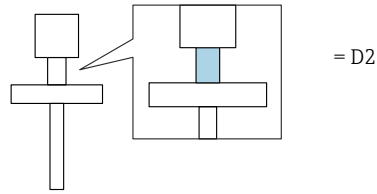
1) Only in connection with Optional specification, ID Jx = JN


2) Functional: Maximum permissible process temperature


 = C	(1)		P1		P2		P3		P4		P5		P6	
			T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a
	E, G	T6	-196	60	60	60	85	57	85	-40 -50 ¹⁾	-40 -50 ¹⁾	-40 -50 ¹⁾	-196	-23 -34 ¹⁾
		T5	-196	75	75	75	100	72	100	-40 -50 ¹⁾	-40 -50 ¹⁾	-40 -50 ¹⁾	-196	-23 -34 ¹⁾
		T4	-196	80	80	80	135	75	135	-40 -50 ¹⁾	-40 -50 ¹⁾	-40 -50 ¹⁾	-196	-23 -34 ¹⁾
		T3	-196	80	80	80	200	68	200	-40 -50 ¹⁾	-40 -50 ¹⁾	-40 -50 ¹⁾	-196	-23 -34 ¹⁾
		T2 ²⁾	-196	80	80	80	280	60	280	-40 -50 ¹⁾	-40 -50 ¹⁾	-40 -50 ¹⁾	-196	-23 -34 ¹⁾

1) Only in connection with Optional specification, ID Jx = JN


2) Functional: Maximum permissible process temperature

FMP54

 = A	(1)		P1		P2		P3		P4		P5		P6	
			T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a
	E, G	T6	-196	58	58	58	85	55	85	-40	-40	-40	-196	-21
		T5	-196	73	73	73	100	70	100	-40	-40	-40	-196	-21
		T4	-196	73	73	73	135	67	135	-40	-40	-40	-196	-21
		T3	-196	73	73	73	200	61	200	-40	-40	-40	-196	-21
		T2	-196	73	73	73	300	51	300	-40	-40	-40	-196	-21
		T1	-196	73	73	73	450	37	450	-40	-40	-40	-196	-21


 = B	(1)		P1		P2		P3		P4		P5		P6	
			T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a
	E, G	T6	-196	60	60	60	85	57	85	-40 -50 ¹⁾	-40 -50 ¹⁾	-40 -50 ¹⁾	-196	-26 -37 ¹⁾
		T5	-196	75	75	75	100	72	100	-40 -50 ¹⁾	-40 -50 ¹⁾	-40 -50 ¹⁾	-196	-26 -37 ¹⁾
		T4	-196	80	80	80	135	76	135	-40 -50 ¹⁾	-40 -50 ¹⁾	-40 -50 ¹⁾	-196	-26 -37 ¹⁾
		T3	-196	80	80	80	200	71	200	-40 -50 ¹⁾	-40 -50 ¹⁾	-40 -50 ¹⁾	-196	-26 -37 ¹⁾
		T2	-196	80	80	80	300	64	300	-40 -50 ¹⁾	-40 -50 ¹⁾	-40 -50 ¹⁾	-196	-26 -37 ¹⁾
		T1	-196	80	80	80	450	52	450	-40 -50 ¹⁾	-40 -50 ¹⁾	-40 -50 ¹⁾	-196	-26 -37 ¹⁾


1) Only in connection with Optional specification, ID Jx = JN


	(1)	P1		P2		P3		P4		P5		P6	
		T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a
	E, G	T6	-196	60	60	85	58	85	-40 -50 ¹⁾	-40 -50 ¹⁾	-40 -50 ¹⁾	-196	-27 -38 ¹⁾
		T5	-196	75	75	100	73	100	-40 -50 ¹⁾	-40 -50 ¹⁾	-40 -50 ¹⁾	-196	-27 -38 ¹⁾
		T4	-196	80	80	135	76	135	-40 -50 ¹⁾	-40 -50 ¹⁾	-40 -50 ¹⁾	-196	-27 -38 ¹⁾
		T3	-196	80	80	200	72	200	-40 -50 ¹⁾	-40 -50 ¹⁾	-40 -50 ¹⁾	-196	-27 -38 ¹⁾
		T2	-196	80	80	300	65	300	-40 -50 ¹⁾	-40 -50 ¹⁾	-40 -50 ¹⁾	-196	-27 -38 ¹⁾
		T1	-196	80	80	450	54	450	-40 -50 ¹⁾	-40 -50 ¹⁾	-40 -50 ¹⁾	-196	-27 -38 ¹⁾

1) Only in connection with Optional specification, ID Jx = JN


FMP55

 = A	(1)		P1		P2		P3		P4		P5		P6	
			T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a
	E, G	T6	-50	58	58	58	85	49	85	-40	-40	-40	-50	-35
		T5	-50	73	73	73	100	64	100	-40	-40	-40	-50	-35
		T4	-50	73	73	73	135	55	135	-40	-40	-40	-50	-35
		T3	-50	73	73	73	200	36	200	-40	-40	-40	-50	-35


 = B	(1)		P1		P2		P3		P4		P5		P6	
			T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a
	E, G	T6	-50	60	60	60	85	52	85	-40	-40	-40	-50	-37
		T5	-50	75	75	75	100	67	100	-40	-40	-40	-50	-37
		T4	-50	80	80	80	135	68	135	-40	-40	-40	-50	-37
		T3	-50	80	80	80	200	52	200	-40	-40	-40	-50	-37

 = C	(1)		P1		P2		P3		P4		P5		P6	
			T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a
	E, G	T6	-50	60	60	60	85	54	85	-40	-40	-40	-50	-37
		T5	-50	75	75	75	100	69	100	-40	-40	-40	-50	-37
		T4	-50	80	80	80	135	69	135	-40	-40	-40	-50	-37
		T3	-50	80	80	80	200	57	200	-40	-40	-40	-50	-37


FMP56

 = A	(1)		P1		P2		P3		P4		P5		P6	
			T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a
	E, G	T6	-40	60	60	60	85	47	85	-40	-40	-40	-	-
		T5	-40	73	73	73	100	62	100	-40	-40	-40	-	-
		T4 ¹⁾	-40	73	73	73	120	58	120	-40	-40	-40	-	-

1) Functional: Maximum permissible process temperature


 = B	(1)		P1		P2		P3		P4		P5		P6	
			T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a
	E, G	T6	-40	60	60	60	85	51	85	-40	-40	-40	-	-
		T5	-40	75	75	75	100	66	100	-40	-40	-40	-	-
		T4 ¹⁾	-40	80	80	80	120	71	120	-40	-40	-40	-	-

1) Functional: Maximum permissible process temperature


 = C	(1)		P1		P2		P3		P4		P5		P6	
			T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a
	E, G	T6	-40	60	60	60	85	54	85	-40	-40	-40	-	-
		T5	-40	75	75	75	100	69	100	-40	-40	-40	-	-
		T4 ¹⁾	-40	80	80	80	120	72	120	-40	-40	-40	-	-

1) Functional: Maximum permissible process temperature


FMP57

 = A	(1)		P1		P2		P3		P4		P5		P6	
			T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a
	E, G	T6	-40	60	60	60	85	49	85	-40	-40	-40	-	-
		T5	-40	73	73	73	100	64	100	-40	-40	-40	-	-
		T4	-40	73	73	73	135	58	135	-40	-40	-40	-	-
		T3 ¹⁾	-40	73	73	73	185	42	185	-40	-40	-40	-	-

1) Functional: Maximum permissible process temperature

 = B	(1)		P1		P2		P3		P4		P5		P6	
			T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a
	E, G	T6	-40	60	60	60	85	53	85	-40	-40	-40	-	-
		T5	-40	75	75	75	100	68	100	-40	-40	-40	-	-
		T4	-40	80	80	80	135	69	135	-40	-40	-40	-	-
		T3 ¹⁾	-40	80	80	80	185	60	185	-40	-40	-40	-	-

1) Functional: Maximum permissible process temperature

 = C	(1)		P1		P2		P3		P4		P5		P6	
			T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a
	E, G	T6	-40	60	60	60	85	55	85	-40	-40	-40	-	-
		T5	-40	75	75	75	100	70	100	-40	-40	-40	-	-
		T4	-40	80	80	80	135	71	135	-40	-40	-40	-	-
		T3 ¹⁾	-40	80	80	80	185	64	185	-40	-40	-40	-	-

1) Functional: Maximum permissible process temperature

Zone 2: Compact; 2 channels

Probe design: compact
 Position 3 = E, G: 2 channels used
 Page references to the temperature tables of the respective device types: See the following list.


- FMP50 → 15
- FMP51 → 16
- FMP52 → 17
- FMP53 → 18
- FMP54 → 19
- FMP55 → 22
- FMP56 → 23
- FMP57 → 24


FMP50

= A	(2)		P1		P2		P3		P4		P5		P6	
			T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a
	E, G	T6	-20	51	51	51	80	46	80	-20	-20	-20	-	-


= C	(2)		P1		P2		P3		P4		P5		P6	
			T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a
	E, G	T6	-20	60	60	60	80	56	80	-20	-20	-20	-	-

FMP51

 = A	(2)		P1		P2		P3		P4		P5		P6	
			T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a
	E, G	T6	-40	51	51	51	85	40	85	-40	-40	-40	-	-
		T5	-40	56	56	56	100	42	100	-40	-40	-40	-	-
		T4	-40	56	56	56	135	31	135	-40	-40	-40	-	-


 = B	(2)		P1		P2		P3		P4		P5		P6	
			T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a
	E, G	T6	-40 -50 ¹⁾	60	60	60	85	51	85	-40 -50 ¹⁾	-40 -50 ¹⁾	-40 -50 ¹⁾	-	-
		T5	-40 -50 ¹⁾	75	75	75	100	66	100	-40 -50 ¹⁾	-40 -50 ¹⁾	-40 -50 ¹⁾	-	-
		T4	-40 -50 ¹⁾	75	75	75	135	61	135	-40 -50 ¹⁾	-40 -50 ¹⁾	-40 -50 ¹⁾	-	-
		T3	-40 -50 ¹⁾	75	75	75	200	45	200	-40 -50 ¹⁾	-40 -50 ¹⁾	-40 -50 ¹⁾	-	-


1) Only in connection with Optional specification, ID Jx = JN


 = C	(2)		P1		P2		P3		P4		P5		P6	
			T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a
	E, G	T6	-40 -50 ¹⁾	60	60	60	85	53	85	-40 -50 ¹⁾	-40 -50 ¹⁾	-40 -50 ¹⁾	-	-
		T5	-40 -50 ¹⁾	75	75	75	100	68	100	-40 -50 ¹⁾	-40 -50 ¹⁾	-40 -50 ¹⁾	-	-
		T4	-40 -50 ¹⁾	75	75	75	135	63	135	-40 -50 ¹⁾	-40 -50 ¹⁾	-40 -50 ¹⁾	-	-
		T3	-40 -50 ¹⁾	75	75	75	200	50	200	-40 -50 ¹⁾	-40 -50 ¹⁾	-40 -50 ¹⁾	-	-

1) Only in connection with Optional specification, ID Jx = JN


FMP52

 = A	(2)		P1		P2		P3		P4		P5		P6	
			T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a
	E, G	T6	-50	51	51	51	85	51	85	-40	-40	-40	-50	-35
		T5	-50	56	56	56	100	56	100	-40	-40	-40	-50	-35
		T4	-50	56	56	56	135	56	135	-40	-40	-40	-50	-35
		T3	-50	56	56	56	200	56	200	-40	-40	-40	-50	-35


 = B	(2)		P1		P2		P3		P4		P5		P6	
			T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a
	E, G	T6	-50	60	60	60	85	52	85	-40	-40	-40	-50	-37
		T5	-50	75	75	75	100	67	100	-40	-40	-40	-50	-37
		T4	-50	75	75	75	135	62	135	-40	-40	-40	-50	-37
		T3	-50	75	75	75	200	47	200	-40	-40	-40	-50	-37

 = C	(2)		P1		P2		P3		P4		P5		P6	
			T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a
	E, G	T6	-50	60	60	60	85	54	85	-40	-40	-40	-50	-37
		T5	-50	75	75	75	100	69	100	-40	-40	-40	-50	-37
		T4	-50	75	75	75	135	64	135	-40	-40	-40	-50	-37
		T3	-50	75	75	75	200	52	200	-40	-40	-40	-50	-37

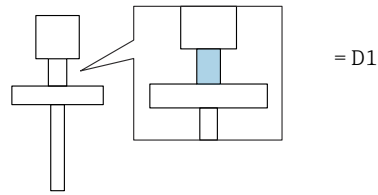
FMP53


 = A	(2)		P1		P2		P3		P4		P5		P6	
			T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a
	E, G	T6	-20	51	51	51	85	41	85	-20	-20	-20	-	-
		T5	-20	56	56	56	100	43	100	-20	-20	-20	-	-
		T4	-20	56	56	56	135	34	135	-20	-20	-20	-	-
		T3 ¹⁾	-20	56	56	56	150	30	150	-20	-20	-20	-	-


1) Functional: Maximum permissible process temperature

 = C	(2)		P1		P2		P3		P4		P5		P6	
			T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a
	E, G	T6	-20	60	60	60	85	54	85	-20	-20	-20	-	-
		T5	-20	75	75	75	100	69	100	-20	-20	-20	-	-
		T4	-20	75	75	75	135	63	135	-20	-20	-20	-	-
		T3 ¹⁾	-20	75	75	75	150	60	150	-20	-20	-20	-	-

1) Functional: Maximum permissible process temperature


FMP54


 = A	(2)		P1		P2		P3		P4		P5		P6	
			T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a
	E, G	T6	-196	51	51	51	85	45	85	-40	-40	-40	-196	-5
		T5	-196	56	56	56	100	49	100	-40	-40	-40	-196	-5
		T4	-196	56	56	56	135	44	135	-40	-40	-40	-196	-5
		T3	-196	56	56	56	200	34	200	-40	-40	-40	-196	-5

 = B	(2)		P1		P2		P3		P4		P5		P6	
			T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a
	E, G	T6	-196	60	60	60	85	56	85	-40 -50 ¹⁾	-40 -50 ¹⁾	-40 -50 ¹⁾	-196	-16 -27 ¹⁾
		T5	-196	75	75	75	100	71	100	-40 -50 ¹⁾	-40 -50 ¹⁾	-40 -50 ¹⁾	-196	-16 -27 ¹⁾
		T4	-196	75	75	75	135	67	135	-40 -50 ¹⁾	-40 -50 ¹⁾	-40 -50 ¹⁾	-196	-16 -27 ¹⁾
		T3	-196	75	75	75	200	59	200	-40 -50 ¹⁾	-40 -50 ¹⁾	-40 -50 ¹⁾	-196	-16 -27 ¹⁾
		T2 ²⁾	-196	75	75	75	280	48	280	-40 -50 ¹⁾	-40 -50 ¹⁾	-40 -50 ¹⁾	-196	-16 -27 ¹⁾

1) Only in connection with Optional specification, ID Jx = JN

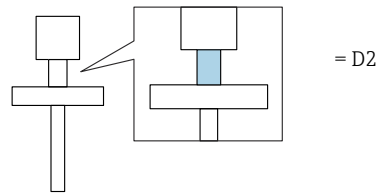
2) Functional: Maximum permissible process temperature


 = C	(2)		P1		P2		P3		P4		P5		P6	
			T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a
	E, G	T6	-196	60	60	60	85	57	85	-40 -50 ¹⁾	-40 -50 ¹⁾	-40 -50 ¹⁾	-196	-23 -34 ¹⁾
		T5	-196	75	75	75	100	72	100	-40 -50 ¹⁾	-40 -50 ¹⁾	-40 -50 ¹⁾	-196	-23 -34 ¹⁾
		T4	-196	75	75	75	135	69	135	-40 -50 ¹⁾	-40 -50 ¹⁾	-40 -50 ¹⁾	-196	-23 -34 ¹⁾
		T3	-196	75	75	75	200	63	200	-40 -50 ¹⁾	-40 -50 ¹⁾	-40 -50 ¹⁾	-196	-23 -34 ¹⁾
		T2 ²⁾	-196	75	75	75	280	55	280	-40 -50 ¹⁾	-40 -50 ¹⁾	-40 -50 ¹⁾	-196	-23 -34 ¹⁾


1) Only in connection with Optional specification, ID Jx = JN

2) Functional: Maximum permissible process temperature


FMP54



 = A	(2)		P1		P2		P3		P4		P5		P6	
			T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a
	E, G	T6	-196	51	51	51	85	47	85	-40	-40	-40	-196	-21
		T5	-196	56	56	56	100	52	100	-40	-40	-40	-196	-21
		T4	-196	56	56	56	135	48	135	-40	-40	-40	-196	-21
		T3	-196	56	56	56	200	42	200	-40	-40	-40	-196	-21
		T2	-196	56	56	56	300	32	300	-40	-40	-40	-196	-21


 = B	(2)		P1		P2		P3		P4		P5		P6	
			T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a
	E, G	T6	-196	59	59	59	85	57	85	-40 -50 ¹⁾	-40 -50 ¹⁾	-40 -50 ¹⁾	-196	-26 -37 ¹⁾
		T5	-196	74	74	74	100	72	100	-40 -50 ¹⁾	-40 -50 ¹⁾	-40 -50 ¹⁾	-196	-26 -37 ¹⁾
		T4	-196	75	75	75	135	71	135	-40 -50 ¹⁾	-40 -50 ¹⁾	-40 -50 ¹⁾	-196	-26 -37 ¹⁾
		T3	-196	75	75	75	200	66	200	-40 -50 ¹⁾	-40 -50 ¹⁾	-40 -50 ¹⁾	-196	-26 -37 ¹⁾
		T2	-196	75	75	75	300	58	300	-40 -50 ¹⁾	-40 -50 ¹⁾	-40 -50 ¹⁾	-196	-26 -37 ¹⁾
		T1	-196	75	75	75	450	47	450	-40 -50 ¹⁾	-40 -50 ¹⁾	-40 -50 ¹⁾	-196	-26 -37 ¹⁾


1) Only in connection with Optional specification, ID Jx = JN


	(2)	P1		P2		P3		P4		P5		P6	
		T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a
	E, G	T6	-196	59	59	85	58	85	-40 -50 ¹⁾	-40 -50 ¹⁾	-40 -50 ¹⁾	-196	-27 -38 ¹⁾
		T5	-196	74	74	100	73	100	-40 -50 ¹⁾	-40 -50 ¹⁾	-40 -50 ¹⁾	-196	-27 -38 ¹⁾
		T4	-196	75	75	135	71	135	-40 -50 ¹⁾	-40 -50 ¹⁾	-40 -50 ¹⁾	-196	-27 -38 ¹⁾
		T3	-196	75	75	200	66	200	-40 -50 ¹⁾	-40 -50 ¹⁾	-40 -50 ¹⁾	-196	-27 -38 ¹⁾
		T2	-196	75	75	300	59	300	-40 -50 ¹⁾	-40 -50 ¹⁾	-40 -50 ¹⁾	-196	-27 -38 ¹⁾
		T1	-196	75	75	450	49	450	-40 -50 ¹⁾	-40 -50 ¹⁾	-40 -50 ¹⁾	-196	-27 -38 ¹⁾

1) Only in connection with Optional specification, ID Jx = JN


FMP55

 = A	(2)		P1		P2		P3		P4		P5		P6	
			T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a
	E, G	T6	-50	51	51	51	85	41	85	-40	-40	-40	-50	-35
		T5	-50	56	56	56	100	43	100	-40	-40	-40	-50	-35
		T4	-50	56	56	56	135	32	135	-40	-40	-40	-50	-35


 = B	(2)		P1		P2		P3		P4		P5		P6	
			T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a
	E, G	T6	-50	60	60	60	85	52	85	-40	-40	-40	-50	-37
		T5	-50	75	75	75	100	67	100	-40	-40	-40	-50	-37
		T4	-50	75	75	75	135	62	135	-40	-40	-40	-50	-37
		T3	-50	75	75	75	200	47	200	-40	-40	-40	-50	-37

 = C	(2)		P1		P2		P3		P4		P5		P6	
			T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a
	E, G	T6	-50	60	60	60	85	54	85	-40	-40	-40	-50	-37
		T5	-50	75	75	75	100	69	100	-40	-40	-40	-50	-37
		T4	-50	75	75	75	135	63	135	-40	-40	-40	-50	-37
		T3	-50	75	75	75	200	51	200	-40	-40	-40	-50	-37


FMP56

 = A	(2)		P1		P2		P3		P4		P5		P6	
			T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a
	E, G	T6	-40	51	51	51	85	40	85	-40	-40	-40	-	-
		T5	-40	56	56	56	100	42	100	-40	-40	-40	-	-
		T4 ¹⁾	-40	56	56	56	120	35	120	-40	-40	-40	-	-

1) Functional: Maximum permissible process temperature


 = B	(2)		P1		P2		P3		P4		P5		P6	
			T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a
	E, G	T6	-40	60	60	60	85	51	85	-40	-40	-40	-	-
		T5	-40	75	75	75	100	66	100	-40	-40	-40	-	-
		T4 ¹⁾	-40	75	75	75	120	65	120	-40	-40	-40	-	-


1) Functional: Maximum permissible process temperature

 = C	(2)		P1		P2		P3		P4		P5		P6	
			T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a
	E, G	T6	-40	60	60	60	85	54	85	-40	-40	-40	-	-
		T5	-40	75	75	75	100	69	100	-40	-40	-40	-	-
		T4 ¹⁾	-40	75	75	75	120	66	120	-40	-40	-40	-	-


1) Functional: Maximum permissible process temperature

FMP57

 = A	(2)		P1		P2		P3		P4		P5		P6	
			T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a
	E, G	T6	-40	51	51	51	85	42	85	-40	-40	-40	-	-
		T5	-40	56	56	56	100	45	100	-40	-40	-40	-	-
		T4	-40	56	56	56	135	37	135	-40	-40	-40	-	-

 = B	(2)		P1		P2		P3		P4		P5		P6	
			T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a
	E, G	T6	-40	60	60	60	85	53	85	-40	-40	-40	-	-
		T5	-40	75	75	75	100	68	100	-40	-40	-40	-	-
		T4	-40	75	75	75	135	63	135	-40	-40	-40	-	-
		T3 ¹⁾	-40	75	75	75	185	54	185	-40	-40	-40	-	-

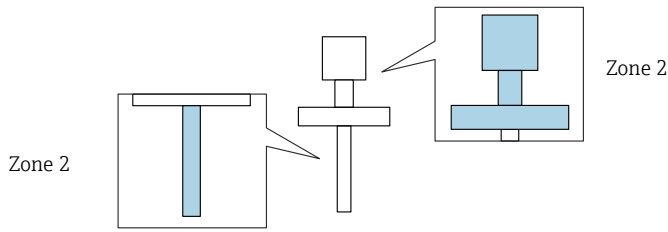
1) Functional: Maximum permissible process temperature

 = C	(2)		P1		P2		P3		P4		P5		P6	
			T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a
	E, G	T6	-40	60	60	60	85	55	85	-40	-40	-40	-	-
		T5	-40	75	75	75	100	70	100	-40	-40	-40	-	-
		T4	-40	75	75	75	135	65	135	-40	-40	-40	-	-
		T3 ¹⁾	-40	75	75	75	185	58	185	-40	-40	-40	-	-


1) Functional: Maximum permissible process temperature

Zone 2: Remote; 1 channel


Probe design: remote
Position 3 = E, G: 1 channel used
Optional specification, ID Mx = MB, MC, MD



FMP5x

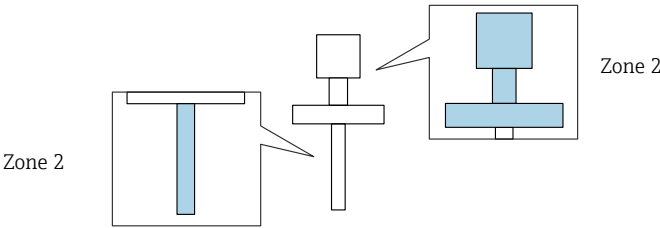
 = A	(1)		P1		P2		P3		P4		P5		P6	
			$T_p^{1)}$	T_a	$T_p^{1)}$	T_a	$T_p^{1)}$	T_a	$T_p^{1)}$	T_a	$T_p^{1)}$	T_a	$T_p^{1)}$	T_a
	E, G	T6	-	58	-	58	-	58	-	-40	-	-40	-	-

1) T_p = dependent on the sensor


 = B, C	(1)		P1		P2		P3		P4		P5		P6	
			$T_p^{1)}$	T_a	$T_p^{1)}$	T_a	$T_p^{1)}$	T_a	$T_p^{1)}$	T_a	$T_p^{1)}$	T_a	$T_p^{1)}$	T_a
	E, G	T6	-	60	-	60	-	60	-	-40	-	-40	-	-
		T5	-	80	-	80	-	80	-	-40	-	-40	-	-

1) T_p = dependent on the sensor


Zone 2: Remote; 2 channels Probe design: remote
Position 3 = E, G: 2 channels used
Optional specification, ID Mx = MB, MC, MD



FMP5x

 = A	(2)		P1		P2		P3		P4		P5		P6	
			$T_p^{1)}$	T_a	$T_p^{1)}$	T_a	$T_p^{1)}$	T_a	$T_p^{1)}$	T_a	$T_p^{1)}$	T_a	$T_p^{1)}$	T_a
	E, G	T6	-	51	-	51	-	51	-	-40	-	-40	-	-

1) T_p = dependent on the sensor

 = B, C	(2)		P1		P2		P3		P4		P5		P6	
			$T_p^{1)}$	T_a	$T_p^{1)}$	T_a	$T_p^{1)}$	T_a	$T_p^{1)}$	T_a	$T_p^{1)}$	T_a	$T_p^{1)}$	T_a
	E, G	T6	-	59	-	59	-	59	-	-40	-	-40	-	-
		T5	-	74	-	74	-	74	-	-40	-	-40	-	-

1) T_p = dependent on the sensor



www.addresses.endress.com
