

Safety Instructions

Micropilot

FMR60B/62B/63B/66B/67B

Control Drawing IS
Class I, Div. 1, Groups A-D



Micropilot FMR60B/62B/63B/66B/67B

Table of contents

Associated documentation 4

Certificates and declarations 4

Certificate holder 4

Extended order code 4

Safety instructions: General 9

Safety instructions: Special conditions 10

Safety instructions: Installation 11

Intrinsic safety 12

Process seals 14

Temperature tables 14

Connection data 22

Associated documentation

All documentation is available on the Internet:
www.endress.com/Deviceviewer
(enter the serial number from the nameplate).

To commission the device, please observe the Operating Instructions pertaining to the device:

HART

- BA02247F (FMR60B)
- BA02248F (FMR62B)
- BA02249F (FMR63B)
- BA02250F (FMR66B)
- BA02251F (FMR67B)

PROFIBUS PA

- BA02261F (FMR60B)
- BA02262F (FMR62B)
- BA02263F (FMR63B)
- BA02264F (FMR66B)
- BA02265F (FMR67B)

PROFINET

- BA02266F (FMR60B)
- BA02267F (FMR62B)
- BA02268F (FMR63B)
- BA02269F (FMR66B)
- BA02270F (FMR67B)

Certificates and declarations**CSA C/US certificate**

Certificate number:
CSA23CA80159823

Certificate holder

Endress+Hauser SE+Co. KG
Hauptstraße 1
79689 Maulburg, Germany
Address of the manufacturing plant: See nameplate.

Extended order code

The extended order code is indicated on the nameplate, which is affixed to the device in such a way that it is clearly visible. Additional information about the nameplate is provided in the associated Operating Instructions.

Structure of the extended order code

FMR6xB	–	*****	+	A*B*C*D*E*F*G*..
(Device type)		(Basic specifications)		(Optional specifications)

* = Placeholder

At this position, an option (number or letter) selected from the specification is displayed instead of the placeholders.

Basic specifications

The features that are absolutely essential for the device (mandatory features) are specified in the basic specifications. The number of positions depends on the number of features available.

The selected option of a feature can consist of several positions.

Optional specifications

The optional specifications describe additional features for the device (optional features). The number of positions depends on the number of features available. The features have a 2-digit structure to aid identification (e.g. JA). The first digit (ID) stands for the feature group and consists of a number or a letter (e.g. J = Test, Certificate). The second digit constitutes the value that stands for the feature within the group (e.g. A = 3.1 material (wetted parts), inspection certificate).

More detailed information about the device is provided in the following tables. These tables describe the individual positions and IDs in the extended order code which are relevant to hazardous locations.

Extended order code: Micropilot



The following specifications reproduce an extract from the product structure and are used to assign:

- This documentation to the device (using the extended order code on the nameplate).
- The device options cited in the document.

Device type

FMR60B, FMR62B, FMR63B, FMR66B, FMR67B

Basic specifications

Position 1, 2 (Approval)		
Selected option		Description
FMR6xB	CC	CSA C/US IS Cl. I, Div. 1, Gr. A-D, Cl. I, Zone 0, AEx/Ex ia IIC T6 Ga

Position 3, 4 (Output)		
Selected option		Description
FMR6xB	BA	2-wire, 4-20 mA HART
	DA	2-wire, PROFIBUS PA
	FA	2-wire, PROFINET, 10Mbit/s (APL)

Position 5 (Display, Operation)		
Selected option		Description
FMR6xB	L	Prepared for display FHX50B + M12 connection
	M	Prepared for display FHX50B + Gland M20
	N	Prepared for display FHX50B + Thread NPT1/2
	O	Prepared for display FHX50B + Thread M20

Position 6 (Housing, Material)		
Selected option		Description
FMR6xB	B	Single compartment; Alu, coated
	J	Dual compartment; Alu, coated
	K	Dual compartment; 316L
	M	Dual compartment L-shape; Alu, coated
	N	Dual compartment L-shape; 316L, coated

Position 8 (Application)		
Selected option		Description
FMR60B	B	Process temperature -20...+150°C
FMR62B	D	Process temperature -20...+200°C
FMR63B		

Position 8 (Application)		
Selected option		Description
FMR60B FMR66B FMR67B	F	Process temperature -40...+80°C
FMR60B FMR66B	H	Process temperature -40...+130°C
FMR60B FMR62B FMR63B FMR67B	J	Process temperature -40...+150°C
	L	Process temperature -40...+200°C
FMR62B FMR67B	N	Process temperature -40...+280°C
	P	Process temperature -40...+450°C
FMR62B	R	Process temperature -60...+150°C
	T	Process temperature -196...+200°C
FMR62B FMR63B	V	Process temperature -20...+150°C, Steam application
	W	Process temperature -20...+200°C, Steam application

Position 9, 10 (Antenna)		
Selected option		Description
FMR60B FMR66B	BS	Encapsulated, PVDF, 40mm/1-1/2"
FMR60B FMR62B FMR66B FMR67B	GA	Drip-off, PTFE 50mm/2"
FMR60B FMR63B	GE	Integrated, PEEK, 20mm/3/4"
FMR60B	GF	Integrated, PEEK, 40mm/1-1/2"
FMR62B FMR63B	GM	Cladded flush mount, PTFE, 50mm/2"
	GN	Cladded flush mount, PTFE, 80mm/3"
FMR67B	GP	Flush mount, PTFE, 80mm/3"
FMR63B	GQ	Cladded, flush mount, PEEK, 20mm/3/4"
	GR	Cladded, flush mount, PEEK, 40mm/1-1/2"
FMR62B FMR67B	GT	Horn, 316L, 65mm/2.6"

Position 11, 12 (Process Connection, Sealing Surface)		
Selected option		Description
FMR67B	JD	Alignment device, UNI flange

Position 16 (Seal)		
Selected option		Description
FMR60B FMR66B	A	PVDF encapsulated
FMR62B FMR63B	B	PTFE cladded
FMR63B	C	PEEK cladded
FMR6xB	D	VKM Viton GLT
	G	EPDM
FMR60B FMR62B FMR63B FMR67B	J	HNBR
FMR63B FMR67B	P	FFKM Kalrez
	U	Graphite

Position 17 (Air Purge Connection)		
Selected option		Description
FMR67B	1	G1/4
	2	NPT1/4
	3	Adapter G1/4
	4	Adapter NPT1/4

Optional specifications

ID Jx, Kx (Test, Certificate, Declaration)		
Selected option		Description
FMR62B FMR67B	JL	Ambient temp. transmitter -50°C/-58°F, sensor see specification

ID Nx, Ox (Accessory Mounted)		
Selected option		Description
FMR6xB	NA	Overvoltage protection ¹⁾

1) Only in connection with Position 6 = J, K, M, N

ID Px, Rx (Accessory Enclosed)		
Selected option		Description
FMR6xB	PA	Weather protection cover, 316L ¹⁾
	PB	Weather protection cover, plastic ²⁾

1) Only in connection with Position 6 = J, K, M, N

2) Only in connection with Position 6 = B

Safety instructions: General

- Comply with the installation and safety instructions in the Operating Instructions.
- Staff must meet the following conditions for mounting, electrical installation, commissioning and maintenance of the device:
 - Be suitably qualified for their role and the tasks they perform
 - Be trained in explosion protection
 - Be familiar with national regulations
- Install the device according to the manufacturer's instructions and national regulations.
- Do not operate the device outside the specified electrical, thermal and mechanical parameters.
- Only use the device in media to which the wetted materials have sufficient durability.
- Avoid electrostatic charging:
 - Of plastic surfaces (e.g. enclosure, sensor element, special varnishing, attached additional plates, ...)
 - Of isolated capacities (e.g. isolated metallic plates)
- Alterations to the device can affect the explosion protection and must be carried out by staff authorized to perform such work by Endress+Hauser.

**Safety
instructions:
Special conditions**

- To avoid electrostatic charging: Do not rub surfaces with a dry cloth.
- In the event of additional or alternative special varnishing on the enclosure or other metal parts or for adhesive plates:
 - Observe the danger of electrostatic charging and discharge.
 - Do not install in the vicinity of processes (≤ 0.5 m) generating strong electrostatic charges.
- Avoid sparks caused by impact and friction.
- In the case of process connections made of polymeric material or with polymeric coatings, avoid electrostatic charging of the plastic surfaces.
- Avoid electrostatic charging of the sensor (e.g. do not rub dry and install outside the filling flow).

Optional specification, ID Px, Rx = PA

Connect the weather protection cover to the local potential equalization.


Device type FMR67B and Basic specification, Position 11, 12 = JD

- Avoid sparks caused by impact and friction.
- Changing the position of the alignment device must be impossible:
 - After the alignment of the antenna via the pivot bracket
 - After tightening of the clamping flange
 - After setting the damping ring (torque 10 to 11 Nm)
- Degree of protection IP67 must be fulfilled.

Device type FMR67B and Basic specification, Position 17 = 1, 2, 3, 4

- Avoid sparks caused by impact and friction.
- After removing the air purge connection: Lock the opening with a suitable plug.
Torque: 6-7 Nm
- Degree of protection IP67 must be fulfilled.

Safety instructions: Installation

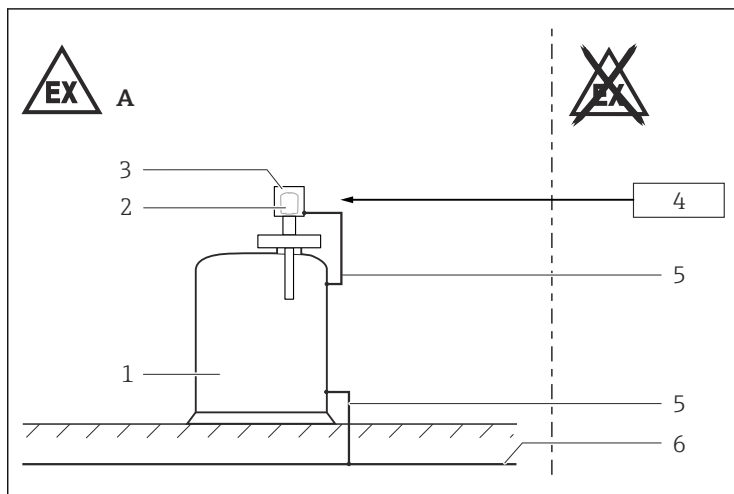


A0025536

- A Zone 0; Class I, Div. 1, Groups A-D
- 1 Tank; Zone 0; Class I, Div. 1, Groups A-D
- 2 Electronic insert
- 3 Enclosure
- 4 Associated intrinsically safe power supply units
- 5 Potential equalization line
- 6 Local potential equalization

- After aligning (rotating) the enclosure, retighten the fixing screw.
- Continuous service temperature of the connecting cable: $\geq T_a + 20\text{ K}$.
- Observe the pertinent guidelines when interconnecting intrinsically safe circuits.
- Observe the maximum process conditions according to the manufacturer's Operating Instructions.
- Install the device to exclude any mechanical damage or friction during the application. Pay particular attention to flow conditions and tank fittings.

Potential equalization


Integrate the device into the local potential equalization.

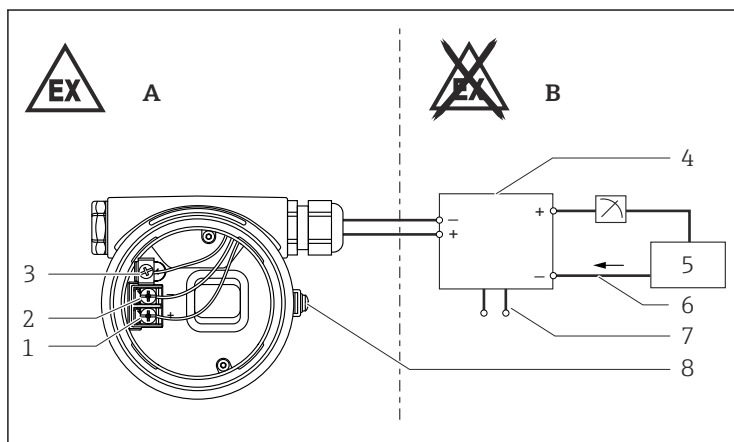Intrinsic safety*Basic specification, Position 3, 4 = BA*

A0045083

- A Hazardous Location:
Class I, Div. 1, Groups A-D; Class I, Zone 0, AEx/Ex ia IIC T6 Ga
- B Non-hazardous location
- 1 Positive terminal
- 2 Negative terminal
- 3 Internal ground terminal
- 4 Barrier / Associated equipment
- 5 External load
- 6 4 to 20 mA loop
- 7 Supply
- 8 External ground terminal

Basic specification, Position 3, 4 = DA, FA

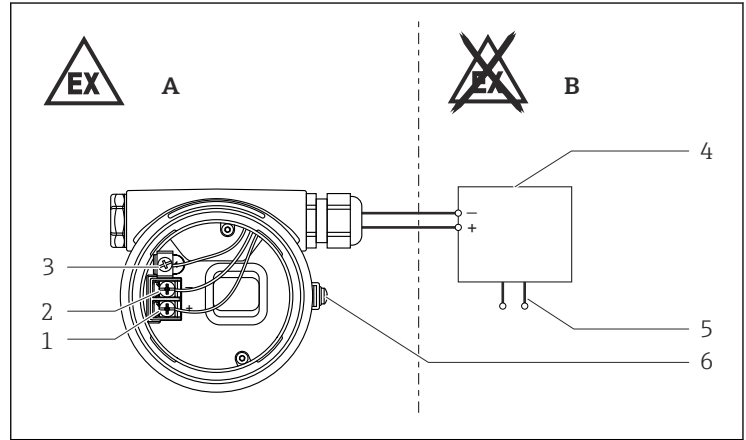

A0052100

- A Hazardous Location:
Class I, Div. 1, Groups A-D; Class I, Zone 0, AEx/Ex ia IIC T6 Ga
- B Non-hazardous location
- 1 Positive terminal
- 2 Negative terminal
- 3 Internal ground terminal
- 4 PROFIBUS PA, FISCO / Associated equipment or
2-WISE Port / Associated equipment (PROFINET APL)
- 5 Supply
- 6 External ground terminal

Entity installation

- Install per National Electrical Code (NFPA70) or Canadian Electrical Code, Part I (C22.1), as applicable.
- Use an intrinsic safety barrier or other associated equipment that is approved for the country in use and satisfies the following conditions:
 $U_o (V_{oc}) \leq U_i (V_{max}), I_o (I_{sc}) \leq I_i (I_{max}), C_o (C_a) \geq C_i + C_{cable},$
 $L_o (L_a) \geq L_i + L_{cable} \text{ and } P_o \leq P_i.$
- For transmitter parameters: See "Connection data" section.
- Associated devices with galvanic isolation between the intrinsically safe and non-intrinsically safe circuits are preferred.
- Control room equipment may not use or generate over $250 V_{rms}$.
- Always follow the installation instructions provided by the intrinsic safety barrier manufacturer when installing this equipment.

- **WARNINGS:** Substitution of components may impair intrinsic safety.
- The transmitter enclosure is to be connected to ground via internal or external ground terminals.
- The intrinsically safe input power circuit of the device is isolated from ground. The dielectric strength is at least 500 V_{rms}.

Optional specification, ID Nx, Ox = NA

The intrinsically safe input power circuit of the device is isolated from ground. The dielectric strength is at least 290 V_{rms}.

Process seals

Basic specification, Position 9, 10 = BS

- The device is not rated as Single Seal in accordance with UL122701 and requires the use of an external secondary process seal.
- The sensor is rated for a Maximum Working Pressure (MWP) of up to 3 bar and a maximum process temperature (T_p) up to 80 °C.

Basic specification, Position 9, 10 = Gx

- The device is rated Single Seal in accordance with UL122701 and does not require the use of an external secondary process seal.
- The sensor is rated for a Maximum Working Pressure (MWP) of up to 100 bar and a maximum process temperature (T_p) up to 450 °C, depending on the antenna.



- Limitation of the Maximum Working Pressure (MWP) for each device is marked on the nameplate and must not be exceeded! This value may be less than the Single Seal rating.
- Limitation of the maximum process temperature (T_p) with regards to the device options, temperature code rating and maximum ambient temperature as specified in the "Temperature tables" section of this document must be considered!
- Verify the chemical compatibility of the process fluid with the process seal material (see field "Mat." on the nameplate)!

Temperature tables



- The specified ambient and process temperature ranges exclusively refer to the explosion protection and must not be exceeded. Operationally permitted ambient temperature ranges can be restricted depending on the version: See Operating Instructions.
- Do not exceed the max. ambient temperature at the enclosure.



Optional specification, ID Jx, Kx = JL

Lower limit of the ambient temperature for explosion protection changes to -50 °C.

Optional specification, ID Px, Rx = PB

When using the weather protection cover: Reduce the admissible ambient temperature by 10 K.

Description notes




Unless otherwise indicated, the positions always refer to the basic specification.

1st column: Temperature classes T6 (85 °C) to T1 (450 °C)


Column P1 to P5: Position (temperature value) on the axes of the derating

- T_a : Ambient temperature in °C
- T_p : Process temperature in °C

Example diagrams of possible deratings

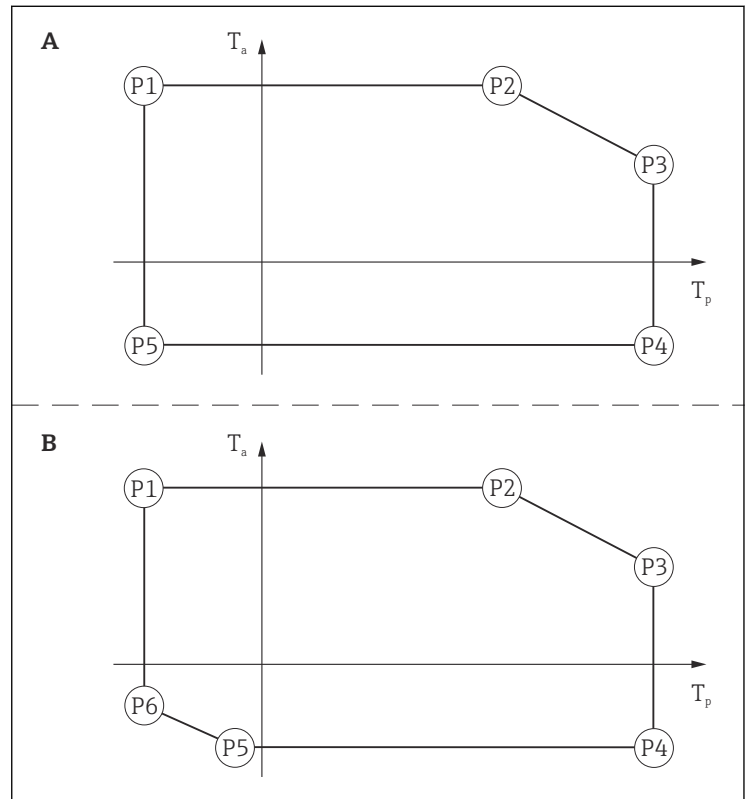

A0022717

	Position 6 (Housing, Material)
	B, J, M

FMR60B, FMR66B

Position 8 (Application)
H

Position 9, 10 (Antenna)
BS

	P1		P2		P3		P4		P5		P6	
	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a
T6	-40	46	46	46	80	28	80	-40	-40	-40	-	-
T5	-40	61	61	61	95	43	95	-40	-40	-40	-	-
T4	-40	65	65	65	130	55	130	-40	-40	-40	-	-

FMR60B, FMR62B, FMR63B, FMR66B, FMR67B

Position 8 (Application)
B, H, J, R, V

Position 9, 10 (Antenna)
GA, GE, GF, GM, GN, GP, GQ, GR

	P1		P2		P3		P4		P5		P6	
	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a
T6	-40 ^{1) 2) 3)}	46	46	46	80	32	80	-40 ⁴⁾	-40 ^{1) 2) 3)}	-40 ⁴⁾	-	-
T5	-40 ^{1) 2) 3)}	61	61	61	95	47	95	-40 ⁴⁾	-40 ^{1) 2) 3)}	-40 ⁴⁾	-	-
T4	-40 ^{1) 2) 3)}	65	65	65	130	54	130	-40 ⁴⁾	-40 ^{1) 2) 3)}	-40 ⁴⁾	-	-
T3	-40 ^{1) 2) 3)}	65	65	65	150	51	150	-40 ⁴⁾	-40 ^{1) 2) 3)}	-40 ⁴⁾	-	-

- 1) Position 8 = B, V: -20 °C
- 2) Position 8 = R: -60 °C
- 3) Position 16 = J, P: -20 °C
- 4) Optional specification, ID Jx, Kx = JL: -50 °C

FMR60B, FMR62B, FMR63B, FMR67B

Position 8 (Application)
D, L, T, W

Position 9, 10 (Antenna)
GA, GE, GF, GM, GN, GP, GQ, GR

	P1		P2		P3		P4		P5		P6	
	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a
T6	-196 ^{1) 2) 3)}	46	46	46	80	37	80	-40 ⁴⁾	-50 ^{1) 2) 3)}	-40 ⁴⁾	-196 ^{1) 2) 3)}	-6
T5	-196 ^{1) 2) 3)}	61	61	61	95	52	95	-40 ⁴⁾	-50 ^{1) 2) 3)}	-40 ⁴⁾	-196 ^{1) 2) 3)}	-6
T4	-196 ^{1) 2) 3)}	65	65	65	130	56	130	-40 ⁴⁾	-50 ^{1) 2) 3)}	-40 ⁴⁾	-196 ^{1) 2) 3)}	-6
T3	-196 ^{1) 2) 3)}	65	65	65	195	47	195	-40 ⁴⁾	-50 ^{1) 2) 3)}	-40 ⁴⁾	-196 ^{1) 2) 3)}	-6
T2	-196 ^{1) 2) 3)}	65	65	65	200	46	200	-40 ⁴⁾	-50 ^{1) 2) 3)}	-40 ⁴⁾	-196 ^{1) 2) 3)}	-6

- 1) Position 8 = D, W: -20 °C; P6 not relevant
- 2) Position 8 = L: -40 °C; P6 not relevant
- 3) Position 16 = J, P: -20 °C
- 4) Optional specification, ID Jx, Kx = JL: -50 °C

FMR62B, FMR67B

Position 8 (Application)
N, T

Position 9, 10 (Antenna)
GT

	P1		P2		P3		P4		P5		P6	
	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a
T6	-196 ¹⁾	46	46	46	80	43	80	-40 ²⁾	-50 ¹⁾	-40 ²⁾	-196 ¹⁾	-32
T5	-196 ¹⁾	61	61	61	95	58	95	-40 ²⁾	-50 ¹⁾	-40 ²⁾	-196 ¹⁾	-32
T4	-196 ¹⁾	65	65	65	130	61	130	-40 ²⁾	-50 ¹⁾	-40 ²⁾	-196 ¹⁾	-32
T3	-196 ¹⁾	65	65	65	195	57	195	-40 ²⁾	-50 ¹⁾	-40 ²⁾	-196 ¹⁾	-32
T2	-196 ¹⁾	65	65	65	280 ³⁾	52	280 ³⁾	-40 ²⁾	-50 ¹⁾	-40 ²⁾	-196 ¹⁾	-32


- 1) Position 8 = N: -40 °C; P6 not relevant
- 2) Optional specification, ID Jx, Kx = JL: -50 °C
- 3) Position 8 = T: 200 °C

Position 8 (Application)
P

Position 9, 10 (Antenna)
GT

	P1		P2		P3		P4		P5		P6	
	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a
T6	-40	46	46	46	80	43	80	-40 ¹⁾	-40	-40 ¹⁾	-	-
T5	-40	61	61	61	95	58	95	-40 ¹⁾	-40	-40 ¹⁾	-	-
T4	-40	65	65	65	130	61	130	-40 ¹⁾	-40	-40 ¹⁾	-	-
T3	-40	65	65	65	195	57	195	-40 ¹⁾	-40	-40 ¹⁾	-	-
T2	-40	65	65	65	290	51	290	-40 ¹⁾	-40	-40 ¹⁾	-	-
T1	-40	65	65	65	440	39	440	-40 ¹⁾	-40	-40 ¹⁾	-	-

- 1) Optional specification, ID Jx, Kx = JL: -50 °C

	Position 6 (Housing, Material)
	K, N

FMR60B, FMR66B

Position 8 (Application)
H

Position 9, 10 (Antenna)
BS

	P1		P2		P3		P4		P5		P6	
	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a
T6	-40	46	46	46	80	29	80	-40	-40	-40	-	-
T5	-40	61	61	61	95	44	95	-40	-40	-40	-	-
T4	-40	65	65	65	130	54	130	-40	-40	-40	-	-

FMR60B, FMR62B, FMR63B, FMR66B, FMR67B

Position 8 (Application)
B, H, J, R, V

Position 9, 10 (Antenna)
GA, GE, GF, GM, GN, GP, GQ, GR

	P1		P2		P3		P4		P5		P6	
	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a
T6	-40 ^{1) 2) 3)}	46	46	46	80	28	80	-40 ⁴⁾	-40 ^{1) 2) 3)}	-40 ⁴⁾	-	-
T5	-40 ^{1) 2) 3)}	61	61	61	95	43	95	-40 ⁴⁾	-40 ^{1) 2) 3)}	-40 ⁴⁾	-	-
T4	-40 ^{1) 2) 3)}	65	65	65	130	53	130	-40 ⁴⁾	-40 ^{1) 2) 3)}	-40 ⁴⁾	-	-
T3	-40 ^{1) 2) 3)}	65	65	65	150	42	150	-40 ⁴⁾	-40 ^{1) 2) 3)}	-40 ⁴⁾	-	-

- 1) Position 8 = B, V: -20 °C
- 2) Position 8 = R: -60 °C
- 3) Position 16 = J, P: -20 °C
- 4) Optional specification, ID Jx, Kx = JL: -50 °C

FMR60B, FMR62B, FMR63B, FMR67B

Position 8 (Application)
D, L, T, W

Position 9, 10 (Antenna)
GA, GE, GF, GM, GN, GP, GQ, GR

	P1		P2		P3		P4		P5		P6	
	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a
T6	-196 ^{1) 2) 3)}	46	46	46	80	34	80	-40 ⁴⁾	-50 ^{1) 2) 3)}	-40 ⁴⁾	-196 ^{1) 2) 3)}	-2
T5	-196 ^{1) 2) 3)}	61	61	61	95	49	95	-40 ⁴⁾	-50 ^{1) 2) 3)}	-40 ⁴⁾	-196 ^{1) 2) 3)}	-2
T4	-196 ^{1) 2) 3)}	65	65	65	130	56	130	-40 ⁴⁾	-50 ^{1) 2) 3)}	-40 ⁴⁾	-196 ^{1) 2) 3)}	-2
T3	-196 ^{1) 2) 3)}	65	65	65	195	39	195	-40 ⁴⁾	-50 ^{1) 2) 3)}	-40 ⁴⁾	-196 ^{1) 2) 3)}	-2
T2	-196 ^{1) 2) 3)}	65	65	65	200	37	200	-40 ⁴⁾	-50 ^{1) 2) 3)}	-40 ⁴⁾	-196 ^{1) 2) 3)}	-2

- 1) Position 8 = D, W: -20 °C; P6 not relevant
- 2) Position 8 = L: -40 °C; P6 not relevant
- 3) Position 16 = J, P: -20 °C
- 4) Optional specification, ID Jx, Kx = JL: -50 °C

FMR62B, FMR67B

Position 8 (Application)
N, T

Position 9, 10 (Antenna)
GT

	P1		P2		P3		P4		P5		P6	
	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a
T6	-196 ¹⁾	46	46	46	80	42	80	-40 ²⁾	-50 ¹⁾	-40 ²⁾	-196 ¹⁾	-30
T5	-196 ¹⁾	61	61	61	95	57	95	-40 ²⁾	-50 ¹⁾	-40 ²⁾	-196 ¹⁾	-30
T4	-196 ¹⁾	65	65	65	130	61	130	-40 ²⁾	-50 ¹⁾	-40 ²⁾	-196 ¹⁾	-30
T3	-196 ¹⁾	65	65	65	195	57	195	-40 ²⁾	-50 ¹⁾	-40 ²⁾	-196 ¹⁾	-30
T2	-196 ¹⁾	65	65	65	280 ³⁾	52	280 ³⁾	-40 ²⁾	-50 ¹⁾	-40 ²⁾	-196 ¹⁾	-30

- 1) Position 8 = N: -40 °C; P6 not relevant
- 2) Optional specification, ID Jx, Kx = JL: -50 °C
- 3) Position 8 = T: 200 °C

Position 8 (Application)
P

Position 9, 10 (Antenna)
GT

	P1		P2		P3		P4		P5		P6	
	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a
T6	-40	46	46	46	80	42	80	-40 ¹⁾	-40	-40 ¹⁾	-	-
T5	-40	61	61	61	95	57	95	-40 ¹⁾	-40	-40 ¹⁾	-	-
T4	-40	65	65	65	130	61	130	-40 ¹⁾	-40	-40 ¹⁾	-	-
T3	-40	65	65	65	195	57	195	-40 ¹⁾	-40	-40 ¹⁾	-	-
T2	-40	65	65	65	290	51	290	-40 ¹⁾	-40	-40 ¹⁾	-	-
T1	-40	65	65	65	440	32	440	-40 ¹⁾	-40	-40 ¹⁾	-	-

- 1) Optional specification, ID Jx, Kx = JL: -50 °C

Connection data

Basic specification, Position 3 = BA

Power supply
U_I ≤ 30 V_{DC} I_I ≤ 300 mA P_I ≤ 1 W C_I ≤ 10 nF L_I = 0

Basic specification, Position 3 = DA

Power supply	
FISCO U _I ≤ 17.5 V _{DC} I _I ≤ 380 mA P _I ≤ 5.32 W C _i ≤ 5 nF L _i = 0	Entity U _I ≤ 24 V _{DC} I _I ≤ 300 mA P _I ≤ 1.2 W C _i ≤ 5 nF L _i = 0

Basic specification, Position 3 = FA

Power supply	
2-WISE U _I ≤ 17.5 V _{DC} I _I ≤ 380 mA P _I ≤ 5.32 W C _I ≤ 5 nF L _I = 0	Entity U _I ≤ 17.5 V _{DC} I _I ≤ 300 mA P _I ≤ 1.2 W C _I ≤ 5 nF L _I = 0

In connection with: *Basic specification, Position 5 = L, M, N, O*
Installation according to the specifications of FHX50B.

 Only the type of protection suitable for the device shall be connected!



71605358

www.addresses.endress.com
