

# Safety Instructions

## Cerabar M

### PMC51, PMP51, PMP55

4-20 mA HART, PROFIBUS PA,  
FOUNDATION Fieldbus

Ex ia IIC T6...T4 Ga/Gb

Ex ia IIC T6...T4 Gb

**Segurança**





# Cerabar M PMC51, PMP51, PMP55

4-20 mA HART, PROFIBUS PA, FOUNDATION Fieldbus

## Table of contents

About this document .....	4
Associated documentation .....	4
Supplementary documentation .....	4
Certificates and declarations .....	4
Certificate holder .....	4
Extended order code .....	4
Safety instructions: General .....	6
Safety instructions: Special conditions .....	7
Safety instructions: Installation .....	7
Temperature tables .....	8
Connection data .....	8

**About this document**

This document has been translated into several languages. Legally determined is solely the English source text.

**Associated documentation**

To commission the device, please observe the Operating Instructions pertaining to the device:

HART  
BA00382P

PROFIBUS PA  
BA00383P

FOUNDATION Fieldbus  
BA00384P

**Supplementary documentation**

Explosion protection brochure: CP00021Z

The explosion protection brochure is available on the Internet:  
[www.endress.com/Downloads](http://www.endress.com/Downloads)

**Certificates and declarations****Certificate of Conformity**

Certificate number:  
TÜV 13.2008

Affixing the certificate number certifies conformity with the following standards (depending on the device version):

- ABNT NBR IEC 60079-0:2013
- ABNT NBR IEC 60079-11:2013
- ABNT NBR IEC 60079-26:2016

**Certificate holder**

Endress+Hauser SE+Co. KG  
Hauptstraße 1  
79689 Maulburg, Germany

Address of the manufacturing plant: See nameplate.

**Extended order code**

The extended order code is indicated on the nameplate, which is affixed to the device in such a way that it is clearly visible. Additional information about the nameplate is provided in the associated Operating Instructions.

## Structure of the extended order code

PMC51, PMP5x  <i>(Device type)</i>	–	*****	+	A*B*C*D*E*F*G*..   <i>(Optional specifications)</i>
---	---	-------	---	--

\* = Placeholder

At this position, an option (number or letter) selected from the specification is displayed instead of the placeholders.

### *Basic specifications*

The features that are absolutely essential for the device (mandatory features) are specified in the basic specifications. The number of positions depends on the number of features available.

The selected option of a feature can consist of several positions.

### *Optional specifications*

The optional specifications describe additional features for the device (optional features). The number of positions depends on the number of features available. The features have a 2-digit structure to aid identification (e.g. JA). The first digit (ID) stands for the feature group and consists of a number or a letter (e.g. J = Test, Certificate). The second digit constitutes the value that stands for the feature within the group (e.g. A = 3.1 material (wetted parts), inspection certificate).

More detailed information about the device is provided in the following tables. These tables describe the individual positions and IDs in the extended order code which are relevant to hazardous locations.

## Extended order code: Cerabar M



The following specifications reproduce an extract from the product structure and are used to assign:

- This documentation to the device (using the extended order code on the nameplate).
- The device options cited in the document.

### *Device type*

PMC51, PMP51, PMP55

*Basic specifications*

Position 1, 2 (Approval)		
Selected option		Description
PMC51	MA	INMETRO Ex ia IIC T6...T4 Ga/Gb
PMP5x		INMETRO Ex ia IIC T6...T4 Gb

Position 3 (Output)		
Selected option		Description
PMC51	2	4-20 mA HART
PMP5x	3	PROFIBUS PA
	4	FOUNDATION Fieldbus

*Optional specifications*

No options specific to hazardous locations are available.


**Safety instructions:**  
**General**

- The device is intended to be used in explosive atmospheres as defined in the scope of IEC 60079-0 or equivalent national standards. If no potentially explosive atmospheres are present or if additional protective measures have been taken: The device may be operated according to the manufacturer's specifications.
- Staff must meet the following conditions for mounting, electrical installation, commissioning and maintenance of the device:
  - Be suitably qualified for their role and the tasks they perform
  - Be trained in explosion protection
  - Be familiar with national regulations
- Comply with the installation and safety instructions in the Operating Instructions.
- Install the device according to the manufacturer's instructions and national regulations.
- Only use the device in media to which the wetted materials have sufficient durability.
- Avoid electrostatic charging:
  - Of plastic surfaces (e.g. enclosure, sensor element, special varnishing, attached additional plates, ...)
  - Of isolated capacities (e.g. isolated metallic plates)

**Safety instructions:**  
**Special conditions**

- In the case of process connections made of polymeric material or with polymeric coatings, avoid electrostatic charging of the plastic surfaces.
- For light metal flanges or flange faces (e.g. titanium, zirconium), avoid sparks caused by impact and friction.
- In the event of additional or alternative special varnishing on the enclosure or other metal parts:
  - Observe the danger of electrostatic charging and discharge.
  - Do not rub surfaces with a dry cloth.

**Safety instructions:**  
**Installation**

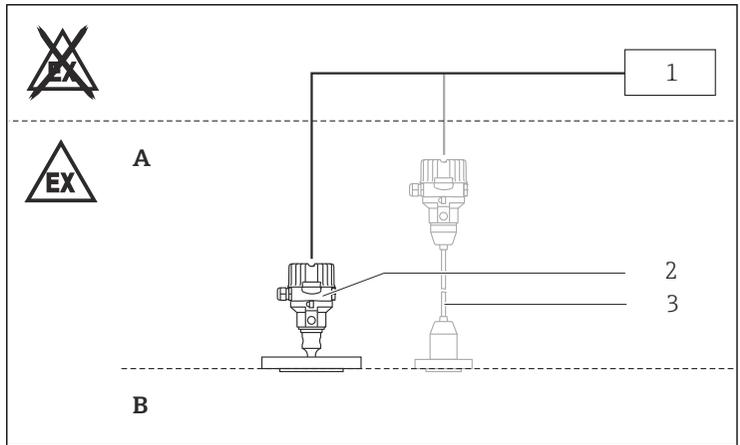

A0024001

- A *Electronic; Zone 1*  
 B *Process; Ga/Gb: Zone 0, Gb: Zone 1*  
 1 *Certified associated apparatus*  
 2 *PMC51, PMP51, PMP55*  
 3 *Option: Separate enclosure*

After aligning (rotating) the enclosure, retighten the fixing screw.

**Intrinsic safety**

- When the device is connected to an intrinsically safe circuit Ex ib, the type of protection changes to Ex ib. Do not operate intrinsically safe circuits Ex ib in Zone 0.
- When the device is connected to an intrinsically safe circuit Ex ic, the type of protection changes to Ex ic. Do not operate intrinsically safe circuits Ex ic in Zone 0 or Zone 1.
- The intrinsically safe input power circuit of the device is isolated from ground. The dielectric strength is at least  $500 V_{rms}$ .

## Service connection

*Basic specification, Position 3 = 2*

- For service operations: connect the Commubox FXA195 (from Endress+Hauser) to the display socket.
- Observe the safety instructions of the Commubox.

## Temperature tables



- The specified ambient and process temperature ranges exclusively refer to the explosion protection and must not be exceeded. Operationally permitted ambient temperature ranges can be restricted depending on the version: See Operating Instructions.
- Do not exceed the max. ambient temperature at the enclosure.



*Device type PMC51, PMP51*

The process temperatures refer to the temperature at the separation membrane.

*Device type PMP55*

Higher temperatures are permitted depending on the type of diaphragm seal.

Temperature class	Process temperature $T_p$ (process)	Ambient temperature range
T6	$\leq 80\text{ °C}$	$-40\text{ °C} \leq T_a \leq +40\text{ °C}$
T4	$\leq 125\text{ °C}$	$-40\text{ °C} \leq T_a \leq +70\text{ °C}$

## Connection data

*Basic specification, Position 3 = 2*

Power supply
$U_i \leq 30\text{ V}_{DC}$ $I_i \leq 300\text{ mA}$ $P_i \leq 1\text{ W}$ $C_i \leq 10\text{ nF}$ $L_i = 0$

*Basic specification, Position 3 = 3, 4*

Power supply	
FISCO	Entity
$U_i \leq 17.5\text{ V}_{DC}$ $I_i \leq 500\text{ mA}$ $P_i \leq 5.5\text{ W}$ $C_i \leq 5\text{ nF}$ $L_i \leq 10\text{ }\mu\text{H}$	$U_i \leq 24\text{ V}_{DC}$ $I_i \leq 250\text{ mA}$ $P_i \leq 1.2\text{ W}$ $C_i \leq 5\text{ nF}$ $L_i \leq 10\text{ }\mu\text{H}$









71602027

[www.addresses.endress.com](http://www.addresses.endress.com)

---