

Safety Instructions

Liquiphant FTL51B, FTL63

ATEX, IECEx: Ex db eb IIC T6 Ga/Gb
Ex db eb IIC T6 Gb



Liquiphant FTL51B, FTL63

Table of contents

About this document 4

Associated documentation 4

Supplementary documentation 4

Certificates and declarations 4

Manufacturer address 5

Other standards 5

Extended order code 5

Safety instructions: General 9

Safety instructions: Specific conditions of use 10

Safety instructions: Installation 11

Safety instructions: Ex d joints 13

Safety instructions: Zone 0 13

Safety instructions: Zone separation Zone 0, Zone 1 13

Temperature tables 13

Connection data 18

About this document



The document number of these Safety Instructions (XA) must match the information on the nameplate.

Associated documentation

All documentation is available on the Internet:

www.endress.com/Deviceviewer

(enter the serial number from the nameplate).



If not yet available, a translation into EU languages can be ordered.

To commission the device, please observe the Operating Instructions pertaining to the device:

- BA01894F (FTL51B)
- BA02286F (FTL63)

Supplementary documentation

Explosion protection brochure: CP00021Z

The explosion protection brochure is available on the Internet:

www.endress.com/Downloads

Certificates and declarations

EU Declaration of Conformity

Declaration Number:

EU_01193

The EU Declaration of Conformity is available on the Internet:

www.endress.com/Downloads

EU type-examination certificate

Certificate number:

DEKRA 24ATEX0011X

List of applied standards: See EU Declaration of Conformity.

IEC Declaration of Conformity

Certificate number:

IECEX DEK 24.0010X

Affixing the certificate number certifies conformity with the following standards (depending on the device version):

- IEC 60079-0 : 2017
- IEC 60079-1 : 2014
- IEC 60079-7 : 2017
- IEC 60079-26 : 2021

Manufacturer address	Endress+Hauser SE+Co. KG Hauptstraße 1 79689 Maulburg, Germany Address of the manufacturing plant: See nameplate.
Other standards	Among other things, the following standards shall be observed in their current version for proper installation: ■ IEC/EN 60079-14: "Explosive atmospheres - Part 14: Electrical installations design, selection and erection" ■ EN 1127-1: "Explosive atmospheres - Explosion prevention and protection - Part 1: Basic concepts and methodology"
Extended order code	The extended order code is indicated on the nameplate, which is affixed to the device in such a way that it is clearly visible. Additional information about the nameplate is provided in the associated Operating Instructions.

Structure of the extended order code

FTL51B, FTL63	–	*****	+	A*B*C*D*E*F*G*..
(Device type)		(Basic specifications)		(Optional specifications)

* = Placeholder
At this position, an option (number or letter) selected from the specification is displayed instead of the placeholders.

Basic specifications

The features that are absolutely essential for the device (mandatory features) are specified in the basic specifications. The number of positions depends on the number of features available. The selected option of a feature can consist of several positions.

Optional specifications

The optional specifications describe additional features for the device (optional features). The number of positions depends on the number of features available. The features have a 2-digit structure to aid identification (e.g. JA). The first digit (ID) stands for the feature group and consists of a number or a letter (e.g. J = Test, Certificate). The second digit constitutes the value that stands for the feature within the group (e.g. A = 3.1 material (wetted parts), inspection certificate).

More detailed information about the device is provided in the following tables. These tables describe the individual positions and IDs in the extended order code which are relevant to hazardous locations.

Extended order code: Liquiphant

-  The following specifications reproduce an extract from the product structure and are used to assign:
- This documentation to the device (using the extended order code on the nameplate).
 - The device options cited in the document.

Device type
FTL51B, FTL63

Basic specifications

Position 1, 2 (Approval)		
Selected option		Description
FTL51B FTL63	BD	ATEX II 1/2 G Ex db eb IIC T6...T1 Ga/Gb
		ATEX II 2 G Ex db eb IIC T6...T1 Gb
		IECEX Ex db eb IIC T6...T1 Ga/Gb
		IECEX Ex db eb IIC T6...T1 Gb

Position 3, 4 (Output)		
Selected option		Description
FTL51B FTL63	A1	FEL61, 2-wire 19-253VAC + test button
	A2	FEL62, 3-wire PNP 10-55VDC + test button
	A3	FEL64DC, relay DPDT 9-20VDC
	A4	FEL64, relay DPDT 19-253VAC/19-55VDC contact 253V/6A + test button
	A7	FEL67, 2-wire PFM + test button
	A8	FEL68, 2-wire NAMUR + test button
	GA	FEL60D, density/concentration


Position 5 (Display, Operation)		
Selected option		Description
FTL51B FTL63	A	W/o; switch
	B ¹⁾	LED module outside visible; switch

1) Only in connection with Position 3, 4 = A2-A4

Position 6 (Housing, Material)		
Selected option		Description
FTL51B	M	Dual compartment L-shape; Alu, coated
FTL63		




Shown in the temperature tables
exemplary as follows:



Position 7 (Electrical Connection)		
Selected option		Description
FTL51B FTL63	B	Gland M20, brass nickel plated, IP66/68 NEMA Type 4X/6P
	C	Gland M20, 316L, IP66/68 NEMA Type 4X/6P
	F	Thread M20, IP66/68 NEMA Type 4X/6P
	G	Thread G1/2, IP66/68 NEMA Type 4X/6P
	I	Thread NPT3/4, IP66/68 NEMA Type 4X/6P
	Y	Special version: Thread NPT1/2, IP66/68 NEMA Type 4X/6P

Position 8 (Application)		
Selected option		Description
FTL51B FTL63	A ¹⁾	Process max 150°C/302°F, max 64bar
	B ¹⁾	Process max 150°C/302°F, max 100bar
	C ²⁾	Process max 80°C/176°F, max 25bar

- 1) Only in connection with Position 3, 4 = A1-A4, A7, A8
- 2) Only in connection with Position 3, 4 = GA

Position 10 (Type of Probe)		
Selected option		Description
FTL51B FTL63	1	Compact version
	2	Extension tube
	3	Short tube version
 Shown in the temperature tables exemplary as follows: 		

Position 11, 12 (Sensor Length, Material)		
Selected option		Description
FTL51B FTL63	AC	Compact version; AlloyC22
	AJ	Compact version; 316L
	BC	Short tube version; AlloyC22
	BJ	Short tube version; 316L
	CC	 mm L, Ra<3,2um/126uin; AlloyC22
	CJ	 mm L, Ra<3,2um/126uin; 316L
	DC	 in L, Ra<3,2um/126uin; AlloyC22
	DJ	 in L, Ra<3,2um/126uin; 316L

Optional specifications

ID Mx (Sensor Design)		
Selected option		Description
FTL51B FTL63	MR	Temperature separator
	MS	Pressure tight feed through (Second line of defence)

ID Nx, Ox (Accessory Mounted)		
Selected option		Description
FTL51B	NF ¹⁾	Bluetooth
FTL63	NG ²⁾	Bluetooth for NAMUR output
	OB	Blind plug marking according to IEC/ATEX Ex d

- 1) Only in connection with Position 3, 4 = A1-A4, A7, Position 5 = A
 2) Only in connection with Position 3, 4 = A8, Position 5 = A

ID Px, Rx (Accessory Enclosed)		
Selected option		Description
FTL51B	PA	Weather protection cover, 316L
FTL63	R6 ¹⁾	Test magnet

- 1) Only in connection with Position 3, 4 = A2-A4, A8

Safety instructions:

General

- The device is intended to be used in explosive atmospheres as defined in the scope of IEC 60079-0 or equivalent national standards. If no potentially explosive atmospheres are present or if additional protective measures have been taken: The device may be operated according to the manufacturer's specifications.
- Devices suitable for zone separation (marked Ga/Gb or Da/Db) are always suitable for installation in the less critical zone (Gb or Db). Due to space limitations the corresponding marking maybe not indicated on the nameplate.
- Staff must meet the following conditions for mounting, electrical installation, commissioning and maintenance of the device:
 - Be suitably qualified for their role and the tasks they perform
 - Be trained in explosion protection
 - Be familiar with national regulations
- Install the device according to the manufacturer's instructions and national regulations.
- Do not operate the device outside the specified electrical, thermal and mechanical parameters.
- Only use the device in media to which the wetted materials have sufficient durability.

- Avoid electrostatic charging:
 - Of plastic surfaces (e.g. enclosure, sensor element, special varnishing, attached additional plates, ...)
 - Of isolated capacities (e.g. isolated metallic plates)
- Refer to the temperature tables for the relationship between the permitted ambient temperature for the sensor and/or transmitter, depending on the range of application and the temperature class.
- Alterations to the device can affect the explosion protection and must be carried out by staff authorized to perform such work by Endress+Hauser.

**Safety
instructions:
Specific
conditions of use**

Permitted ambient temperature range at the electronics enclosure:
 $-40\text{ °C} \leq T_a \leq +70\text{ °C}$

- Limitations of the maximum ambient temperature at the electronics enclosure may be required dependent on device configuration, process temperatures and temperature classification.
- Details of limitations: →  13, "Temperature tables".
- To avoid electrostatic charging: Do not rub surfaces with a dry cloth.
- In the event of additional or alternative special varnishing on the enclosure or other metal parts or for adhesive plates:
 - Observe the danger of electrostatic charging and discharge.
 - Do not install in the vicinity of processes ($\leq 0.5\text{ m}$) generating strong electrostatic charges.
- Covers with glass window only permitted for the following ambient temperatures:
 - $-50\text{ °C} \leq T_a \leq +70\text{ °C}$
- Avoid sparks caused by impact and friction.


Optional specification, ID Px, Rx = PA

Connect the weather protection cover to the local potential equalization.

Optional specification, ID Px, Rx = R6

Suitable for use in explosion hazardous areas.

Safety instructions: Installation

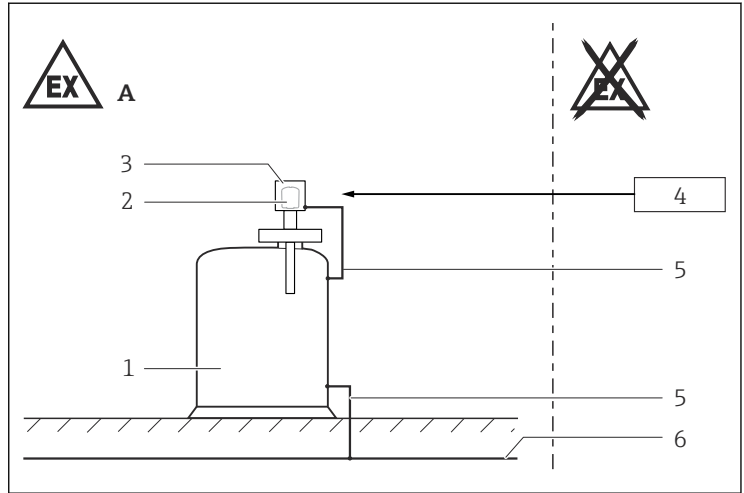

1

- A Zone 1
 1 Tank; Zone 0, Zone 1
 2 Electronic insert
 3 Enclosure
 4 Supply unit
 5 Potential equalization line
 6 Local potential equalization

- In potentially explosive atmospheres:
 - Do not disconnect the electrical connection of the power supply circuit when energized.
 - Do not open the connection compartment cover and the electronics compartment cover.
- Perform the following to achieve the degree of protection IP66/68:
 - Screw the cover tight.
 - Mount the cable entry correctly.
- Observe the maximum process conditions according to the manufacturer's Operating Instructions.
- At high medium temperatures, note flange pressure load capacity as a factor of temperature.
- Install the device to exclude any mechanical damage or friction during the application. Pay particular attention to flow conditions and tank fittings.
- Connect the device:
 - Using suitable cable and wire entries of protection type "Increased safety (Ex eb)".
 - Using piping systems of protection type "Increased safety (Ex eb)".

- Continuous service temperature of the connecting cable / cable gland / cable entry: $\geq T_a + 20\text{ K}$.
- Support extension tube of the device if a dynamic load is expected.
- Only use certified cable entries suitable for the application. Observe national regulations and standards. Accordingly, the connection terminal does not include any ignition sources.
- Seal unused entry glands with approved sealing plugs that correspond to the type of protection.
- When operating the transmitter enclosure at an ambient temperature under $-20\text{ }^{\circ}\text{C}$, use appropriate cables and cable entries permitted for this application.
- The device can be equipped with the Bluetooth® module: refer to the Operating Instructions and specifications in the "Bluetooth® module" chapter.
- Before operation:
 - Screw in the cover all the way.
 - Tighten the securing clamp on the cover.

Cross section connecting wire	Tightening torque of terminal screw	Stripped insulation
0.2 to 2.5 mm ²	$\leq 0.4\text{ Nm}$	6 to 8 mm

Accessory high pressure sliding sleeve

The high pressure sliding sleeve can be used for a continuous setting of the switch point and is suited for zone separation if mounted properly (see Operating Instructions).

Potential equalization

Integrate the device into the local potential equalization.

Optional specification, ID Px, Rx = PA

Connect the weather protection cover to the local potential equalization.

Bluetooth® module

Basic specification, Position 3, 4 = A7

If the device is equipped with the Bluetooth® module, no battery is required or allowed.

Basic specification, Position 3, 4 = A8

- If the device is equipped with the Bluetooth® module, a battery is required.
- Removal or replacement of the battery is only permitted in non-hazardous areas.
- Connection or disconnection of the Bluetooth® module is permitted in hazardous areas.

Only use one of the following battery types:

Manufacturer	Battery type
Tadiran	SL-360/S
XENO ENERGY	ER14505 / XL-060F

Safety instructions: Ex d joints

- If required or if in doubt: ask manufacturer for specifications.
- Flameproof joints are not intended to be repaired.

Safety instructions: Zone 0

When using under non-atmospheric pressures and non-atmospheric temperatures: The sensor part of the device approved for Zone 0 does not cause any ignition hazards.

Safety instructions: Zone separation Zone 0, Zone 1

The zone separation wall of the device is made of stainless steel or high corrosion-resistant alloy of thickness ≥ 1 mm.

Temperature tables

Description notes



Unless otherwise indicated, the positions always refer to the basic specification.


1st column: Position 8 = A, B, ...

2nd column: Maximum load current

3rd column: Temperature classes T6 (85 °C) to T1 (450 °C)


Column P1 to P5: Position (temperature value) on the axes of the derating

- T_a: Ambient temperature in °C
- T_p: Process temperature in °C

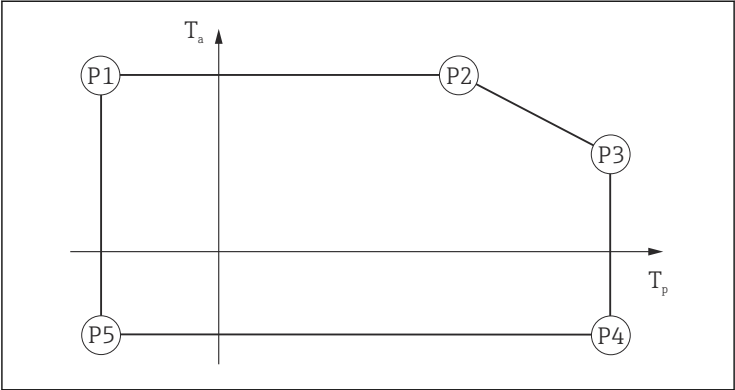

A0033052

Zone 0, Zone 1

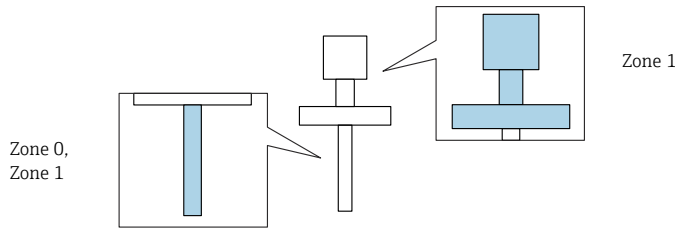

Position 3, 4 = A1

Without Optional specification, ID Mx = MR, MS

A, B			P1		P2		P3		P4		P5	
			T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a
	180 mA											
		T6	-50	70	70	70	80	59	80	-40	-50	-40
		T5	-50	70	70	70	95	70	95	-40	-50	-40
		T4	-50	70	70	70	130	70	130	-40	-50	-40
		T3...T1	-50	70	70	70	150	69	150	-40	-50	-40

With Optional specification, ID Mx = MR, MS

A, B			P1		P2		P3		P4		P5	
			T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a
	180 mA											
		T6	-50	70	70	70	80	62	80	-40	-50	-40
		T5	-50	70	70	70	95	70	95	-40	-50	-40
		T4	-50	70	70	70	130	70	130	-40	-50	-40
		T3...T1	-50	70	70	70	150	70	150	-40	-50	-40
	350 mA											
		T4	-50	70	70	70	130	55	130	-40	-50	-40
		T3...T1	-50	70	70	70	150	54	150	-40	-50	-40

Position 3, 4 = A2

Without Optional specification, ID Mx = MR, MS

A, B			P1		P2		P3		P4		P5	
			T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a
	350 mA											
		T6	-50	70	70	70	80	70	80	-40	-50	-40
		T5	-50	70	70	70	95	70	95	-40	-50	-40
		T4	-50	70	70	70	130	66	130	-40	-50	-40
		T3...T1	-50	70	70	70	150	54	150	-40	-50	-40

With Optional specification, ID Mx = MR, MS

A, B			P1		P2		P3		P4		P5	
			T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a
	350 mA											
		T6	-50	70	70	70	80	70	80	-40	-50	-40
		T5	-50	70	70	70	95	70	95	-40	-50	-40
		T4	-50	70	70	70	130	70	130	-40	-50	-40
		T3...T1	-50	70	70	70	150	70	150	-40	-50	-40

Position 3, 4 = A3, A4

Without Optional specification, ID Mx = MR, MS

A, B			P1		P2		P3		P4		P5	
			T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a
	2 A											
		T6	-50	55	55	55	80	50	80	-40	-50	-40
		T5	-50	70	70	70	95	65	95	-40	-50	-40
		T4	-50	70	70	70	130	65	130	-40	-50	-40
		T3...T1	-50	70	70	70	150	65	150	-40	-50	-40

With Optional specification, ID Mx = MR, MS

A, B			P1		P2		P3		P4		P5	
			T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a
	2 A											
		T6	-50	55	55	55	80	54	80	-40	-50	-40
		T5	-50	70	70	70	95	68	95	-40	-50	-40
		T4	-50	70	70	70	130	70	130	-40	-50	-40
		T3...T1	-50	70	70	70	150	70	150	-40	-50	-40
	4 A											
		T6	-50	45	45	45	80	44	80	-40	-50	-40
		T5	-50	60	60	60	95	59	95	-40	-50	-40
		T4	-50	67	67	67	130	63	130	-40	-50	-40
		T3...T1	-50	67	67	67	150	62	150	-40	-50	-40

Position 3, 4 = A7, A8

A, B		P1		P2		P3		P4		P5	
		T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a
	T6	-50	70	70	70	80	70	80	-40	-50	-40
	T5	-50	70	70	70	95	70	95	-40	-50	-40
	T4	-50	70	70	70	130	70	130	-40	-50	-40
	T3...T1	-50	70	70	70	150	70	150	-40	-50	-40

Position 3, 4 = GA

C		P1		P2		P3		P4		P5	
		T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a
	T6...T1	-50	70	70	70	80	70	80	-40	-50	-40

Connection data

Optional specification, ID Nx, OX = NF, NG
When using the Bluetooth® module: No changes to the connection values.

Basic specification, Position 3, 4	Power supply circuit	Output
A1	U = 19 to 253 V _{AC} , 50/60 Hz; P _{max} < 2 VA	I _{max} = 180 mA I _{max} = 350 mA ¹⁾
A2	U = 10 to 55 V _{DC} ; P _{max} < 0.5 W, P _{max} < 1.2 W ²⁾	I _{max} = 350 mA
A3	U = 9 to 20 V _{DC} ; P _{max} < 1 W, P _{max} < 1.7 W ²⁾	2 potential free change-over contacts; 2 A Ex e 4 A Ex e ³⁾
A4	U = 19 to 253 V _{AC} , 50/60 Hz or 19 to 55 V _{DC} ; P _{max} < 25 VA or < 1.3 W, P _{max} < 31 VA or < 2 W ²⁾	

Basic specification, Position 3, 4	Power supply circuit	Output
A7	U = 9.5 to 12.5 V _{DC} ; PFM; I _{max} = 12 mA Connection only to power supply unit FTL325P or FTL375P from Endress+Hauser.	
A8	U = 8.2 V _{DC} ±20 %	NAMUR; I _{max} = 3.8 mA
GA	U = 21 to 26 V _{DC} ; I _{max} = 16 mA Connection only to power supply unit FML621 from Endress+Hauser.	

- 1) Only in connection with Position 8 = A, B, Optional Specification ID Mx = MR, MS
- 2) Only in connection with Position 5 = B
- 3) Only in connection with Optional Specification ID Mx = MR, MS

Cable entry parameters

Cable gland: *Basic specification, Position 7 = B*

Thread	Clamping range	Material	Sealing insert	O-ring
M20x1,5	ø 8 to 10.5 mm	Ms, nickel-plated	Silicone	EPDM (ø 17x2)

Cable gland: *Basic specification, Position 7 = C*

Thread	Clamping range	Material	Sealing insert	O-ring
M20x1,5	ø 7 to 12 mm	1.4404	NBR	EPDM (ø 17x2)



- The tightening torque refers to cable glands installed by the manufacturer:
 - Recommended torque to connect the cable gland into the enclosure: 3.75 Nm
 - Recommended torque to tighten the cable into the cable gland: 3.5 Nm
 - Maximum torque to tighten the cable into the cable gland: 10 Nm
 - This value may be different depending on the type of cable. However, the maximum value must not be exceeded.
- Only suitable for fixed installation. The operator must pay attention to a suitable strain relief of the cable.
- To maintain the ingress protection of the enclosure: Install the enclosure cover, cable glands and blind plugs correctly.
- The cable glands are suitable for a low risk of mechanical danger (4 Joule) and must be mounted in a protected position if larger impact energy levels are expected.



71662245

www.addresses.endress.com
