

Safety Instructions

Proline Promass 500

Class I, Division 1 for IS
(Ex i Intrinsically safe version)



Proline Promass 500

Table of contents

About this document 4

Associated documentation 4

Certificates and declarations 5

Manufacturer address 5

Extended order code 5

Safety instructions: General 10

Safety instructions: Installation 11

Safety instructions: Class II, Class III 13

Temperature tables Proline 500 - digital 13

Temperature tables Proline 500 25

Connection values: Signal circuits 35

About this document

 The document number of these Safety Instructions (XA) must match the information on the nameplate.

Associated documentation

For an overview of the scope of the associated Technical Documentation, refer to the following:

- *Device Viewer* (www.endress.com/deviceviewer): Enter serial number from nameplate.
- *Endress+Hauser Operations app*: Enter serial number from nameplate or scan matrix code on nameplate.

To commission the device, please observe the Operating Instructions pertaining to the device:

Measuring instrument	Documentation code			
	HART	FOUNDATION Fieldbus	PROFIBUS PA	PROFIBUS DP
Promass A 500 (8A5B)	BA01526D	BA01559D	BA01548D	–
Promass A 500 (8A5C)	BA01817D	BA01883D	BA01869D	BA01870D
Promass E 500	BA01528D	BA01561D	BA01550D	BA01872D
Promass F 500	BA01529D	BA01562D	BA01551D	BA01873D
Promass H 500	BA01530D	BA01563D	BA01552D	BA01874D
Promass I 500	BA01531D	BA01564D	BA01553D	BA01875D
Promass O 500	BA01532D	BA01565D	BA01554D	BA01876D
Promass P 500	BA01533D	BA01566D	BA01555D	BA01877D
Promass Q 500	BA01534D	BA01567D	BA01556D	BA01878D
Promass S 500	BA01535D	BA01568D	BA01557D	BA01879D
Promass X 500	BA01536D	BA01569D	BA01558D	BA01880D

Measuring instrument	Documentation code				
	Modbus RS485	Modbus over Ethernet-APL	EtherNet/IP	PROFINET	PROFINET over Ethernet-APL
Promass A 500 (8A5B)	BA01537D	–	BA01747D	BA01758D	–
Promass A 500 (8A5C)	BA01884D	BA02412D	BA01885D	BA01886D	BA02121D
Promass E 500	BA01539D	BA02414D	BA01749D	BA01760D	BA02124D
Promass F 500	BA01540D	BA02415D	BA01750D	BA01761D	BA02119D
Promass H 500	BA01541D	BA02416D	BA01751D	BA01762D	BA02125D
Promass I 500	BA01542D	BA02417D	BA01752D	BA01763D	BA02126D
Promass O 500	BA01543D	BA02418D	BA01753D	BA01764D	BA02127D

Measuring instrument	Documentation code				
	Modbus RS485	Modbus over Ethernet-APL	EtherNet/IP	PROFINET	PROFINET over Ethernet-APL
Promass P 500	BA01544D	BA02419D	BA01754D	BA01765D	BA02128D
Promass Q 500	BA01545D	BA02420D	BA01755D	BA01766D	BA02129D
Promass S 500	BA01546D	BA02421D	BA01756D	BA01767D	BA02130D
Promass X 500	BA01547D	BA02423D	BA01757D	BA01768D	BA02131D

Additional documentation

Contents	Document type	Documentation code
Explosion Protection	Brochure	CP00021Z/11
Ethernet-APL Installation Drawing	Installation Drawing	HE_01622
Control drawing		As wanted on the nameplate.

Please note the documentation associated with the device.

Certificates and declarations

Certificate number
CSA 16.70087366

Notified body
CSA Group


Manufacturer address

Endress+Hauser Flowtec AG
Kägenstrasse 7
4153 Reinach BL
Switzerland

Extended order code

The extended order code is indicated on the nameplate, which is affixed to the device in such a way that it is clearly visible. Additional information about the nameplate is provided in the associated Operating Instructions.

Structure of the extended order code

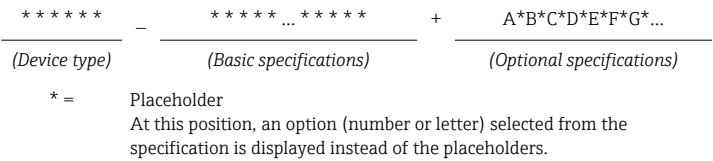

Device type

The device and the device design is defined in the "Device type" section (Product root).

Basic specifications

The features that are absolutely essential for the device (mandatory features) are specified in the basic specifications. The number of positions depends on the number of features available. The selected option of a feature can consist of several positions.

Optional specifications



The optional specifications describe additional features for the device (optional features). The number of positions depends on the number of features available. The features have a 2-digit structure to aid identification (e.g. JA). The first digit (ID) stands for the feature group and consists of a number or a letter (e.g. J = Test, Certificate). The second digit constitutes the value that stands for the feature within the group (e.g. A = 3.1 material (wetted parts), inspection certificate).

More detailed information about the device is provided in the following tables. These tables describe the individual positions and IDs in the extended order code which are relevant to hazardous locations.

Device type

Position	Order code for	Selected option	Description
1	Instrument family	8	Coriolis flowmeter
2	Sensor	A, E, F, H, I, O, P, Q, S, X ¹⁾	Sensor type
3	Transmitter	5	Transmitter type: 4-wire, remote version
4	Generation index	B, C	Platform generation
5, 6	Nominal diameter	Examples: 02, 04, 40, 50, 1H, 3E ²⁾ ³⁾	Nominal diameter of sensor

- 1) For replacement transmitter only: X
- 2) For the exact specification of the nominal diameter, see nameplate
- 3) For replacement transmitter only: XX

Proline 500 – digital	Proline 500
Order code for "Integrated ISEM Electronic", option A "Sensor"	Order code for "Integrated ISEM Electronic", option B "Transmitter"
 1 Transmitter 2 Connecting cable 3 Sensor connection housing with integrated ISEM	 1 Transmitter with integrated ISEM 2 Connecting cable 3 Sensor connection housing

Basic specifications

Position 1, 2 Order code for "Approval" Selected option	Position 10 Order code for "Integrated ISEM electronics" Selected option	Type of protection	
		Transmitter	Sensor
CC	B	Cl.I, Div.1, Cl.II, III, Gps. C-G T6...T5	Cl.I, Div.1, Cl.II, III, Gps. C-G T6...T1
CD	B	Cl.I, Div.1, Cl.II, III, Gps. A-G T6...T5	Cl.I, Div.1, Cl.II, III, Gps. A-G T6...T1
CM	A	Cl.I, Div.2, Gps. A-D T5...T4	Cl.I, Div.1, Cl.II, III, Gps. C-G T6...T1
CN	A	Cl.I, Div.2, Gps. A-D T5...T4	Cl.I, Div.1, Cl.II, III, Gps. A-G T6...T1

Position	Order code for	Selected option	Description
4, 5	Output; input 1	BA	4-20mA HART
		CA	4-20mA Ex-i passive
		CC	4-20mA HART Ex-i active
		GA	PROFIBUS PA
		HA	PROFIBUS PA Ex-i
		LA	PROFIBUS DP
		MA	Modbus RS485
		MB	Modbus TCP over Ethernet-APL/SPE, 10Mbit/s

Position	Order code for	Selected option	Description
		MC	Modbus TCP over Ethernet-APL, Ex-i, 10Mbit/s
		NA	EtherNet/IP 2-port switch integrated
		RA	PROFINET IO 2-port switch integrated
		RB	PROFINET over Ethernet-APL/SPE, 10Mbit/s
		RC	PROFINET over Ethernet-APL, Ex-i, 10Mbit/s
		SA	FOUNDATION Fieldbus
		TA	FOUNDATION Fieldbus Ex-i
6	Output; input 2	A	W/o
		B	4-20mA
		C	4-20mA Ex-i passive
		D	Configurable I/O initial setting off
		E	Pulse/frequency/switch output
		F	Pulse output, phase-shifted
		G	Pulse/frequency/switch output Ex-i passive
		H	Relay
		I	4-20mA input
		J	Status input
7	Output; input 3	A	W/o
		B	4-20mA
		C	4-20mA Ex-i passive
		D	Configurable I/O initial setting off
		E	Pulse/frequency/switch output
		F	Pulse output, phase-shifted
		G	Pulse/frequency/switch output Ex-i passive
		H	Relay
		I	4-20mA input
		J	Status input
8	Output; input 4 ¹⁾	A	W/o
		B	4-20mA
		C	4-20mA Ex-i passive
		D	Configurable I/O initial setting off
		E	Pulse/frequency/switch output
		G	Pulse/frequency/switch output Ex-i passive

Position	Order code for	Selected option	Description
		H	Relay
		I	4-20mA input
		J	Status input
9	Display; Operation	F	4-line, illuminated; touch control
		G	4-line, illuminated; touch control + WLAN
10	Integrated ISEM Electronic	A	Sensor
		B	Transmitter
11	Transmitter Housing	A	Alu, coated
		D	Polycarbonate
		L	Cast, stainless
12	Sensor junction Housing	A	Alu, coated
		B	Stainless
		L	Cast, stainless
15, 16	Meas. Tube Mat., Wetted Parts Surface	LA	Stainl. steel, cryogenic -196°C/-320°F
21, 22	Device Model	A1	1
		A2	2

- 1) The order code "Output; input 4" is only available for the Proline 500 – digital transmitter.

Optional specifications

ID	Order code for	Selected option	Description
Cx	Sensor option	CA	Rupture disk
Cx	Sensor option	CG	Extended neck for insulation
Cx	Sensor option	CH	Purge connection
Jx	Test, certificate	JP	Ambient temperature measuring device -50 °C
Jx	Test, certificate	JQ	Ambient temperature, transmitter-50 °C Ambient temperature, sensor-60 °C
Px	Enclosed accessories	P8	Wireless antenna, wide area (external WLAN antenna) ¹⁾

- 1) The external WLAN antenna is available with the order code for "Accessory Enclosed", option P8.

Safety instructions:

General

- Staff must meet the following conditions for mounting, electrical installation, commissioning and maintenance of the device:
 - Be suitably qualified for their role and the tasks they perform
 - Be trained in explosion protection
 - Be familiar with national regulations or guidelines (e.g. CEC or NEC)
- Install the device according to the manufacturer's instructions and national regulations.
- Do not operate the device outside the specified electrical, thermal and mechanical parameters.
- Use the device only in media where the wetted materials are known to be suitable.
- Refer to the temperature tables for the relationship between the permitted ambient temperature for the sensor and/or transmitter, depending on the range of application, and the temperature classes.
- Alterations to the device can affect the explosion protection and must be carried out by staff authorized to perform such work by Endress+Hauser.
- Only open the cover of the transmitter housing if one of the following conditions is met:
 - An explosive atmosphere is not present.
 - A waiting time of 10 minutes is observed after switching off the power supply.

The following warning notice is on the device:
 WARNING – AFTER DE-ENERGIZING, DELAY 10 MINUTES
 BEFORE OPENING ENCLOSURE IN TYPE OF PROTECTION EX D
- In devices with damaged AEx/Ex db threads:
 - Use in hazardous areas is not permitted.
 - Repair of AEx/Ex db threads is not permitted.
- Observe all the technical data of the device (see nameplate).
- Avoid electrostatic charges which could result in electrostatic discharges while installing, operating, cleaning or maintaining:
 - For external non-metallic surfaces, e.g. housing, attached additional plates, RFID tag.
 - For attached external metallic parts that are not integrated into the local potential equalization system, e.g. nameplate tag, RFID tag.
 - Do not use in areas where the devices/electronic housing are exposed to highly charge-generating processes, pneumatically conveyed dusts and/or charge spraying in an electrostatic coating process.
 - Do not rub surfaces dry. Clean only with moist cloth.
 - Information on electrostatic hazards and how to minimize the generation of static electricity can be found in the technical specification CEC or NEC.
- Class II Group G: The surface temperature of the apparatus cannot exceed +165 °C.

⚠ WARNING**Substitution of components is not permitted.**

- ▶ Substitution of components may impair intrinsic safety.

**Safety
instructions:
Installation****General installation instructions**

- Continuous service temperature of the connecting cable:
–40 to +85 °C (–50 to +85 °C for optional specification, ID Jx (Test, certificate) = JP) (–60 to +85 °C for optional specification, ID Jx (Test, certificate) = JQ); but at least according to the operating temperature range of the application plus allowance for process conditions ($T_{a, \min}$ and $T_{a, \max} + 20$ K).
- When the measuring device is connected, attention must be paid to the type of protection at the transmitter.
- For devices with order code "Sensor connection housing", option B: To maintain the required degree of ingress protection, ensure that the cover seal of the sensor connection housing is flat and free of bends or distortions before securing the cover. Replace any damaged or non-flat seals prior to reassembly.
- For the device with order code "Output; Input 1", option MC:
 - When using Port 1 (terminal 26/27) as a 2-WISE power load APL port with the SLAA profile, Port 2 (RJ45) must not be used for Modbus TCP.
 - Parallel operation of Port 1 (terminal 26/27) and Port 2 (RJ45) is not permitted.
- Install transmitter circuit wiring, using threaded conduit or other suitable wiring methods, in accordance with the Canadian Electrical Code (CEC), Section 18, or the National Electrical Code (NEC), Articles 500–516, as applicable.

Installation in potentially explosive atmospheres

- Do not disconnect the electrical connection of the power supply circuit when energized.
- Do not open the connection compartment cover when the device is energized.
- Connection to or operation with Service interface (Port 2) is not permitted.

Use of cable glands, sealing plugs and thread adapters

- Only use Ex certified cable glands, sealing plugs and thread adapters that are suitable for the intended application (see nameplates).
- Plastic sealing plugs are mounted to cable entries and metallic thread extensions for temporary protection during transport and storage. These must be replaced with suitable Ex certified cable entry devices for permanent use.
- The mounted metallic thread extensions and sealing plugs are tested and certified as part of the device. These meet the device's specific requirements.
- Supplied Ex cable glands are separately certified and meet the device's specific requirements.
- All unused cable entries must be closed with suitable Ex certified sealing plugs.
- Observe selection criteria for Ex cable entry devices as per CEC or NEC.

Optional external WLAN antenna

- The external WLAN antenna (with or without extension cable) and the antenna feedthrough can only be installed in devices with an AEx/Ex eb or AEx/Ex ec connection compartment. Using them with an XP connection compartment is not permitted.
- Use only the external antenna (with or without extension cable) and the antenna feedthrough supplied by Endress+Hauser.
- The antenna feedthrough must be mounted to the transmitter with a tightening torque of 4 Nm.
Tightening torques for Polycarbonate transmitter housing: 2.5 Nm
- Use only an external antenna (with or without extension cable) equipped with a Type-N male connector (MIL-STD-348).
- The coupling nut of the Type-N male connector must be tightened by hand only.

Optional RFID TAG

- Do not use in areas with high electromagnetic field intensities.
- Avoid electrostatic charging.
- Ensure sufficient distance from processes generating high charges.

Intrinsic safety

- Observe the guidelines for interconnecting intrinsically safe circuits (e.g. CEC or NEC as applicable , proof of intrinsic safety).
- Proline 500 - digital (Order code for "Integrated ISEM electronics", option A)
The connecting cables between the transmitter and sensor must meet the following requirements:
 - Group IIC: $L_{\text{cable}}/R_{\text{cable}} \leq 0.0089 \text{ mH}/\Omega$ or $L_{\text{cable}} \leq 26 \mu\text{H}$ and $C_{\text{cable}} \leq 760 \text{ nF}$
 - Group IIB: $L_{\text{cable}}/R_{\text{cable}} \leq 0.0356 \text{ mH}/\Omega$ or $L_{\text{cable}} \leq 104 \mu\text{H}$ and $C_{\text{cable}} \leq 4.2 \mu\text{F}$
- Proline 500 (Order code for "Integrated ISEM electronics", option B)
Connecting cables between the transmitter and sensor with a maximum length of 120 m must meet the following requirements:
 - Maximum cable capacitance C_{cable} : $0.5 \text{ nF}/\text{m}$
 - Maximum cable inductance L_{cable} : $0.5 \mu\text{H}/\text{m}$
- The supplied connecting cable meets all the above requirements.

Potential equalization

- The device must be connected to the potential equalization system using designated protective ground terminals.
- It is also possible to integrate the device into the potential equalization system through a pipe system, provided that the pipe system meets the grounding requirements of applicable national regulations.

Safety instructions: Class II, Class III

The enclosure may only be opened for brief maintenance or inspection activities where the area is confirmed to be free of combustible dust. Suitable precautions must be taken during this time to prevent dust entering the electronic compartment.

Temperature tables Proline 500 - digital

Order code for "Integrated ISEM electronics", option A

NOTICE

In case of heating, risk of overheating.

- ▶ On devices with Heating jacket the corresponding temperature tables for devices with thermal insulation, are to be observed.
- ▶ Make sure that the heating medium, may not exceeded the maximum specified medium temperature of the exact used temperature classes of the device.

Minimum ambient temperature

- $T_{a, \min} = -40\text{ }^{\circ}\text{C}$
- *Optional specification, ID Jx (Test, Certificate) = JP*
 $T_{a, \min} = -50\text{ }^{\circ}\text{C}$ depending on the selected device variant (see nameplate)
- Promass F, Q, X with order code "Integrated ISEM electronics", Option B and order code "Test, Certificate", Option JQ:
 - Sensor: $-60\text{ }^{\circ}\text{C}$
 - Transmitter: $-50\text{ }^{\circ}\text{C}$

Maximum ambient temperature

$T_{a, \max} = +60\text{ }^{\circ}\text{C}$ depending on temperature class, maximum medium temperature and device-specific features. See the corresponding temperature tables.

Transmitter: Non-hazardous area, Class I Division 2

Transmitter housing material	$T_{a, \max}\text{ }[^{\circ}\text{C}]$			
	Non-hazardous area ¹⁾	T6 [85 °C]	T5 [100 °C]	T4 [135 °C]
Aluminum	60	–	45	60
Polycarbonate	60	–	–	–

1) The transmitter is located in the non-hazardous area

Minimum medium temperature

- Promass A, F, H, I, P, Q, S, X:
 $T_{m, \min} = -50\text{ }^{\circ}\text{C}$
- Promass E, O:
 $T_{m, \min} = -40\text{ }^{\circ}\text{C}$
- Promass F, Q with cryogenic temperature version (order code for "Measuring tube material", option LA):
 $T_{m, \min} = -196\text{ }^{\circ}\text{C}$

Maximum medium temperature without thermal insulation

Promass A (8A5B**-*...)

DN	$T_{m, \max \text{ range}}\text{ }[^{\circ}\text{C}]$	$T_{a, \max}\text{ }[^{\circ}\text{C}]$	$T_{m, \max}\text{ }[^{\circ}\text{C}]$					
			T6 [85 °C]	T5 [100 °C]	T4 [135 °C]	T3 [200 °C]	T2 [300 °C]	T1 [450 °C]
1...4	205	35	60	95	130	150	205	205
		50	–	95	130	150	205	205
		60	–	–	130	150	205	205

*Promass A (8A5C**-*...)*

DN	T _{m, max range} [°C]	T _{a, max} [°C]	T _{m, max} [°C]					
			T6 [85 °C]	T5 [100 °C]	T4 [135 °C]	T3 [200 °C]	T2 [300 °C]	T1 [450 °C]
1...4	205	35	55	85	130	150	205	205
		50	–	95	130	150	205	205
		55	–	–	130	150	205	205
		60	–	–	130	150	190	190

Promass E

DN	T _{m, max range} [°C]	T _{a, max} [°C]	T _{m, max} [°C]					
			T6 [85 °C]	T5 [100 °C]	T4 [135 °C]	T3 [200 °C]	T2 [300 °C]	T1 [450 °C]
8...50	150	35	40	60	130	130	150	150
		50	–	60	130	130	150	150
		60	–	–	130	130	150	150
80	150	35	40	60	110	150	150	150
		50	–	60	110	150	150	150
		60	–	–	110	150	150	150

Promass F

DN	T _{m, max range} ¹⁾ [°C]	T _{a, max} [°C]	T _{m, max} [°C]					
			T6 [85 °C]	T5 [100 °C]	T4 [135 °C]	T3 [200 °C]	T2 [300 °C]	T1 [450 °C]
08...50	150	35	40	65	130	150	150	150
		50	–	65	130	150	150	150
		60	–	–	130	130	130	130
	150 ²⁾	35	40	65	130	150	150	150
		50	–	65	130	150	150	150
		60	–	–	130	150	150	150
	240	35	40	65	130	160	240	240
		50	–	65	130	160	240	240
		60	–	–	130	160	240	240
15...25	350	35	40	80	130	175	275	350
		50	–	80	130	175	275	350

DN	T _{m, max range} ¹⁾ [°C]	T _{a, max} [°C]	T _{m, max} [°C]					
			T6 [85 °C]	T5 [100 °C]	T4 [135 °C]	T3 [200 °C]	T2 [300 °C]	T1 [450 °C]
		60	–	–	130	175	240 (275)	240 (350)
80...250	150	35	40	65	110	150	150	150
		50	–	65	110	150	150	150
		60	–	–	110	130	130	130
	150 ²⁾	35	40	65	110	150	150	150
		50	–	65	110	150	150	150
		60	–	–	110	150	150	150
	240	35	40	65	110	170	240	240
		50	–	65	110	170	240	240
		60	–	–	110	170	240	240
50...250	350	35	40	80	120	175	275	350
		50	–	80	120	175	275	350
		60	–	–	120	175	240 (275)	240 (350)

- 1) Maximum temperature range, see nameplate
 2) Cryogenic temperature version: T_m = –196 to 150 °C

Promass H

DN	T _{m, max range} ¹⁾ [°C]	T _{a, max} [°C]	T _{m, max} [°C]					
			T6 [85 °C]	T5 [100 °C]	T4 [135 °C]	T3 [200 °C]	T2 [300 °C]	T1 [450 °C]
8	150	35	40	65	100	150	150	150
		50	–	65	100	150	150	150
		60	–	–	100	150	150	150
	205	35	40	65	100	160	205	205
		50	–	65	100	160	205	205
		60	–	–	100	160	205	205
15...50	150	35	40	65	115	150	150	150
		50	–	65	115	150	150	150
		60	–	–	115	150	150	150
	205	35	40	65	115	180	205	205

DN	T _{m, max range} ¹⁾ [°C]	T _{a, max} [°C]	T _{m, max} [°C]					
			T6 [85 °C]	T5 [100 °C]	T4 [135 °C]	T3 [200 °C]	T2 [300 °C]	T1 [450 °C]
		50	–	65	115	180	205	205
		60	–	–	115	180	205	205

1) Maximum temperature range, see nameplate

Promass I

DN	T _{m, max range} [°C]	T _{a, max} [°C]	T _{m, max} [°C]					
			T6 [85 °C]	T5 [100 °C]	T4 [135 °C]	T3 [200 °C]	T2 [300 °C]	T1 [450 °C]
8...80	150	35	45	70	115	140	140	150
		50	–	70	115	140	140	150
		55	–	–	115	140	140	150
		60	–	–	115	140	140	140

Promass O

DN	T _{m, max range} [°C]	T _{a, max} [°C]	T _{m, max} [°C]					
			T6 [85 °C]	T5 [100 °C]	T4 [135 °C]	T3 [200 °C]	T2 [300 °C]	T1 [450 °C]
80 ... 250	205	35	45	65	110	170	205	205
		50	–	65	110	170	205	205
		60	–	–	110	170	205	205

Promass P

DN	T _{m, max range} ¹⁾ [°C]	T _{a, max} [°C]	T _{m, max} [°C]					
			T6 [85 °C]	T5 [100 °C]	T4 [135 °C]	T3 [200 °C]	T2 [300 °C]	T1 [450 °C]
8	150	35	45	65	100	150	150	150
		50	–	65	100	150	150	150
		60	–	–	100	150	150	150
	205	35	45	65	100	160	205	205
		50	–	65	100	160	205	205
		60	–	–	100	160	205	205
15...50	150	35	45	65	110	150	150	150

DN	T _{m, max range} ¹⁾ [°C]	T _{a, max} [°C]	T _{m, max} [°C]					
			T6 [85 °C]	T5 [100 °C]	T4 [135 °C]	T3 [200 °C]	T2 [300 °C]	T1 [450 °C]
		50	–	65	110	150	150	150
		60	–	–	110	150	150	150
	205	35	45	65	110	180	205	205
		50	–	65	110	180	205	205
		60	–	–	110	180	205	205

1) Maximum temperature range, see nameplate

Promass Q

DN	T _{m, max range} ¹⁾ [°C]	T _{a, max} [°C]	T _{m, max} [°C]					
			T6 [85 °C]	T5 [100 °C]	T4 [135 °C]	T3 [200 °C]	T2 [300 °C]	T1 [450 °C]
25 ... 250	205	35	45	65	100	160	205	205
		50	–	65	100	160	205	205
		60	–	–	100	160	205	205
	150 ²⁾	35	45	65	100	150	150	150
		50	–	65	100	150	150	150
		60	–	–	100	150	150	150

1) Maximum temperature range, see nameplate

2) Cryogenic temperature version: T_m = –196 to 150 °C

Promass S

DN	T _{m, max range} [°C]	T _{a, max} [°C]	T _{m, max} [°C]					
			T6 [85 °C]	T5 [100 °C]	T4 [135 °C]	T3 [200 °C]	T2 [300 °C]	T1 [450 °C]
8	150	35	45	65	100	150	150	150
		50	–	65	100	150	150	150
		60	–	–	100	150	150	150
15...50	150	35	45	65	110	150	150	150
		50	–	65	110	150	150	150
		60	–	–	110	150	150	150

Promass X

DN	T _{m, max range} [°C]	T _{a, max} [°C]	T _{m, max} [°C]					
			T6 [85 °C]	T5 [100 °C]	T4 [135 °C]	T3 [200 °C]	T2 [300 °C]	T1 [450 °C]
350	180	35	45	65	110	170	180	180
		50	–	65	110	170	180	180
		60	–	–	110	170	180	180

Maximum medium temperature with thermal insulation according to Endress+Hauser specifications

 For information on the thermal insulation of the device, see the "Thermal insulation" section of the "Operating instructions" document .

Promass A (8A5B**-*, 8A5C**-*...)

DN	T _{m, max range} [°C]	T _{a, max} [°C]	T _{m, max} [°C]					
			T6 [85 °C]	T5 [100 °C]	T4 [135 °C]	T3 [200 °C]	T2 [300 °C]	T1 [450 °C]
1 to 4	205	35	40	90	90	150	150	150
		40	–	90	90	150	150	150
		45	–	–	90	150	150	150
		50	–	–	90	120	120	120

Promass E

DN	T _{m, max range} [°C]	T _{a, max} [°C]	T _{m, max} [°C]					
			T6 [85 °C]	T5 [100 °C]	T4 [135 °C]	T3 [200 °C]	T2 [300 °C]	T1 [450 °C]
8 to 50	150	35	40	55	130	150	150	150
		50	–	55	130	150	150	150
80		35	40	55	110	150	150	150
		50	–	55	110	150	150	150

Promass F

DN	T _{m, max range} ¹⁾ [°C]	T _{a, max} [°C]	T _{m, max} [°C]					
			T6 [85 °C]	T5 [100 °C]	T4 [135 °C]	T3 [200 °C]	T2 [300 °C]	T1 [450 °C]
08 to 50	150	35	40	60	130	130	130	130
		45	–	60	130	130	130	130
		50	–	–	130	130	130	130
	150 ²⁾	35	40	60	130	150	150	150
		45	–	60	130	150	150	150
		50	–	–	130	150	150	150
	240	35	40	60	130	160	240	240
		45	–	60	130	160	240	240
		50	–	–	130	160	240	240

DN	T _{m, max range} ¹⁾ [°C]	T _{a, max} [°C]	T _{m, max} [°C]					
			T6 [85 °C]	T5 [100 °C]	T4 [135 °C]	T3 [200 °C]	T2 [300 °C]	T1 [450 °C]
15 to 25	350	35	40	80	130	175	275	350
		50	–	80	130	175	275	350
		60	–	–	130	175	240 (275)	240 (350)
80 to 250	150	35	40	60	110	130	130	130
		45	–	60	110	130	130	130
		50	–	–	110	130	130	130
	150 ²⁾	35	40	60	110	150	150	150
		45	–	60	110	150	150	150
		50	–	–	110	150	150	150
	240	35	40	60	110	170	240	240
		45	–	60	110	170	240	240
		50	–	–	110	170	240	240
50 to 250	350	35	40	80	120	175	275	350
		50	–	80	120	175	275	350
		60	–	–	120	175	240 (275)	240 (350)

1) Maximum temperature range, see nameplate

2) Cryogenic temperature version: T_m = –196 to 150 °C

Promass H

DN	T _{m, max range} ¹⁾ [°C]	T _{a, max} [°C]	T _{m, max} [°C]					
			T6 [85 °C]	T5 [100 °C]	T4 [135 °C]	T3 [200 °C]	T2 [300 °C]	T1 [450 °C]
8	150	35	40	65	100	150	150	150
		45	–	65	100	150	150	150
		55	–	–	100	150	150	150
	205	35	40	65	100	160	205	205
		45	–	65	100	160	205	205
		55	–	–	100	160	205	205
15 to 50	150	35	40	65	115	150	150	150
		45	–	65	115	150	150	150
		55	–	–	115	150	150	150

DN	T _{m, max range} ¹⁾ [°C]	T _{a, max} [°C]	T _{m, max} [°C]					
			T6 [85 °C]	T5 [100 °C]	T4 [135 °C]	T3 [200 °C]	T2 [300 °C]	T1 [450 °C]
	205	35	40	65	115	180	205	205
		45	–	65	115	180	205	205
		55	–	–	115	180	205	205

1) Maximum temperature range, see nameplate

Promass I

DN	T _{m, max range} [°C]	T _{a, max} [°C]	T _{m, max} [°C]					
			T6 [85 °C]	T5 [100 °C]	T4 [135 °C]	T3 [200 °C]	T2 [300 °C]	T1 [450 °C]
8 to 80	150	35	45	70	90	150	150	150
		45	–	70	90	150	150	150
		50	–	–	90	120	120	–

Promass O

DN	T _{m, max range} [°C]	T _{a, max} [°C]	T _{m, max} [°C]					
			T6 [85 °C]	T5 [100 °C]	T4 [135 °C]	T3 [200 °C]	T2 [300 °C]	T1 [450 °C]
80 to 250	205	35	40	55	110	170	205	205
		50	–	55	110	170	205	205

Promass P

DN	T _{m, max range} ¹⁾ [°C]	T _{a, max} [°C]	T _{m, max} [°C]					
			T6 [85 °C]	T5 [100 °C]	T4 [135 °C]	T3 [200 °C]	T2 [300 °C]	T1 [450 °C]
8	150	35	40	55	100	150	150	150
		45	–	55	100	150	150	150
		50	–	–	100	120	120	120
	205	35	40	55	100	160	205	205
		50	–	55	100	160	205	205
		55	–	–	100	160	205	205
15 to 50	150	35	40	55	110	150	150	150
		45	–	55	110	150	150	150

DN	T _{m, max range} ¹⁾ [°C]	T _{a, max} [°C]	T _{m, max} [°C]					
			T6 [85 °C]	T5 [100 °C]	T4 [135 °C]	T3 [200 °C]	T2 [300 °C]	T1 [450 °C]
	205	50	–	–	110	120	120	120
		35	40	55	100	180	205	205
		50	–	55	100	180	205	205
		55	–	–	100	180	205	205

1) Maximum temperature range, see nameplate

Promass Q

DN	T _{m, max range} ¹⁾ [°C]	T _{a, max} [°C]	T _{m, max} [°C]					
			T6 [85 °C]	T5 [100 °C]	T4 [135 °C]	T3 [200 °C]	T2 [300 °C]	T1 [450 °C]
25 to 250	205	35	40	55	100	160	205	205
		50	–	55	100	160	205	205
25 to 250	150 ²⁾	35	40	55	100	150	150	150
		50	–	55	100	150	150	150

- 1) Maximum temperature range, see nameplate
2) Cryogenic temperature version: T_m = –196 to 150 °C

Promass S


DN	T _{m, max range} [°C]	T _{a, max} [°C]	T _{m, max} [°C]					
			T6 [85 °C]	T5 [100 °C]	T4 [135 °C]	T3 [200 °C]	T2 [300 °C]	T1 [450 °C]
8	150	35	40	55	100	150	150	150
		45	–	55	100	150	150	150
		50	–	–	100	120	120	120
15 to 50	150	35	40	55	110	150	150	150
		45	–	55	110	150	150	150
		50	–	–	110	120	120	120

Promass X

DN	T _{m, max} range [°C]	T _{a, max} [°C]	T _{m, max} [°C]					
			T6 [85 °C]	T5 [100 °C]	T4 [135 °C]	T3 [200 °C]	T2 [300 °C]	T1 [450 °C]
350	180	35	40	55	120	170	180	180
		50	–	55	120	170	180	180
		55	–	–	120	170	180	180

Maximum medium temperature for devices with thermal insulation
NOT in accordance with Endress+Hauser specifications

The specified reference temperature T_{ref} and the maximum medium temperature T_{m, max} for each temperature class must not be exceeded.
→  20

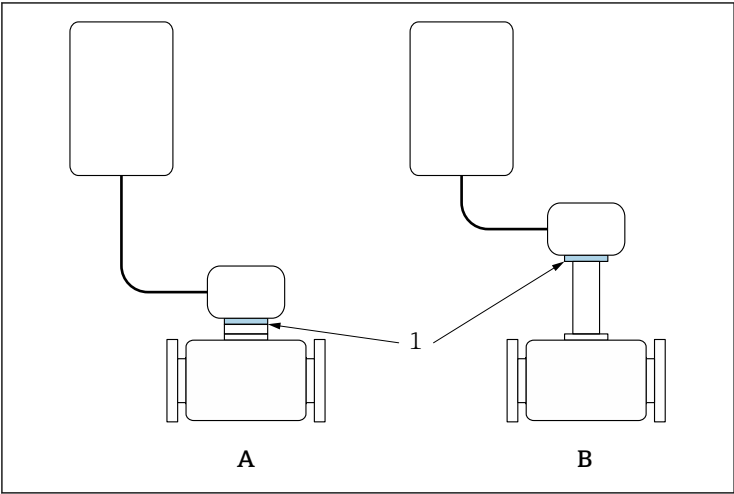

-  1
- Position of reference point for temperature measurement
- A
- Standard version
- B
- Extended temperature version, cryogenic temperature version, high-temperature version
- 1
- Reference point (T_{ref})

Reference temperature T_{ref}

T6 [85 °C]	T5 [100 °C]	T4 [135 °C]	T3 [200 °C]	T2 [300 °C]	T1 [450 °C]
45	64	82	82	85	85

Temperature
tables Proline 500

Order code for "Integrated ISEM electronics", option B "Transmitter"

NOTICE

In case of heating, risk of overheating.

- ▶ On devices with Heating jacket the corresponding temperature tables for devices with thermal insulation, are to be observed.
- ▶ Make sure that the heating medium, may not exceeded the maximum specified medium temperature of the exact used temperature classes of the device.

Minimum ambient temperature

- $T_{a, \min} = -40\text{ }^{\circ}\text{C}$
- *Optional specification, ID Jx (Test, Certificate) = JP*
 $T_{a, \min} = -50\text{ }^{\circ}\text{C}$ depending on the selected device variant (see nameplate)
- Promass F, Q , X with order code "Integrated ISEM electronics", Option **B** and order code "Test, Certificate", Option **JQ**:
 - Sensor: $-60\text{ }^{\circ}\text{C}$
 - Transmitter: $-50\text{ }^{\circ}\text{C}$

Maximum ambient temperature

$T_{a, \max} = +60\text{ }^{\circ}\text{C}$ depending on temperature class, maximum medium temperature and device-specific features. See the corresponding temperature tables.

Transmitter: Class I Division 1

T _{a, max} [°C]	
T6 [85 °C]	T5 [100 °C]
55	60

Transmitter: Class II, III

Maximum surface temperature T _a = 60 °C	85 °C
--	-------

Minimum medium temperature

- Promass A, F, H, I, P, Q, S, X:
 $T_{m, \min} = -50\text{ }^{\circ}\text{C}$
- Promass E, O:
 $T_{m, \min} = -40\text{ }^{\circ}\text{C}$
- Promass F, Q with cryogenic temperature version (order code for "Measuring tube material", option LA):
 $T_{m, \min} = -196\text{ }^{\circ}\text{C}$

Maximum medium temperature without thermal insulation

Promass A (8A5B**-*...)

DN	T _{m, max range} [°C]	T _{a, max} [°C]	T _{m, max} [°C]					
			T6 [85 °C]	T5 [100 °C]	T4 [135 °C]	T3 [200 °C]	T2 [300 °C]	T1 [450 °C]
1...4	205	60	60	95	130	150	205	205

Promass A (8A5C**-*...)

DN	T _{m, max range} [°C]	T _{a, max} [°C]	T _{m, max} [°C]					
			T6 [85 °C]	T5 [100 °C]	T4 [135 °C]	T3 [200 °C]	T2 [300 °C]	T1 [450 °C]
1...4	205	55	55	95	130	150	205	205
		60	–	95	130	150	205	205

Promass E

DN	T _{m, max range} [°C]	T _{a, max} [°C]	T _{m, max} [°C]					
			T6 [85 °C]	T5 [100 °C]	T4 [135 °C]	T3 [200 °C]	T2 [300 °C]	T1 [450 °C]
8...50	150	50	50	100	130	130	150	150
		60	–	100	130	130	150	150
80	150	60	60	75	110	150	150	150

Promass F

DN	T _{m, max range} ¹⁾ [°C]	T _{a, max} [°C]	T _{m, max} [°C]					
			T6 [85 °C]	T5 [100 °C]	T4 [135 °C]	T3 [200 °C]	T2 [300 °C]	T1 [450 °C]
08...15	150	55	50	95	130	150	150	150
		60	–	95	130	150	150	150
	150 ²⁾	55	50	95	130	150	150	150
		60	–	95	130	150	150	150
	240	55	50	95	130	160	240	240
		60	–	95	130	160	240	240
15...25	350	60	70	95	130	175	265	350
25...40	150	55	55	95	130	150	150	150
		60	–	95	130	150	150	150

DN	T _{m, max range} ¹⁾ [°C]	T _{a, max} [°C]	T _{m, max} [°C]					
			T6 [85 °C]	T5 [100 °C]	T4 [135 °C]	T3 [200 °C]	T2 [300 °C]	T1 [450 °C]
	150 ²⁾	55	55	95	130	150	150	150
		60	–	95	130	150	150	150
	240	55	55	95	130	160	240	240
		60	–	95	130	160	240	240
50	150	55	55	95	130	150	150	150
		60	–	95	130	150	150	150
	150 ²⁾	60	60	95	130	150	150	150
	240	60	60	95	130	170	240	240
80...250	150	55	55	75	110	150	150	150
		60	–	75	110	150	150	150
	150 ²⁾	60	60	75	110	150	150	150
	240	60	60	75	110	170	240	240
50...250	350	60	70	85	120	175	265	350

1) Maximum temperature range, see nameplate

2) Cryogenic temperature version: T_m = –196 to 150 °C

Promass H

DN	T _{m, max range} ¹⁾ [°C]	T _{a, max} [°C]	T _{m, max} [°C]					
			T6 [85 °C]	T5 [100 °C]	T4 [135 °C]	T3 [200 °C]	T2 [300 °C]	T1 [450 °C]
8	150	50	50	65	100	150	150	150
		60	–	65	100	150	150	150
	205	50	50	65	100	160	205	205
		60	–	65	100	160	205	205
15...50	150	60	60	75	115	150	150	150
	205	60	60	75	115	180	205	205

1) Maximum temperature range, see nameplate

Promass I

DN	T _{m, max range} [°C]	T _{a, max} [°C]	T _{m, max} [°C]					
			T6 [85 °C]	T5 [100 °C]	T4 [135 °C]	T3 [200 °C]	T2 [300 °C]	T1 [450 °C]
8, 15, 15FB, 25	150	60	60	95	130	150	150	150
25FB, 40, 40FB, 50, 50FB, 80	150	60	70	85	120	150	150	150
FB = Full bore								

Promass O

DN	T _{m, max range} [°C]	T _{a, max} [°C]	T _{m, max} [°C]					
			T6 [85 °C]	T5 [100 °C]	T4 [135 °C]	T3 [200 °C]	T2 [300 °C]	T1 [450 °C]
80 ... 250	205	60	60	75	110	170	205	205

Promass P

DN	T _{m, max range} ¹⁾ [°C]	T _{a, max} [°C]	T _{m, max} [°C]					
			T6 [85 °C]	T5 [100 °C]	T4 [135 °C]	T3 [200 °C]	T2 [300 °C]	T1 [450 °C]
8	150	45	45	65	100	150	150	150
		60	–	65	100	150	150	150
	205	45	45	65	100	160	205	205
		60	–	65	100	160	205	205
15...40	150	50	50	75	115	150	150	150
		60	–	75	115	150	150	150
	205	50	50	75	115	180	205	205
		60	–	75	115	180	205	205
50	150	60	60	75	115	150	150	150
	205	60	60	75	115	180	205	205

1) Maximum temperature range, see nameplate

Promass Q

DN	T _{m, max range} ¹⁾ [°C]	T _{a, max} [°C]	T _{m, max} [°C]					
			T6 [85 °C]	T5 [100 °C]	T4 [135 °C]	T3 [200 °C]	T2 [300 °C]	T1 [450 °C]
25 ... 250	205	60	55	75	110	160	205	205
	150 ²⁾	60	55	75	110	150	150	150

- 1) Maximum temperature range, see nameplate
2) Cryogenic temperature version: T_m = -196 to 150 °C

Promass S

DN	T _{m, max range} [°C]	T _{a, max} [°C]	T _{m, max} [°C]					
			T6 [85 °C]	T5 [100 °C]	T4 [135 °C]	T3 [200 °C]	T2 [300 °C]	T1 [450 °C]
8	150	45	45	65	100	150	150	150
		60	–	65	100	150	150	150
15...40		50	50	75	115	150	150	150
		60	–	75	115	150	150	150
50		60	60	75	115	150	150	150

Promass X

DN	T _{m, max range} [°C]	T _{a, max} [°C]	T _{m, max} [°C]					
			T6 [85 °C]	T5 [100 °C]	T4 [135 °C]	T3 [200 °C]	T2 [300 °C]	T1 [450 °C]
350	180	60	70	90	120	170	180	180

Maximum medium temperature with thermal insulation according to Endress+Hauser specifications

 For information on the thermal insulation of the device, see the "Thermal insulation" section of the "Operating instructions" document .

Promass A (8A5B**-*-...)

DN	T _{m, max range} [°C]	T _{a, max} [°C]	T _{m, max} [°C]					
			T6 [85 °C]	T5 [100 °C]	T4 [135 °C]	T3 [200 °C]	T2 [300 °C]	T1 [450 °C]
1 to 4	205	50	60	95	130	150	(180)	(180)
		60	60	95	130	150	150	150

Promass A (8A5C**-*-...)

DN	T _{m, max range} [°C]	T _{a, max} [°C]	T _{m, max} [°C]					
			T6 [85 °C]	T5 [100 °C]	T4 [135 °C]	T3 [200 °C]	T2 [300 °C]	T1 [450 °C]
1 to 4	205	50	60	95	130	150	(180)	(180)
		55	55	95	130	150	150	150
		60	–	95	130	150	150	150

Promass E

DN	T _{m, max range} [°C]	T _{a, max} [°C]	T _{m, max} [°C]					
			T6 [85 °C]	T5 [100 °C]	T4 [135 °C]	T3 [200 °C]	T2 [300 °C]	T1 [450 °C]
8 to 50	150	50	50	100	130	130	150	150
		60	–	100	130	130	150	150
80	150	60	60	75	110	150	150	150

Promass F

DN	T _{m, max range} ¹⁾ [°C]	T _{a, max} [°C]	T _{m, max} [°C]					
			T6 [85 °C]	T5 [100 °C]	T4 [135 °C]	T3 [200 °C]	T2 [300 °C]	T1 [450 °C]
08 to 15	150	55	50	95	130	150	150	150
		60	–	95	130	150	150	150
	150 ²⁾	55	50	95	130	150	150	150
		60	–	95	130	150	150	150

DN	T _{m, max range} ¹⁾ [°C]	T _{a, max} [°C]	T _{m, max} [°C]					
			T6 [85 °C]	T5 [100 °C]	T4 [135 °C]	T3 [200 °C]	T2 [300 °C]	T1 [450 °C]
	240	55	50	95	130	160	240	240
		60	–	95	130	160	240	240
15 to 25	350	60	70	95	130	175	265	350
25 to 40	150	55	55	95	130	150	150	150
		60	–	95	130	150	150	150
	150 ²⁾	55	55	95	130	150	150	150
		60	–	95	130	150	150	150
	240	55	55	95	130	160	240	240
		60	–	95	130	160	240	240
50	150	55	55	95	130	150	150	150
		60	–	95	130	150	150	150
	150 ²⁾	60	60	95	130	150	150	150
	240	60	60	95	130	170	240	240
80 to 250	150	55	55	75	110	150	150	150
		60	–	75	110	150	150	150
	150 ²⁾	60	60	95	130	150	150	150
	240	60	60	75	110	170	240	240
50 to 250	350	60	70	85	120	175	265	350

- 1) Maximum temperature range, see nameplate
 2) Cryogenic temperature version: T_m = –196 to 150 °C

Promass H

DN	T _{m, max range} ¹⁾ [°C]	T _{a, max} [°C]	T _{m, max} [°C]					
			T6 [85 °C]	T5 [100 °C]	T4 [135 °C]	T3 [200 °C]	T2 [300 °C]	T1 [450 °C]
8	150	50	50	65	100	150	150	150
		60	–	65	100	150	150	150
	205	50	50	65	100	160	205	205
		60	–	65	100	160	205	205
15 to 50	150	60	60	75	115	150	150	150
	205	60	60	75	115	180	205	205

- 1) Maximum temperature range, see nameplate

Promass I

DN	T _{m, max range} [°C]	T _{a, max} [°C]	T _{m, max} [°C]					
			T6 [85 °C]	T5 [100 °C]	T4 [135 °C]	T3 [200 °C]	T2 [300 °C]	T1 [450 °C]
8, 15, 15FB, 25	150	60	60	95	130	150	150	150
25FB, 40, 40FB, 50, 50FB, 80			70	85	120	150	150	150
FB = Full bore								

Promass O

DN	T _{m, max range} [°C]	T _{a, max} [°C]	T _{m, max} [°C]					
			T6 [85 °C]	T5 [100 °C]	T4 [135 °C]	T3 [200 °C]	T2 [300 °C]	T1 [450 °C]
80 to 250	205	60	60	75	110	170	205	205

Promass P

DN	T _{m, max range} ¹⁾ [°C]	T _{a, max} [°C]	T _{m, max} [°C]					
			T6 [85 °C]	T5 [100 °C]	T4 [135 °C]	T3 [200 °C]	T2 [300 °C]	T1 [450 °C]
8	150	45	45	65	100	150	150	150
		60	–	65	100	150	150	150
	205	45	45	65	100	160	205	205
		60	–	65	100	160	205	205
15 to 40	150	50	50	75	115	150	150	150
		60	–	75	115	150	150	150
	205	50	50	75	115	180	205	205
		60	–	75	115	180	205	205
50	150	60	60	75	115	150	150	150
	205	60	60	75	115	180	205	205

1) Maximum temperature range, see nameplate

Promass Q

DN	T _{m, max range} ¹⁾ [°C]	T _{a, max} [°C]	T _{m, max} [°C]					
			T6 [85 °C]	T5 [100 °C]	T4 [135 °C]	T3 [200 °C]	T2 [300 °C]	T1 [450 °C]
25 to 250	205	60	55	75	110	160	205	205
	150 ²⁾	60	55	75	110	150	150	150

- 1) Maximum temperature range, see nameplate
- 2) Cryogenic temperature version: T_m = -196 to 150 °C

Promass S


DN	T _{m, max range} [°C]	T _{a, max} [°C]	T _{m, max} [°C]					
			T6 [85 °C]	T5 [100 °C]	T4 [135 °C]	T3 [200 °C]	T2 [300 °C]	T1 [450 °C]
8	150	45	45	65	100	150	150	150
		60	–	65	100	150	150	150
15 to 40	150	50	50	75	115	150	150	150
		60	–	75	115	150	150	150
50	150	60	60	75	115	150	150	150

Promass X

DN	T _{m, max range} [°C]	T _{a, max} [°C]	T _{m, max} [°C]					
			T6 [85 °C]	T5 [100 °C]	T4 [135 °C]	T3 [200 °C]	T2 [300 °C]	T1 [450 °C]
350	180	60	70	90	120	170	180	180

Maximum medium temperature for devices with thermal insulation
NOT in accordance with Endress+Hauser specifications

The specified reference temperature T_{ref} and the maximum medium temperature T_{m, max} for each temperature class must not be exceeded.
→  30

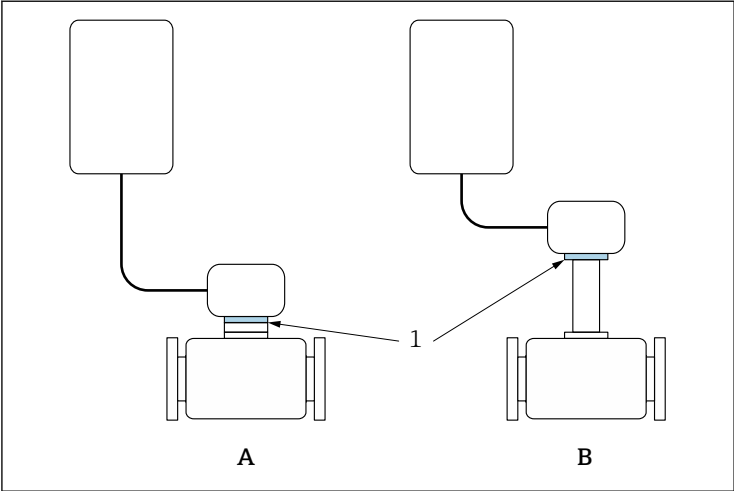

A0031199

2 Position of reference point for temperature measurement

- A Standard version
- B Extended temperature version, cryogenic temperature version, high-temperature version
- 1 Reference point (T_{ref})

Reference temperature T_{ref}

T6 [85 °C]	T5 [100 °C]	T4 [135 °C]	T3 [200 °C]	T2 [300 °C]	T1 [450 °C]
63	72	84	91	91	91

Connection
values: Signal
circuits

The following tables contain specifications which are dependent on the transmitter type and its input and output assignment. Compare the following specifications with those on the nameplate of the transmitter.

Terminal assignment

Transmitter: supply voltage, input/outputs

HART

Supply voltage		Input/output 1 (port 1)		Input/output 2		Input/output 3		Input/output 4 ¹⁾		Service interface (Port 2)
1 (+)	2 (-)	26 (+)	27 (-)	24 (+)	25 (-)	22 (+)	23 (-)	20 (+)	21 (-)	CDI-RJ45
Device-specific terminal assignment: adhesive label in terminal cover.										

1) Input/output only available for Proline 500 - digital.

FOUNDATION fieldbus

Supply voltage		Input/output 1 (port 1)		Input/output 2		Input/output 3		Input/output 4 ¹⁾		Service interface (Port 2)
1 (+)	2 (-)	26 (A)	27 (B)	24 (+)	25 (-)	22 (+)	23 (-)	20 (+)	21 (-)	CDI-RJ45
Device-specific terminal assignment: adhesive label in terminal cover.										

1) Input/output only available for Proline 500 - digital.

PROFIBUS DP

Supply voltage		Input/output 1 (port 1)		Input/output 2		Input/output 3		Input/output 4 ¹⁾		Service interface (Port 2)
1 (+)	2 (-)	26 (B)	27 (A)	24 (+)	25 (-)	22 (+)	23 (-)	20 (+)	21 (-)	CDI-RJ45
Device-specific terminal assignment: adhesive label in terminal cover.										

1) Input/output only available for Proline 500 - digital.

PROFIBUS PA

Supply voltage		Input/output 1 (port 1)		Input/output 2		Input/output 3		Input/output 4 ¹⁾		Service interface (Port 2)
1 (+)	2 (-)	26 (B)	27 (A)	24 (+)	25 (-)	22 (+)	23 (-)	20 (+)	21 (-)	CDI-RJ45
Device-specific terminal assignment: adhesive label in terminal cover.										

1) Input/output only available for Proline 500 - digital.

Modbus RS485

Supply voltage		Input/output 1 (port 1)		Input/output 2		Input/output 3		Input/output 4 ¹⁾		Service interface (Port 2)
1 (+)	2 (-)	26 (B)	27 (A)	24 (+)	25 (-)	22 (+)	23 (-)	20 (+)	21 (-)	CDI-RJ45
Device-specific terminal assignment: adhesive label in terminal cover.										

1) Input/output only available for Proline 500 - digital.

Modbus TCP

Supply voltage		Input/output 1 (Port 1 ¹⁾)		Input/output 2		Input/output 3		Input/output 4 ²⁾		Service interface (Port 2) ¹⁾
1 (+)	2 (-)	26 (+)	27 (-)	24 (+)	25 (-)	22 (+)	23 (-)	20 (+)	21 (-)	CDI-RJ45
Device-specific terminal assignment: adhesive label in terminal cover.										

- 1) For Modbus TCP communication, either port 1 OR port 2 can be used.
- 2) Input/output only available for Proline 500 - digital.

PROFINET

Supply voltage		Input/output 1 (Port 1) ¹⁾	Input/output 2		Input/output 3		Input/output 4 ²⁾		Service interface (Port 2) ¹⁾
1 (+)	2 (-)	RJ45	24 (+)	25 (-)	22 (+)	23 (-)	20 (+)	21 (-)	CDI-RJ45
Device-specific terminal assignment: adhesive label in terminal cover.									

- 1) Port can be used for communication or as a service interface (CDI-RJ45).
- 2) Input/output only available for Proline 500 - digital.

PROFINET over Ethernet-APL

Supply voltage		Input/output 1 (Port 1)		Input/output 2		Input/output 3		Input/output 4 ¹⁾		Service interface (Port 2 ²⁾)
1 (+)	2 (-)	26 (+)	27 (-)	24 (+)	25 (-)	22 (+)	23 (-)	20 (+)	21 (-)	CDI-RJ45
Device-specific terminal assignment: adhesive label in terminal cover.										

1) Input/output only available for Proline 500 - digital.

2) No PROFINET communication available on port 2

Ethernet/IP

Supply voltage		Input/output 1 (Port 1) ¹⁾	Input/output 2		Input/output 3		Input/output 4 ²⁾		Service interface (Port 2) ¹⁾
1 (+)	2 (-)	RJ45	24 (+)	25 (-)	22 (+)	23 (-)	20 (+)	21 (-)	CDI-RJ45
Device-specific terminal assignment: adhesive label in terminal cover.									

1) Port can be used for communication or as a service interface (CDI-RJ45).

2) Input/output only available for Proline 500 - digital.

Safety-related values

Order code for "Output; input 1"	Output type	Safety-related values	
		Output; input 1 (Port 1)	Service interface (Port 2)
Option BA	Current output 4-20 mA HART	$U_N = 30 V_{DC}$ $U_M = 250 V_{AC}$	$U_N = 3.3 V_{AC}$ $U_M = 250 V_{AC}$
Option GA	PROFIBUS PA	$U_N = 32 V_{DC}$ $U_M = 250 V_{AC}$	$U_N = 3.3 V_{AC}$ $U_M = 250 V_{AC}$
Option LA	PROFIBUS DP	$U_N = 5 V$ $U_M = 250 V_{AC}$	$U_N = 3.3 V_{AC}$ $U_M = 250 V_{AC}$
Option MA	Modbus RS485	$U_N = 5 V$ $U_M = 250 V_{AC}$	$U_N = 3.3 V_{AC}$ $U_M = 250 V_{AC}$
Option MB	Modbus TCP over Ethernet- APL 10 Mbit/s, SPE 10 Mbit/s, Ethernet 100 Mbit/s	APL port profile SLAX SPE PoDL classes 10, 11, 12 $U_N = 30 V_{DC}$ $U_M = 250 V_{AC}$	$U_N = 3.3 V_{AC}$ $U_M = 250 V_{AC}$
Option NA	EtherNet/IP	$U_N = 3.3 V_{AC}$ $U_M = 250 V_{AC}$	$U_N = 3.3 V_{AC}$ $U_M = 250 V_{AC}$
Option RA	PROFINET	$U_N = 3.3 V_{AC}$ $U_M = 250 V_{AC}$	$U_N = 3.3 V_{AC}$ $U_M = 250 V_{AC}$

Order code for "Output; input 1"	Output type	Safety-related values	
		Output; input 1 (Port 1)	Service interface (Port 2)
Option RB	PROFINET over Ethernet- APL/SPE, 10Mbit/s	APL port profile SLAX SPE PoDL classes 10, 11, 12 $U_N = 30\text{ V}_{DC}$ $U_M = 250\text{ V}_{AC}$	$U_N = 3.3\text{ V}_{AC}$ $U_M = 250\text{ V}_{AC}$
Option SA	FOUNDATION Fieldbus	$U_N = 32\text{ V}_{DC}$ $U_M = 250\text{ V}_{AC}$	$U_N = 3.3\text{ V}_{AC}$ $U_M = 250\text{ V}_{AC}$

Order code for "Output; input 2" "Output; input 3" "Output; input 4"	Output type	Safety-related values		
		Output; input 2	Output; input 3	Output; input 4
Option B	Current output 4-20 mA	$U_N = 30\text{ V}_{DC}$ $U_M = 250\text{ V}_{AC}$		
Option D	Configurable I/O initial setting off	$U_N = 30\text{ V}_{DC}$ $U_M = 250\text{ V}_{AC}$		
Option E	Pulse/frequency/switch output	$U_N = 30\text{ V}_{DC}$ $U_M = 250\text{ V}_{AC}$		
Option F	Double pulse output	$U_N = 30\text{ V}_{DC}$ $U_M = 250\text{ V}_{AC}$		
Option H	Relay output	$U_N = 30\text{ V}_{DC}$ $I_N = 100\text{ mA}_{DC}/500\text{ mA}_{AC}$ $U_M = 250\text{ V}_{AC}$		
Option I	Current input 4-20 mA	$U_N = 30\text{ V}_{DC}$ $U_M = 250\text{ V}_{AC}$		
Option J	Status input	$U_N = 30\text{ V}_{DC}$ $U_M = 250\text{ V}_{AC}$		

Intrinsically safe values

Order code for "Output; input 1"	Output type	Intrinsically safe values	
		Output; input 1 (Port 1)	Service interface (Port 2)
Option CA	Current output 4-20mA HART Ex-i passive	Ex ia ¹⁾ $U_i = 30 \text{ V}$ $I_i = 100 \text{ mA}$ $P_i = 1.25 \text{ W}$ $L_i = 0 \text{ } \mu\text{H}$ $C_i = 6 \text{ nF}$	Ex ia ¹⁾ $U_i = 10 \text{ V}$ $I_i = \text{n. a.}$ $P_i = \text{n. a.}$ $L_i = 0 \text{ } \mu\text{H}$ $C_i = 200 \text{ nF}$
		Ex ic (NIFW) ²⁾ $U_i = 30 \text{ V}$ $I_i = 100 \text{ mA}$ $P_i = 1.25 \text{ W}$ $L_i = 0 \text{ } \mu\text{H}$ $C_i = 6 \text{ nF}$	Non-intrinsically safe ³⁾
Option CC	Current output 4-20mA HART Ex-i active	Ex ia ¹⁾ $U_0 = 21.8 \text{ V}$ $I_0 = 90 \text{ mA}$ $P_0 = 491 \text{ mW}$ $L_0 = 4.1 \text{ mH(IIC)}/15 \text{ mH(IIB)}$ $C_0 = 160 \text{ nF(IIC)}/1 160 \text{ nF(IIB)}$ $U_i = 30 \text{ V}$ $I_i = 10 \text{ mA}$ $P_i = 0.3 \text{ W}$ $L_i = 5 \text{ } \mu\text{H}$ $C_i = 6 \text{ nF}$	Ex ia ¹⁾ $U_i = 10 \text{ V}$ $I_i = \text{n. a.}$ $P_i = \text{n. a.}$ $L_i = 0 \text{ } \mu\text{H}$ $C_i = 200 \text{ nF}$
		Ex ic (NIFW) ²⁾ $U_0 = 21.8 \text{ V}$ $I_0 = 90 \text{ mA}$ $P_i = 491 \text{ mW}$ $L_0 = 9 \text{ mH(IIC)}/39 \text{ mH(IIB)}$ $C_0 = 600 \text{ nF(IIC)}/4 000 \text{ nF(IIB)}$ $U_i = 30 \text{ V}$ $I_i = 10 \text{ mA}$ $P_i = 0.3 \text{ W}$ $L_i = 5 \text{ } \mu\text{H}$ $C_i = 6 \text{ nF}$	Non-intrinsically safe ³⁾

Order code for "Output; input 1"	Output type	Intrinsically safe values	
		Output; input 1 (Port 1)	Service interface (Port 2)
Option HA	PROFIBUS PA Ex i (STANDARD + FISCO)	Ex ia ¹⁾ U _i = 30 V I _i = 570 mA P _i = 8.5 W L _i = 10 µH C _i = 5 nF	Ex ia ¹⁾ U _i = 10 V I _i = n. a. P _i = n. a. L _i = 0 µH C _i = 200 nF
		Ex ic (NIFW) ²⁾ U _i = 32 V I _i = 570 mA P _i = 8.5 W L _i = 10 µH C _i = 5 nF	Non-intrinsically safe ³⁾

Order code for "Output; input 1"	Output type	Intrinsically safe values	
		Output; input 1 (Port 1)	Service interface (Port 2)
Option MC	Modbus TCP over Ethernet-APL, Ex-i, 10Mbit/s	2-WISE power load, APL port profile SLAA ⁴⁾ Ex ia ¹⁾ $U_i = 17.5 \text{ V}$ $I_i = 380 \text{ mA}$ $P_i = 5.32 \text{ W}$ $L_i = 10 \text{ } \mu\text{H}$ $C_i = 5 \text{ nF}$ Cable specifications according to 2-WISE: $R_c = 15 \text{ to } 150 \text{ } \Omega/\text{km}$ $L_c = 0.4 \text{ to } 1 \text{ mH/km}$ $C_c = 45 \text{ to } 200 \text{ nF/km}$ $C_c = C_c \text{ line/line} + 0.5 C_c \text{ line/screen}$, if both lines are floating, or $C_c = C_c \text{ line/line} + C_c \text{ line/screen}$, if the screen is connected to one line Length of cable (not including cable stubs): $\leq 200 \text{ m (656.2 ft)}$ Length of cable stubs: $\leq 1 \text{ m (3.3 ft)}$	Ex ia ¹⁾ $U_i = 10 \text{ V}$ $I_i = \text{n. a.}$ $P_i = \text{n. a.}$ $L_i = 0 \text{ } \mu\text{H}$ $C_i = 200 \text{ nF}$
		2-WISE power load, APL port profile SLAC ⁴⁾ Ex ic (NIFW) ²⁾ $U_i = 17.5 \text{ V}$ $I_i = 380 \text{ mA}$ $P_i = 5.32 \text{ W}$ $L_i = 10 \text{ } \mu\text{H}$ $C_i = 5 \text{ nF}$ Cable specifications according to 2-WISE: $R_c = 15 \text{ to } 150 \text{ } \Omega/\text{km}$ $L_c = 0.4 \text{ to } 1 \text{ mH/km}$ $C_c = 45 \text{ to } 200 \text{ nF/km}$ $C_c = C_c \text{ line/line} + 0.5 C_c \text{ line/screen}$, if both lines are floating, or $C_c = C_c \text{ line/line} + C_c \text{ line/screen}$, if the screen is connected to one line Length of cable (not including cable stubs): $\leq 200 \text{ m (656.2 ft)}$ Length of cable stubs: $\leq 1 \text{ m (3.3 ft)}$	Non-intrinsically safe ³⁾

Order code for "Output; input 1"	Output type	Intrinsically safe values	
		Output; input 1 (Port 1)	Service interface (Port 2)
Option RC	PROFINET over Ethernet-APL, Ex-i, 10Mbit/s	2-WISE power load, APL port profile SLAA ⁴⁾ Ex ia ¹⁾ $U_i = 17.5 \text{ V}$ $I_i = 380 \text{ mA}$ $P_i = 5.32 \text{ W}$ $L_i = 10 \text{ }\mu\text{H}$ $C_i = 5 \text{ nF}$ Cable specifications according to 2-WISE: $R_c = 15 \text{ to } 150 \text{ }\Omega/\text{km}$ $L_c = 0.4 \text{ to } 1 \text{ mH/km}$ $C_c = 45 \text{ to } 200 \text{ nF/km}$ $C_c = C_c \text{ line/line} + 0.5 C_c \text{ line/screen}$, if both lines are floating, or $C_c = C_c \text{ line/line} + C_c \text{ line/screen}$, if the screen is connected to one line Length of cable (not including cable stubs): $\leq 200 \text{ m (656.2 ft)}$ Length of cable stubs: $\leq 1 \text{ m (3.3 ft)}$	Ex ia ¹⁾ $U_i = 10 \text{ V}$ $I_i = \text{n. a.}$ $P_i = \text{n. a.}$ $L_i = 0 \text{ }\mu\text{H}$ $C_i = 200 \text{ nF}$
		2-WISE power load, APL port profile SLAC ⁴⁾ Ex ic (NIFW) ²⁾ $U_i = 17.5 \text{ V}$ $I_i = 380 \text{ mA}$ $P_i = 5.32 \text{ W}$ $L_i = 10 \text{ }\mu\text{H}$ $C_i = 5 \text{ nF}$ Cable specifications according to 2-WISE: $R_c = 15 \text{ to } 150 \text{ }\Omega/\text{km}$ $L_c = 0.4 \text{ to } 1 \text{ mH/km}$ $C_c = 45 \text{ to } 200 \text{ nF/km}$ $C_c = C_c \text{ line/line} + 0.5 C_c \text{ line/screen}$, if both lines are floating, or $C_c = C_c \text{ line/line} + C_c \text{ line/screen}$, if the screen is connected to one line Length of cable (not including cable stubs): $\leq 200 \text{ m (656.2 ft)}$ Length of cable stubs: $\leq 1 \text{ m (3.3 ft)}$	Non-intrinsically safe ³⁾

Order code for "Output; input 1"	Output type	Intrinsically safe values	
		Output; input 1 (Port 1)	Service interface (Port 2)
Option TA	FOUNDATION Fieldbus Ex i (STANDARD + FISCO)	Ex ia ¹⁾ U _i = 30 V I _i = 570 mA P _i = 8.5 W L _i = 10 µH C _i = 5 nF	Ex ia ¹⁾ U _i = 10 V I _i = n. a. P _i = n. a. L _i = 0 µH C _i = 200 nF
		Ex ic (NIFW) ²⁾ U _i = 32 V I _i = 570 mA P _i = 8.5 W L _i = 10 µH C _i = 5 nF	Non-intrinsically safe ³⁾

- 1) Only for the order code for "Approval", option CC, CD
 2) Only for the order code for "Approval", option CM, CN
 3) Connection to or operation with Service interface (Port 2) is not permitted in potentially explosive atmospheres.
 4) For further options see Ethernet-APL Installation Drawing HE_01622.

Order code for "Output; input 2" "Output; input 3" "Output; input 4"	Output type	Intrinsically safe values or NIFW values		
		Output; input 2	Output; input 3	Output; input 4
Option C	Current output 4-20mA Ex-i passive	Ex ia or Ex ic (NIFW) U _i = 30 V I _i = 100 mA P _i = 1.25 W L _i = 0 C _i = 0		
Option G	Pulse/frequency/switch output Ex-i passive	Ex ia or Ex ic (NIFW) U _i = 30 V I _i = 100 mA P _i = 1.25 W L _i = 0 C _i = 0		



71713420

www.addresses.endress.com
