

Safety Instructions

iTHERM MultiSens Bundle

TMS31

0Ex ia IIC T6...T1 Ga X

Ex ia IIIC T85°C...T450°C Da/Db X

0/1Ex ia IIC T6...T1 Ga/Gb X

0/1Ex ia/db IIC T6...T1 Ga/Gb X

Ex ia/tb IIIC T85°C...T450°C Da/Db X



iTHERM MultiSens Bundle TMS31

Table of contents

About this document 3

Associated documentation 3

Supplementary documentation 3

Certificates and declarations 3

Manufacturer address 3

Safety instructions 4

Safety instructions: General 4

Safety instructions: Installation in equipment of Group III 4

Safety instructions: Installation in equipment of Group III 5

Safety instructions: Partition wall 5

Intrinsic safety 5

Safety instructions: Zone0/Zone20 6

Potential equalization 6

Safety instructions: Flameproof 6

Safety instructions: Specific conditions of use 7

Temperature tables 8

Electrical connection data 11

About this document

The document number of these Safety Instructions (XA) must match the information on the nameplate.

Associated documentation

All documentation is available on the Internet: www.endress.com/Deviceviewer (enter the serial number from the nameplate).



If not yet available, a translation into EU languages can be ordered.

To commission the device, please observe the Operating Instructions pertaining to the device: www.endress.com/<product code>, e.g. iTHERM TMS31

Supplementary documentation

Explosion protection brochure: CP00021Z

The Explosion-protection brochure is available:

- In the download area of the Endress+Hauser website:
www.endress.com -> Downloads -> Brochures and Catalogs -> Text Search: CP00021Z
- On the CD for devices with CD-based documentation

Certificates and declarations**EAC certificate**

The device meet the fundamental health and safety requirements for the design and construction of devices and protective systems intended for use in potentially explosive atmospheres.

- Certification body: ТОО/Ж ШС "Т-Стандарт"
- Certificate number: EA3C KZ 7500525.01.01.0193


Affixing the certificate number certifies conformity with the following standards:

- GOST 31610.0 : 2019
- GOST 31610.1 : 2013
- GOST 31610.11 : 2014
- GOST 31610.26 : 2016
- GOST 31610.31 : 2013

Manufacturer address

Endress+Hauser Wetzer GmbH + Co. KG
Obere Wank 1
87484 Nesselwang, Germany

Safety instructions

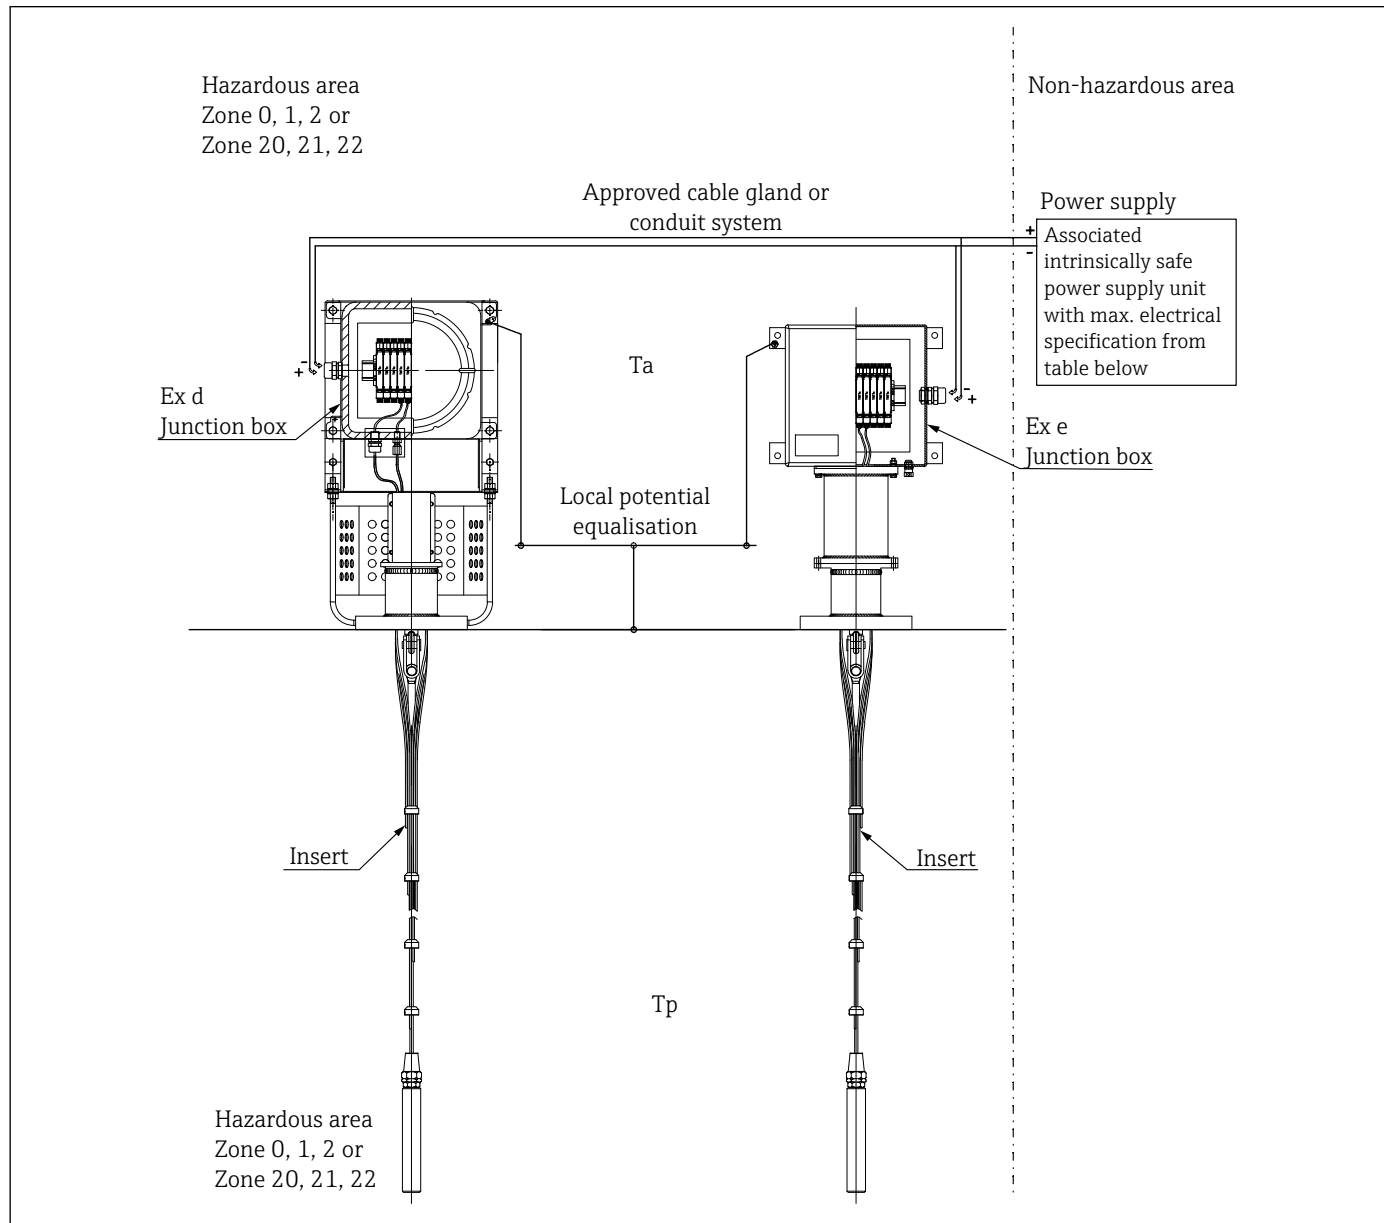

A0051280

Safety instructions: General

- Staff must meet the following conditions for mounting, electrical installation, commissioning and maintenance of the device:
 - Be suitably qualified for their role and the tasks they perform
 - Be trained in explosion protection
 - Be familiar with national regulations or guidelines (e.g. GOST IEC 60079-14)
- Install the device according to the manufacturer's instructions and national regulations.
- Do not operate the device outside the specified electrical, thermal and mechanical parameters.
- Only use the device in media to which the wetted materials have sufficient durability.
- The relationship between the permitted ambient temperature for the electronics housing, dependent on the range of application, and the temperature classes is shown in next tables.
- Alterations to the device can affect the explosion protection and must be carried out by staff authorized to perform such work by Endress+Hauser.

Safety instructions: Installation in equipment of Group III

- Refer to the enclosed Safety instructions of assembled Transmitters.
- Refer to the marked maximum ratings for assembled temperature transmitter's supply.

**Safety instructions:
Installation in equipment of
Group III**

- Install the sensor in thermometer/enclosure suitable for Group III in compliance with GOST 31610.11 (IEC 60079-11) and GOST 31610.0 (IEC 60079-0) and its ultimate application.
- The device must be installed and maintained so, that even in the event of rare incidents, an ignition source due to impact or friction between the enclosure and iron/steel is excluded.
- For ambient temperatures higher than +70 °C, use suitable heat-resisting cables or wires, cable entries and sealing facilities for Ta +5 K above surrounding.
- The degree of protection shall be at least equal to IP6X throughout the equipment.
- The cable gland (or other accessories) chosen as ingress into junction box shall be certified accordingly to relevant Standards GOST 31610.0 (IEC 60079-0) and GOST 31610.31 (IEC 60079-31).
- User must regularly clean enclosure external surface due to avoid formation and deposition of dust layers on the surface itself (the maximum allowed thickness of dust is equal to 5 mm).
- For dust 'Ex t' applications, the compression fittings installed on junction box connection thread must have PTFE or graphite sealing tape applied to maintain the approval stated.

Only for TMS31_010 = -G4:

⚠ WARNING

Explosive atmosphere

- In an explosive atmosphere, do not open the device when voltage is supplied (ensure that the IP6x housing protection is maintained during operation).

**Safety instructions: Partition
wall**

Install the equipment in a partition wall which is in compliance with GOST 31610.26 (IEC 60079-26) in reference to its ultimate application.

Only for TMS31_010 = -G4:

⚠ WARNING

Explosive atmosphere

- In an explosive atmosphere, do not open the device when voltage is supplied (ensure that the IP6x housing protection is maintained during operation).

Intrinsic safety

- Comply with the installation and safety instructions in the Operating Instructions.
- Install the device according to the manufacturer's instructions and any other valid standards and regulations (e.g. GOST IEC 60079-14).
- Observe the safety instructions for the used transmitters (if any).
- Observe the safety instructions for the other used equipment.
- The device must be connected to the local potential equalization.
- Connect the device using suitable cable and wire entries of protection type "Intrinsic safety (Ex i)".
- For sensor elements an intrinsically safe supply with galvanic isolation must be used.
- When iTHERM TMS31_010 = -GA, -GJ, -G4, associated apparatus with galvanic isolation between the intrinsically safe and non-intrinsically safe circuits shall be preferred.
- The type of protection changes as follows when the devices are connected to certified intrinsically safe circuits of Category Ex ib for Equipment Groups IIC and IIB: Ex ib IIC T6 or Ex ib IIB T6.
- Continuous duty temperature of the cable Ta +5 K.
- To maintain the ingress protection of the enclosure IP66: Install the enclosure cover, cable glands and blind plugs correctly.
- Close unused entry glands with sealing plugs.
- The pertinent guidelines must be observed when intrinsically safe circuits are connected together acc. GOST IEC 60079-14 (Proof of Intrinsic Safety).
- The type of protection changes as follows when the devices are connected to certified intrinsically safe circuits of Category ib: Ex ib IIC. When connecting to an intrinsically safe ib circuit, do not operate the sensor at Zone 0 without any mechanical protection (e.g. thermowell) according to GOST 31610.26 (IEC 60079-26).
- When connecting multiple sensors make sure that the potential equalizations are at the same local potential equalization.
- Pay attention to the maximum process conditions according to the manufacturer's operating Instructions.
- Respect the maximum ambient temperature permitted in base of used junction box, temperature transmitters and its number.
- Install the device to exclude any mechanical damage or friction. The device Connection Head enclosures, when made in Aluminum light alloy, shall be mounted in a way to avoid an ignition hazard due to impact or friction. Pay particular attention to flow conditions and tank fittings.

**Safety instructions: Zone0/
Zone20**

- The aluminum housing must **not** be installed in Zone 0(Ga)/Zone 20(Da), only the sensors or an optional mechanical protection (e.g. a thermowell) are allowed to extend through Zone 0(Ga)/Zone 20(Da) as shown in the scheme on page 4
- The iTHERM TMS31_010 = -GA can be installed completely in Zone 0(Ga)/Zone 20(Da). Only Stainless Steel Junction box shall be used.
- Associated devices with galvanic isolation between the intrinsically safe and non-intrinsically safe circuits are preferred.

Potential equalization

The device must be connected to the local potential equalization.

**Safety instructions:
Flameproof**

- Only certified cable glands (or other accessories) in accordance to GOST 31610.0 (IEC 60079-0) and GOST 31610.1 (IEC 60079-1) shall be used. Cable entry system shall be in compliance with clause 10 of GOST IEC 60079-14 and/or other Local Regulations and Laws
- User's cable entries always assure at least 5 engaged threads.
- The thread of cover must be always sprinkled by silicone grease (LOCTITE_8104 or LOXEAL_GS9) or copper paste or similar.
- The ground terminal board in and out is preview for the conductor which must be placed between the anti-rotation washer and the flat washer. If the connection is made by means of lug, this must be with an anti-rotation pin, or must be provide on fitting to avoid the rotation of the cable.
- Any unused holes in the enclosure must be closed with conical or cylindrical plugs in such way that anti-explosion seal characteristics of the enclosure are preserved. These plugs must only be removed with special tools.
- Degree of protection IP66 is guaranteed only if the cover is provided with an appropriate O-ring gasket; after each opening integrity of such gasket shall be verified.
- Any damaged parts may **only** be replaced or repaired by the manufacturer, unless of express authorization of itself. It is forbidden to machine further the junction box.
- As a general rule, whichever operations and maintenance on the electrical or mechanical parts or on the system, must be preceded from the interruption of the electrical supply system.

Ex d Compression Fitting - Junction box side

- When assembling the compression fitting, tighten the nut by hand and ensure that the nut is in the finger-tight position and mark/scribe it for a visual reference.
- Tight the nut to the required setting using the following table:

Insert Diameter	Torque settings (No. of turns past finger-tight)
≤ 4.5 mm	1 full turn
4.76 to 9.53 mm	3/4 turn

This equipment is not re-usable or repairable. Once installed it must be replaced if any damage is observed.

Version with Field Housing Transmitters Devices

When iTHERM TMS31 is fitted with Field Housing Transmitters (i.e. iTEMP TMT142B, iTEMP TMT162 - for iTHERM TMS31_510=-BA, -BB, -BC, -BD, -BG) the ambient temperature and temperature class is given by the following table:

Transmitter	EPL Gb			EPL Db		
	T6	T5	T4	T85 °C	T100 °C	T135 °C
iTEMP TMT162	-40 to +55 °C	-40 to +70 °C	-40 to +85 °C	-40 to +55 °C	-40 to +70 °C	-40 to +85 °C
iTEMP TMT142B	-50 to +55 °C	-50 to +70 °C	-50 to +85 °C	-40 to +55 °C	-40 to +70 °C	-40 to +85 °C

Electrical parameters in Chapter Electrical connection data:

Transmitter	Dissipated Power (W)
iTEMP TMT162	5.32 W
iTEMP TMT142B	1.00 W

This equipment is not re-usable or repairable. Once installed it must be replaced if any damage is observed.

Safety instructions: Specific conditions of use

- The device must be installed and maintained so, that even in the event of rare incidents, an ignition source due to impact or friction between the enclosure and iron/steel is excluded.
- When installing and commissioning the device, make sure that an electrostatic charge of the connection cable is avoided.
- As a rule of the thumb, the whole length of each thermoelement installed within the iTHERM TMS31 shall be limited to 200 m for single thermocouple, to 100 m for double and to 66.7 m for triple ones. For special applications (i.e. very long thermoelements), it shall always be verified the verification of total Capacitance and Inductance.
- When install the TMS31, all the accessories used (e.g. cable glands, etc.) shall be certified according to GOST 31610.0 (IEC 60079-0), GOST 31610.1 (IEC 60079-1), GOST 31610.31 (IEC 60079-31), providing a degree of protection at least equal to the junction box one. For the correct choice of the cable entry system, please refer to GOST IEC 60079-14 (latest revision) and/or to National Regulations and Laws.
- When iTHERM TMS31_010 = -GA,-GJ,-G4, associated apparatus with galvanic isolation between the intrinsically safe and non-intrinsically safe circuits are preferred.
- The separation between Zone 0/20 and Zone 1/21 shall be in compliance with requirements of GOST 31610.26 (IEC 60079-26).
- The iTHERM TMS31 shall be connected to the same local potential equalization in at least one point (alternatively through the junction box or at process connection). The user shall assess the functionality.
- The enclosure and/or terminal box shall be kept at a distance from the process flange sufficient to guarantee it is installed in an ambient temperature compliant with the temperature limits stated by the relevant certificate. The same should be evaluated concerning the position of the cold junctions.
- For the use of the enclosures in environments with explosive atmosphere for the combustible dust presence, the following precautions must be taken: to avoid the accumulation of dust on the surfaces, the user must proceed with a regular cleaning of the enclosures; the dust layer shall always less than 5 mm.
- The width of the flameproof joints is superior to those specified in tables of GOST 31610.1 (IEC 60079-1) standard.
- No battery is permitted within the device assemblies.
- The ambient temperature Ta shall not exceed the values given in tables into safety instructions.
- The Ambient Temperature range of the device, may vary depending on the number and the type of the transmitters mounted inside to the Connection Head. For a safe use of the products, the Safety Instructions shall be followed precisely.
- When Eye Bolt (iTHERM TMS31_020=-AA) and Roof Bracket (iTHERM TMS31_020=-AB) process connection is used refer to following table for the maximum temperature of TMS31, temperature class/maximum surface temperature of iTHERM TMS31 and maximum process temperature shall be limited to:

Ambient temperature	Temperature class	Maximum surface temperature	Process temperature
-20 to +40 °C	T6	T85 °C	85 °C

Temperature tables

The dependency of *PROCESS* temperatures upon the temperature class for device for RTD sensors:

Insert Diameter	Temperature class/ Maximum surface temperature	Maximum allowed process temperature (sensor) Tp (process)	
		Pi≤50 mW	Pi≤100 mW
1.5 mm 3.0 mm 6.0 mm	T1/T450 °C	426 °C	415 °C
	T2/T300 °C	276 °C	265 °C
	T3/T200 °C	181 °C	170 °C
	T4/T135 °C	116 °C	105 °C
	T5/T100 °C	81 °C	70 °C
	T6/T85 °C	66 °C	55 °C

For TC sensors:

Insert Diameter	Temperature class/ Maximum surface temperature	Maximum allowed process temperature (sensor) Tp (process)
0.5 mm	T1/T450 °C	440 °C
0.8 mm	T2/T300 °C	290 °C
1 mm	T3/T200 °C	195 °C
2 mm	T4/T135 °C	130 °C
3 mm	T5/T100 °C	95 °C
4.5 mm	T6/T85 °C	80 °C
4.8 mm		
6 mm		

Ambient temperature:

Minimum ambient temperature is $T_a \geq -55\text{ °C}$ (depending on enclosure)

Maximum ambient temperature depends on product configuration:

- The type of enclosure selected
- The type and the number of mounted transmitters as summarized in the following tables:

[illegible]

[illegible]

Electrical connection data

Associated intrinsically safe power supply unit with maximum electrical specifications below the characteristic values of the assembled transmitter:

Transmitter	Power supply			Sensor circuit		
	U_i	I_i	P_i	U_o	I_o	P_o
iTEMP TMT71/ TMT72 ¹⁾	30 V	100 mA	800 mW/700 mW	4.3 V	4.8 mA	5.2 mW
iTEMP TMT82 ¹⁾	30 V	130 mA	800 mW/770 mW	7.6 V/9 V	13 mA	24.7 mW/29.3 mW
iTEMP TMT84/ TMT85 ²⁾	17.5 V/24 V	380 mA/250 mA	2 187 mW	7.2 V	25.9 mA	46.7 mW
iTEMP TMT142B	30 V	300 mA	1 000 mW	7.6 V	13 mA	24.7 mW
iTEMP TMT162 ^{3) 4) 5)}	17.5 V/24 V	500 mA/250 mA	5 320 mW/1 200 mW	7.6 V/8.6 V	29.3 mA/ 26.9 mA	55.6 mW/57.6 mW

- 1) Values on left: Head transmitter version / Values on right: DIN version
 2) Values on left: 17.5 V version / Values on right: 24 V version
 3) For sensor circuit: Values on left: Transmitters 4-20 mA / Values on right: Transmitters with Fieldbus connection
 4) For power supply: Values on left: for FISCO / Values on right: LS.circuit
 5) Not available for RTD

Supply circuit: in type of protection intrinsic safety Ex ia IIC and Ex ia IIIC, for connection to a certified intrinsically safe circuit with following maximum values for each intrinsic safe circuits (For P_i (RTD): For iTHERM TMS31_510=-BA, -BB, -BC, -BD, -BG, refer to column $P_i \leq 100$ mW for RTD inserts.):

U_i	9.8 V
I_i	30 mA
P_i (RTD)	50 mW
P_i (TC)	60 mW

Certified Inserts:

Insert	Single/Double	$C_{i_nom,n}$	$L_{i_nom,n}$
iTHERM TS111	Single	15.1 nF	75.3 μ H
	Double	15.1 nF	75.3 μ H
TPx100	Single	15.0 nF	75.1 μ H
	Double	15.0 nF	75.1 μ H
TSx310 ¹⁾	Single	15.0 nF	75.1 μ H
	Double	15.0 nF	75.1 μ H

- 1) An additional length of 20 m for the extension cables have been considered.



Where **n** indicates the intrinsic safe input circuits (from 2 up to 40).

Simple apparatus (only for TC's):

Sensor type	Extension Cable		Sensor	
Single	200 pF/m	1 μ H/m	200 pF/m	1 μ H/m
Double	400 pF/m	2 μ H/m	400 pF/m	2 μ H/m
Triple	600 pF/m	3 μ H/m	600 pF/m	3 μ H/m

Determination of total inner capacitances C_i and inductances L_i for sensors:

- $C_i = C_{i \text{ Sensor X L Sensor}} + C_{i \text{ Extension Cable X L Extension Cable}}, C_i \leq 15.5 \text{ nF}$
- $L_i = L_{i \text{ Sensor X L Sensor}} + L_{i \text{ Extension Cable X L Extension Cable}}, L_i \leq 75.5 \mu\text{H}$

Type of protection (EAC)	Type	Assembled Transmitters
OEx ia IIC T6...T1 Ga X	iTHERM TMS31_010 = GA	iTEMP TMT8x iTEMP TMT7x iTEMP TMT162 iTEMP TMT142B
Ex ia IIIC T85°C...T450°C Da/Db X		
O/1Ex ia IIC T6...T1 Ga/Gb X	iTHERM TMS31_010 = Gj	
Ex ia IIIC T85°C...T450°C Da/Db X		
O/1Ex ia/db IIC T6...T1 Ga/Gb X	iTHERM TMS31_010 = G4	
Ex ia/tb IIIC T85°C...T450°C Da/Db X		



71706792

www.addresses.endress.com
