

Operating Instructions

ControlCare Application Designer

MODBUS Tutorial

MODBUS

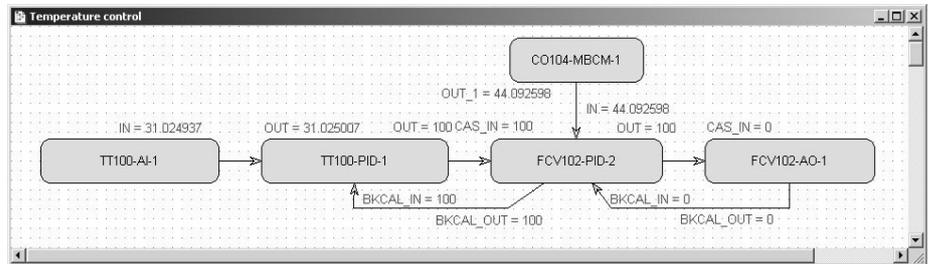
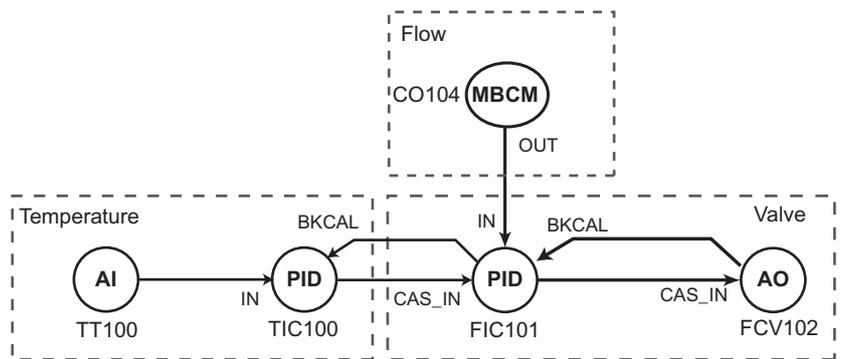


Table of Contents

Revision History	2	3.10 Connect to the Field Controller	37
Product Version	2	3.10.1 Change the IP address of your computer ..	37
Registered Trademarks	2	3.10.2 Set the Field Controller IP address	38
1 Safety	3	3.11 Go online	41
1.1 Designated use	3	3.11.1 Create the HSE live list	41
1.2 Installation, commissioning and operation	3	3.11.2 Assign the HSE Device IDs	42
1.3 Operational safety	3	3.11.3 Create the FOUNDATION Fieldbus live list	42
1.4 Conventions and icons	4	3.11.4 Assign the Fieldbus Device IDs	43
1.5 ControlCare documents	5	3.11.5 Assign the Device Tags	44
2 Modbus	6	3.11.6 Download the project	45
2.1 Description	6	3.12 Make the Modbus Connection	46
2.2 Using Modbus with ControlCare	7	3.12.1 Start the Modbus	46
2.2.1 Use as Modbus master	7	3.12.2 Check the control strategy	47
2.2.2 Use as a Modbus slave	8	3.13 Modify the project	48
3 FieldController as Modbus Master ...	9	3.13.1 On-line characterization	48
3.1 Task Description	9	3.13.2 Off Line characterization	49
3.1.1 Application	9	3.14 Export the configuration	50
3.1.2 Network	10	3.14.1 File data source folder	50
3.1.3 Installation and commissioning	10	3.14.2 Machine data source folder	51
3.1.4 Device ID and tag	11	3.14.3 XML file	52
3.2 Create a project	12	3.15 Close Application Designer	53
3.3 Determine the naming preferences	13	3.15.1 Reconnecting	53
3.4 Create a fieldbus network	14	4 Field Controller as Modbus Slave ...	54
3.4.1 Add the controller	14	4.1 Task Description	54
3.4.2 Add a fieldbus segment	15	4.2 Create a project	57
3.4.3 Add the Modbus function blocks	16	4.3 Configure the devices	58
3.4.4 Add the FF field devices	17	4.4 Create the Control Strategy	62
3.5 Configure the devices	18	4.5 Configure the strategy	65
3.5.1 MBCF Modbus Configuration block	18	4.6 Connect to the Field Controller	67
3.5.2 MBCM Modbus Control Master block	19	4.7 Go online	69
3.5.3 TMT165 transducer block	21	4.8 Make the Modbus connection	72
3.5.4 Metso ND9103FN positioner	22	5 Trouble-Shooting	75
3.6 Create the Control Strategy	23	5.1 Factory initialisation and reset	75
3.6.1 Add a Process Cell	23	5.2 Field Controller	76
3.6.2 Add a Control Module	24	5.3 Modbus	77
3.6.3 Create the function blocks	25	6 Function Block Descriptions	78
3.6.4 Add the Function Block Links	27	6.1 MBCF Modbus Configuration Block	78
3.7 Configure the strategy	29	6.2 MBCM Modbus Control Master Block	80
3.7.1 Analog Input parameters	29	6.2.1 Block description	80
3.7.2 Configuring the Analog Input blocks	30	6.2.2 MBCM parameters	81
3.7.3 Basic PID parameters	31	6.3 MBCS Modbus Control Slave Block	83
3.7.4 Configure the PID blocks	32	6.3.1 Block description	83
3.7.5 Analog Output parameters	33	6.3.2 MBCS parameters	84
3.7.6 Configuring the Analog Output block	33	LOCAL_MOD_MAP	86
3.7.7 Store the strategy as a template	34	Index	88
3.8 Assign the Function Blocks to the Devices	35		
3.9 Export tags	36		

Revision History

Product version	Manual	Changes	Remarks
2.01.xx	BA037S/04/en/08.05	Original manual	
2.02.xx	BA037S/04/en/07.06	Product	<ul style="list-style-type: none"> ■ FB schedule configured by drag&drop (Chap.3.8 and 4.5.2) ■ Incremental download (Chap. 3.11.6 and 4.7.6)
		Editorial	<ul style="list-style-type: none"> ■ Update version and documentation tables

Product Version

The table below indicates the product versions of the main components of ControlCare Field-based Control System. More details on the individual components can be seen in About ControlCare

Product Version	Component	Version
V2.02.xx	ControlCare Application Designer Suite	Version 2.02.xx
	ControlCare PROFIBUS Configurator	Version 2.9xx
	ControlCare Field Control (OPC) Server	Version 3.11.xx
	ControlCare Device Libraries*	Version 2.02.xx
	ControlCare Manuals	Version 2.02.xx
*Version No. may increase independent of Product Version as the latest devices are added to the library		

Registered Trademarks

FOUNDATION Fieldbus®

Registered trademark of the FOUNDATION Fieldbus User Organisation, Karlsruhe Germany.

FOUNDATION™ Fieldbus

Trademark of the Fieldbus Foundation, Austin, TX 78759, USA

Microsoft®, Windows®, Windows 2000®, Windows XP®, Windows 2003 Server® and the Microsoft logo are registered trademarks of the Microsoft Corporation.

Acrobat Reader® is a registered trade mark of the Adobe Systems Incorporated.

All other brand and product names are trademarks or registered trademarks of the companies and organisations in question

1 Safety

1.1 Designated use

ControlCare is a field-based control system comprising hardware and software modules. It can be used to visualize, monitor and control production processes. The approved usage of the individual units used in the system can be taken from the corresponding parts of the operating instructions.

The software described in this particular manual allows Modbus devices connected to a SFC162 FOUNDATION Fieldbus or SFC173 PROFIBUS Field Controller to be engineered, configured and commissioned. In addition, appropriate control strategies can be built using the function blocks contained in the controller and connected devices.

1.2 Installation, commissioning and operation

ControlCare Field Controller modules have been designed to operate safely in accordance with current technical safety and EU directives. Essential to their use is the ControlCare Application Designer software, which allows control strategies to be created for both FOUNDATION Fieldbus and PROFIBUS applications. Field devices, links, junction boxes, cables and other hardware comprising the Fieldbus system must also be designed to operate safely in accordance with current technical safety and EU directives.

If devices are installed incorrectly or used for applications for which they are not intended, or if the controller is not configured correctly, it is possible that dangers may arise. For this reason, the system must be installed, connected, configured, operated and maintained according to the instructions in this and the associated manuals: personnel must be authorised and suitably qualified.

1.3 Operational safety

Location

Field Controllers must be mounted in a permanent and weather-protected location in a safe area. The environment shall be a metal cabinet or an installation frame with a well grounded mounting plane. The environment shall be protected.

Hazardous areas

The controller must be connected to networks operating in explosion hazardous areas via barriers or other safety components. When installing components in explosion hazardous areas:

- Ensure that all installation and maintenance personnel are suitably qualified
- Check that all equipment has the appropriate safety certificates
- Observe the specifications in the device certificates as well as national and local regulations.

This topic is discussed in BA013S (FOUNDATION Fieldbus Guidelines) and BA034S (PROFIBUS Guidelines).

EMC

All modules are suitable for industrial use and conform with the following standard, see Appendix:

- EN 61326: 1997/A1: 1998
Interference emission: Class A apparatus
Interference immunity: as per Annex A, industrial environment

Depending upon the environment in which the bus is operating, particular attention should be paid to the grounding of the bus cables. This topic is discussed in BA013S (FOUNDATION Fieldbus Guidelines) and BA034S (PROFIBUS Guidelines).

IP Address

Field Controller is normally configured from a workstation connected into the control system backbone. You will require a unique IP address to set it up.

**Warning**

The use of IP addresses is strictly controlled. Usually your system administrator will be authorised to allocate unique addresses. Assigning an unauthorised address to a Field Controller may result in conflicts within your system and the failure of the associated devices!

Since the system can be accessed and manipulated through the various Field Controller tools, it is advisable to control access both to the workstation and the folders in which the configuration is stored. Always make a back-up of the project.

Technical improvement

Endress+Hauser reserves the right to make technical improvements to its software and equipment at any time and without prior notification. Where such improvements have no effect on the operation of the equipment, they are not documented. If the improvements effect operation, a new version of the operating instructions is normally issued.

1.4 Conventions and icons

In order to highlight safety relevant or alternative operating procedures in the manual, the following conventions have been used, each indicated by a corresponding icon in the margin.

Safety conventions

Icon	Meaning
	A note highlights actions or procedures which, if not performed correctly, may indirectly affect operation or may lead to an instrument response which is not planned
	Caution! Caution highlights actions or procedures which, if not performed correctly, may lead to personal injury or incorrect functioning of the instrument
	Warning! A warning highlights actions or procedures which, if not performed correctly, will lead to personal injury, a safety hazard or destruction of the instrument

1.5 ControlCare documents

Table 1.1 indicates the documents, planned and realized, containing safety relevant information, installation, commissioning and operating instructions for the equipment and software associated with Field Controller.

All documentation available at the time of release is included on the ControlCare CD-ROM and is installed in **Start=>Programs=>Endress+Hauser=ControlCare=Manuals** during set-up.

Component	Description	Document type	Designation	Order No.
System	ControlCare System Overview	Operating manual	BA016S/04/en	56004883
	ControlCare System Design	Operating manual	BA039S/04/en	Planned
	ControlCare System Specifications	Operating manual	BA040S/04/en	56004888
Software	Application Designer Overview	Operating manual	BA017S/04/en	70104301
	Application Designer Drawing Tool	Operating manual	BA032S/04/en	Planned
	Application Designer: FF Tutorial	Operating manual	BA019S/04/en	70101151
	Application Designer: PROFIBUS Tutorial	Operating manual	BA036S/04/en	70101152
	Application Designer: MODBUS Tutorial	Operating manual	BA037S/04/en	70101153
	Application Designer: IEC 61131 Tutorial	Operating manual	BA038S/04/en	70101386
	Field Control HSE & IEC OPC Server	Operating manual	BA018S/04/en	71031428
Field Controller	Hardware Installation Guide	Operating manual	BA021S/04/en	56004885
	Commissioning and Configuration	Operating manual	BA035S/04/en	56004887
Function Blocks	Function Block Manual	Operating manual	BA022S/04/en	56004886
Set-Up	Getting Started	Operating manual	BA020S/04/en	56004884
General	FOUNDATION Fieldbus Guidelines	Operating manual	BA013S/04/en	70100707
	PROFIBUS Guidelines	Operating manual	BA034S/04/en	56004242

Tab. 1-1: ControlCare Documentation

2 Modbus

This tutorial describes all steps necessary for integrating Modbus values into a SFC162 or SFC173 Field Controller. It does not aim to give an exhaustive account of the associated Application Designer functions, but rather shows you one of a number of methods to reach your goal. It is assumed that the user is familiar with the programming of Modbus masters and slaves.

The tags and names used in the tutorial are imaginary and will be different in a proper application. A full description of Application Designer functions is to be found in Application Designer Overview BA017S/04/en and Drawing Tool BA032S/04/en. Function block descriptions are to be found in BA022S/04/en, Function Block manual.

2.1 Description

MODBUS is a quasi-industrial standard developed some years ago by Gould-Modicon and provides a messaging service that may run on a variety of physical layers. For the SFC162 and SFC173 Field Controllers, there are two possibilities for integrating Modbus:

- MODBUS RTU can be connected point-to-point to the RS-232C input on the front panel. If appropriate a RS-232C/RS-485 (or RS-232C/RS-422) interface is required for connection to the device.
- MODBUS TCP (also known as MODBUS TCP/IP) can be connected to the Ethernet connector on the front panel. This allows the exchange of data between the Field Controller and a PLC or Remote I/O.

The MODBUS protocol exchanges data in a master-slave relationship. Each slave has a unique address, and the data are identified by their location in the slave address register. Certain characteristics of the MODBUS protocol are fixed, such as the frame format, frame sequences, handling of communications errors, exception conditions and the functions performed. Other characteristics are user selectable; these include transmission medium, baudrate, character parity, number of stop bits, and transmission modes. The contents of the data carried by the protocol are also freely selectable, i.e. nothing is said about strings, integers, floating-point numbers etc.

The MODBUS protocol controls the query and response cycle between master and slave devices. Only the master can initiate a transaction. A query and response may involve only a single slave, or it may be in the form of a broadcast, in which case the slaves do not answer. The query is contained in a frame that includes the address of the intended receiver, what this slave is to do, data needed to perform the action, and a means of checking for errors. The slave checks if errors have occurred and performs the desired action. After the action is performed the slave builds the response and returns it to the master. The master can send another message to any slave as soon as it receives a valid response or after a user-selected time interval. This "time-out" period has to be selected on the master device and depends on the slave response time.

The data can be exchanged in two transmission modes: ASCII (American Standard Code for Information Interchange) and RTU (Remote Terminal Unit). The major differences between them are the type of error check performed on the message and the number of characters used. MODBUS offers several read, write and test functions, each identified by a code number. They are designed as control commands for sensors and actuators, e.g. coils, inputs, input registers, holding or output registers, diagnosis and test reports, programs, polling control and reset. For MODBUS TCP the serial frame is simply inserted into the Ethernet data frame. In addition, not all codes are implemented.

2.2 Using Modbus with ControlCare

When connected to a Modbus device, the ControlCare Field Controller SFC162 or SFC173 can be used as a master or slave, see Section 2.2.1 and 2.2.2. Application Designer has five function blocks that are used to configure the system, whereby up to 16 Master/Slave configuration blocks can be assigned to a Field Controller:

- MBCF (Modbus Configuration Block)
configures the Field Controller for Modbus operation
- MBSS (Modbus Supervision Slave)
allows the Field Controller to be used as a Modbus supervision slave, e.g. to a SCADA host
- MBSM (Modbus Supervision Master)
allows the Field Controller to operate as a Modbus supervision master, e.g. to a SCADA host
- MBCS (Modbus Control Slave)
allows the Field Controller to be operated as slave, allowing a Modbus controller access to the PROFIBUS or FOUNDATION Fieldbus, depending on controller type
- MBCM (Modbus Control Master)
allows the Field Controller to operate as a master and access Modbus slave data, e.g. from controller or device registers

This tutorial describes the use of a Field Controller as a Modbus Control Master or Slave. A description of the Modbus Supervisory Master and Modbus Supervisory Slave blocks is to be found in the Function Block Manual BA022S/047en.

2.2.1 Use as Modbus master

When used in master mode, the Field Controller can read data from and write data to the Modbus slaves. Fig 2-1 shows the possible network topology.

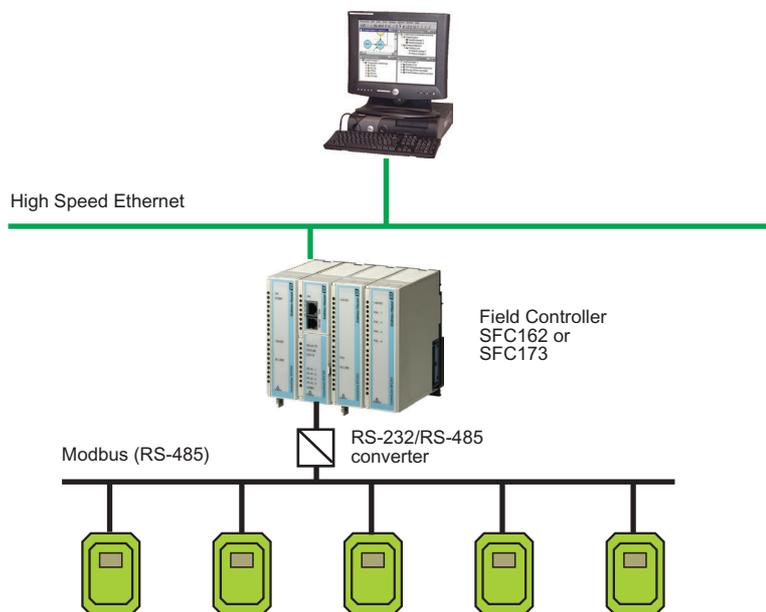


Fig. 2-1 Use of the Field Controller to access parameters on a Modbus line

The Field Controller uses the standard Modbus commands for read and write, making the slave data available for use in the control strategy or for display and trending in the operator workstation. The operator may also actuate slave devices and perform other supervisory functions. This type of application is described in Chapter 3.

2.2.2 Use as a Modbus slave

Most legacy systems such as DCS or PLC have serial interface modules that support Modbus. This may be used to supervise Fieldbus instruments through a slave Field Controller acting as a gateway as shown in Fig. 2-2. This allows the existing system to access some of the capabilities provided by Fieldbus devices.

Data in the Field Controller can be read or written by a master when the Field Controller operates in a slave mode. The data can be accessed in a binary format (Functions 1, 2, 5 and 15) or through registers (Functions 3, 4, 6 and 16). This application is described in Chapter 4.

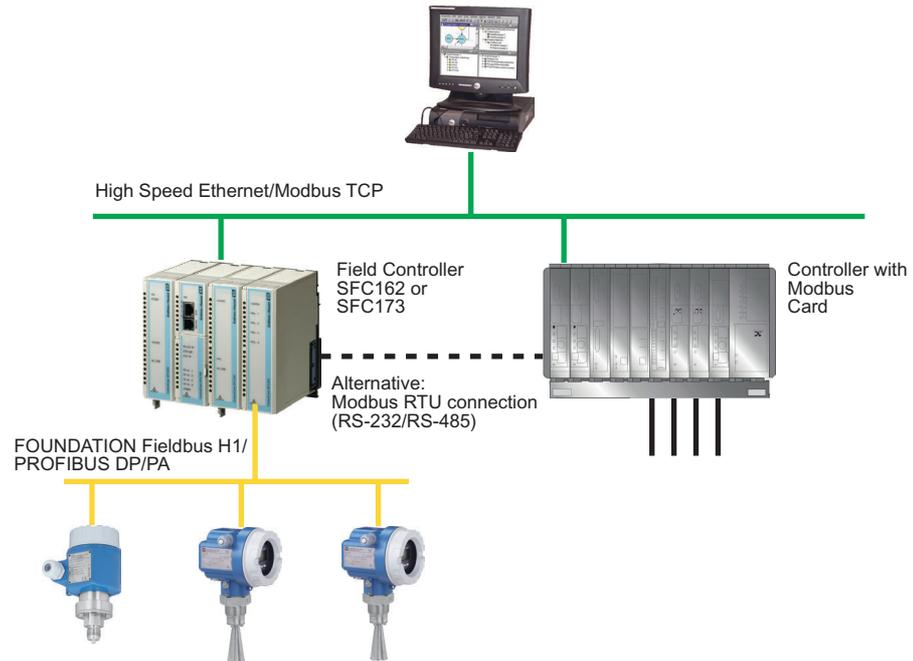


Fig. 2-2 Use of the Field Controller to allow legacy systems access to selected Fieldbus parameters

3 FieldController as Modbus Master

3.1 Task Description

This part of the tutorial describes all steps necessary for setting up the Field Controller as a Modbus Control Master. It does not aim to give an exhaustive account of Application Designer functions, but rather shows you one of a number of methods to reach your goal. The tags and names used in the tutorial are imaginary and will be different in a proper application. A full description of Application Designer functions is to be found in Application Designer Overview BA017S/04/en and Drawing Tool BA032S/04/en. Function block descriptions are to be found in BA022/04/en, Function Block manual.

3.1.1 Application

For this tutorial, the case of cascade control for a heat exchanger will be used, see Fig. 3-1.

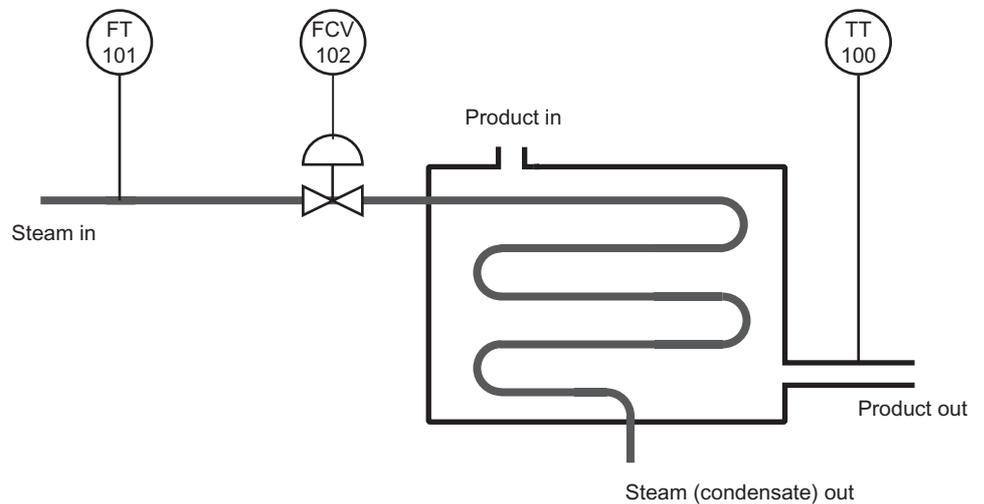


Fig. 3-1: Schematic diagram of heat exchanger application

A liquid flows through the heat exchanger and is heated by condensing steam. The controlled variable is the exit temperature of the liquid flowing through the exchanger. The manipulated variable is the steam flow to the exchanger. The temperature of the product defines the set point of the steam flow, which is controlled by a valve in order to avoid excessive waste of energy (=steam). The flow values are delivered by a Modbus slave via the MBCM block in the Field Controller, which acts as Modbus master. The corresponding control strategy is shown in Fig. 3-2.

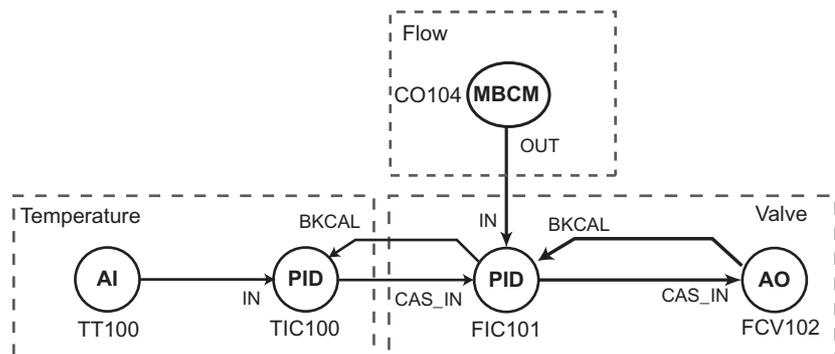


Fig. 3-2 Cascade control strategy for heat exchanger application

3.1.2 Network

The network is assumed to be constructed as shown in Fig. 3-3.

- The flowmeter is a Promass 83F with Modbus RS-485 interface, acting as Modbus slave, suitable for steam measurement
- The valve positioner is a Metso ND9103FN (FOUNDATION fieldbus)
- The temperature transmitter TMT165 (FOUNDATION fieldbus)

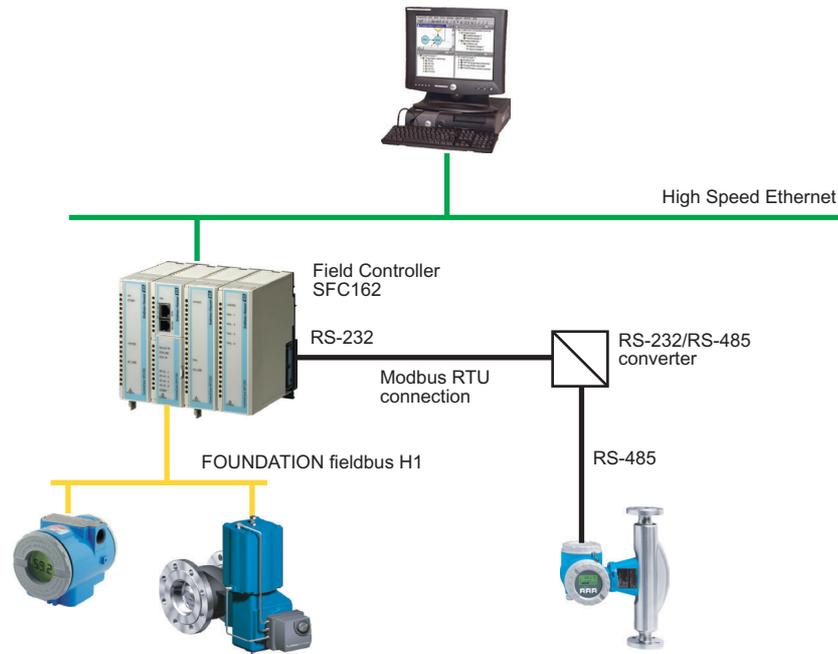


Fig. 3-3 Network for application example

As shown in Figure 3-2, the control will be done in the TMT165 temperature transmitter and the ND99103FN valve positioner. As far as traffic on the bus is concerned, this is the most efficient method. The user has, however, the alternative of performing all control in the controller, should this be preferred.

The Promass 83 delivers the flow measurement for the cascade control. To do this it must be connected to the RS-232 port of controller via a RS-232/RS-485 interface. The both the Field Controller and the flowmeter can be configured as master or slave. In this example, the Field Controller is used as master.

3.1.3 Installation and commissioning

Before you can start this part of the Modbus tutorial, Application Designer must be installed on your computer, the SFC 162 FOUNDATION Fieldbus Controller installed and commissioned and a connection made to your computer. Instructions on how to do this are to be found in:

- Operating Instructions BA020S/04/en, Getting Started
- Operating Instructions BA021S/04/en, Field Controller: Hardware Installation
- Operating Instructions BA035S/04/en, Field Controller: Commissioning and Configuration

3.1.4 Device ID and tag

For a FOUNDATION Fieldbus system, each device that communicates has a unique bus address. Addresses are assigned automatically during the start-up of the system on the basis of the device ID. The device ID is a unique identifier that is based on a Manufacturer ID and the serial number of the device. When the project goes online, the actual device IDs must be assigned to virtual devices that have been planned in Application Designer by using the Assign Tags procedure.


To aid the offline engineering of the network, it is necessary to keep a record of the measuring point tags (device tags), often as an Excel sheet. Measuring point tags are used in P&I diagrams to indicate the type of measurement or action performed at a particular location in a process. Table 3-1 below provides an example of how this might look for the application at hand.

Area	Process Cell	Device	Vendor	Tag	Unit	Task
Pasteurization	Heat Exchanger	TMT165	E+H	TT100 TIC100	°C	Product temperature Temperature PID
Pasteurization	Heat Exchanger	Promass 83F	E+H	FT101	kg/h	Steam flow
Pasteurization	Heat Exchanger	ND9103FN	Metso	FCV102 FIC101	%	Steam valve positioner Flow PID
Pasteurization	Heat Exchanger	SFC162	E+H	CO104		Field Controller acquiring and passing on flow measurement


Tab. 3-1: : Measuring point tag list for tutorial application

3.2 Create a project


- 1 Start ControlCare Application Designer by clicking on the icon on your desktop or via **Start => Programs => Endress+Hauser => ControlCare => ControlCare Application Designer**
- 2 The project starts from a blank application screen
 - With the right mouse key select **Project File=>New**




- 1 The **Document Type** box appears: Click the option **Project**



- 2 The **New Project** dialog box opens:

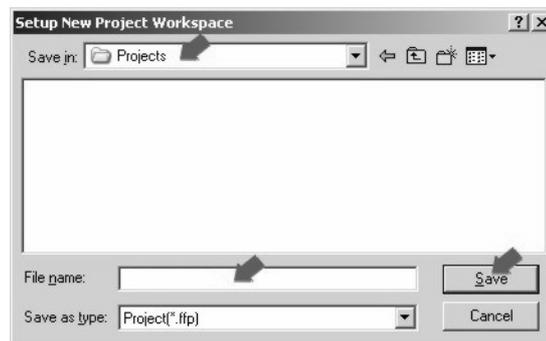


1. Choose the folder where the project will be saved.
2. Type the name of the project in the File Name box, e.g. My Modbus project.
3. Click **Save**.
If the new project is not to be created, click **Cancel**.
- 3 ControlCare Application Designer automatically creates a folder with the entered file name within the selected folder.
- 4 The project opens with the first branches of the plant and network view already created:

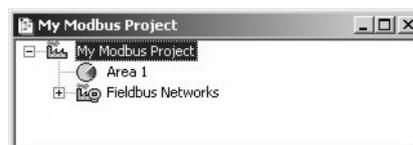

3.3 Determine the naming preferences

Before you start, you can set preferences for the way your project is created. Of particular interest at this stage is the labelling of the function blocks.

- 1 Press **Project File => Preferences**
 - The **Preferences** Dialog appears

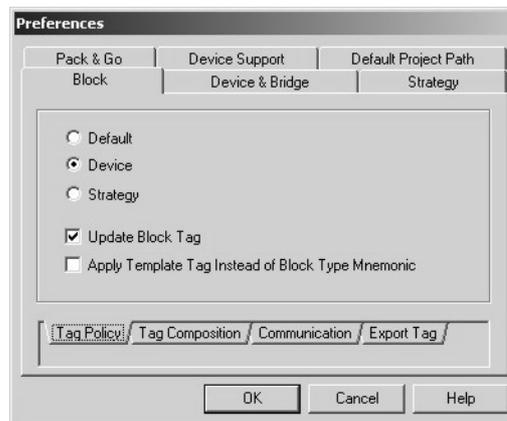

Tag Policy

Tag Policy determines how the blocks are labelled by default if no tag names are entered

- 1 Select the folder **Block** and the subfolder **Tag Policy**, then check the following buttons
 - **Device**
 - **Update Block Tag**
- 2 Press **OK** to confirm your selection
 - Application Designer will now automatically rename any blocks created in the control strategy window as they are assigned to the devices by adding the device tag as prefix.

Tag Composition

Tag Composition determines how the block identifiers are added to the block tag if no block name is entered.

- 1 Select the subfolder **Tab Composition**:
 - Enter a mnemonic separator: for this manual the setting was "-"
Default setting is "_" and mandatory for if flexible function blocks are to be used
 - Check **Prefix**
- 2 Press **OK** to confirm your selection
 - Application Designer will now automatically compose the blocks according to your selection, e.g. TagName-Block-n or TagName_Block_n.

Export Tag


Export Tag causes tags to be automatically exported every time the project goes online

- 1 Select the subfolder **Export Tag**
 - Check the **Automatic** button
- 2 Press **OK** to confirm your selection

3.4 Create a fieldbus network


3.4.1 Add the controller

- 1 Expand the **Fieldbus Networks** branch in the project window and right-click on **HSE Network 1**

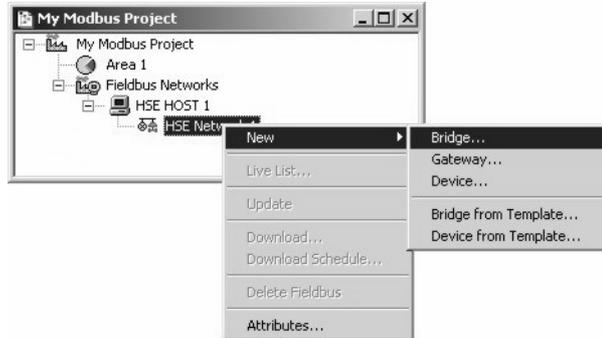


- Select **New => Bridge** to add the Field Controller SFC162
- If the Field Controller SFC173 was to be used, it would be added by **New => Gateway**

- 2 The **New Bridge** dialog opens

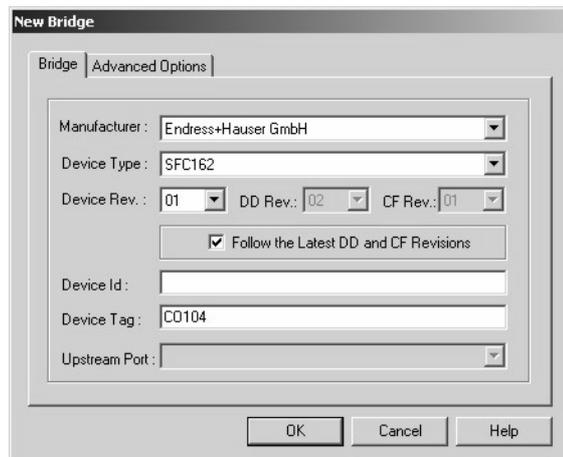


- Enter the **Device Tag**, e.g. CO104
- Press **OK** to create the bridge

- 3 The Field Controller SFC162 is added to the network

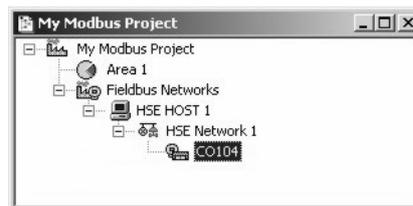


3.4.2 Add a fieldbus segment

- 1 Right-click on the Field Controller (CO104)

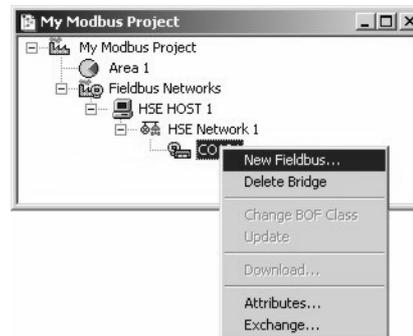


- Select **New Fieldbus**

- 2 The New Fieldbus dialog opens

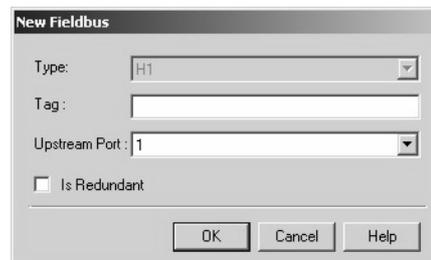


- Press **OK** to create the fieldbus with default settings

- 3 The fieldbus is created with the default name **Fieldbus 1**

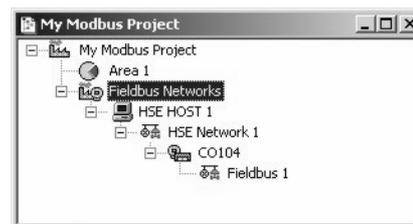


3.4.3 Add the Modbus function blocks

- 1 Right-click on the **Fieldbus 1** leaf and select **Expand**

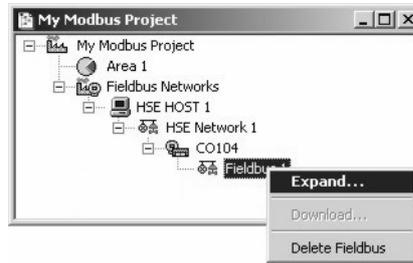


- 2 A new window opens with the name **Fieldbus 1**
 - Expand the tree until all leaves until you see **FB VFD** under the controller

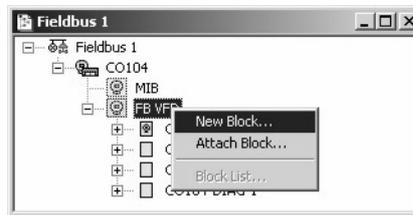


- Right-click on **FB VFD** and select **New Block**

- 3 The **New Block** dialog for the SFC162 Field Controller opens

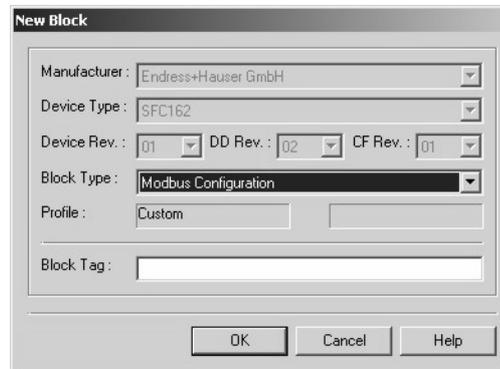


- In **Block Type**, select the function block **Modbus Configuration**
- Press **OK** to create the block with default values
- Only one block is required

- 4 Repeat Step 2 and create a **Modbus Control Master** block
 - Depending on the number of inputs required, up to 16 MBCM blocks can be created

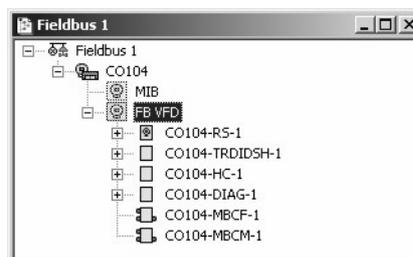


3.4.4 Add the FF field devices


- 1 In the Fieldbus 1 window, right-click on the **Fieldbus 1** leaf and select **New => Device**

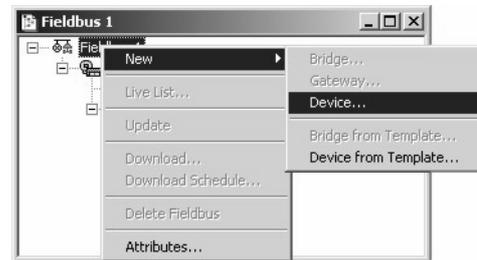

- 2 The **New Device** dialog appears

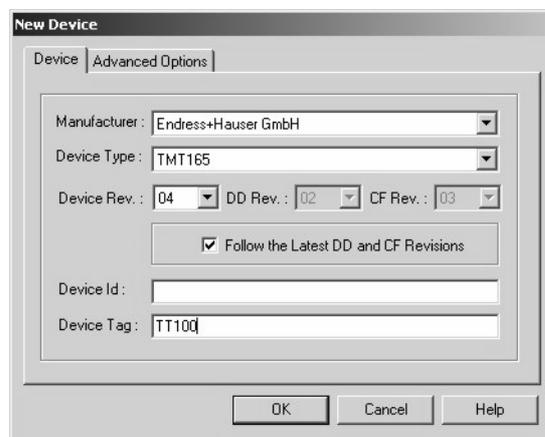


- Select **Manufacturer:** Endress+Hauser
 - Select **Device Type:** TMT165
 - Enter **Device Tag:** TT100
 - Press **OK** to create the device
- 3 Repeat Step 2 to create the Metso positioner
 - Select **Manufacturer:** Metso Automation
 - Select **Device Type:** Metso FBLK Interface
 - Enter **Device Tag:** FCV102
 - Press **OK** to create the device
 - 4 Fieldbus 1 now looks like this

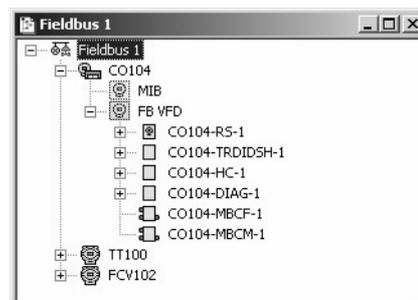


3.5 Configure the devices

3.5.1 MBCF Modbus Configuration block


- 1 In the Fieldbus 1 window, right-click on the Field Controller function block **CO104-MBCF-1** and select **Off Line Characterization**

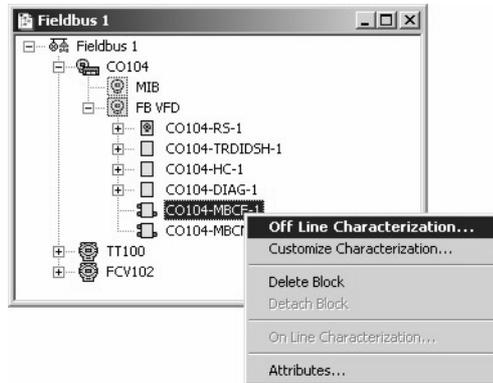

- 2 The **Off Line Characterization** dialog opens: Press **All** to show all parameters

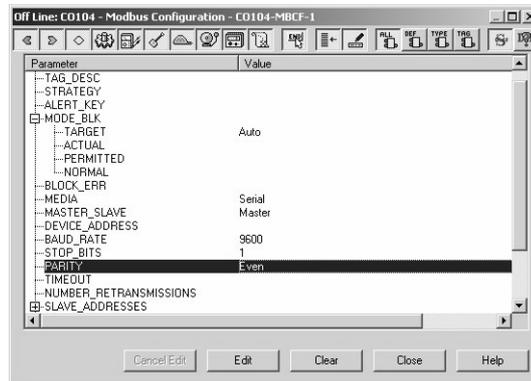

- 3 Set the following parameters by double-clicking in the middle of the parameter line, entering or selecting the parameter from the drop-down menu, and clicking End Edit to register the change (MBCF block parameters are described in Chapter 6.1):
 - **MODE_BLK TARGET** = Auto
 - **MEDIA** = Serial
 - **MASTER_SLAVE** = Master
 - **BAUD_RATE** = 38400 (default value in Promass 83)
 - **STOP_BITS** = 1 (RTU, supported by Promass 83)
 - **PARITY** = Even (RTU, supported by Promass 83)
- 4 Click **Close** to close the dialog; the parameters are added to the MBCF function block

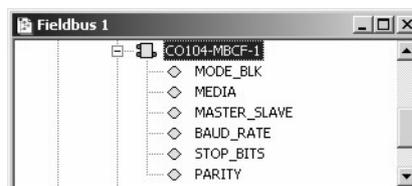

3.5.2 MBCM Modbus Control Master block

The MBCM function block allows 16 Modbus registers to be mapped. Each block offers:

- Four OUT channels for reading analog values from Modbus device registers
- Four OUT_D channels for reading discrete values from Modbus registers
- Four IN channels for writing analog values to Modbus device registers
- Four IN_D channels for writing discrete values to Modbus device registers

The SCALE_LOC_XXX parameter allows each channel to be individually configured for scaling, slave address, register and data type. The registers are listed in the operating instructions of the Modbus device. Field Controller uses 5 digit register addresses, so should the device instructions show only four digits, a "3" must be prefixed for OUT values and a "4" for IN values. If more than four registers of a particular type are required, up to 16 MBCM blocks can be created. By default the LOCAL_MOD_MAP = 0, valid range is 0 – 15.

The Promass 83 offers several measured values which can be read from different MODBUS registers, see below. For our example, mass flow (2007 = 32007) will be selected.

Measured value	Register 1	Register 2	Data type	Access
Mass flow	2007	247	Float	Read
Volume flow	2009	253	Float	Read
Corrected volume flow	2011	–	Float	Read
Density	2013	249	Float	Read
Reference density	2015	–	Float	Read
Temperature	2017	251	Float	Read
Totalizer 1	2610	259/261	Float	Read
Totalizer 2	2810	–	Float	Read
Totalizer 3	3010	–	Float	Read

Tab. 3-2: Modbus registers for Promass measured values

By default, the Promass sends its float number with the bytes order 1-0-3-2 and not in the sequence 3-2-1-0. For the Field Controller this corresponds to the DATA_TYPE "float".

The values mapped to the Field Controller or sent to a Modbus device register can be scaled. The parameters:


- FROM_EU_0
- FROM_EU_100
- TO_EU_0
- TO_EU_100

allow a conversion from one set of engineering units to a second set of engineering units, by simply entering the lower and upper limit values of each set. In our example, the mass flow value offered by the Promass will be scaled from 0% to 100% by entering the lower and upper range limits of the transmitter in the "FROM" parameters.


Full details of how to parametrize the Promass flow transmitter with Modbus interface are to be found Operating Instructions BA107D and BA108D respectively.

Procedure


- 1 Right-click on the **CO104-MBCM-1** block and open the **Off Line Characterization** dialog

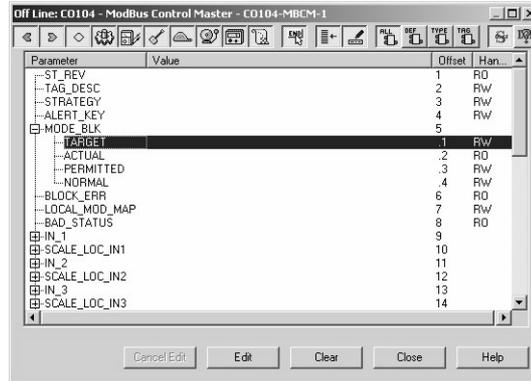

- 2 Click All to reveal all parameters and enter the following parameters by double-clicking in the middle of the parameter line, entering or selecting the parameter from the drop-down menu, and clicking End Edit to register the change:
 - **MODE_BLK TARGET** = Auto
 - **LOCAL_MOD_MAP** = 0 (first MBCM function block)
- 3 Now set the following **SCALE_LOC_OUT1** parameters for the Modbus read value:
 - **FROM_EU_0** = 0
 - **FROM_EU_100** = 8000 (Upper range limit for Promass)
 - **TO_EU_0** = 0
 - **TO_EU_100** = 100
 - **DATA_TYPE** = Float
 - **SLAVE_ADDRESS** = 10 (Default address of Promass 83)
 - **MODBUS_ADDRESS_OF_VALUE** = 32007

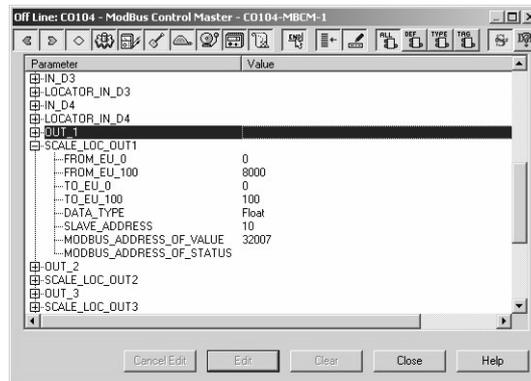

- 4 Press **Close** to close the Off Line Characterization dialog. You should now see the parameters attached to the MBCM block:

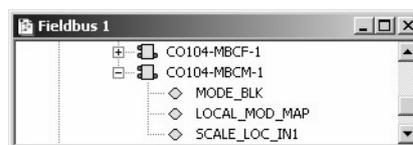

- 5 Open **Project File**, then press **Save**, to save the project.

3.5.3 TMT165 transducer block

Full details of how to parametrize the TMT165 temperature transmitter are to be found Operating Instructions BA114REN.

Transducer Block

Table 3-3 shows the parameters that must be set in the TMT165 transducer block

Parameter	Function	Temperature TT100
MODE_BLOCK/TARGET	Normal operating mode of block	Auto
PRIMARY_VALUE_TYPE	Measuring method for primary process value <ul style="list-style-type: none"> ■ Process temperature ■ Differential temperature ■ Back up 	Process temperature
SENSOR_TYPE	Type of sensor connected to the transmitter <ul style="list-style-type: none"> ■ All types of standardized temperature sensors 	Pt 100 IEC
SENSOR_CONNECTION	Way in which the sensor is connected <ul style="list-style-type: none"> ■ Four wires ■ Three wires ■ Two wires ■ Double two wires (2nd transducer block must be configured) 	Four wires

Tab. 3-3: Basic parameters for TMT165 transducer block

Order of parameters

Some block parameters have a write check based on the value of others parameters. It is therefore important to set the parameters in the order shown in Table 3-3 (the same order in which they are displayed in the **Off Line Characterization** dialog. After parametrization of the block, the parameters will appear in the FOUNDATION Fieldbus tree. If you find a parameter in the wrong position, it can be move by dragging and dropping to the correct one.

Parametrize

- 1 In the Fieldbus network workspace, expand the TT100 tree until the function blocks are visible
 - Right click on the transducer function block **TT100-BLK-1** and select **Off Line Characterization...**
- 2 The **Off Line Characterization** dialog opens: Press **All** to reveal all parameters.
- 3 Now set the following parameters to the values in Table 3-3:
 - **MODE_BLK TARGET** = Auto
 - **PRIMARY_VALUE_TYPE** = Process temperature
 - **SENSOR_TYPE** = Pt 100 IEC
 - **SENSOR_CONNECTION** = Four wires
 - Double-click on the "Value space" next to the parameter
 - Enter a value or select a parameter from the drop-down menu
 - Press **End Edit** to register your change
- 4 Press Close to quit the Off Line Characterization dialog

3.5.4 Metso ND9103FN positioner

Full details of how to parametrize the Metso ND9103FN valve positioner are to be found in the ND900F User Guide which can be downloaded from www.metso.com.

Transducer Block

In the tutorial, you have probably only the valve positioner, but not the valve itself. In real life, the positioner must be told what it is driving and certain assembly information must always be entered into the transducer block. Rotary valve parameters are included in Table 3-4.

Parameter	Function	Positioner FCV102
MODE_BLOCK/TARGET	Normal operating mode of block	Auto
VALVE_TYPE	Type of valve the positioner is actuating ■ Select from drop-down menu	Rotary
FINAL_VALUE_RATE_DN	Maximum travel rate in closing direction ■ 0 = parameter not in use	0
FINAL_VALUE_RATE_UP	Maximum travel rate in opening direction ■ 0 = parameter no in use	0
POSITIONER_FAIL_ACTION	Action of position on loss of electrical power or reception of an output signal with a bad status ■ Select from drop-down menu	Close
POS_SENSOR_ROT	Relationship between valve action and position sensor rotation ■ Select from drop-down menu	Standard: Clockwise to close
DEAD_ANGLE_COMP	Dead angle for segment and rotary valves	0
ACT_TYPE	Type of positioner action ■ Select from drop-down menu	Double-acting actuator
PERFORMANCE_LEVEL	Target performance level of valve position control Select from drop-down menu	Optimum
CHAR_TYPE	Type of linearization ■ Select from drop-down menu	No characterization

Tab. 3-4: : Basic parameters for Promass 83F transducer block

Order of parameters

Some block parameters have a write check based on the value of others parameters. It is therefore important to set the parameters in the order shown in Table 3-4 (the same order in which they are displayed in the **Off Line Characterization** dialog. After parametrization of the block, the parameters will appear in the FOUNDATION Fieldbus tree. If you find a parameter in the wrong position, it can be move by dragging and dropping to the correct one.

Parametrize


- In the Fieldbus network workspace, expand the FCV102 tree until the function blocks are visible.
 - Right click on the transducer function block **FCV102-BLK-2** block and select **Off Line Characterization...**
- The **Off Line Characterization** dialog opens: Press **All** to reveal all parameters
 - Expand the **Mode Block** parameter tree
- Now set the parameters to the values in Table 3-4:
 - Double-click on the "Value space" next to the parameter
 - Enter a value or select a parameter from the drop-down menu
 - Press **End Edit** to register your change
- Press Close to quit the Characterization dialog
- Open **Project File**, then press **Save**, to save the project

3.6 Create the Control Strategy


Having created a physical view of the process, the next step is to create control strategy. This is done in the logical view of the plant. This represents the plant as Areas/Process Cells in accordance with ISA S88/IEC 61518.

3.6.1 Add a Process Cell

- 1 Click on the "**Area 1**" leaf in the project and select **Attributes...**

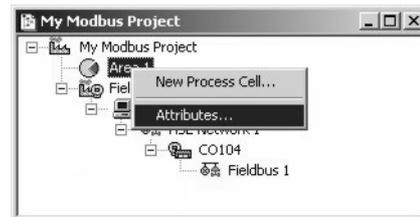


- 2 The **Attributes** dialog box appears

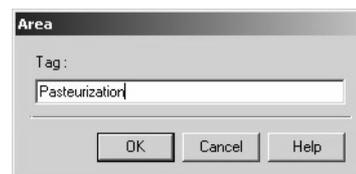

- Enter a name for the area, e.g. Pasteurization (see Table 3-1, Chapter 3.1)
- Click **OK** to store your changes

- 3 Click on the Area leaf again and select **New Process Cell...**

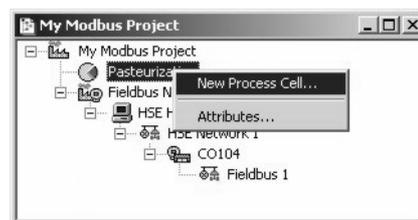

- 4 The **Process Cell** dialog box appears




- Enter a name for the process cell, e.g. Heat Exchanger (see Table 3-1, Chapter 3.1.4)
- Click **OK** to store your changes


- 5 Open **Project File**, then press **Save**, to save the project.

3.6.2 Add a Control Module


- 1 Right-click on the Process Cell leaf you just created and select **Expand**

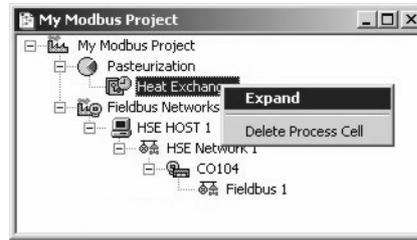

- 1 A new window with the name of the leaf opens
 - Right-click on the top leaf and select **New Control Module**

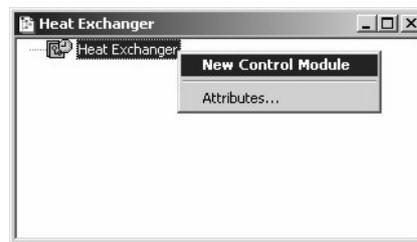


- 2 The **Control Module** dialog box appears

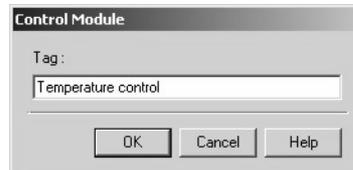

- Enter a name for the control module, e.g. Temperature Control (see Table 3-1)
- Click **OK** to store your changes


- 3 The project now looks something like this:

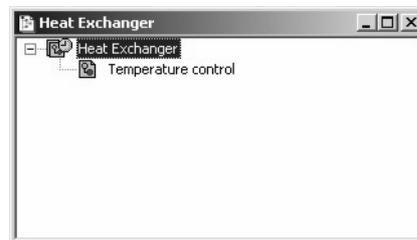


- 4 For a real project, Step 2 and 3 would be repeated until all the required control modules for a particular process cell have been added.
- 5 Open **Project File**, then press **Save**, to save the project.

3.6.3 Create the function blocks


- 1 Double-click on the control module leaf or right-click and select **Expand** to open the **Control Strategy** workspace - this has the same name as the leaf

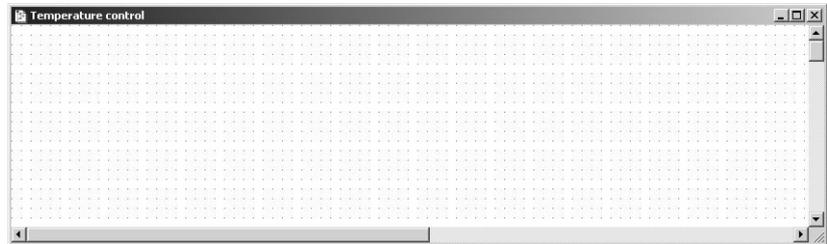


- 2 Press the Function Block button  in the toolbar and click in the workspace
 - The **New Block** dialog appears

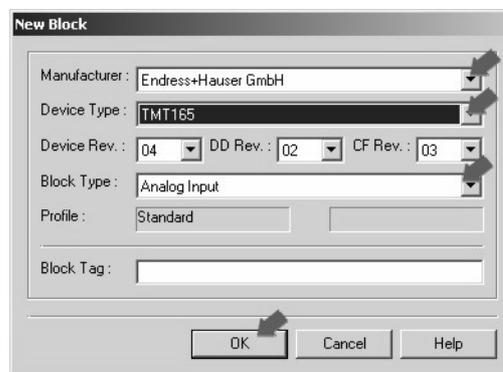

- Select the **Manufacturer** = Endress+Hauser
 - Select the **Device Type** = TMT165
 - Select the **Block Type** = Analog Input
 - Press **OK** to create the function block
- 3 The block now appears in the strategy window with the default name

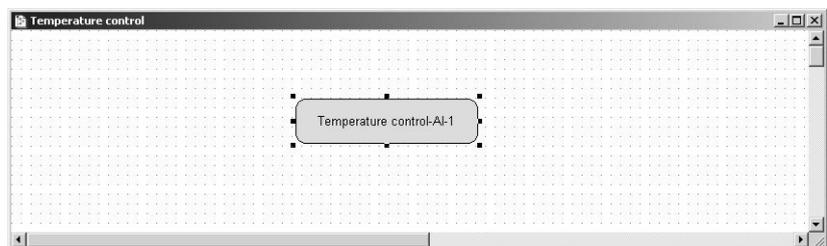

- 4 Repeat Steps 2 and 3 for the Temperature PID, Flow PID and Valve AO blocks
 - Temperature PID:
Manufacturer = Endress+Hauser
Device Type = TMT165
Block Type = PID Control
 - Flow PID
Manufacturer = Metso Automation
Device Type = FBLK Interface
Block Type = PID Control
 - Positioner AO
Manufacturer = Metso Automation
Device Type = FBLK Interface
Block Type = Analog Output
- 5 The data exchange is managed by the MBCM block which you have already created
 - In the **Fieldbus 1** window expand the **CO104** leaf and click on **CO104-MBCM-1**
 - Drag and drop the block into the control strategy window
- 6 The control strategy now looks like this

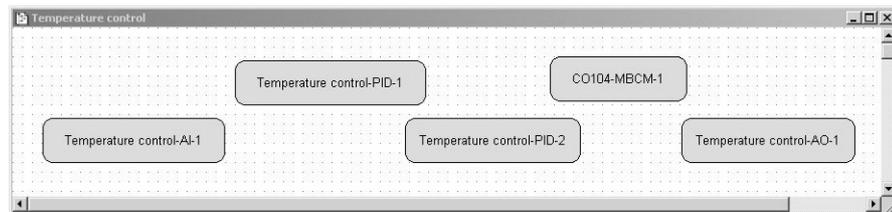


- 7 Open **Project File**, then press **Save**, to save the project

Note


- In the tutorial we created the MBCM block together with the MBCF block. It is also possible to create the MBCM block in the strategy window as we have done with the PID, AI and AO blocks, and then drag and drop it to the Field Controller in the Fieldbus Network view, see Chapter 3.6.7.

3.6.4 Add the Function Block Links


- 1 In the Control Strategy workspace position the blocks according to your strategy

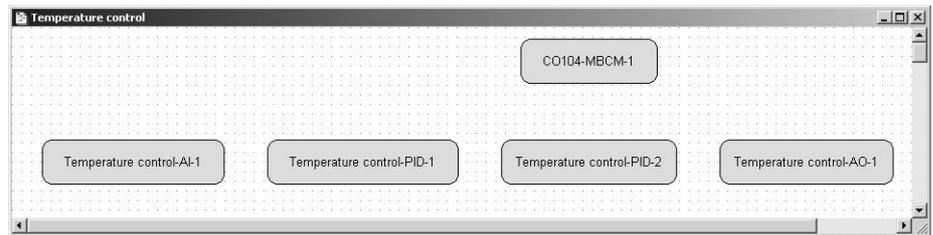

- The blocks can be dragged and dropped by selecting and holding down the right mouse key
- The blocks can be aligned by selecting, then via **Tools => Alignment => e.g. Middle** followed by a click on the block to which the alignment is to be made
- The **Tools** menu also contains other standard drawing functions such as toolbars, standard shapes, line thickness, colours etc.

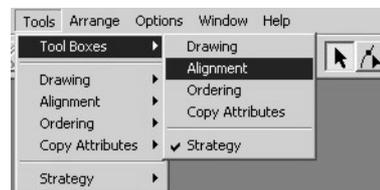


- 2 Click on **Function Block Link**  button in the tool bar, the cursor changes to a cross
 - Select the **Temperature AI block** with the cross: the **Output Parameter Selection** dialog appears

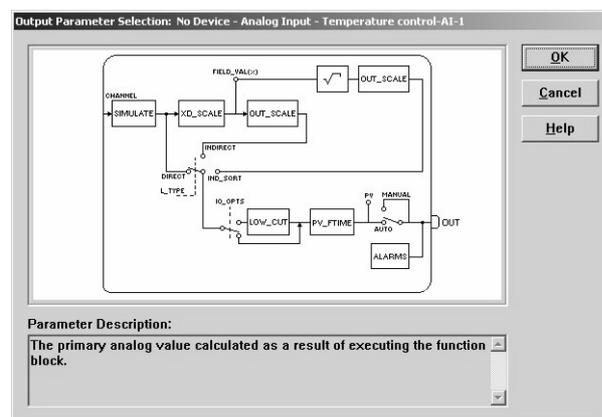


- 3 Click the box next to **OUT** – it changes color – then click on **OK**
 - The **Output Parameter Selection** dialog closes
 - The cursor is now connected to a blue dotted line
 - Place the Cursor in the Controller PID Block 1 and click to make the link

4 When the link is made, the Input Parameter Selection dialog for the PID block appears

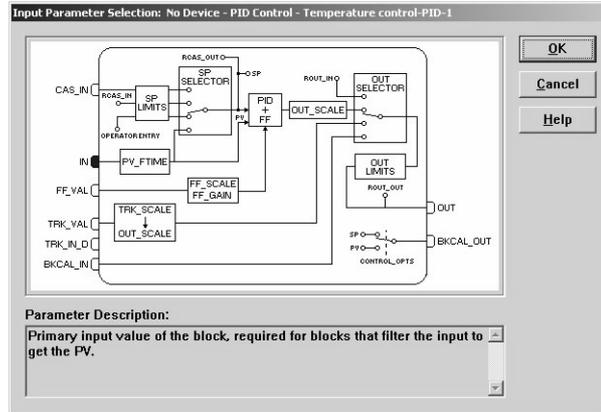

- Click the box next to **IN** – it changes color – then click on **OK**

5 When the Input Parameter Selection dialog changes, the link is made and appears as below:

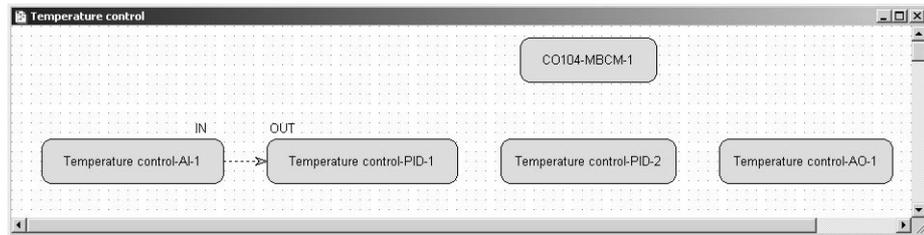


- You may have to move the parameter legends "IN" and "OUT" by selecting and positioning with the left mouse key depressed

6 Repeat steps 2 to 5 and make the following links between the function blocks

- PID1 and PID2 = **OUT** to **CAS_IN**
- PID2 and PID1 = **BKCAL_OUT** to **BKCAL_IN**
- CO104-MBMC-1 to PID2 = **OUT1** to **IN**
- PID2 to Valve AO = **OUT** to **CAS_IN**
- Valve AO to PID2 = **BKCAL_OUT** to **BKCAL_IN**

7 Your Control Strategy now looks something like this

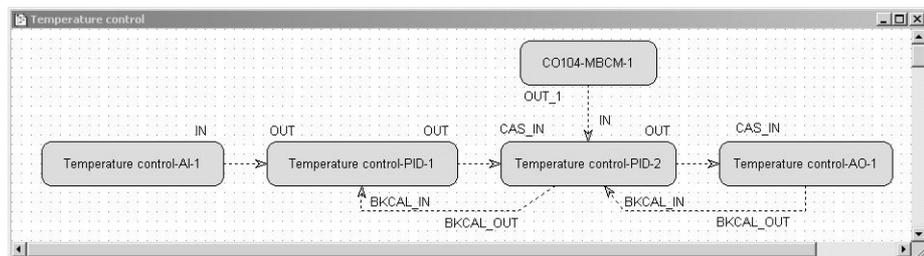

8 Open **Project File**, then press **Save**, to save the project.

3.7 Configure the strategy

FOUNDATION Fieldbus offers the possibility of storing complete control strategies as fully configured generic templates. This is especially useful when particular control strategies occur several times within a project. The strategies are stored independent of device assignment, which is performed as a separate step, see Chapter 3.8.

In this tutorial, the strategy will be configured to receive the incoming process value from the input block as % of full range, and to output a % value to the positioner.

3.7.1 Analog Input parameters

The function block **Temperature control- A1-1** for the TMT165 has to be configured. The basic parameters required are shown in Table 3-5. A full description of the parameters are to be found in the Operating Instructions BA114REN.

Parameter	Function	Temperature TC100
MODE_BLOCK/TARGET	Normal operating mode of block	Auto
XD_SCALE/EU_100 XD_SCALE/EU_0 XD_SCALE/UNITS_INDEX	Upper range limit for process variable Lower range limit for process variable Unit of process variable	850 -200 °C
OUT_SCALE/EU_100 OUT_SCALE/EU_0 OUT_SCALE/UNITS_INDEX	Upper range limit for output variable Lower range limit for output variable Unit of output variable	100 0 %
CHANNEL	Output channels of Transducer Block assigned to Analog Input Block. <ul style="list-style-type: none"> ■ TMT = 1 or 2 depending on whether one or two sensors are connected ■ Promass = 1 to 7, depending on which type of process value is required 	1 = 1 sensor
L_TYPE	Selects the type of linearisation for the input value. <ul style="list-style-type: none"> ■ Direct: PV value = OUT value, Identical XD_SCALE and OUT_SCALE ■ Indirect: PV value scaled to OUT value ■ Indirect Square Root: as Indirect but scaling with root function 	Indirect
PV_FTIME	Output damping constant (in seconds).	1

Tab. 3-5: Basic parameters for Analog Input blocks

Order of parameters


Some block parameters have a write check based on the value of others parameters. It is therefore important to set the parameters in the order shown in Table 3-5 (the same order in which they are displayed in the **Off Line Characterization** dialog. After parametrization of the block, the parameters will appear in the FOUNDATION Fieldbus tree. If you find a parameter in the wrong position, it can be move by dragging and dropping to the correct one.

Note


- In the tutorial we configured the MBCM block together with the MBCF block, see Chapter 3.5.2. If the MBCM block had been created in the strategy window as we have done with the PID, AI and AO blocks, it could also be configured in the same manner has described here.

3.7.2 Configuring the Analog Input blocks

- 1 In the Control strategy workspace, double-click on the **Temperature control AI-1** block
 - The **Off Line Characterization** dialog opens
 - Press **All** to display all the parameters

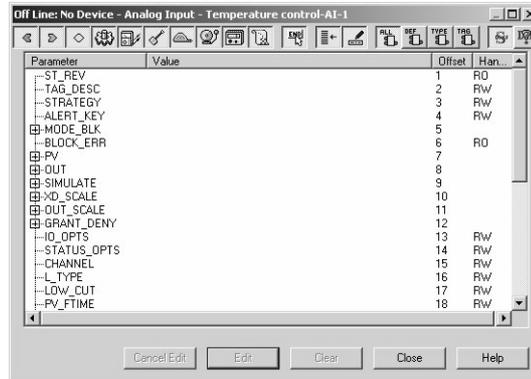

- 2 The Mode Block **Target** must be set to **Auto**.

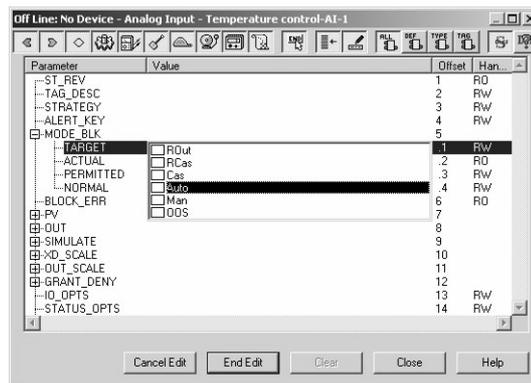

- Expand the **Mode Block** parameter tree
 - Double-click on the "Value space" next to the **Target** parameter
 - Select **"Auto"** from the drop-down menu
 - Press **End Edit** to register your change
- 3 Repeat this procedure for the remainder of the Temperature parameters in Table 3-5
 - Remember to press **End Edit** after every change
 - When all parameters have been entered, press **Close** to quit the Characterization dialog
 - 4 Open **Project File**, then press **Save**, to save the project

3.7.3 Basic PID parameters

The controller PID blocks must now be parametrized. In practice, the values for the GAIN, RESET and RATE as well as the setpoint value SP for the temperature loop will be known. The other values determine the way the control is handled when the block moves from auto/cas or a value becomes bad. See also ControlCare Function Block manual BA022S/04/en.

Parameter	Function	Temperature TC100	Flow FC101
MODE BLOCK/TARGET	Normal operating mode of block	Auto	CAS
SP/VALUE	Setpoint for product temperature	40%	–
PV_SCALE/EU_100 PV_SCALE/EU_0 PV_SCALE/UNITS_INDEX	Upper range limit for process variable Lower range limit for process variable Unit of process variable	100 0 %	100 0 %
OUTSCALE/EU_100 OUTSCALE/EU_0 OUTSCALE/UNITS_INDEX	Upper range limit for output variable Lower range limit for output variable Unit of output variable	100 0 %	100 0 %
CONTROL_OPTS	Sets control options for bad input	Bypass Enable	Bypass Enable
BYPASS	When ON, SP value is transferred to the OUT without the calculation of PID terms.	OFF	OFF
SP_RATE_DN SP_RATE_UP	Rate of change from old to new, higher SP Rate of change from old to new, lower SP	0 0	0 0
GAIN RESET RATE	Tuning constants for the P, I and D terms, of the PID block respectively.	1.5 0.1 0.5	2 0.2 0.6
SHED_OPT	Behaviour when shedding from remote mode	Normal shed, normal return	Normal shed, normal return

Tab. 3-6: Basic parameters for temperature and flow PID blocks


Order of parameters

Some block parameters have a write check based on the value of others parameters. It is therefore important to set the parameters in the order shown in Table 3-6 (the same order in which they are displayed in the **Off Line Characterization** dialog.


After parametrization of the block, the parameters will appear in the FOUNDATION Fieldbus tree. If you find a parameter in the wrong position, it can be move by dragging and dropping to the correct one.

3.7.4 Configure the PID blocks

- 1 In the Control strategy workspace, double-click on the **Temperature control PID-1** block
 - The **Off Line Characterization** dialog opens
 - Press **All** to display all the parameters

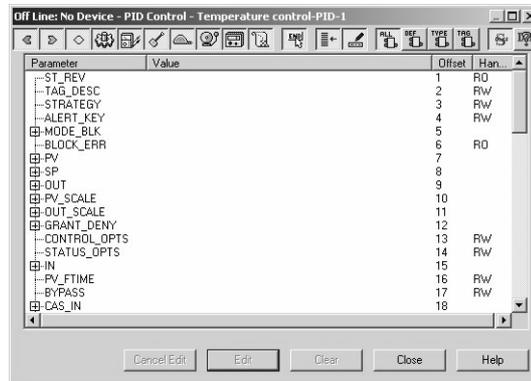

- 2 The Mode Block **Target** must be set to **Auto**.

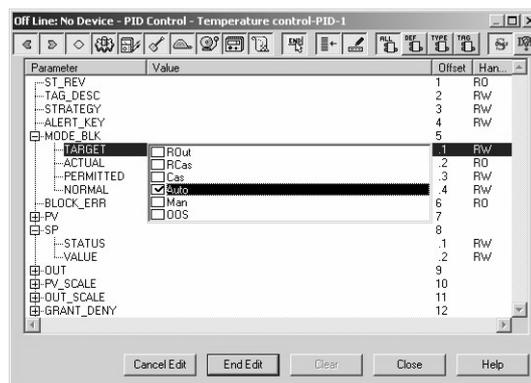

- Expand the **Mode Block** parameter tree
 - Double-click on the "Value space" next to the **Target** parameter
 - Select **"Auto"** from the drop-down menu
 - Press **End Edit** to register your change
- 3 Repeat this procedure for the remainder of the Temperature PID parameters in Table 3-6
 - Remember to press **End Edit** after each entry
 - When all parameters have been entered, press Close to quit the Characterization dialog
 - 4 Repeat Steps 1 to 3 for the Flow PID parameters in the **Temperature control-PID-2** block
 - Remember to set the Block Mode **Target** to **CAS**
 - 5 Open **Project File**, then press **Save**, to save the project

3.7.5 Analog Output parameters

The function block **Temperature control- AO-1** for the ND9103FN now has to be configured. The basic parameters required are shown in Table 3-7. A full description of the parameters are to be found in the Operating Instructions


- ND9000F Users Guide, downloadable from www.metso.com

Parameter	Function	Positioner FCV102
MODE BLOCK/TARGET	Normal operating mode of block	Cas
PV_SCALE/EU_100 PV_SCALE/EU_0 PV_SCALE/UNITS_INDEX	Upper range limit for process variable Lower range limit for process variable Unit of process variable	100 0 %
XD_SCALE/EU_100 XD_SCALE/EU_0 XD_SCALE/UNITS_INDEX	Upper range limit for output variable Lower range limit for output variable Unit of output variable	100 0 %
CHANNEL	Defines the signal configuration between the AO block and transducer block.. <ul style="list-style-type: none"> ■ 1 = AO, valve control ■ 2 = AO, no transducer connected 	1 = valve control
SHED_OPT	Behaviour when shedding from remote mode	Normal shed, normal return

Tab. 3-7: Basic parameters for Analog Output block

3.7.6 Configuring the Analog Output block

- 1 In the Control strategy workspace, double-click on the **Temperature control AO-1** block
 - The **Off Line Characterization** dialog opens
 - Press **All** to display all the parameters

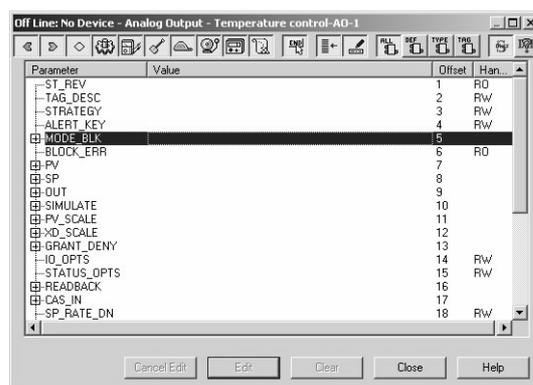


- 2 The Mode Block **Target** must be set to **Cas**.
 - Expand the **Mode Block** parameter tree
 - Double-click on the "Value space" next to the **Target** parameter
 - Select **"CAS"** from the drop-down menu
 - Press **End Edit** to register your change
- 3 Repeat this procedure for the remainder of the Temperature AO parameters in Table 4-3
 - Remember to press **End Edit** after each entry
- 4 Open **Project File**, then press **Save**, to save the project


3.7.7 Store the strategy as a template

After configuration, the strategy can be stored as a template for similar applications

- 1 In the Strategy workspace, drag the mouse across the complete strategy with the lefthand button depressed, until all function blocks are selected

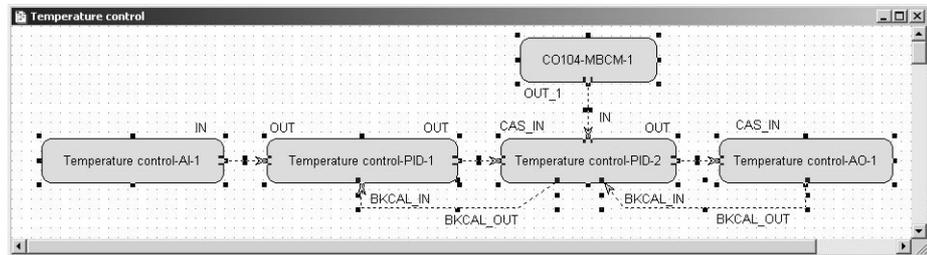

- 2 Now press the **Strategy Export** button  in the toolbar
 - The **Save As** dialog appears

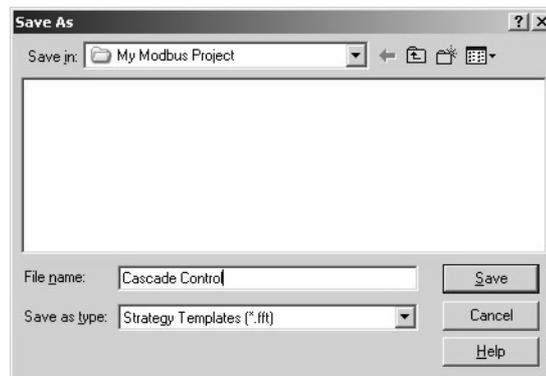


- If appropriate, browse to another folder
 - Enter a **File Name**
 - Press **Save Entire Configuration** to save the strategy
- 3 The strategy can be imported again pressing the **Strategy Import** button  in the toolbar and double-clicking on the appropriate file name.


3.8 Assign the Function Blocks to the Devices

Now assign the function blocks in the control strategy to the devices where they are to run. The order of assignation determines the order of executions (can be changed by drag&drop).

- 1 Expand the **Fieldbus** workspace (Fieldbus 1) and the **Process Cell** workspace (Heat exchanger)

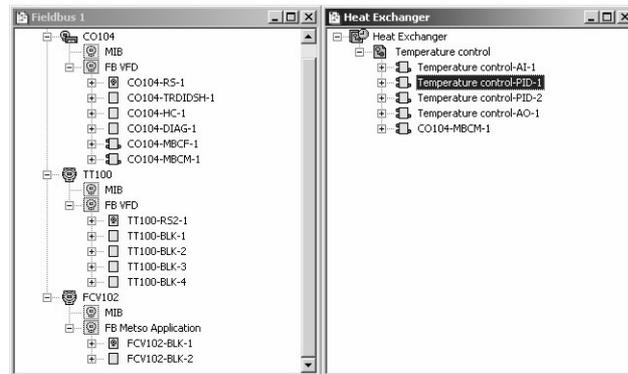

- Note that the Heat Exchanger tree now contains all the function blocks that you created in the Control Strategy workspace
- 2 Now drag and drop the **Temperature control-AI-1** block to the greyed Function Block Application leaf of the TT100 tree
 - When you drop the block, it is attached to tree
 - Its name changes to TT100-AI-1 in both views
 - You have now assigned the Temperature AI block to the temperature transmitter
 - 3 Repeat Step 2 for the other function blocks
 - **Temperature control-PID-1** => TT100
 - **Temperature control-PID-2** => FCV102
 - **Temperature control-AO-1** => FCV102
 - 4 Your project now looks like this

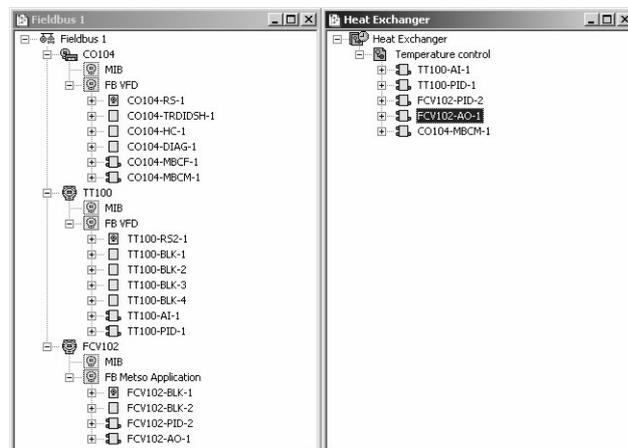

- 5 Open **Project File**, then press **Save Entire Configuration**, to save the project.


3.9 Export tags



Note!

- You should use the **Export Tags** function everytime you change the configuration of the project, so the the OPC server information is always up-to-date.
- Application Designer will do this automatically everytime you go online, if the corresponding preferences are set, see Chapter 3.3.

- 1 Active the project view by clicking in its workspace.
- 2 Right click on the project name, a context menu appears

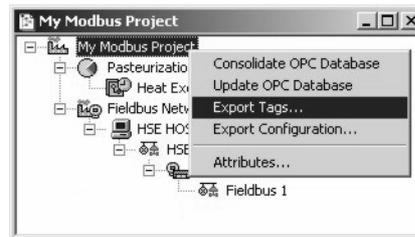

- 3 Select the option **Export Tags...**
 - The Export Tags dialog confirms the successful export



- Press **OK** to close the dialog
- 4 Open **Project File**, then press **Save Entire Configuration**, to save the project

3.10 Connect to the Field Controller

After the Field Controller and other components have been physically installed in the network, connection must be established.

The Field Controller SFC162 is delivered with a default IP address of 192.168.164.100. For the purpose of this tutorial, it is sufficient to connect to this address, however in practice it would be normal to change this address to one allocated by your system administrator.




Warning

- The use of IP addresses is strictly controlled. Usually your system administrator will be authorised to allocate unique addresses. Assigning an unauthorised address to a Field Controller may result in conflicts within your system and the failure of the associated devices!

3.10.1 Change the IP address of your computer

- 1 Open the Windows Control Panel by pressing **Start => Settings => Control Panel** and choose the option Network Connections
- 2 Double-click on **Local Area Connection** and in the Local Area Connection Status dialog select **Properties**
- 3 Select **Internet Protocol TCP/IP** then select **Properties** again

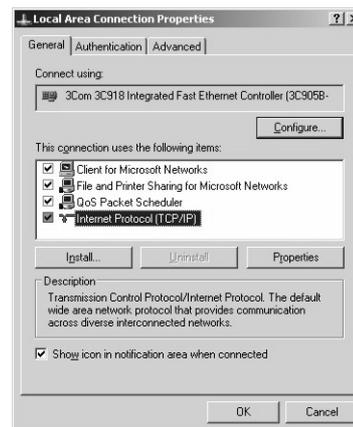


Note!



If "TCP/IP protocol" is not included in the Network, it must be installed by using the Windows setup before you proceed with Step 4.

- 4 Note the original property settings (e.g. make a screen shot and store it in a Word document) of so that they can be restored at end of the operation.


- 5 Change the IP address and the Subnet Mask of the computer, so that it is in the same subnet as the Field Controller.
 - IP Address 192.168.164.XXX and network mask (Subnet Mask) 255.255.255.0.
 - Do not use the addresses 192.168.164.100 or 101, as these are reserved as default addresses for the Field Controllers SFC162 and SFC173 respectively

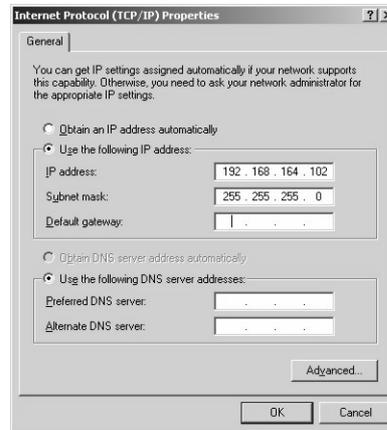


- Click on the OK button to confirm your settings

3.10.2 Set the Field Controller IP address

- 1 Now call FC Tools: **Programs =>Endress+Hauser=>ControlCare=>Tools=>FC Tools**
- 2 Choose the Field Control (OPC) Server path, default **Local**, then press **Connect**

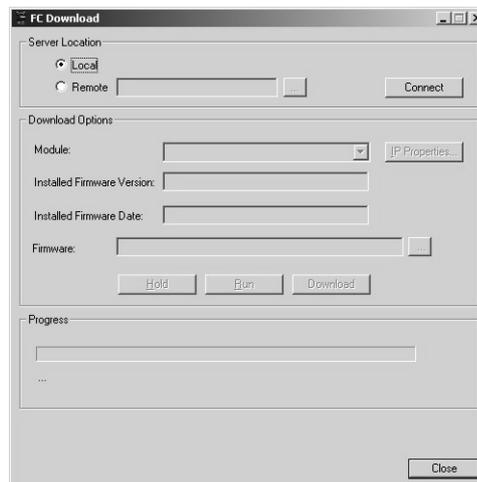


- 3 Select the desired Field Controller module option Module using its serial number as reference. The serial number is printed on the inside of the module door.

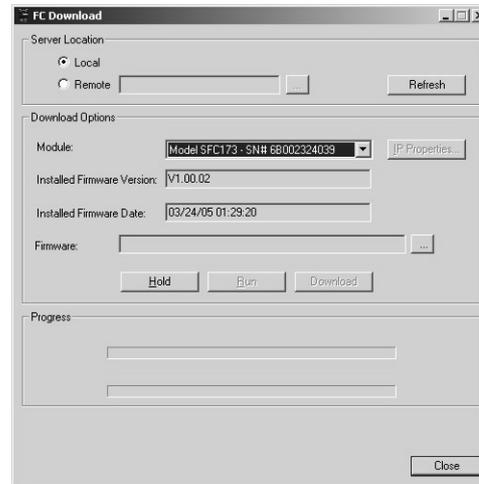

- 4 Press the **Hold** button to interrupt the firmware that is being executed in the module
 - A confirmation window appears, press **Yes** to continue
 - Any application running on the Field Controller will be stopped at this point




- 5 Check that the HOLD LED on the Controller module is lit, then press Connect to continue with the procedure.

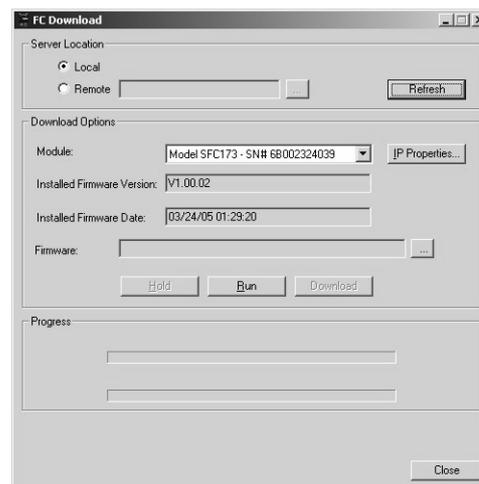


- If the HOLD LED does not light, there is a communication problem: Type PING 192.168.164.100 or 101 in the DOS command window and check whether the Field Controller is found. If there is a reply, replace the Ethernet cable by a cross-cable and try Step 4 again.

- 6 Reselect the desired Controller module, then click on the IP Properties button.
Now check the option **Specify an IP address**, then enter the IP Address and the Subnet Mask
 - Answer **Yes** to the confirmation box
 - Now enter the Field Controller address given to you by your system administrator (in our example we have kept the default address 196.168.164.100)
 - Make a note of the IP addresses and the corresponding Controller serial number. This will help in the identification and diagnosis of possible faults.

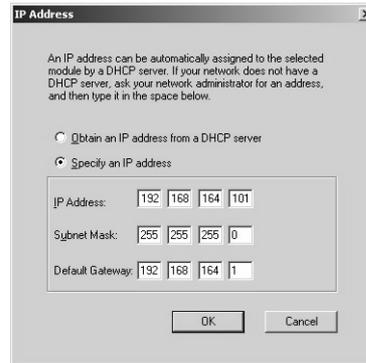

- 7 Click on OK to finish the operation
- 8 Now change the address of your computer as described in Chapter 3.10.1 to the new domain, so that it can continue to communicate with the Field Controller at its new address:
(Note: if the address domain has not changed, the computer address does not need resetting)
 - **Start =>Settings =>Control Panel =>Network Connections**
 - **Local Area Connection => Properties**
 - **Protocol (TCP/IP)=>Properties**
 - Enter an unused IP address and the subnet work address of the new domain
 - Press **OK** to finish the process
- 9 Now return to FC Tools and click on Refresh
- 10 When the Refresh is complete, press Run to start the execution of the Field Controller firmware
 - Confirm the action with **Yes**

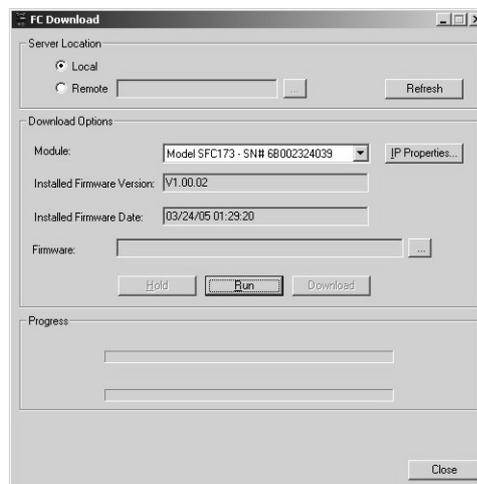

- 11 Check that the HOLD LED on the Field Controller has extinguished, then press Close.
- 12 The Computer is now connected to the Field Controller

3.11 Go online


3.11.1 Create the HSE live list

Once the Computer and Field Controller are able to communicate with each other, the connection to the network can be checked by creating a live list.

- 1 Press the **On-Line** button  in the menu toolbar
 - The project goes on on-line



- Red crosses appear against the Field Controller and Fieldbus network in the Project workspace
- 2 In the Project workspace, right click on **HSE Network** and select **Live List**

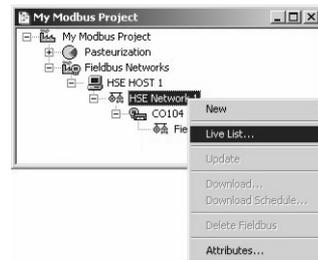


- A live list is generated of the devices on the HSE network


Tag	Id	Address
CO104	452B482010:E+H-SFC162:6600042...	0x64
HSE HOST 1	0000000001:FF-HSE HOST:000000001	0x66

3.11.2 Assign the HSE Device IDs

- 1 In the project workspace, right click on the **Field Controller** (CO104) and select **Attributes...**

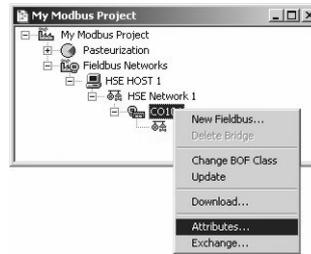


- The **Attributes** dialog opens
- 2 Open the drop-down menu of the **Device ID** and select the Field Controller that is associated with the displayed TAG (in our case CO104) - the serial number is on the front panel
 - Do this even though the correct ID is already displayed - the program expects it!
 - Confirm your choice with **OK**

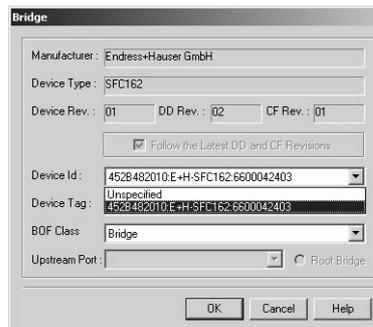

- 3 Click on the **Project View** workspace and **Export Tags...**, see Chapter 3.9
 - Open **Project File**, then press **Save Entire Configuration**, to save the project

3.11.3 Create the FOUNDATION Fieldbus live list

- 1 In the Fieldbus network workspace, right-click on the Field Controller (CO104) and select the option **Live List**

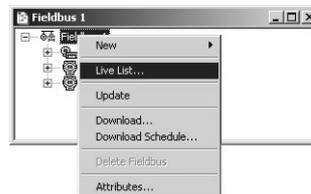


- 2 The Fieldbus live list is created

Tag	Id	Address
TT100	452B481200_007610041C4	0x18
FCV102	000E052328ND90000434007830	0x1A
CO104	452B482010E+H-SFC162-6600042...	0x10


- Check that all the devices in the project appear in the live list
- If this is not the case, check connections, power etc.

3.11.4 Assign the Fieldbus Device IDs


- 1 In the fieldbus workspace, right click on **TT100** and select **Attributes...**

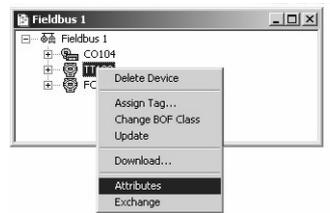

- The **Attributes** dialog opens
- 2 Open the drop-down menu of the **Device ID** and select the Field Controller that is associated with the displayed TAG (in our case TT100) - the serial number is on the nameplate

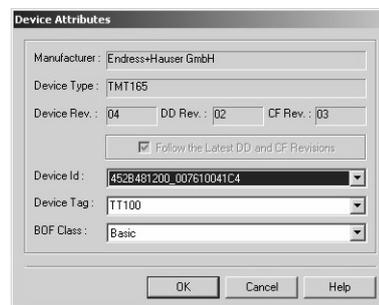


- Confirm your choice with **OK**
 - After a short period of time, the red cross disappears from the device in the Fieldbus network
- 3 Now repeat the process for the rest of the devices in the Fieldbus network (FT101, FCV102)
 - Your Fieldbus network should now look like this



- 4 Click on the **Project View** workspace and **Export Tags...**, see Chapter 3.9
 - Open **Project File**, then press **Save Entire Configuration**, to save the project

3.11.5 Assign the Device Tags

- 1 In the Fieldbus workspace, right-click on the bridge (CO104) and select **Assign Tag**

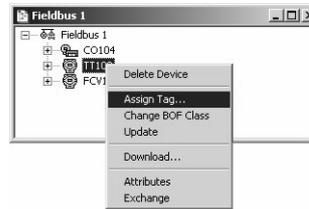

- 2 Application Designer transmits the change to the Fieldbus network via the Field Controller



- 3 The Field Controller transmits the change to the device
 - The device goes grey in the live list
 - The Field Controller initiates a new network scan
 - After about 1 - 2 minutes, the device goes black and appears with the new tag
- 4 Repeat Step 1 for all devices in the Fieldbus network
 - At the end of the process, the live list looks like this

The screenshot shows a window titled 'HI Live List - Fieldbus 1 (CO104 Port 1)'. It contains a table with three columns: 'Tag', 'Id', and 'Address'. The table lists three devices: TT100, FCV102, and CO104. The CO104 tag is marked with an asterisk, indicating it is the active device.

Tag	Id	Address
TT100	452B481200_007610041C4	0x18
FCV102	000E052328ND90000434007830	0x1A
* CO104	452B482010:E++SFC162:6600042...	0x10

3.11.6 Download the project




Note!


- The procedure below describes the initial download for the entire HSE network.
- Partial downloads can be made later from lower leaves, when changes are confined to this level
- Incremental downloads can be made to a running project by checking the boxes **Incremental Download** and **Compare Parameters**: Unaffected Local I/Os will hold their last values.

When the devices in the Fieldbus live list correspond to those configured in the project, the download can begin.


- 1 In the Project workspace right-click on **HSE Network 1** and select **Download**

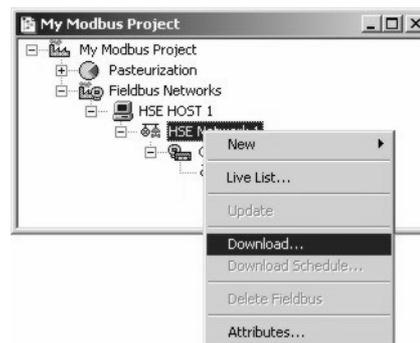

- 2 The **Download dialog** appears

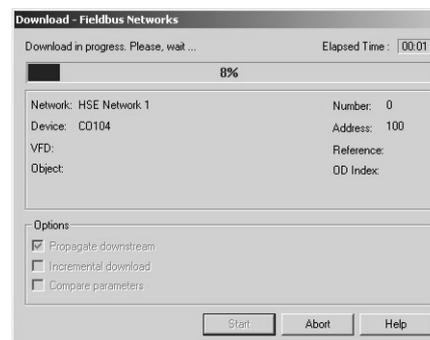

- Press **Start** to start the download
- A log at the bottom of the screen allows you to identify and non-critical download problems

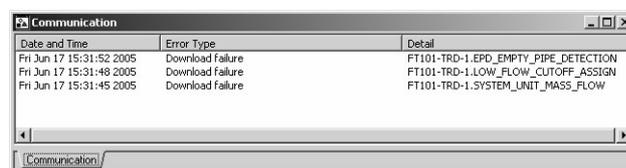


- 3 The download will be interrupted if the project encounters a critical problem, e.g.
 - The Project tags are not up-to-date => Chapter 3.9
 - The Device IDs have not been assigned correctly => Chapter 3.11.2, Chapter 3.11.4
 - The Device Tags have not been assigned => Chapter 3.11.5
- 4 When the download is successfully completed, the dialog is closed, and you are ready to start the Modbus and test the control strategy

3.12 Make the Modbus Connection


3.12.1 Start the Modbus

The Modbus must be started after the download (and restarted on every change in the Modbus configuration)


- 1 In the Fieldbus window, expand the Field Controller tree

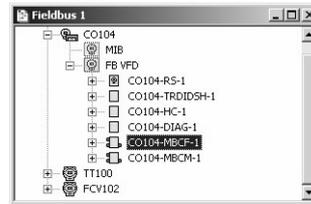

- 2 Right-click on the **CO104 -MBCF-1** block and select **On Line Characterization**

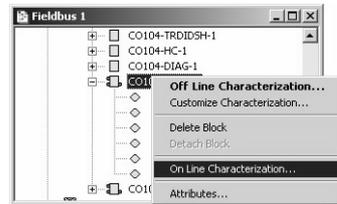

- 3 In the **On Line Characterization** dialog
 - Select **All** to display all parameters
 - Select the parameter **ON_APPLY**

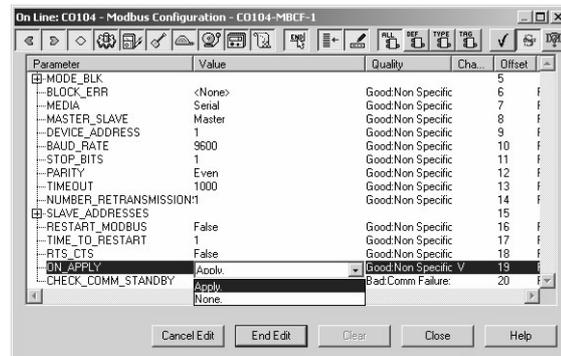


- 4 Click in the value space at the center of the line and open the drop-down menu
 - Select **Apply**
 - Click **End Edit** to confirm your choice
 - The parameter remains for two or three seconds, then reverts to **None**
 - The Modbus starts
 - Press **Close** to close the dialog

Note!


- This procedure must be repeated every time the Modbus configuration is changed

3.12.2 Check the control strategy


- 1 Click in the Control Strategy workspace (Temperature control) and press the button  in the menu toolbar – the control strategy goes "on-line"

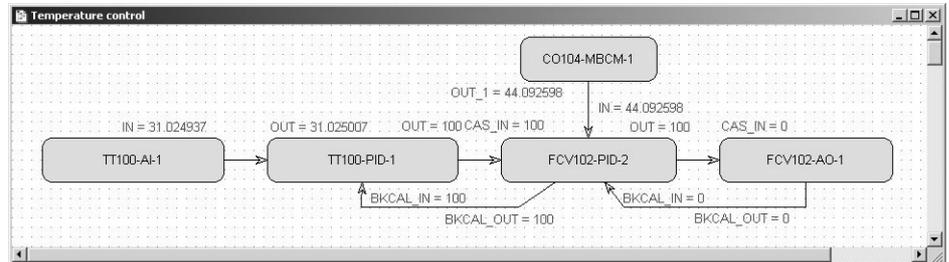

- Values appear in green when the status is good
 - Values appear in red if the status is bad – at this stage this is an indication of a Fieldbus configuration, a strategy configuration or a device parametrization error
- 2 Check that the loop is working by changing the Setpoint parameter in the temperature PID TT100
 - Double-click on the **Temperature PID block** TT100-PID-1, the **On-line Characterization** dialog appears
 - Press the **All** icon to reveal all parameters
 - Open the **SP** leaf and double-click in the space next to **Value**
 - Enter a new SP value – for $T > SP$, set $SP < T$ or vice versa
 - Click **End Edit** to set the parameter
 - Press **Close** to store the value (if you are prompted – answer with **Yes**)

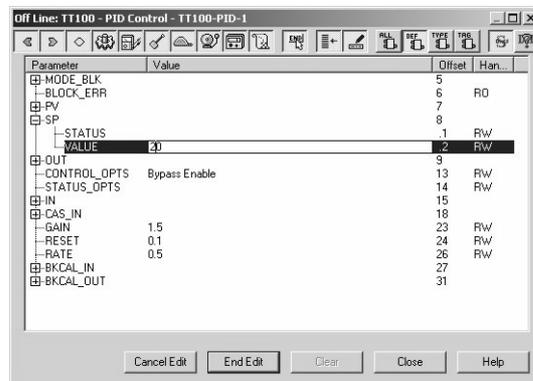

- 3 Now check that the control loop has responded properly

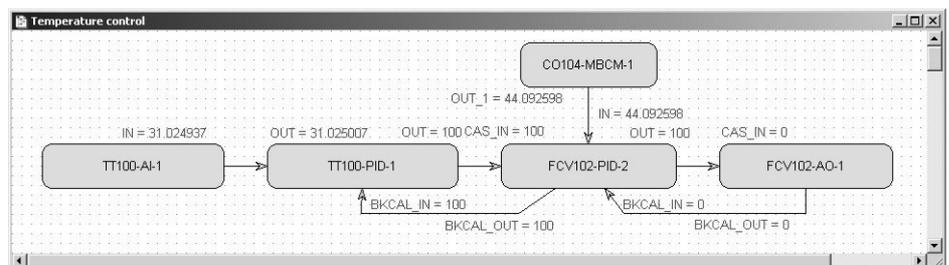

3.13 Modify the project

3.13.1 On-line characterization

Once the project is on-line you may want to change parameters to e.g. tune the control-loop or eliminate configuration errors. With the exception of the **SP** (PID block) and **Apply** (MBCF block) parameters, the function block must be put out of service before the parameter is changed:

- 1 In the Control strategy workspace double-click on the function block you want to modify, or in the Fieldbus network or Control module workspace, right-click on the function block and select **On-line Characterization**
- 2 The function block **On-line Characterization** dialog appears:
 - Press the **All** icon to reveal all parameters
 - Open the **Mode** leaf and double-click in the space next to **Target**
 - Set the Target to **OOS** (Out of Service)
 - Click **End Edit** to set the parameter
- 3 Change the parameters you wish to modify
 - If appropriate, open the parameter leaf and double-click in the space next to the parameter you require
 - Enter the new parameter or select it from the drop-down menu
 - Click **End Edit** to set the parameter
 - Repeat the procedure for all the parameters you wish to modify
- 4 Put the function block back into standard operating mode
 - Open the **Mode** leaf and double-click in the space next to **Target**
 - Set the Target back to the original value (**Auto** (Automatic) or **Cas** (Cascade))
 - Click **End Edit** to set the parameter
 - If you have modified the Modbus configuration (MBCF or MBCM blocks), start the Modbus again with the ON-APPLY parameter, see Chapter 3.12.1
 - Check that the **Mode** really changes to the Target Mode (failure to do so indicates a configuration error)
 - Press **Close** to store the values (if you are prompted - answer with **Yes**)
- 5 Click on the **Project View** workspace and **Export Tags...**, see Chapter 3.9
 - Open **Project File**, then press **Save Entire Configuration**, to save the project
- 6 Put the Control strategy back "on-line" to check the results of your modification, see Chapter 3.12.2.

3.13.2 Off Line characterization

You may prefer to change parameters off-line, e.g. when modifying the control strategy or adding new functions to the project.

- 1 If you are on-line, press the **Off-line** button  in the menu toolbar alternatively, in the FOUNDATION Fieldbus network or Control module workspace, right-click on the function block and select **Off Line Characterization**
 - The function block **Off Line Characterization** dialog appears
- 2 Change the parameters you wish to modify
 - If appropriate, open the parameter leaf and double-click in the space next to the parameter you require
 - Enter the new parameter or select it from the drop-down menu
 - Click **End Edit** to set the parameter
 - Repeat the procedure for all the parameters you wish to modify
 - Press **Close** to store the values
- 3 Click on the **Project View** workspace and **Export Tags...**, see Chapter 3.9
 - Open **Project File**, then press **Save Entire Configuration**, to save the project
- 4 Press the **On-line** button  in the menu toolbar to go on-line again
- 5 Download the modified project
 - In the Project workspace right-click on **HSE Network 1** and select **Download**
 - Follow the procedure in Chapter 3.11.6.
- 6 Start the Modbus with the **ON_APPLY** parameter, see Chapter 3.12.1
- 7 Put the Control strategy back "on-line" to check the results of your modification, see Chapter 3.12.2.


3.14 Export the configuration

The project configuration can be exported to an existing ODBC file data source, e.g. Oracle, a machine database, e.g. Excel to provide a record of the current status of the project or to an XML sheet for viewing with a browser.


3.14.1 File data source folder

The file data source must have been created before the export.

- 1 In the Project window, right-click on the Project icon and select **Export Configuration:**

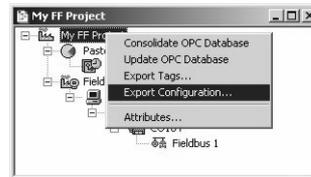

- 2 The Select Data Source dialog box appears
- 3 In the File Data Source folder, select the source that describes the driver that you wish to connect to. You can use any file data source that refers to an ODBC driver which is installed on your machine.
 - Use the **New...** button and **Look In** dropdown menu to browse or
 - Click the data source icon to select the driver:

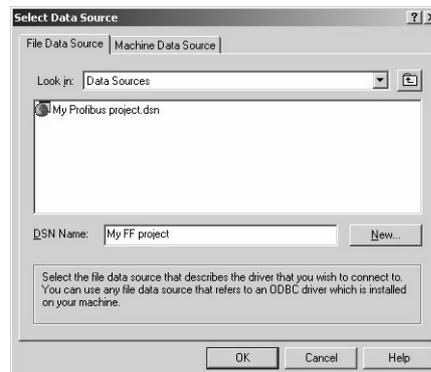


- Press **OK** to make the connection

3.14.2 Machine data source folder


The Machine Data Source is specific to the machine, and cannot be shared. "User" data sources are specific to a user on the machine; "System" data sources can be used by all users on the machine, or by a system-wide service. The Machine Data Source must have been created before export.

Procedure


- 1 In the Project window, right-click on the Project icon and select **Export Configuration:**

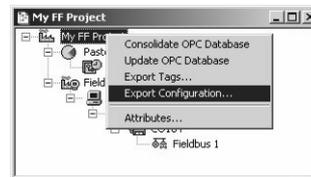

- 2 The Select Data Source dialog box appears
 - Click on the **Machine Data Source** tab to open the folder
 - Double-click the data source name to select the machine, e.g. Excel:

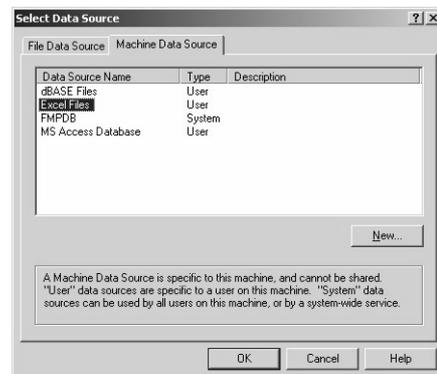

- 3 The Select Workbook dialog box will appear:
 - Select the folder where the data file is and double-click the workbook icon.

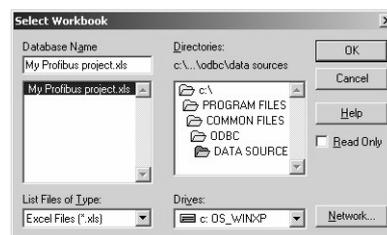


- Your project configuration will be exported to the workbook file.
 - A message box appears on completion - press OK
- 4 Open the Excel file to check the result:


	A	B	C	D	E	F	G	H	I
1	BlockTag	BlockType	Manufacturer	DeviceType	DeviceRevision	DDRevision	StartingTimeOffset	ExecutionTime	ControlModule
2	TT100-AI-1	Analog Input	Endress+Hauser GmbH	TMT165	04	02	0	87	Temperature c
3	TT100-PID-1	PID Control	Endress+Hauser GmbH	TMT165	04	02	0	200	Temperature c
4	FT101-AI-2	Analog Input	Endress+Hauser GmbH	Promass83	02	02	0	50	Temperature c
5	FCV102-AO-1	Analog Output	Metso Automation	METSO FBK Interface	02	01	0	30	Temperature c
6	FCV102-PID-2	PID Control	Metso Automation	METSO FBK Interface	02	01	0	50	Temperature c
7									

3.14.3 XML file

- 1 Click in the Project workspace and select **Project File => Export => Configuration as XML**
 - The **Export Configuration as XML dialog** appears

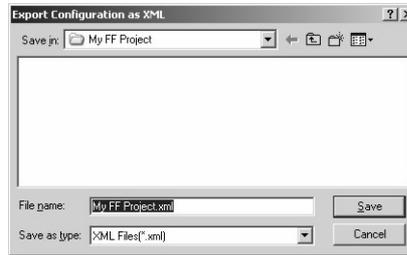

- 2 Enter a **File Name** and **Save In** location, then press **Save**
 - The project is saved as an XML file at the selected location

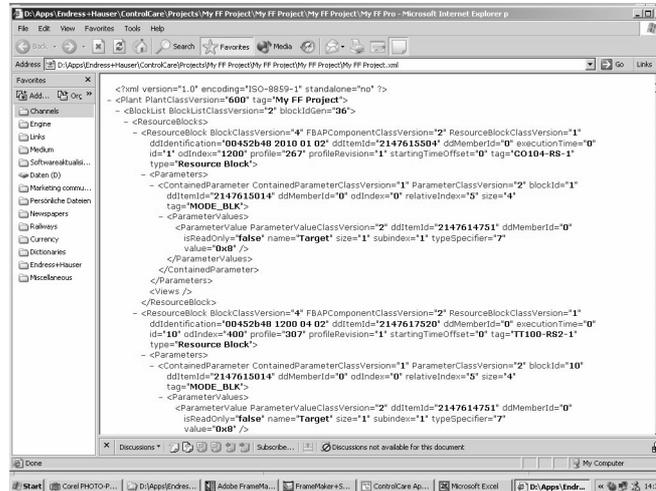

3.15 Close Application Designer

When you have completed your session, close Application Designer

- 1 If you are on-line, press the **Off-line** button  in the menu toolbar
- 2 If you have made any modifications while you were on line, you will be prompted to store them
 - If appropriate answer with **Yes**
- 3 Close the project by clicking on **Project File => Close**
- 4 Exit Application Designer by clicking on **Project File => Exit**
- 5 The Field Controller continues to operate with the project configured according to the last download/on-line correction
 - If you switch off the Field Controller, the project remains stored in its memory (back-up switch must be set as described in BA021S/04/en, Field Controller, Hardware Installation)
 - It is initialized and re-executed as soon as the Field Controller is switched on again

3.15.1 Reconnecting

Provided your computer is operating in the same IP address domain as the Field Controller, you can reconnect at any time.

- 1 Start up Application Designer and select the Project you require
- 2 Press the **On-line** button  in the menu toolbar
- 3 Expand the various workplaces as required
- 4 Click in the **Control Strategy** workspace and press the button  in the menu toolbar – the control strategy goes "on-line" with the last configuration that was downloaded.

4 Field Controller as Modbus Slave

4.1 Task Description

This part of tutorial describes all steps necessary for setting up the Field Controller as a Modbus Control Slave. It does not aim to give an exhaustive account of Application Designer functions, but rather shows you one of a number of methods to reach your goal. The tags and names used in the tutorial are imaginary and will be different in a proper application. A full description of Application Designer functions is to be found in Application Designer Overview BA017S/04/en and Drawing Tool BA032S/04/en. Function block descriptions are to be found in BA022/04/en, Function Block manual.

4.1.1 Application

For this part of the tutorial it is assumed that a Controller acting as a Modbus master acquires a temperature value from a FOUNDATION Fieldbus device through the Field Controller, which acts as a Modbus slave. The Modbus master returns a control signal to a FOUNDATION Fieldbus positioner, which in turn reports its new position to the Modbus controller. It is assumed that all control is done in the Modbus master, so the FOUNDATION Fieldbus network supplies and receives values only. The corresponding control strategy is shown in Fig. 4-1.

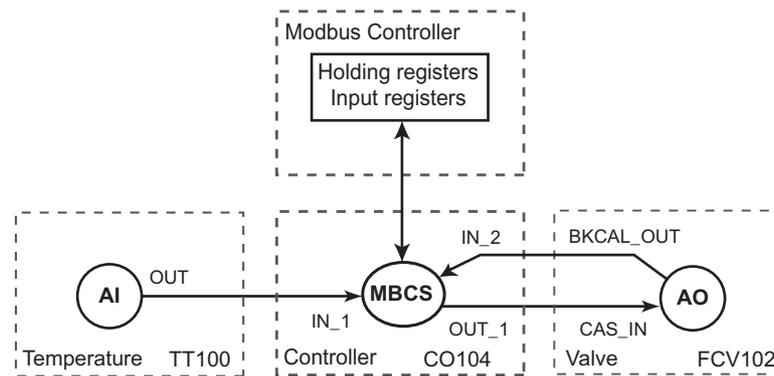


Fig. 4-1 Cascade control strategy for heat exchanger application

Since it is not the object of this tutorial to describe the programming of a Modbus controller, the control function has been simulated by the ModSim32 software. This provides a simple means of testing the application and checking what is being transmitted across the Modbus interface.

4.1.2 Network

The network is assumed to be constructed as shown in Fig. 4-2.

- The Modbus master is simulated by the ModSim32 application
- The valve positioner is a Metso ND9103FN
- The temperature transmitter TMT165

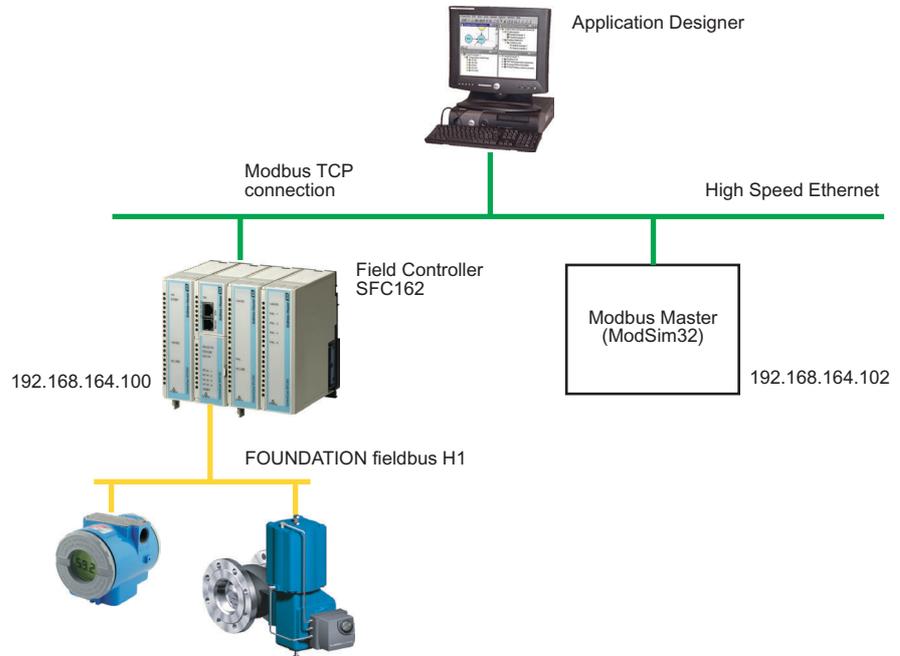


Fig. 4-2 Network for application example

4.1.3 Installation and commissioning

Before you can start this part of the Modbus tutorial, Application Designer must be installed on your computer, the SFC 162 FOUNDATION Fieldbus Controller installed and commissioned and a connection made to your computer. Instructions on how to do this are to be found in:

- Operating Instructions BA020S/04/en, Getting Started
- Operating Instructions BA021S/04/en, Field Controller: Hardware Installation
- Operating Instructions BA035S/04/en, Field Controller: Commissioning and Configuration

4.1.4 Device ID and tag

For a FOUNDATION Fieldbus system, each device that communicates has a unique bus address. Addresses are assigned automatically during the start-up of the system on the basis of the device ID. The device ID is a unique identifier that is based on a Manufacturer ID and the serial number of the device. When the project goes online, the actual device IDs must be assigned to virtual devices that have been planned in Application Designer by using the Assign Tags procedure.

To aid the offline engineering of the network, it is necessary to keep a record of the measuring point tags (device tags), often as an Excel sheet. Measuring point tags are used in P&I diagrams to indicate the type of measurement or action performed at a particular location in a process. Table 4-1 below provides an example of how this might look for the application at hand.


Area	Process Cell	Device	Vendor	Tag	Unit	Task
Pasteurization	Heat Exchanger	TMT165	E+H	TT100	°C	Product temperature
Pasteurization	Heat Exchanger	ND9103FN	Metso	FCV102	%	Steam valve positioner
Pasteurization	Heat Exchanger	SFC162	E+H	CO104		Field Controller acting as Modbus slave

Tab. 4-1: Measuring point tag list for tutorial application


4.2 Create a project

4.2.1 Create the project and add the fieldbus

- 1 Following the instructions in Chapter 3.2 create a new project, e.g. My Modbus Slave Project
- 2 Following the instructions in Chapter 3.3, set the preferences
- 3 Following the instructions in Chapter 3.4, add the bridge, fieldbus and devices
 - In this case, do not add the MBCF and MBCM blocks to the controller yet.
- 4 Your project should now look something like this:

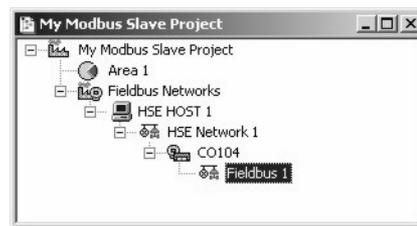


and the fieldbus like this

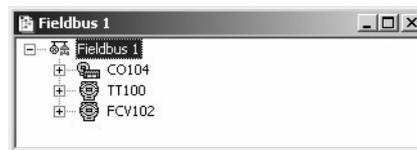

4.2.2 Add the Modbus blocks

- 1 Expand the Field Controller (CO104) leaf on the Fieldbus tree and add the Modbus blocks MBCF and MBCS
 - Right-click on the FB VFD leaf and select New Block
 - Select the Modbus Configuration block
 - Repeat and select the Modbus Control Slave block
- 2 The Fieldbus tree now looks like this

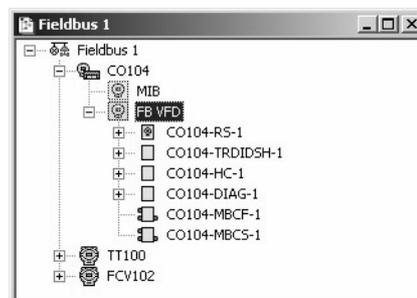


- 3 Open **Project File**, then press **Save**, to save the project


4.3 Configure the devices

4.3.1 MBCF Modbus Configuration block


- 1 In the Fieldbus 1 window, right-click on the Field Controller function block **CO104-MBCF-1** and select **Off Line Characterization**

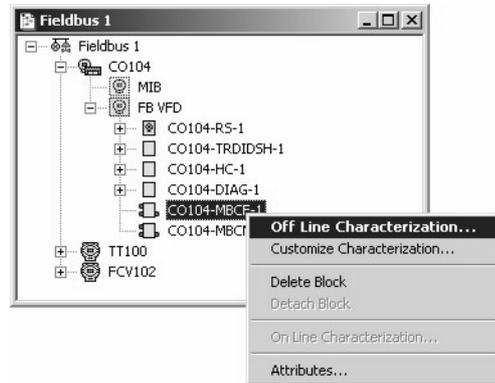

- 2 The **Offline Characterization** dialog opens: Press **All** to show all parameters

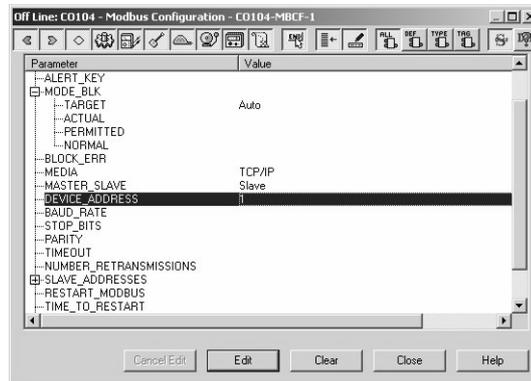

- 3 Set the following parameters by double-clicking in the middle of the parameter line, entering or selecting the parameter from the drop-down menu, and clicking End Edit to register the change (MBCF block parameters are described in Chapter 6.1):
 - **MODE_BLK TARGET** = Auto
 - **MEDIA** = TCP/IP
 - **MASTER_SLAVE** = Slave
 - **DEVICE_ADDRESS** = 1
- Click **Close** to close the dialog: the parameters are added to the MBCF function block

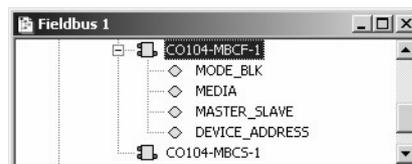

4.3.2 MBCS Modbus Control Slave block

The MBCS function block allows fieldbus and Modbus data to be exchanged through 16 Modbus registers: if required, the register addresses in the Field Controller can be calculated from the LOCAL_MOD_MAP table, see Chapter 6.2. The block offers:

- Four OUT channels for reading analog values from the Field Controller Modbus registers
- Four OUT_D channels for reading discrete values from the Field Controller Modbus registers
- Four IN channels for writing analog values to the Field Controller Modbus registers
- Four IN_D channels for writing discrete values to the Field Controller Modbus registers

The SCALE_CONV_XXX parameter allows each channel to be individually configured for scaling and data type. If more than four registers of a particular type are required, up to 16 MBCM blocks can be created: in this case the various blocks are identified by the parameter LOCAL_MOD_MAP. By default LOCAL_MOD_MAP = 0, valid range 0 – 15.

For the tutorial we require the IN_1, IN_2 and OUT_1 channels. When LOCAL_MOD_MAP is set to zero, the data will be mapped to the registers in Table 4-2.

Parameter	Channel	Register	Data type	Access
Temperature	IN_1	40001	Float	Write
Status		40017		
Positioner	OUT_1	40009	Float	Read
Status		40021		
Back calculation	IN_2	40003	Float	Write
Status		40018		

Tab. 4-2: Modbus registers for exchange of data

By default, the Field Controller sends its float number with the bytes order 1-0-3-2 and not in the sequence 3-2-1-0. This corresponds to the DATA_TYPE "float".

The values mapped to the Field Controller or sent to a Modbus device register can be scaled. The parameters:

- FROM_EU_0
- FROM_EU_100
- TO_EU_0
- TO_EU_100


allow a conversion from one set of engineering units to a second set of engineering units, by simply entering the lower and upper limit values of each set. In our example, no scaling will be done and the default parameters 0 and 1 entered for both "TO" and "FROM" parameters.

The STATUS_OUT_Dx and STATUS_OUTPUT elements used in the OUT parameters define the following rules for OUTPUT STATUS parameters:


- If the option "Set by master" is used, the output status will behave exactly as the Fieldbus protocol works, in other words, the status will reflect the value which the master is writing but if after TIMEOUT (defined in MBCF block) the status is not updated, this status will be forced to BAD COMMUNICATION.
- If the user defines this element with anything other than "Set by master", this value will be reflected in output status, while communication OK, otherwise the status goes to BAD COMMUNICATION..

Procedure

- 1 Right-click on the **CO104-MBCS-1** block and open the **Off Line Characterization** dialog

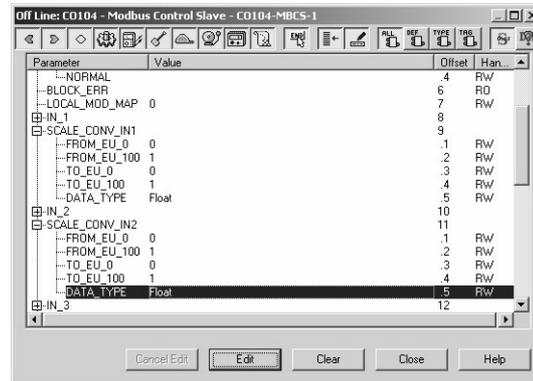

- 2 Click All to reveal all parameters and enter the following parameters by double-clicking in the middle of the parameter line, entering or selecting the parameter from the drop-down menu, and clicking End Edit to register the change:
 - **MODE_BLK TARGET** = Auto
 - **LOCAL_MOD_MAP** = 0
- 3 Now set the following **SCALE_LOC_CONV1** parameters for the **IN_1** and **IN_2** channels:
 - **FROM_EU_0** = 0
 - **FROM_EU_100** = 1
 - **TO_EU_0** = 0
 - **TO_EU_100** = 1
 - **DATA_TYPE** = Float
- 4 Set the following **SCALE_LOC_CONV1** parameters for the **OUT_1** channel:
 - **FROM_EU_0** = 0
 - **FROM_EU_100** = 1
 - **TO_EU_0** = 0
 - **TO_EU_100** = 1
 - **DATA_TYPE** = Float
 - **STATUS_OUTPUT** = "Good_Cascade::NonSpecific:NotLimited"
- 5 Press **Close** to close the Off Line Characterization dialog. You should now see the parameters attached to the MBCM block:

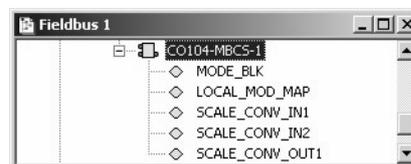

- 6 Open **Project File**, then press **Save**, to save the project.

4.3.3 Configure the Fieldbus devices

- 1 Configure the devices according to Tables 4-3 and 4-4 as described in Chapter 3.5.3 and 3.5.4 respectively.
- 2 Open **Project File**, then press **Save**, to save the project.

TMT165

Table 4-3 shows the parameters that must be set in the TMT165 transducer block

Parameter	Function	Temperature TT100
MODE_BLOCK/TARGET	Normal operating mode of block	Auto
PRIMARY_VALUE_TYPE	Measuring method for primary process value <ul style="list-style-type: none"> ■ Process temperature ■ Differential temperature ■ Back up 	Process temperature
SENSOR_TYPE	Type of sensor connected to the transmitter <ul style="list-style-type: none"> ■ All types of standardized temperature sensors 	Pt 100 IEC
SENSOR_CONNECTION	Way in which the sensor is connected <ul style="list-style-type: none"> ■ Four wires ■ Three wires ■ Two wires ■ Double two wires (2nd transducer block must be configured) 	Four wires

Tab. 4-3: Basic parameters for TMT165 transducer block

ND9103FN

Rotary valve parameters are included in Table 4-4.

Parameter	Function	Positioner FCV102
MODE_BLOCK/TARGET	Normal operating mode of block	Auto
VALVE_TYPE	Type of valve the positioner is actuating <ul style="list-style-type: none"> ■ Select from drop-down menu 	Rotary
FINAL_VALUE_RATE_DN	Maximum travel rate in closing direction <ul style="list-style-type: none"> ■ 0 = parameter not in use 	0
FINAL_VALUE_RATE_UP	Maximum travel rate in opening direction <ul style="list-style-type: none"> ■ 0 = parameter no in use 	0
POSITIONER_FAIL_ACTION	Action of position on loss of electrical power or reception of an output signal with a bad status <ul style="list-style-type: none"> ■ Select from drop-down menu 	Close
POS_SENSOR_ROT	Relationship between valve action and position sensor rotation <ul style="list-style-type: none"> ■ Select from drop-down menu 	Standard: Clockwise to close
DEAD_ANGLE_COMP	Dead angle for segment and rotary valves	0
ACT_TYPE	Type of positioner action <ul style="list-style-type: none"> ■ Select from drop-down menu 	Double-acting actuator
PERFORMANCE_LEVEL	Target performance level of valve position control Select from drop-down menu	Optimum
CHAR_TYPE	Type of linearization <ul style="list-style-type: none"> ■ Select from drop-down menu 	No characterization

Tab. 4-4: Basic parameters for Metso ND9103FN transducer block

4.4 Create the Control Strategy


Having created a physical view of the process, the next step is to create control strategy. This is done described in Section 3.6.

4.4.1 Add a Process Cell

- 1 Click on the "Area 1" leaf in the project and select **Attributes...**
 - The **Attributes** dialog box appears
 - Enter a name for the area, e.g. Pasteurization (see Table 3-1, Chapter 3.1.4)
 - Click **OK** to store your changes
- 2 Click on the Area leaf again and select **New Process Cell..**
 - The **Process Cell** dialog box appears
 - Enter a name for the process cell, e.g. Heat Exchanger (see Table 3-1)
 - Click **OK** to store your changes
- 3 Open **Project File**, then press **Save**, to save the project.

4.4.2 Add a Control Module


- 1 Right-click on the Process Cell leaf you just created and select **Expand**
 - A new window with the name of the leaf opens
- 2 Right-click on the top leaf and select **New Control Module**
 - The **Control Module** dialog box appears
 - Enter a name for the control module, e.g. Temperature Control (see Table 3-1)
 - Click **OK** to store your changes
- 3 The project looks something like this

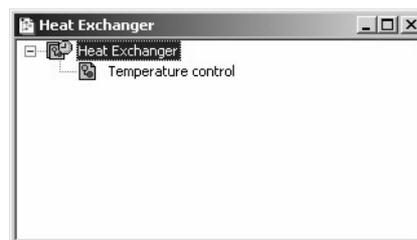

- 4 Open **Project File**, then press **Save**, to save the project.

4.4.3 Create the function blocks

- 1 Double-click on the control module leaf or right-click and select **Expand** to open the **Control Strategy** workspace - this has the same name as the leaf
- 2 Press the Function Block button  in the toolbar and click in the workspace
 - The **New Block** dialog appears
 - Select the **Manufacturer** = Endress+Hauser
 - Select the **Device Type** = TMT165
 - Select the **Block Type** = Analog Input
 - Press **OK** to create the function block
- 3 The block now appears in the strategy window with the default name
- 4 Repeat Steps 2 and 3 for the Positioner AO block
 - Positioner AO
 - **Manufacturer** = Metso Automation
 - **Device Type** = FBLK Interface
 - **Block Type** = Analog Output
- 5 The flow value is supplied by the MBCS block which you have already created
 - In the **Fieldbus 1** window expand the **CO104** leaf and click on **CO104-MBCS-1**
 - Drag and drop the block into the control strategy window
- 6 The control strategy now looks like this

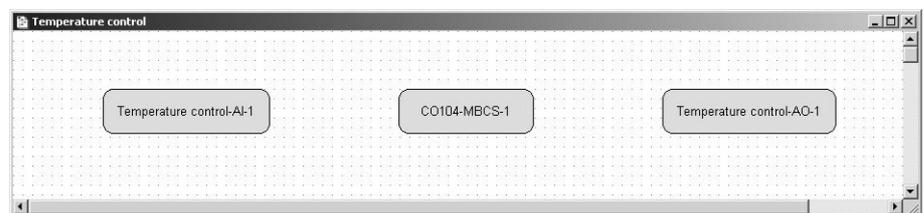


- 7 Open **Project File**, then press **Save Entire Configuration**, to save the project

Note

- In the tutorial we created the MBCS block together with the MBCF block. It is also possible to create the MBCS block in the strategy window as we have done with the AI and AO blocks, and then drag and drop it to the Fieldbus, see Chapter 3.8.

4.4.4 Add the Function Block links

- 1 In the Control Strategy workspace position the blocks according to your strategy
- 2 Click on **Function Block Link**  button in the tool bar, the cursor changes to a cross
- 3 Select the **Temperature AI block** with the cross: the **Output Parameter Selection** dialog appears
 - Click the box next to **OUT** – it changes color – then click on **OK**
 - The **Output Parameter Selection** dialog closes
 - The cursor is now connected to a blue dotted line
 - Place the Cursor in the **CO104-MBCS-1** block and click to make the link
 - When the link is made, the Input Parameter Selection dialog for the PID block appears
 - Click the box next to **IN_1** – it changes color – then click on **OK**
- 4 Repeat steps 2 to 3 and make the following links between the function blocks
 - CO104-MBMS-1 to Valve AO = **OUT_1** to **CAS_IN**
 - Valve AO to CO104-MBMS-1 = **BKCAL_OUT** to **IN_2**
- 5 Your Control Strategy now looks something like this

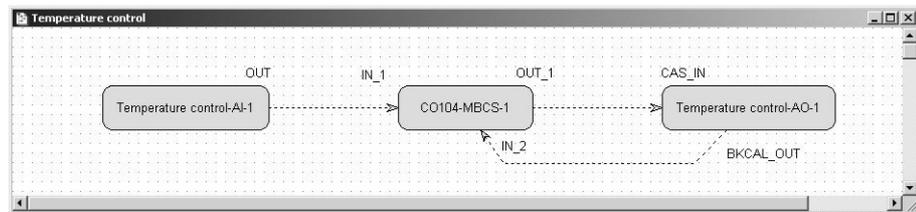

- 6 Open **Project File**, then press **Save Entire Configuration**, to save the project.

4.5 Configure the strategy

4.5.1 Configure the blocks

- 1 In the Control strategy workspace, double-click on the **Temperature control AI-1** block
Set the parameters in Table 4-5 as described in Chapter 3.7.2
- 2 In the Control strategy workspace, double-click on the **Temperature control AO-1** block
Set the parameters in Table 4-6 as described in Chapter 3.7.6
- 3 Open **Project File**, then press **Save**, to save the project

Analog Input parameters

Parameter	Function	Temperature TC100
MODE BLOCK/TARGET	Normal operating mode of block	Auto
XD_SCALE/EU_100 XD_SCALE/EU_0 XD_SCALE/UNITS_INDEX	Upper range limit for process variable Lower range limit for process variable Unit of process variable	850 -200 °C
OUT_SCALE/EU_100 OUT_SCALE/EU_0 OUT_SCALE/UNITS_INDEX	Upper range limit for output variable Lower range limit for output variable Unit of output variable	100 0 %
CHANNEL	Output channels of Transducer Block assigned to Analog Input Block. <ul style="list-style-type: none"> ■ TMT = 1 or 2 depending on whether one or two sensors are connected ■ Promass = 1 to 7, depending on which type of process value is required 	1 = 1 sensor
L_TYPE	Selects the type of linearisation for the input value. <ul style="list-style-type: none"> ■ Direct: PV value = OUT value, Identical XD_SCALE and OUT_SCALE ■ Indirect: PV value scaled to OUT value ■ Indirect Square Root: as Indirect but scaling with root function 	Indirect
PV_FTIME	Output damping constant (in seconds).	1

Tab. 4-5: Basic parameters for Analog Input block

Analog Output parameters


Parameter	Function	Positioner FCV102
MODE BLOCK/TARGET	Normal operating mode of block	Cas
PV_SCALE/EU_100 PV_SCALE/EU_0 PV_SCALE/UNITS_INDEX	Upper range limit for process variable Lower range limit for process variable Unit of process variable	100 0 %
XD_SCALE/EU_100 XD_SCALE/EU_0 XD_SCALE/UNITS_INDEX	Upper range limit for output variable Lower range limit for output variable Unit of output variable	100 0 %
CHANNEL	Defines the signal configuration between the AO block and transducer block.. <ul style="list-style-type: none"> ■ 1 = AO, valve control ■ 2 = AO, no transducer connected 	1 = valve control
SHED_OPT	Behaviour when shedding from remote mode	Normal shed, normal return

Tab. 4-6: : Basic parameters for Analog Output block

4.5.2 Assign the Function Blocks to the Devices

Now assign the function blocks in the control strategy to the devices where they are to run. The order of assignation determines the order of executions (can be changed by drag&drop).

- 1 Expand the **Fieldbus** workspace (Fieldbus 1) and the **Process Cell** workspace (Heat exchanger)
- 2 Now drag and drop the **Temperature control-AI-1** block to the greyed Function Block Application leaf of the TT100 tree
 - When you drop the block, it is attached to tree
 - Its name changes to TT100-AI-1 in both views
 - You have now assigned the Temperature AI block to the temperature transmitter
- 3 Repeat Step 2 for the other function block
 - **Temperature control-AO-1** => FCV102
- 4 Your project now looks like this

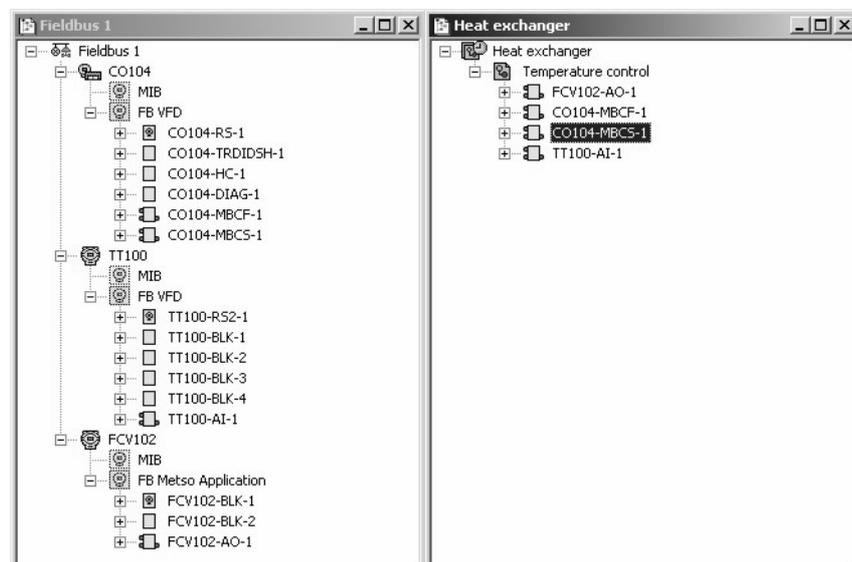

- 5 Open **Project File**, then press **Save**, to save the project.

4.5.3 Export tags


- 1 Active the project view by clicking in its workspace.
- 2 Right click on the project name, a context menu appears
 - Select the option **Export Tags...**
 - The Export Tags dialog confirms the successful export
 - Press **OK** to close the dialog
- 3 Open **Project File**, then press **Save**, to save the project

4.6 Connect to the Field Controller

After the Field Controller and other components have been physically installed in the network, connection must be established as described in Chapter 3.10.

4.6.1 Change the IP address of your computer

- 1 Open the Windows Control Panel by pressing **Start => Settings => Control Panel** and choose the option Network Connections
- 2 Double-click on **Local Area Connection** and in the Local Area Connection Status dialog select **Properties**
- 3 Select **Internet Protocol TCP/IP** then select **Properties** again
- 4 Note the original property settings (e.g. make a screen shot and store it in a Word document) of so that they can be restored at end of the operation.
- 5 Change the IP address and the Subnet Mask of the computer, so that it is in the same subnet as the Field Controller.
 - IP Address 192.168.164.XXX and network mask (Subnet Mask) 255.255.255.0.
 - Do not use the addresses 192.168.164.100 or 101, as these are reserved as default addresses for the Field Controllers SFC162 and SFC173 respectively

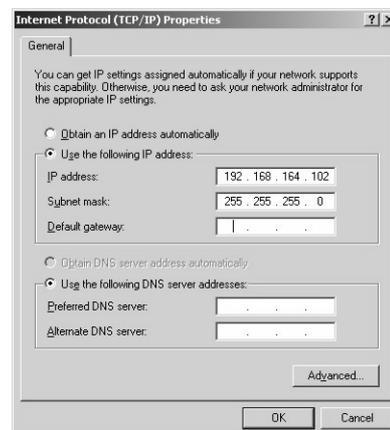

- Click on the OK button to confirm your settings

4.6.2 Set the Field Controller IP address

- 1 Now call FC Tools: **Programs =>Endress+Hauser=>ControlCare=>Tools=>FC Tools**
- 2 Choose the Field Control (OPC) Server path, default **Local**, then press **Connect**
- 3 Select the desired Field Controller module option Module using its serial number as reference. The serial number is printed on the inside of the module door.
- 4 Press the **Hold** button to interrupt the firmware that is being executed in the module
 - A confirmation window appears, press **Yes** to continue
 - Any application running on the Field Controller will be stopped at this point
- 5 Check that the HOLD LED on the Controller module is lit, then press Connect to continue with the procedure.
- 6 Reselect the desired Controller module, then click on the IP Properties button. Now check the option **Specify an IP address**, then enter the IP Address and the Subnet Mask
 - Answer **Yes** to the confirmation box
 - Now enter the Field Controller address given to you by your system administrator (in our example we have kept the default address 196.168.164.100)
 - Make a note of the IP addresses and the corresponding Controller serial number. This will help in the identification and diagnosis of possible faults.
 - Click on OK to finish the operation
- 7 Now change the address of your computer as described in Chapter 3.10 to the new domain, so that it can continue to communicate with the Field Controller at its new address: (Note: if the address domain has not changed, the computer address does not need resetting)
 - **Start =>Settings =>Control Panel =>Network Connections**
 - **Local Area Connection => Properties**
 - **Protocol (TCP/IP)=>Properties**
 - Enter an unused IP address and the subnet work address of the new domain
 - Press **OK** to finish the process
- 8 Return to FC Tools and click on Refresh
- 9 When the Refresh is complete, press Run to start the execution of the Field Controller firmware
 - Confirm the action with **Yes**
- 10 Check that the HOLD LED on the Field Controller has extinguished, then press Close.
- 11 The Computer is now connected to the Field Controller

4.7 Go online

Now go online as described in more detail in Chapter 3.11.

4.7.1 Create the HSE live list

Once the Computer and Field Controller are able to communicate with each other, the connection to the network can be checked by creating a live list.


- 1 Press the **On-Line** button  in the menu toolbar
 - The project goes on on-line
 - Red crosses appear against the Controller and Fieldbus network in the Project workspace
- 2 In the Project workspace, right click on **HSE Network** and select **Live List**
 - A live list is generated of the devices on the HSE network



Tag	Id	Address
CO104	452B482010:E+H-SFC162:6600042...	0x64
HSE HOST 1	0000000001:FF-HSE HOST:000000001	0x66

4.7.2 Assign the HSE Device IDs


- 1 In the project workspace, right click on the **Field Controller** (CO104) and select **Attributes...**
 - The **Attributes** dialog opens
- 2 Open the drop-down menu of the **Device ID** and select the Field Controller that is associated with the displayed TAG (in our case CO104) – the serial number is on the front panel

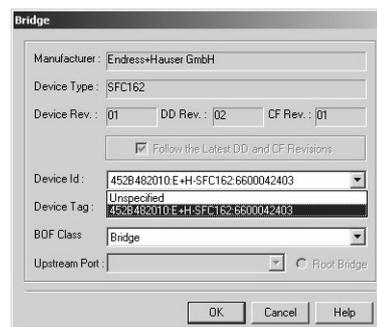

- Do this even though the correct ID is already displayed – the program expects it!
 - Confirm your choice with **OK**
- 3 Click on the **Project View** workspace and **Export Tags...**, see Chapter 3.10
 - Open **Project File**, then press **Save**, to save the project

4.7.3 Create the FOUNDATION Fieldbus live list

- 1 In the Fieldbus network workspace, right-click on the Field Controller (CO104) and select the option **Live List**
- 2 The Fieldbus live list is created

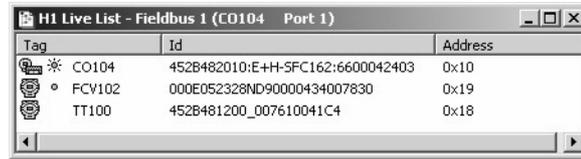


Tag	Id	Address
CO104	452B482010:E+H-SFC162:6600042403	0x10
FCV102	000E052328ND90000434007830	0x19
TT100	452B481200_007610041C4	0x18

- Check that all the devices in the project appear in the live list
- If this is not the case, check connections, power etc.

4.7.4 Assign the Fieldbus Device IDs

- 1 In the fieldbus workspace, right click on **TT100** and select **Attributes...**
 - The **Attributes** dialog opens

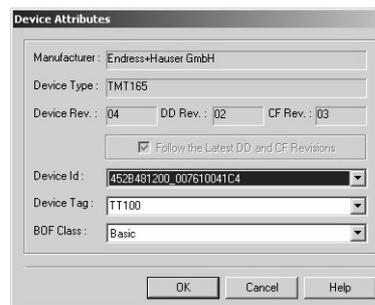

Device Attributes

Manufacturer: Endress+Hauser GmbH

Device Type: TMT165

Device Rev.: 04 DD Rev.: 02 CF Rev.: 03

Follow the Latest DD and CF Revisions

Device Id: 452B481200_007610041C4

Device Tag: TT100

BDF Class: Basic

OK Cancel Help

- 2 Open the drop-down menu of the **Device ID** and select the Field Controller that is associated with the displayed TAG (in our case TT100) – the serial number is on the nameplate
 - Confirm your choice with **OK**
 - After a short period of time, the red cross disappears from the device in the Fieldbus network
- 3 Now repeat the process for the valve positioner (FCV102)
- 4 Click on the **Project View** workspace and **Export Tags...**, see Chapter 3.10
- 5 Open **Project File**, then press **Save**, to save the project

4.7.5 Assign the Device Tags

- 1 In the Fieldbus workspace, right-click on the bridge (CO104) and select **Assign Tag**
- 2 Application Designer transmits the change to the Fieldbus network via the Field Controller
- 3 The Field Controller transmits the change to the device
 - The device goes grey in the live list
 - The Field Controller initiates a new network scan
 - After about 1 - 2 minutes, the device goes black and appears with the new tag
- 4 Repeat Step 1 for all devices in the Fieldbus network

4.7.6 Download the project




Note!


- The procedure below describes the initial download for the entire HSE network.
- Partial downloads can be made later from lower leaves, when changes are confined to this level
- Incremental downloads can be made to a running project by checking the boxes **Incremental Download** and **Compare Parameters**: Unaffected Local I/Os will hold their last values.

When the devices in the Fieldbus live list correspond to those configured in the project, the download can begin.

- 1 In the Project workspace right-click on **HSE Network 1** and select **Download**

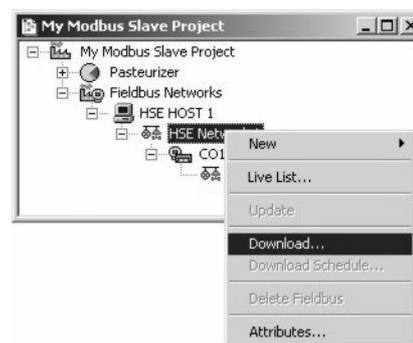

- 2 The **Download dialog** appears

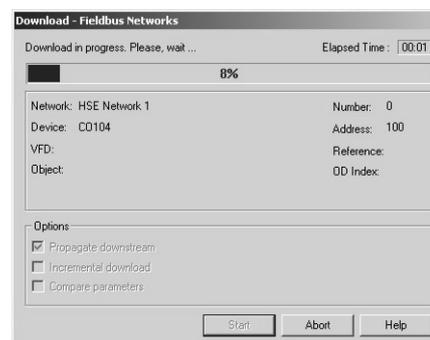

- Press **Start** to start the download
- A log at the bottom of the screen allows you to identify and non-critical download problems

- 3 The download will be interrupted if the project encounters a critical problem, e.g.

- The Project tags are not up-to-date => Chapter 3.10
- The Device IDs have not been assigned correctly => Chapter 4.7.2, Chapter 4.7.4
- The Device Tags have not been assigned => Chapter 4.7.5


- 4 When the download is successfully completed, the dialog is closed, and you are ready to test the control strategy

4.8 Make the Modbus connection


4.8.1 Start the Modbus

The Modbus must be started after the download (and restarted on every change in the Modbus configuration)


- 1 In the Fieldbus window, expand the Field Controller tree

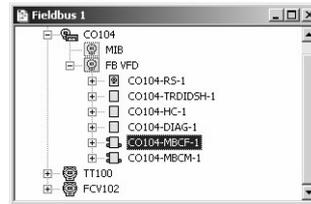

- 2 Right-click on the **CO104 -MBCF-1** block and select **On Line Characterization**

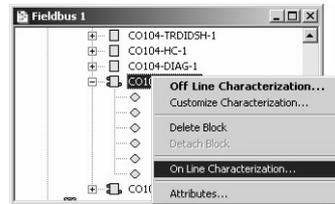

- 3 In the **On Line Characterization** dialog
 - Select **All** to display all parameters
 - Select the parameter **ON_APPLY**

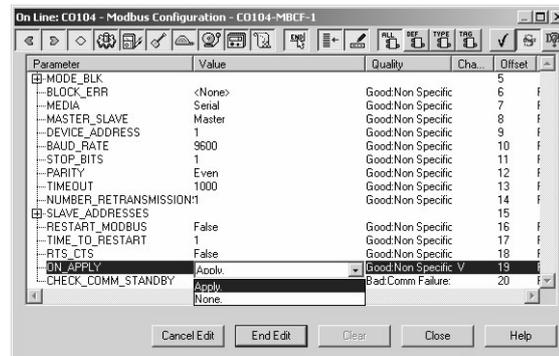


- 4 Click in the value space at the center of the line and open the drop-down menu
 - Select **Apply**
 - Click **End Edit** to confirm your choice
 - The parameter remains for two or three seconds, then reverts to **None**
 - The Modbus starts
 - Press **Close** to close the dialog

Note!

- This procedure must be repeated every time the Modbus configuration is changed


4.8.2 Start the Modbus simulator

- 1 Start the ModSim32 or other Modbus simulator as master from the desktop or through the Explorer
- 2 Set up the communication by selecting **Connections => Connect**

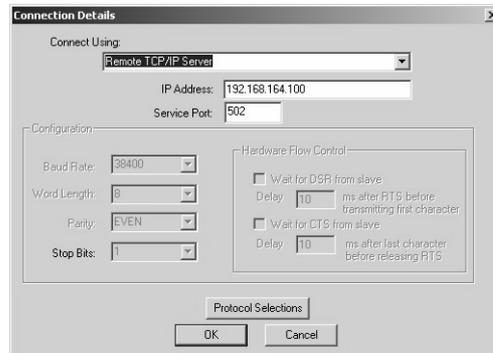


- Set the **Connect Using** to **Remote TCP/IP Server**
- Enter the **IP Address** of the Field Controller (here default 192.168.164.100)
- Press **OK** to confirm the settings

- 3 Set up the data display by selection **Setup => Display Options**

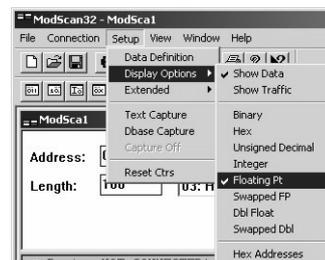

- Select **Show Data**
- Select **Floating Pt**


- 4 Select the view **Holding Registers** from the drop-down menu in the user interface.
 - Set the **Address** to 0001 and **Length** to 50
 - You should now be able to see **IN_1** and **IN_2** in registers **40001** and **40003**

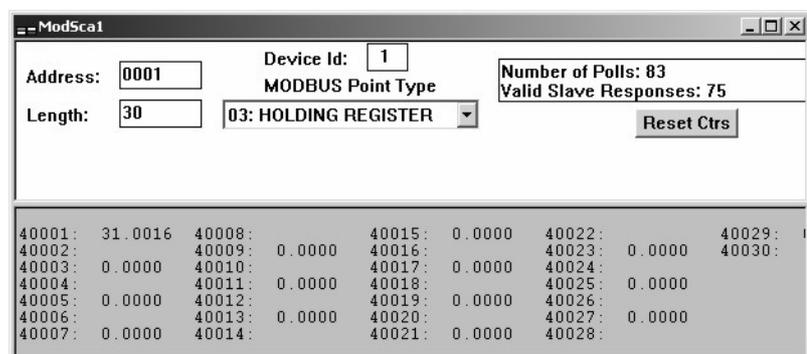

- 5 Double-click on register **40009** and enter a value to simulate the **OUT_1** value.

4.8.3 Check the control strategy

- 1 Click in the Control Strategy workspace (Temperature control) and press the button  in the menu toolbar – the control strategy goes "on-line"

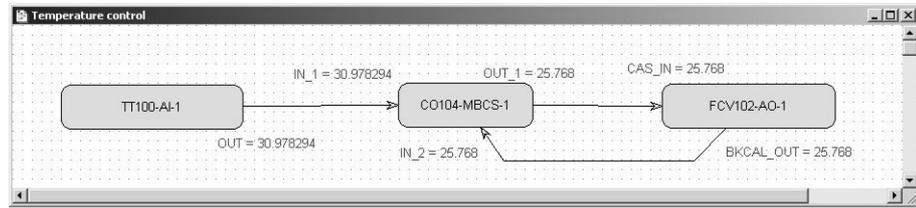

- Values appear in green when the status is good
- Values appear in red if the status is bad – at this stage this is an indication of a Fieldbus configuration, a strategy configuration or a device parametrization error

4.8.4 Modify, export and close the project

See Chapters 3.13 to 3.15.


5 Trouble-Shooting

5.1 Factory initialisation and reset



Warning!

- Do not use the pushbuttons located in the Field Controller unless you are certain that you want to reset the system.

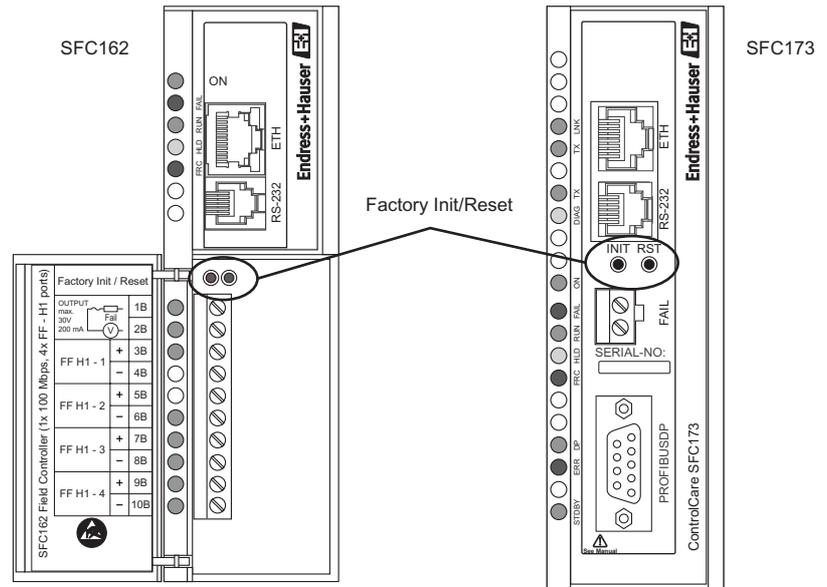

Two pushbuttons, located in the Field Controller module allow the system to be initialised and reset. The function and effect of the buttons is described in the table below.

- To "click " the pushbuttons use a pointed instrument (e.g. a ballpoint pen).
- Once started, any mode (Factory Init or HOLD Mode) can be exited by keeping the right pushbutton pressed and releasing the left pushbutton.
- If you loose the count of the times that the right pushbutton was pressed, check the rate at which the **FORCE** LED is flashing. It will return to a rate of once a second after the fourth touch (the function is rotative).

Function	Effect
Reset	Click the right pushbutton (see details in Fig. 5.1) and the system will execute the RESET , taking some seconds for correct system initialization. In accordance with the procedure via FC Tools, a new IP will be attributed automatically or the last configured IP will be accepted for the system. Verify that the RUN and ETH LNK LEDs remain lit.
Factory Init	Keep the left pushbutton pressed and then click the right pushbutton, checking that the FORCE LED flashes once a second. Release the left push button and the system will execute the RESET , deleting the previous configurations.
HOLD mode	Keep the left pushbutton pressed and then double click the right pushbutton, checking that the assuring that FORCE LED flashes twice a second. Release the left pushbutton and the system will execute the RESET and then enter the HOLD mode. Verify that the HOLD and ETH LNK LEDs remain lit. With the Field Controller in this mode, you can use the FC Tools Wizard to update the firmware or change the IP address. Use the Reset again, case you want to return to the execution mode (RUN).

5.2 Field Controller

Problem	Remedy
The HOLD LED remains lit, the Field Controller does not run	If the HOLD LED remains lit after the Field Controller has been turned on, the firmware may be invalid. The firmware should be downloaded again, see the relevant chapter in Operating Instructions BA035S/04/en, Field Controller, Commissioning and Configuration.
FC Tools does not put the Field Controller in HOLD	Use the Mode HOLD procedure of Factory Init/Reset. <ul style="list-style-type: none"> ■ With the FieldController in HOLD mode, execute the firmware update procedure, see the relevant chapter in Operating Instructions BA035S/04/en, Field Controller, Commissioning and Configuration. ■ If the problem persists, check the related TCP/IP connection (check the cables and ETH LNK LED)
The firmware begins to execute but after a certain time it stops	It might be a configuration problem. Use the Factory Init procedure and configure the Field Controller again. If the problem persists, download the firmware again
The ETH LNK LED does not light	Check if the cable is connected correctly, or that the cable is not damaged. Check the specification of the cables: <ul style="list-style-type: none"> ■ SFC 954 - Cable Standard. To be used in a network between the Field Controller and a Switch/HUB. ■ SFC 955 - Crossed Cable (Cross). To be used point to point between a PC and the Field Controller
The FORCE is flashing	Use the RESET procedure
The FC Tools does not find the Field Controller	<ul style="list-style-type: none"> ■ Make sure that the initial connection procedure was followed, see Chapter 3.10 ■ Check the Ethernet cable, see above. ■ Check if the network adapter is switched on and OK, PING command to its IP address, via DOS PROMPT. ■ Check if the Ethernet connection is OK, PING command to the Field Controller.
Field Controller does not appear in HSE live list	No connection to Field Controller <ul style="list-style-type: none"> ■ Field Controller is on HOLD, set it to RUN mode ■ IP address is not configured correctly, use PING to check, see above
Red cross appears on HSE Network	No connection to Field Controller <ul style="list-style-type: none"> ■ Field Controller is on HOLD, set it to RUN mode ■ IP address is not configured correctly, use PING to check, see above

5.3 Modbus

Problem	Remedy
No communication via Modbus RS-232	<ul style="list-style-type: none"> ■ If you have changed the configuration of a Modbus block, check that you have restarted the bus by using the ON_APPLY parameter, Chapter 3.17 ■ Check that the Field Controller and Modbus device are using the same communication settings: RTU/ASCII, Data bytes, Stop bits, Parity, Baudrate, Chapter 3.5.1 ■ Check that you are using the correct Modbus Block, Chapter 3.5.2, Chapter 4.3.2 ■ Check that you are using the correct Modbus addresses ■ Check that the Controller connector, all cables and any interfaces, e.g. RS-232/RS-485 are correctly wired
No communication via Modbus TCP	<ul style="list-style-type: none"> ■ Check that the IP addresses are in the same domain ■ Check that any slave IP addresses have been properly entered, Chapter 6.2 ■ Check that the correct cables have been used, see Chapter 5.2, ETH LNK LED and any switches etc. are powered ■ If you have changed the configuration of a Modbus block, check that you have restarted the bus by using the ON_APPLY parameter, Chapter 3.17
A Modbus block does not switch to "Auto" but remains "OOS"	<ul style="list-style-type: none"> ■ Check that the Mode Block target is set to "Auto" ■ Check that the Local Mod Map of each Modbus Block has a unique identifier between 0 and 15 ■ Check that the Modbus has been started by using the ON_APPLY parameter, Chapter 3.17
Local Mod Map identifier is not accepted	<ul style="list-style-type: none"> ■ Check that value is between 0 and 15 ■ Check that no other Modbus block of the same time is using the value you entered
A static value in the Modbus Block was changed, but the value does not update.	<ul style="list-style-type: none"> ■ Put the block out of service (OOS) before editing the parameter. ■ After the edit, put the block back to "Auto" and restart the bus with ON_APPLY
The Modbus parameters cannot be found or displayed	<ul style="list-style-type: none"> ■ Check that you are looking at the correct registers ■ Check that the data format has been set correctly Chapter 6.

6 Function Block Descriptions

A more detailed description of the blocks MBSC and MBSS are to be found in the Function Block manual BA022S/04/en.

6.1 MBCF Modbus Configuration Block

The MBCF allows the Field Controller to be configured for Modbus TCP or RTU operation.

- The parameters MEDIA and MASTER_SLAVE determine the medium and mode of Modbus communication
- The Modbus address of Field Controller is entered in DEVICE_ADDRESS. It is 1 by default and must only be entered if the Field Controller is to be a slave
- For Modbus RTU, the communication parameters BAUD_RATE, STOP_BITS, PARITY must be set. For Field Controllers operating as Modbus Master via Modbus TCP, the IP and Modbus addresses of up to six slaves can be defined in the SLAVE_ADDRESSES parameter
- The ON_APPLY parameter starts Modbus after download or change in Modbus configuration

Details of these and other parameters can be taken from the table below.

MBCF parameters

Parameter	Valid range/ Options	Default value	Description/Action
ST_VER		0	Increments on every static parameter change
TAG_DESC		blanks	User specific text of 32-characters to uniquely identify the block
STRATEGY	0 to 255	0	User specific value that may be used in configuration and diagnostics as a key in sorting block information
ALERT_KEY	1 to 255	1	User specific value that may be used in sorting the alarms and events generated by the block
MODE_BLK	TARGET	O/S	Set to AUTO
BLOCK_ERR	0 to 15		Error status of hardware and software components associated with the block
MEDIA	0: Serial 1: TCP/IP	Serial	Define the type of Modbus channel.
MASTER_SLAVE	0: Master 1: Slave	Slave	Define if Field Controller is master or slave
DEVICE_ADDRESS	0 - 247	1	Define the Field Controller Modbus address (only when used as slave).
BAUD_RATE	0 - 10	19200	Define the baud rate (only for media serial) 0:110, 1:300, 2: 600, 3:1200, 4:2400, 5:4800, 6:9600, 7:19200, 8:38400, 9:57600, 10:115200
STOP_BITS	0: 1, 1: 2	1	Define the number of stop bits (only for media serial).
PARITY	0: None, 1: Even, 2: Odd	Even	Define the parity (only for media serial)
TIMEOUT	0 - 65535	1000	Time to wait a response from a slave (for Field Controller master) or time to wait the OUTs be updated (for Field Controller slave). Value 0 is used to disable.
NUMBER_RETRANSMISSIONS	0 - 255	1	Number of retransmission if the Field Controller does not receive a response from a slave


Parameter	Valid range/ Options	Default value	Description/Action
SLAVE_ADDRESSES			IP number and Modbus addresses of slaves (only for Field Controller master using TCP/IP media)
RESTART_MODBUS		FALSE	Indicate if after communication failure with slave, there will be a new transmission after the time defined in TIME_TO_RESTART (only for Field Controller master).
TIME_TO_RESTART	1 - 65535	1	Time to restart communication with slave
RTS_CTS		FALSE	Enable or disable handshaking
ON_APPLY	0: None 1: Apply	None	Apply the changes made in the Modbus blocks
UPDATE_EVT			This alert is generated by any change to the static data
BLOCK_ALM			The block alarm is used for all configuration, hardware, connection failure or system problems in the block. The cause of the alert is entered in the subcode field. The first alert to become active will set the Active status in the Status attribute. As soon as the Unreported status is cleared by the alert reporting task, another block alert may be reported without clearing the Active status, if the subcode has changed.

6.2 MBCM Modbus Control Master Block

6.2.1 Block description

The Modbus Control Master block allows the Field Controller to read or write to Modbus registers in a slave application, e.g. a controller or field device. The values are mapped into a FOUNDATION Fieldbus function block, with four sets of analog and discrete I/O channels, allowing connection to other function blocks in a control strategy.

- Up to 16 MBCM blocks can be created in a project, the blocks being managed via the LOCAL_MOD_MAP parameter (0 to 15).
- The SCALE_LOC_XXX and LOCATOR_XXX parameters allow the configuration of the analog and discrete I/O channels

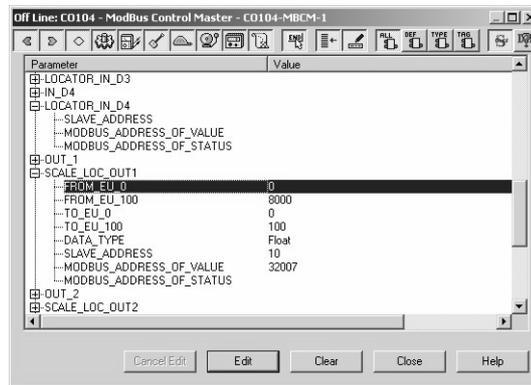

- Each input or output channel is assigned to a Modbus slave through the SLAVE_ADDRESS parameter. The register address is entered in the MODBUS_ADDRESS_OF_XXX parameter. Read Values (IN) are taken from registers with 4xxxx addresses, write values (OUT) are sent to registers with 3xxxx addresses.
- Analog inputs and outputs scale the slave values with the FROM_EU_XX and TO_EU_XX parameters and the data format is set with the DATA_TYPE parameter.

Details of these and other parameters can be taken from the table in Chapter 6.2.2.

MODBUS_ADDRESS_OF_STATUS

The MODBUS_ADDRESS_OF_STATUS elements define the following rules regarding OUTPUT STATUS parameters:

- If this element is set with a value that is not ZERO, the output status will behave exactly as the fieldbus protocol, in other words, the status will reflect the value which the master is reading but if after TIMEOUT (defined in MBCF block) the status is not updated, this status will be forced to BAD COMMUNICATION.
- If this element is set with a value equal to ZERO, the output status will be set automatically to GOOD and will also accept a characterization via the ControlCare Configurator (e.g GOOD CASCADE, etc). But, if after TIMEOUT (defined in MBCF block) the communication with the Modbus Device is not running properly, the status will be forced to BAD COMMUNICATION.

6.2.2 MBCM parameters

Parameter	Valid range/ Options	Default value	Description/Action
ST_VER		0	Increments on every static parameter change
TAG_DESC		blanks	User specific text of 32-characters to uniquely identify the block
STRATEGY	0 to 255	0	User specific value that may be used in configuration and diagnostics as a key in sorting block information
ALERT_KEY	1 to 255	1	User specific value that may be used in sorting the alarms and events generated by the block
MODE_BLK	TARGET	O/S	Set to AUTO
BLOCK_ERR	0 to 15		Error status of hardware and software components associated with the block
LOCAL_MOD_MAP	0 to 15	0	Define the modbus addresses
BAD_STATUS		0	Indicates if communication from slave is good or not (each bit corresponds to a Modbus variable)
IN_1			Analog input 1
SCALE_LOC_IN1			Scaling, data format and register addresses for input signal
IN_2			Analog input 2
SCALE_LOC_IN2			Scaling, data format and register addresses for input signal
IN_3			Analog input 3
SCALE_LOC_IN3			Scaling, data format and register addresses for input signal
IN_4			Analog input 4
SCALE_LOC_IN4			Scaling, data format and register addresses for input signal
IN_D1			Discrete input 1
LOCATOR_IN_D1			Register addresses for input signal
IN_D2			Discrete input 2
LOCATOR_IN_D2			Register addresses for input signal
IN_D3			Discrete input 3
LOCATOR_IN_D3			Register addresses for input signal
IN_D4			Discrete input 4
LOCATOR_IN_D4			Register addresses for input signal
OUT1			Analog output 1
SCALE_LOC_OUT1			Scaling, data format and register addresses for output signal
OUT2			Analog output 2
SCALE_LOC_OUT2			Scaling, data format and register addresses for output signal
OUT3			Analog output 3
SCALE_LOC_OUT3			Scaling, data format and register addresses for output signal
OUT4			Analog output 4
SCALE_LOC_OUT4			Scaling, data format and register addresses for output signal
OUT_D1			Discrete output 1


Parameter	Valid range/ Options	Default value	Description/Action
LOCATOR_OUT_D1			Register addresses for output signal
OUT_D2			Discrete output 2
LOCATOR_OUT_D2			Register addresses for output signal
OUT_D3			Discrete output 3
LOCATOR_OUT_D3			Register addresses for output signal
OUT_D4			Discrete output 4
LOCATOR_OUT_D4			Register addresses for output signal
UPDATE_EVT			This alert is generated by any change to the static data
BLOCK_ALM			The block alarm is used for all configuration, hardware, connection failure or system problems in the block. The cause of the alert is entered in the subcode field. The first alert to become active will set the Active status in the Status attribute. As soon as the Unreported status is cleared by the alert reporting task, another block alert may be reported without clearing the Active status, if the subcode has changed.

6.3 MBCS Modbus Control Slave Block

6.3.1 Block description

The Modbus Control Slave block allows a Modbus master to read or write to values in the Field Controller Modbus registers. The values are mapped from a FOUNDATION Fieldbus function block, with four sets of analog and discrete I/O channels, into fixed registers, allowing connection to other function blocks in a control strategy.

- Up to 16 MBCF blocks can be created in a project, the blocks being managed via the LOCAL_MOD_MAP parameter (0 to 15).
- The SCALE_CONV_XXX parameters allow the configuration of the analog channels

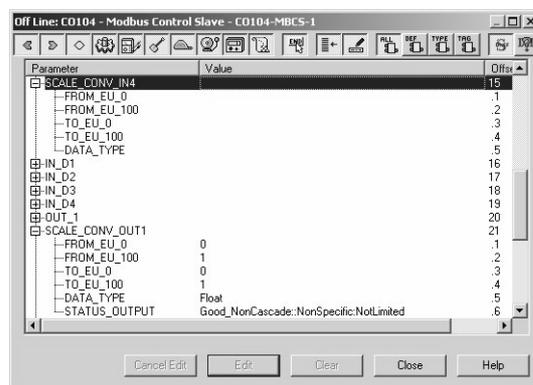

- Each input or output channel is assigned to a Modbus slave register through its I/O parameter and an OFFSET value which is 40 x LOCAL_MOD_MAP parameter. The basic addresses are listed in the table in Section 6.3.3. All registers are Read/Write.
- Analog inputs and outputs scale the slave values with the FROM_EU_XX and TO_EU_XX parameters and the data format is set with the DATA_TYPE parameter.

Details of these and other parameters can be taken from the table on Chapter 6.3.2.

STATUS_OUT_Dx and STATUS_OUTPUT

The STATUS_OUT_Dx and STATUS_OUTPUT elements used in the OUT parameters define the following rules for OUTPUT STATUS parameters:

- If the option "Set by master" is used, the output status will behave exactly as the Fieldbus protocol works, in other words, the status will reflect the value which the master is writing but if after TIMEOUT (defined in MBCF block) the status is not updated, this status will be forced to BAD COMMUNICATION.
- If the user defines this element with anything other than "Set by master", this value will be reflected in output status, while communication OK, otherwise the status goes to BAD COMMUNICATION..

6.3.2 MBCS parameters

Parameter	Valid range/ Options	Default value	Description/Action
ST_VER		0	Increments on every static parameter change
TAG_DESC		blanks	User specific text of 32-characters to uniquely identify the block
STRATEGY	0 to 255	0	User specific value that may be used in configuration and diagnostics as a key in sorting block information
ALERT_KEY	1 to 255	1	User specific value that may be used in sorting the alarms and events generated by the block
MODE_BLK	TARGET	O/S	Set to AUTO
BLOCK_ERR	0 to 15		Error status of hardware and software components associated with the block
LOCAL_MOD_MAP	0 to 15	0	Define the modbus addresses
IN1			Analog input 1
SCALE_CONV_IN1			Information to generate constants A and B em equation $Y=A*X+B$
IN2			Analog input 2
SCALE_CONV_IN2			Information to generate constants A and B em equation $Y=A*X+B$
IN3			Analog input 3
SCALE_CONV_IN3			Information to generate constants A and B em equation $Y=A*X+B$
IN4			Analog input 4
SCALE_CONV_IN4			Information to generate constants A and B em equation $Y=A*X+B$
IN_D1			Discrete input 1
IN_D2			Discrete input 2
IN_D3			Discrete input 3
IN_D4			Discrete input 4
OUT1			Analog output 1
SCALE_CONV_OUT1			Information to generate constants the A and B and equation $Y=A*X+B$ plus output status
OUT2			Analog output 2
SCALE_CONV_OUT2			Information to generate constants the A and B and equation $Y=A*X+B$ plus output status
OUT3			Analog output 3
SCALE_CONV_OUT3			Information to generate constants the A and B and equation $Y=A*X+B$ plus output status
OUT4			Analog output 4
SCALE_CONV_OUT4			Information to generate constants the A and B and equation $Y=A*X+B$ plus output status
OUT_D1			Discrete output 1
STATUS_OUT_D1			Status to OUT_D1 if master will not update

Parameter	Valid range/ Options	Default value	Description/Action
OUT_D2			Discrete output 2
STATUS_OUT_D2			Status to OUT_D2 if master will not update
OUT_D3			Discrete output 3
STATUS_OUT_D3			Status to OUT_D3 if master will not update
OUT_D4			Discrete output 4
STATUS_OUT_D4			Status to OUT_D4 if master will not update
UPDATE_EVT			This alert is generated by any change to the static data
BLOCK_ALM			The block alarm is used for all configuration, hardware, connection failure or system problems in the block. The cause of the alert is entered in the subcode field. The first alert to become active will set the Active status in the Status attribute. As soon as the Unreported status is cleared by the alert reporting task, another block alert may be reported without clearing the Active status, if the subcode has changed.

6.3.3 LOCAL_MOD_MAP

MBCS			MBSS		
Parameter	LOCAL_MOD_MAP = x OFFSET = 40 * x x = 0 - 15	e.g. LOCAL_ MOD_MAP	Parameter	LOCAL_MOD_MAP = x OFFSET = 40 * x x = 0 - 15	e.g. LOCAL_ MOD_MAP
IN1-Value	40001+ OFFSET 40002+ OFFSET	40041 40042	FBLOCK_TAG1	42601+ OFFSET 42602+ OFFSET	42641 42642
IN2-Value	40003+ OFFSET 40004+ OFFSET	40043 40044	FBLOCK_TAG2	42603+ OFFSET 42604+ OFFSET	42643 42644
IN3-Value	40005+ OFFSET 40006+ OFFSET	40045 40046	FBLOCK_TAG3	42605+ OFFSET 42606+ OFFSET	42645 42646
IN4-Value	40007+ OFFSET 40008+ OFFSET	40047 40048	FBLOCK_TAG4	42607+ OFFSET 42608+ OFFSET	42647 42648
OUT1-Value	40009+ OFFSET 40010+ OFFSET	40049 40050	FBLOCK_TAG5	42609+ OFFSET 42610+ OFFSET	42649 42650
OUT2-Value	40011+ OFFSET 40012+ OFFSET	40051 40052	FBLOCK_TAG6	42611+ OFFSET 42612+ OFFSET	42651 42652
OUT3-Value	40013+ OFFSET 40014+ OFFSET	40053 40054	FBLOCK_TAG7	42613+ OFFSET 42614+ OFFSET	42653 42654
OUT4-Value	40015+ OFFSET 40016+ OFFSET	40055 40056	FBLOCK_TAG8	42615+ OFFSET 42616+ OFFSET	42655 42656
IN1-Status	40017+ OFFSET	40057	IBLOCK_TAG1	42617+ OFFSET 42618+ OFFSET	42657 42658
IN2-Status	40018+ OFFSET	40058	IBLOCK_TAG2	42619+ OFFSET 42620+ OFFSET	42659 42660
IN3-Status	40019+ OFFSET	40059	IBLOCK_TAG3	42621+ OFFSET 42622+ OFFSET	42661 42662
IN4-Status	40020+ OFFSET	40060	IBLOCK_TAG4	42623+ OFFSET 42624+ OFFSET	42663 42664
OUT1-Status	40021+ OFFSET	40061	BBLOCK_TAG1	2601+ OFFSET	2641
OUT2-Status	40022+ OFFSET	40062	BBLOCK_TAG1	2602+ OFFSET	2642
OUT3-Status	40023+ OFFSET	40063	BBLOCK_TAG1	2603+ OFFSET	2643
OUT4-Status	40024+ OFFSET	40064	BBLOCK_TAG1	2604+ OFFSET	2644
IN_D1-Status	40025+ OFFSET	40065			
IN_D2-Status	40026+ OFFSET	40066			
IN_D3-Status	40027+ OFFSET	40067			
IN_D4-Status	40028+ OFFSET	40068			
OUT_D1-Status	40029+ OFFSET	40069			
OUT_D1-Status	40030+ OFFSET	40070			
OUT_D1-Status	40031+ OFFSET	40071			
OUT_D1-Status	40032+ OFFSET	40072			
IN_D1-Value	1+ OFFSET	41			
IN_D2-Value	2+ OFFSET	42			
IN_D3-Value	3+ OFFSET	43			
IN_D4-Value	4+ OFFSET	44			
OUT_D1-Value	5+ OFFSET	45			
OUT_D1-Value	6+ OFFSET	46			
OUT_D1-Value	7+ OFFSET	47			
OUT_D1-Value	8+ OFFSET	48			

For your notes.

Index

A

All 18, 46, 48
 Analog Input block 30
 Analog Output Block 33, 65
 Assign Tag 44, 70
 Assigning an IP address 37, 67
 Attributes 23, 42, 43, 69, 70

B

Bridge 14

C

Close 53
 Commissioning 3
 Configuration as XML 52
 Control module 24, 62
 Control Strategy 23, 25, 29, 47, 62, 65, 74

D

Device ID 11, 42, 43, 56, 69, 70
 Device Tag 11, 14, 17, 44, 56, 70
 Download 45, 71

E

Expand 16, 24, 25
 Explosion protection 5
 Export Configuration 50, 51
 Export tags 13, 36, 66

F

Factory initialisation 75
 FB VFD 16
 Field Controller 5, 37, 67, 76
 Field Controller IP address 38, 68
 Fieldbus live list 70
 Fieldbus Network 14
 FieldController set-up 37, 67
 Function Block assignment 35, 66
 Function Block descriptions 78
 Function Block links 27, 64

G

Gateway 14

H

HSE Network 14, 41, 69

I

Input Parameter Selection 28, 64
 Installation 3
 IP address of your computer 37, 67

L

Live List 41, 42, 70, 69
 LOCAL_MOD_MAP 86

M

Manufacturer 17
 MBCF Modbus Configuration block 18, 58, 78
 MBCM Modbus Control Master Block 19, 80
 MBCS Modbus Control Slave block 59, 83
 Modbus 6, 46
 Modbus connection 72
 Modbus master 7, 9
 Modbus RTU 6
 Modbus simulator 73
 Modbus slave 8, 54
 Modbus TCP 6
 Mode Block Target 30, 32, 33

N

ND9103FN positioner 22
 Network 10, 55
 New Block 16, 25, 63
 New Control Module 24, 62
 New Device 17
 New Fieldbus 15
 New Process Cell 23, 62
 New Project 12

O

Off Line Characterization . 18, 20, 21, 22, 30, 32, 33, 60
 On Line Characterization 46, 48
 ON_APPLY 46
 On-Line 41, 69
 Operation 3
 Output Parameter Selection 27, 64

P

Parametrization 21, 22
 PID Block 32
 Preferences 13
 Process cell 23, 35, 62
 PROFIBUS live list 42

S

SP 47, 48
 Strategy Export 34
 Strategy Import 34
 Strategy template 34

T

Tag Composition 13
 Tag Policy 13
 TMT165 temperature transmitter 21
 Tools 27
 Transducer Block 21, 22, 61

X

XML file 52

www.endress.com/worldwide

Endress+Hauser 
People for Process Automation
