
# Technical Information

# Proline Promass S 500

Coriolis flowmeter

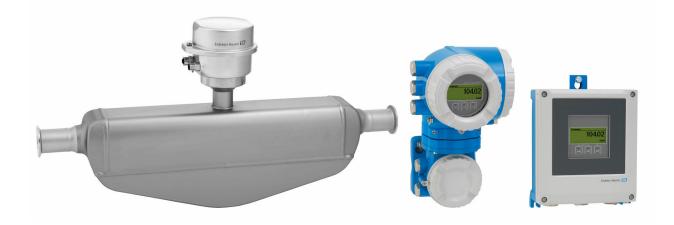

# Easy-to-clean device with self-drainable single-tube system, as remote version with up to $4\ \mathrm{I/Os}$

# Application

- Measuring principle operates independently of physical fluid properties such as viscosity or density
- Dedicated to applications requiring optimal cleanability under hygienic conditions

# Device properties

- Large range of hygienic process connections
- 3-A and EHEDG conform
- Fast recovery from CIP/SIP
- Remote version with up to 4 I/Os
- Backlit display with touch control and WLAN access
- Standard cable between sensor and transmitter

# Your benefits

- Increased process safety easily cleanable and fully selfdrainable tube design
- Fewer process measuring points multivariable measurement (flow, density, temperature)
- Space-saving installation no in-/outlet run needs
- Full access to process and diagnostic information numerous, freely combinable I/Os and Ethernet
- Reduced complexity and variety freely configurable I/O functionality
- Integrated verification Heartbeat Technology



# Table of contents

About this document	
Symbols	• 4
The structure of a structure to structure	-
Function and system design	
Measuring principle	
Measuring system	
Equipment architecture	
Security	. 9
Input	11
Measured variable	11
Measuring range	11
Operable flow range	11
Input signal	11
	10
Output	13
Output and input variants	13
Output signal	15
Signal on alarm	21
Load	23 23
Ex connection data	25 25
Low flow cut off	25 25
Protocol-specific data	25
Power supply	31
Terminal assignment	31
Available device plugs	33
Pin assignment, device plug	34
Supply voltage	36
Power consumption	36
Current consumption	36
Power supply failure	36
Overcurrent protection element	36
Electrical connection	36
Potential equalization	49
Terminals	49
Cable entries	49
Cable specification	49
Overvoltage protection	55
Performance characteristics	55
Reference operating conditions	55
Maximum measured error	55
Repeatability	56
Response time	57
Influence of ambient temperature	57
Influence of medium temperature	57
Influence of medium pressure	58
Design fundamentals	58
Installation	F٥
Installation	<b>59</b>
Mounting location	59 60
Orientation	60 61
Mounting the transmitter housing	62
Special mounting instructions	63
	55

Environment	<b>65</b> 65 65 65 65 65 65 66 66
Electromagnetic compatibility (EMC)	66
Process . Medium temperature range . Density . Pressure-temperature ratings . Sensor housing . Flow limit . Pressure loss . System pressure . Thermal insulation . Heating . Vibrations .	<b>66</b> 67 67 70 71 71 71 71 72 72
Mechanical construction	<b>73</b> 73 85 93 93 96 96
Network integration	<b>96</b> 96 97 97 103 105 106 107
CE mark	<b>109</b> 109 109 112 113 113 113 113 113 113 113 114 114

Additional certification	114 114
Ordering information	115
Application packages	115
Diagnostic functionality	115
Heartbeat Technology	116
Concentration measurement	116
Special density	116
OPC-UA Server	116
Accessories	117
Device-specific accessories	117
Communication-specific accessories	118
Service-specific accessories	119
System components	119
Documentation	120
Standard documentation	120
Supplementary device-dependent documentation	121
Registered trademarks	122

# About this document

# Symbols

# Electrical symbols

Symbol	Meaning
	Direct current
$\sim$	Alternating current
8	Direct current and alternating current
<u>+</u>	<b>Ground connection</b> A grounded terminal which, as far as the operator is concerned, is grounded via a grounding system.
	Potential equalization connection (PE: protective earth) Ground terminals that must be connected to ground prior to establishing any other connections.
	<ul><li>The ground terminals are located on the interior and exterior of the device:</li><li>Interior ground terminal: potential equalization is connected to the supply network.</li><li>Exterior ground terminal: device is connected to the plant grounding system.</li></ul>

# Communication-specific symbols

Symbol	Meaning
((i•	Wireless Local Area Network (WLAN) Communication via a wireless, local network.
	LED Light emitting diode is off.
-X-	LED Light emitting diode is on.
×	LED Light emitting diode is flashing.

# Symbols for certain types of information

Symbol	Meaning
	<b>Permitted</b> Procedures, processes or actions that are permitted.
	<b>Preferred</b> Procedures, processes or actions that are preferred.
×	<b>Forbidden</b> Procedures, processes or actions that are forbidden.
i	<b>Tip</b> Indicates additional information.
	Reference to documentation
	Reference to page
	Reference to graphic
	Visual inspection

#### Symbols in graphics

Symbol	Meaning
1, 2, 3,	Item numbers
1., 2., 3.,	Series of steps
A, B, C,	Views
A-A, B-B, C-C,	Sections
EX	Hazardous area
X	Safe area (non-hazardous area)
≈➡	Flow direction

# Function and system design

#### Measuring principle


The measuring principle is based on the controlled generation of Coriolis forces. These forces are always present in a system when both translational and rotational movements are superimposed.

- $F_c = 2 \cdot \Delta m (v \cdot \omega)$
- F<sub>c</sub> = Coriolis force
- $\Delta m = moving mass$ 
  - $\omega =$  rotational velocity
  - v = radial velocity in rotating or oscillating system

The amplitude of the Coriolis force depends on the moving mass  $\Delta m$ , its velocity v in the system and thus on the mass flow. Instead of a constant rotational velocity  $\omega$ , the sensor uses oscillation.

In the sensor, an oscillation is produced in the measuring tube. The Coriolis forces produced at the measuring tube cause a phase shift in the tube oscillations (see illustration):

- If there is zero flow (i.e. when the fluid stands still), the oscillation measured at points A and B has the same phase (no phase difference) (1).
- Mass flow causes deceleration of the oscillation at the inlet of the tubes (2) and acceleration at the outlet (3).

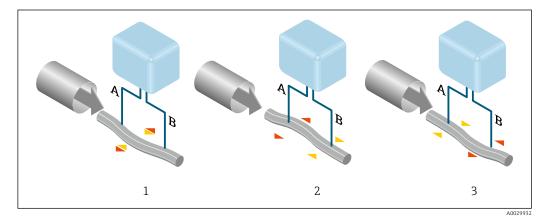

The phase difference (A-B) increases with increasing mass flow. Electrodynamic sensors register the tube oscillations at the inlet and outlet. System balance is ensured by the antiphase oscillation of an eccentrically arranged swinging mass. The measuring principle operates independently of temperature, pressure, viscosity, conductivity and flow profile.

#### **Density measurement**

The measuring tube is continuously excited at its resonance frequency. A change in the mass and thus the density of the oscillating system (comprising measuring tube and fluid) results in a corresponding, automatic adjustment in the oscillation frequency. The resonance frequency is thus a function of the medium density. The microprocessor utilizes this relationship to obtain a density signal.

#### Volume measurement

Together with the measured mass flow, this is used to calculate the volume flow.

#### **Temperature measurement**

The temperature of the measuring tube is determined in order to calculate the compensation factor due to temperature effects. This signal corresponds to the process temperature and is also available as an output signal.

#### Gas Fraction Handler (GFH)

The Gas Fraction Handler is a Promass software function that improves measurement stability and repeatability. The function continuously checks for the presence of disturbances in single-phase flow, i.e. gas bubbles in liquids or droplets in gas. In the presence of the second phase, flow and density become increasingly unstable. The Gas Fraction Handler function improves measurement stability with respect to the severity of the disturbances, without any effect under single-phase flow conditions.



The Gas Fraction Handler is only available in device versions with HART, Modbus RS485, PROFINET and PROFINET with Ethernet-APL.




For detailed information on the Gas Fraction Handler, see the Special Documentation for "Gas Fraction Handler" → 🗎 121

#### Measuring system

The measuring system consists of a transmitter and a sensor. The transmitter and sensor are mounted in physically separate locations. They are interconnected by connecting cables.

#### Transmitter

Two versions of the transmitter are available.

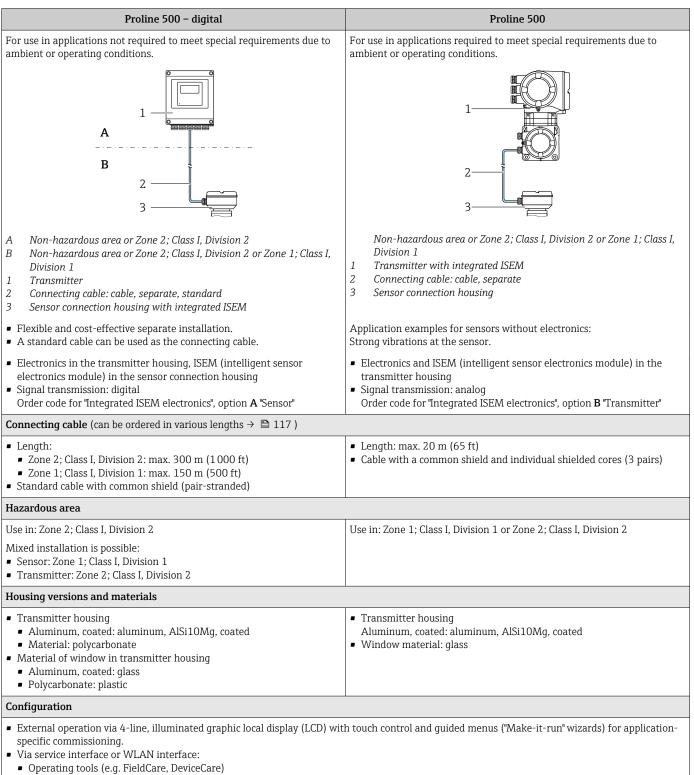


• Web server (access via Web browser, e.g. Microsoft Internet Explorer, Microsoft Edge)

#### Sensor connection housing


Different versions of the connection housing are available.

Order code for "Sensor connection housing", option A, "Aluminum, coated": Aluminum, AlSi10Mg, coated This device version is only available in conjunction with the Proline 500 – digital transmitter.
<ul> <li>Order code for "Sensor connection housing", option B, "Stainless":</li> <li>Hygienic version, stainless steel 1.4301 (304)</li> <li>Optional: order code for "Sensor feature", option CC "Hygienic version, for maximum corrosion resistance": stainless steel 1.4404 (316L)</li> </ul>
<ul> <li>Order code for "Sensor connection housing", option C, "Ultra-compact hygienic, stainless":</li> <li>Hygienic version, stainless steel 1.4301 (304)</li> <li>Optional: order code for "Sensor feature", option CC "Hygienic version, for maximum corrosion resistance": stainless steel 1.4404 (316L)</li> <li>This device version is only available in conjunction with the Proline 500 - digital transmitter.</li> </ul>

#### Sensor

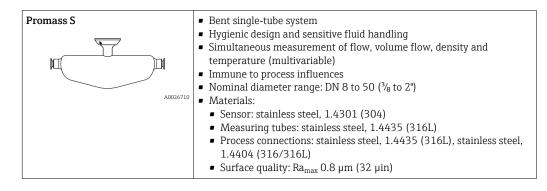

# Equipment architecture

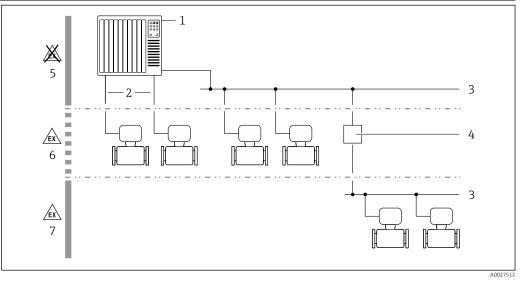

- 1 Possibilities for integrating measuring devices into a system
- 1 Control system (e.g. PLC)
- 2 Connecting cable (0/4 to 20 mA HART etc.)
- 3 Fieldbus
- 4 Coupler
- 5 Non-hazardous area
- 6 Hazardous area: Zone 2; Class I, Division 2
- 7 Hazardous area: Zone 1; Class I, Division 1

#### Security

#### IT security

Our warranty is valid only if the product is installed and used as described in the Operating Instructions. The product is equipped with security mechanisms to protect it against any inadvertent changes to the settings.

IT security measures, which provide additional protection for the product and associated data transfer, must be implemented by the operators themselves in line with their security standards.

#### Device-specific IT security

The device offers a range of specific functions to support protective measures on the operator's side. These functions can be configured by the user and guarantee greater in-operation safety if used correctly. An overview of the most important functions is provided in the following section:

Function/interface	Factory setting	Recommendation
Write protection via hardware write protection switch $\rightarrow \textcircled{B} 9$	Not enabled	On an individual basis following risk assessment
Access code (also applies for Web server login or FieldCare connection) $\rightarrow \bigcirc 9$	Not enabled (0000)	Assign a customized access code during commissioning
WLAN (order option in display module)	Enabled	On an individual basis following risk assessment
WLAN security mode	Enabled (WPA2- PSK)	Do not change
WLAN passphrase (password) → 🗎 10	Serial number	Assign a customized WLAN passphrase during commissioning
WLAN mode	Access point	On an individual basis following risk assessment
Web server $\rightarrow \blacksquare 10$	Enabled	On an individual basis following risk assessment
CDI-RJ45 service interface $\rightarrow \square 10$	-	On an individual basis following risk assessment

Protecting access via hardware write protection

Write access to the parameters of the device via the local display, Web browser or operating tool (e.g. FieldCare, DeviceCare) can be disabled via a write protection switch (DIP switch on the main electronics module). When hardware write protection is enabled, only read access to the parameters is possible.

Hardware write protection is disabled when the device is delivered.

#### Protecting access via a password

Different passwords are available to protect write access to the device parameters or access to the device via the WLAN interface.

User-specific access code

Protect write access to the device parameters via the local display, Web browser or operating tool (e.g. FieldCare, DeviceCare). Access authorization is clearly regulated through the use of a user-specific access code.

WLAN passphrase

The network key protects a connection between an operating unit (e.g. notebook or tablet) and the device via the WLAN interface which can be ordered as an option.

Infrastructure mode

When the device is operated in infrastructure mode, the WLAN passphrase corresponds to the WLAN passphrase configured on the operator side.

#### User-specific access code

Write access to the device parameters via the local display, Web browser or operating tool (e.g. FieldCare, DeviceCare) can be protected by the modifiable, user-specific access code.

#### WLAN passphrase: Operation as WLAN access point

A connection between an operating unit (e.g. notebook or tablet) and the device via the WLAN interface, which can be ordered as an optional extra, is protected by the network key. The WLAN authentication of the network key complies with the IEEE 802.11 standard.

When the device is delivered, the network key is pre-defined depending on the device. It can be changed via the **WLAN settings** submenu in the **WLAN passphrase** parameter.

#### Infrastructure mode

A connection between the device and WLAN access point is protected by means of an SSID and passphrase on the system side. Please contact the relevant system administrator for access.

#### General notes on the use of passwords

- The access code and network key supplied with the device should be changed during commissioning.
- Follow the general rules for generating a secure password when defining and managing the access code or network key.
- The user is responsible for the management and careful handling of the access code and network key.

#### Access via Web server

The device can be operated and configured via a Web browser with the integrated Web server. The connection is via the service interface (CDI-RJ45) or the WLAN interface. For device versions with the EtherNet/IP and PROFINET communication protocols, the connection can also be established via the terminal connection for signal transmission with EtherNet/IP, PROFINET (RJ45 plug) or PROFINET with Ethernet-APL (two-wire).

The Web server is enabled when the device is delivered. The Web server can be disabled if necessary (e.g. after commissioning) via the **Web server functionality** parameter.

The device and status information can be hidden on the login page. This prevents unauthorized access to the information.

For detailed information on device parameters, see:

The "Description of Device Parameters" document  $\rightarrow$  120

#### Access via OPC-UA

The "OPC UA Server" application package is available in the device version with the HART communication protocol  $\rightarrow \cong 116$ .

The device can communicate with OPC UA clients using the "OPC UA Server" application package.

The OPC UA server integrated in the device can be accessed via the WLAN access point using the WLAN interface - which can be ordered as an optional extra - or the service interface (CDI- RJ45) via Ethernet network. Access rights and authorization as per separate configuration.

The following Security Modes are supported as per the OPC UA Specification (IEC 62541):

- None
- Basic128Rsa15 signed
- Basic128Rsa15 signed and encrypted

#### Access via service interface (CDI-RJ45)

The device can be connected to a network via the service interface (CDI-RJ45). Device-specific functions guarantee the secure operation of the device in a network.

The use of relevant industrial standards and guidelines that have been defined by national and international safety committees, such as IEC/ISA62443 or the IEEE, is recommended. This includes organizational security measures such as the assignment of access authorization as well as technical measures such as network segmentation.

Transmitters with an Ex de approval may not be connected via the service interface (CDI-RJ45)!

Order code for "Approval transmitter + sensor", options (Ex de): BA, BB, C1, C2, GA, GB, MA, MB, NA, NB

The device can be incorporated into a ring topology. The device is integrated via the terminal connection for signal transmission (output 1) and the connection to the service interface (CDI-RJ45).

# Innut

	Input				
Measured variable	Direct measured variabl	es			
	<ul><li>Mass flow</li><li>Density</li><li>Temperature</li></ul>				
	Calculated measured va	riables			
	<ul> <li>Volume flow</li> <li>Corrected volume flow</li> <li>Reference density</li> </ul>				
Measuring range	Measuring range for lig	uids			
	D	N	Measuring range full scal	e values $\dot{m}_{\min(F)}$ to $\dot{m}_{\max(F)}$	
	[mm]	[in]	[kg/h]	[lb/min]	
	8	3/8	0 to 2 000	0 to 73.50	
	15	1/2	0 to 6 500	0 to 238.9	
	25	1	0 to 18 000	0 to 661.5	
	40	11/2	0 to 45 000	0 to 1654	
	50	2	0 to 70 000	0 to 2 573	
0	Flow limit → <sup>(1)</sup> 71				
Operable flow range	Over 1000 : 1.				
	Flow rates above the preset full scale value do not override the electronics unit, with the result that the totalizer values are registered correctly.				
nput signal	Output and input variants				
	→ 🗎 13				
	External measured values				
	<ul> <li>To increase the accuracy of certain measured variables, the automation system can continuously write various measured values to the measuring device:</li> <li>Operating pressure to increase accuracy (Endress+Hauser recommends the use of a pressure measuring device for absolute pressure, e.g. Cerabar M or Cerabar S)</li> <li>Medium temperature to increase accuracy (e.g. iTEMP)</li> </ul>				
	Various pressure and temperature measuring devices can be ordered from Endress+Hauser: see "Accessories" section $\rightarrow \square$ 119				
	HART protocol				
	The measured values are		comation system to the measur ort the following protocol-spec		

- HART protocolBurst mode

Current input

The measured values are written from the automation system to the measuring device via the current input  $\rightarrow$   $\cong$  12.

#### Digital communication

The measured values can be written by the automation system via:

- FOUNDATION Fieldbus
- PROFIBUS DP
- PROFIBUS PA
- Modbus RS485
- EtherNet/IP
- PROFINET
- PROFINET with Ethernet-APL

# Current input 0/4 to 20 mA

Current input	0/4 to 20 mA (active/passive)
Current span	<ul> <li>4 to 20 mA (active)</li> <li>0/4 to 20 mA (passive)</li> </ul>
Resolution	1 μΑ
Voltage drop	Typically: 0.6 to 2 V for 3.6 to 22 mA (passive)
Maximum input voltage	≤ 30 V (passive)
Open-circuit voltage	< 28.8 V (active)
Possible input variables	<ul><li>Pressure</li><li>Temperature</li><li>Density</li></ul>

# Status input

Maximum input values	<ul> <li>DC -3 to 30 V</li> <li>If status input is active (ON): R<sub>i</sub> &gt;3 kΩ</li> </ul>
Response time	Configurable: 5 to 200 ms
Input signal level	<ul> <li>Low signal: DC -3 to +5 V</li> <li>High signal: DC 12 to 30 V</li> </ul>
Assignable functions	<ul> <li>Off</li> <li>Reset the individual totalizers separately</li> <li>Reset all totalizers</li> <li>Flow override</li> </ul>

# Output

Output and input variants	Depending on the option selected for output/input 1, different options are available for the other outputs and inputs. Only one option can be selected for each output/input 1 to 4. The following tables must be read vertically ( $\downarrow$ ).
	Example: If the option BA "4–20 mA HART" was selected for output/input 1, one of the options A, B, D, E, F, H, I or J is available for output 2 and one of the options A, B, D, E, F, H, I or J is available for output 3 and 4.
	Output/input 1 and options for output/input 2



Order code for "Output; input 1" (020) →	Possible options												
Current output 4 to 20 mA HART	BA												
Current output 4 to 20 mA HART Ex i passive	$\downarrow$	CA											
Current output 4 to 20 mA HART Ex i active		$\downarrow$	СС										
FOUNDATION Fieldbus			$\downarrow$	SA									
FOUNDATION Fieldbus Ex i				$\downarrow$	TA								
PROFIBUS DP					$\downarrow$	LA							
PROFIBUS PA						$\downarrow$	GA						
PROFIBUS PA Ex i							$\downarrow$	HA					
Modbus RS485								$\downarrow$	MA				
EtherNet/IP 2-port switch integrated									$\downarrow$	NA			
PROFINET 2-port switch integrated										$\downarrow$	RA		
PROFINET with Ethernet-APL											$\rightarrow$	RB	
PROFINET with Ethernet-APL Ex i												$\rightarrow$	RC
Order code for "Output; input 2" (021) $\rightarrow$	$\leftarrow$	$\leftarrow$	$\downarrow$	$\downarrow$	$\rightarrow$	$\rightarrow$	$\downarrow$	$\rightarrow$	$\rightarrow$	$\rightarrow$	$\rightarrow$	$\rightarrow$	$\leftarrow$
Not assigned	Α	Α	Α	A	A	A	A	A	A	Α	Α	Α	Α
Current output 4 to 20 mA	В			В		В	В		В	В	В	В	
Current output 4 to 20 mA Ex i passive		С	С		С			С					С
User-configurable input/output <sup>1)</sup>	D			D		D	D		D	D	D	D	
Pulse/frequency/switch output	Е			E		E	E		E	Е	Е	Е	
Double pulse output <sup>2)</sup>	F								F				
Pulse/frequency/switch output Ex i passive		G	G		G			G					G
Relay output	н			н		н	н		н	н	н	н	
Current input 0/4 to 20 mA	I			I		I	I		Ι	Ι	Ι	Ι	
Status input	J			J		J	J		J	J	J	J	

1)

A specific input or output can be assigned to a user-configurable input/output  $\rightarrow \square$  20. If double pulse output (F) is selected for output/input 2 (021), only the double pulse output (F) option is available for selection for output/input 3 2) (022).

# Output/input 1 and options for output/input 3 and 4

**P** Options for output/input  $2 \rightarrow \square 13$ 

Order code for "Output; input 1" (020) → Possible options													
Current output 4 to 20 mA HART	BA												
Current output 4 to 20 mA HART Ex i passive	$\downarrow$	CA											
Current output 4 to 20 mA HART Ex i active		$\downarrow$	сс										
FOUNDATION Fieldbus			$\downarrow$	SA									
FOUNDATION Fieldbus Ex i				$\downarrow$	TA								
PROFIBUS DP					$\downarrow$	LA							
PROFIBUS PA						$\downarrow$	GA						
PROFIBUS PA Ex i							$\downarrow$	HA					
Modbus RS485								$\downarrow$	MA				
EtherNet/IP 2-port switch integrated									$\downarrow$	NA			
PROFINET 2-port switch integrated										$\downarrow$	RA		
PROFINET with Ethernet-APL											$\downarrow$	RB	
PROFINET with Ethernet-APL Ex i												$\downarrow$	RC
Order code for "Output; input 3" (022), "Output; input 4" (023) $^{1)}$ $\rightarrow$		$\downarrow$											
Not assigned	A	A	Α	Α	Α	Α	Α	Α	Α	Α	Α	Α	Α
Current output 4 to 20 mA	В					В			В	В	В	В	
Current output 4 to 20 mA Ex i passive <sup>2)</sup>		С	С										
User-configurable input/output	D					D			D	D	D	D	
Pulse/frequency/switch output	E					E			E	Е	Е	Е	
Double pulse output (slave) <sup>3)</sup>	F								F				
Pulse/frequency/switch output Ex i passive <sup>4)</sup>		G	G										
Relay output	н					н			н	н	н	н	
Current input 0/4 to 20 mA	I					I			I	I	I	Ι	
Status input	J					J			J	J	J	J	

The order code for "Output; input 4" (023) is only available for the Proline 500-digital transmitter, order code for "Integrated ISEM electronics", 1) option A.

The current output 4 to 20 mA Ex i passive (C) option is not available for input/output 4. 2)

The double pulse output (F) option is not available for input/output 4. The pulse/frequency/switch output Ex i passive (G) option is not available for input/output 4. 3) 4)

# Output signal

# Current output 4 to 20 mA HART

Order code	"Output; input 1" (20): Option BA: current output 4 to 20 mA HART
Signal mode	Can be set to: • Active • Passive
Current range	Can be set to: 4 to 20 mA NAMUR 4 to 20 mA US 4 to 20 mA 0 to 20 mA (only if the signal mode is active) Fixed current
Open-circuit voltage	DC 28.8 V (active)
Maximum input voltage	DC 30 V (passive)
Load	250 to 700 Ω
Resolution	0.38 μΑ
Damping	Configurable: 0 to 999.9 s
Assignable measured variables	<ul> <li>Mass flow</li> <li>Volume flow</li> <li>Corrected volume flow</li> <li>Density</li> <li>Reference density</li> <li>Temperature</li> <li>Electronics temperature</li> <li>Oscillation frequency 0</li> <li>Oscillation damping 0</li> <li>Signal asymmetry</li> <li>Exciter current 0</li> <li>The range of options increases if the measuring device has one or more application packages.</li> </ul>

# Current output 4 to 20 mA HART Ex i

Order code	<ul> <li>"Output; input 1" (20) choose from:</li> <li>Option CA: current output 4 to 20 mA HART Ex i passive</li> <li>Option CC: current output 4 to 20 mA HART Ex i active</li> </ul>
Signal mode	Depends on the selected order version.
Current range	Can be set to: • 4 to 20 mA NAMUR • 4 to 20 mA US • 4 to 20 mA • 0 to 20 mA (only if the signal mode is active) • Fixed current
Open-circuit voltage	DC 21.8 V (active)
Maximum input voltage	DC 30 V (passive)
Load	<ul> <li>250 to 400 Ω (active)</li> <li>250 to 700 Ω (passive)</li> </ul>
Resolution	0.38 μΑ

Damping	Configurable: 0 to 999.9 s
Assignable measured variables	<ul> <li>Mass flow</li> <li>Volume flow</li> <li>Corrected volume flow</li> <li>Density</li> <li>Reference density</li> <li>Temperature</li> <li>Electronics temperature</li> <li>Oscillation frequency 0</li> <li>Oscillation damping 0</li> <li>Signal asymmetry</li> <li>Exciter current 0</li> <li>Image of options increases if the measuring device has one or more application packages.</li> </ul>

# FOUNDATION Fieldbus

FOUNDATION Fieldbus	H1, IEC 61158-2, galvanically isolated
Data transfer	31.25 kbit/s
Current consumption	10 mA
Permitted supply voltage	9 to 32 V
Bus connection	With integrated reverse polarity protection

# PROFIBUS DP

Signal encoding	NRZ code
Data transfer	9.6 kBaud12 MBaud
Terminating resistor	Integrated, can be activated via DIP switches

# PROFIBUS PA

PROFIBUS PA	In accordance with EN 50170 Volume 2, IEC 61158-2 (MBP), galvanically isolated
Data transmission	31.25 kbit/s
Current consumption	10 mA
Permitted supply voltage	9 to 32 V
Bus connection	With integrated reverse polarity protection

# Modbus RS485

Physical interface	RS485 in accordance with EIA/TIA-485 standard
Terminating resistor	Integrated, can be activated via DIP switches

# EtherNet/IP

Standards	In accordance with IEEE 802.3
-----------	-------------------------------

# PROFINET

Standards	In accordance with IEEE 802.3
-----------	-------------------------------

# **PROFINET** with Ethernet-APL

Device use	<ul> <li>Device connection to an APL field switch</li> <li>The device may only be operated according to the following APL port classifications:</li> <li>If used in hazardous areas: SLAA or SLAC<sup>1)</sup></li> <li>If used in non-hazardous areas: SLAX</li> </ul>
	Connection values of APL field switch (corresponds to APL port classification SPCC or SPAA, for instance): <ul> <li>Maximum input voltage: 15 V<sub>DC</sub></li> </ul>
	<ul> <li>Minimum output values: 0.54 W</li> </ul>
	<b>Device connection to an SPE switch</b> The device may only be operated according to the following PoDL power class: If used in the non-hazardous area: PoDL power class 10
	Connection values of SPE switch (corresponds to PoDL power class 10, 11 or 12): Maximum input voltage: 30 V <sub>DC</sub> Minimum output values: 1.85 W
PROFINET	According to IEC 61158 and IEC 61784
Ethernet-APL	According to IEEE 802.3cg, APL port profile specification v1.0, galvanically isolated
Data transfer	10 Mbit/s
Current consumption	Transmitter Max. 400 mA(24 V) Max. 200 mA (110 V, 50/60 Hz; 230 V, 50/60 Hz)
Permitted supply voltage	9 to 30 V
Network connection	With integrated reverse polarity protection

1) For more information on using the device in the hazardous area, see the Ex-specific Safety Instructions

# Current output 4 to 20 mA

Order code	"Output; input 2" (21), "Output; input 3" (022) or "Output; input 4" (023): Option B: current output 4 to 20 mA
Signal mode	Can be set to: • Active • Passive
Current span	Can be set to: • 4 to 20 mA NAMUR • 4 to 20 mA US • 4 to 20 mA • 0 to 20 mA (only if the signal mode is active) • Fixed current
Maximum output values	22.5 mA
Open-circuit voltage	DC 28.8 V (active)
Maximum input voltage	DC 30 V (passive)
Load	0 to 700 Ω
Resolution	0.38 μΑ

Damping	Configurable: 0 to 999.9 s
Assignable measured variables	<ul> <li>Mass flow</li> <li>Volume flow</li> <li>Corrected volume flow</li> <li>Density</li> <li>Reference density</li> <li>Temperature</li> <li>Electronics temperature</li> <li>Oscillation frequency 0</li> <li>Oscillation damping 0</li> <li>Signal asymmetry</li> <li>Exciter current 0</li> <li>Image of options increases if the measuring device has one or more application packages.</li> </ul>

# Current output 4 to 20 mA Ex i passive

Order code	"Output; input 2" (21), "Output; input 3" (022): Option C: current output 4 to 20 mA Ex i passive
Signal mode	Passive
Current span	Can be set to: • 4 to 20 mA NAMUR • 4 to 20 mA US • 4 to 20 mA • Fixed current
Maximum output values	22.5 mA
Maximum input voltage	DC 30 V
Load	0 to 700 Ω
Resolution	0.38 μΑ
Damping	Configurable: 0 to 999 s
Assignable measured variables	<ul> <li>Mass flow</li> <li>Volume flow</li> <li>Corrected volume flow</li> <li>Density</li> <li>Reference density</li> <li>Temperature</li> <li>Electronics temperature</li> <li>Oscillation frequency 0</li> <li>Oscillation damping 0</li> <li>Signal asymmetry</li> <li>Exciter current 0</li> <li>Image of options increases if the measuring device has one or more application packages.</li> </ul>

# Pulse/frequency/switch output

Function	Can be configured as pulse, frequency or switch output
Version	Open collector Can be set to: • Active • Passive • Passive NAMUR Ex-i, passive
Maximum input values	DC 30 V, 250 mA (passive)
Open-circuit voltage	DC 28.8 V (active)
Voltage drop	For 22.5 mA: ≤ DC 2 V

Pulse output	
Maximum input values	DC 30 V, 250 mA (passive)
Maximum output current	22.5 mA (active)
Open-circuit voltage	DC 28.8 V (active)
Pulse width	Configurable: 0.05 to 2 000 ms
Maximum pulse rate	10 000 Impulse/s
Pulse value	Configurable
Assignable measured variables	<ul> <li>Mass flow</li> <li>Volume flow</li> <li>Corrected volume flow</li> </ul>
Frequency output	
Maximum input values	DC 30 V, 250 mA (passive)
Maximum output current	22.5 mA (active)
Open-circuit voltage	DC 28.8 V (active)
Output frequency	Configurable: end value frequency 2 to $10000$ Hz(f <sub>max</sub> = 12 500 Hz)
Damping	Configurable: 0 to 999.9 s
Pulse/pause ratio	1:1
Assignable measured variables	<ul> <li>Mass flow</li> <li>Volume flow</li> <li>Corrected volume flow</li> <li>Density</li> <li>Reference density</li> <li>Temperature</li> <li>Electronics temperature</li> <li>Oscillation frequency 0</li> <li>Oscillation damping 0</li> <li>Signal asymmetry</li> <li>Exciter current 0</li> <li>In range of options increases if the measuring device has one or more application packages.</li> </ul>
Switch output	
Maximum input values	DC 30 V, 250 mA (passive)
Open-circuit voltage	DC 28.8 V (active)
Switching behavior	Binary, conductive or non-conductive
Switching delay	Configurable: 0 to 100 s
Number of switching cycles	Unlimited
Assignable functions	<ul> <li>Off</li> <li>On</li> <li>Diagnostic behavior</li> <li>Limit value <ul> <li>Mass flow</li> <li>Volume flow</li> <li>Corrected volume flow</li> <li>Density</li> <li>Reference density</li> <li>Temperature</li> <li>Totalizer 1-3</li> </ul> </li> <li>Flow direction monitoring</li> <li>Status <ul> <li>Partially filled pipe detection</li> <li>Low flow cut off</li> </ul> </li> <li>The range of options increases if the measuring device has one or more application packages.</li> </ul>

# Double pulse output

Function	Double pulse
Version	Open collector
	Can be set to: • Active • Passive • Passive NAMUR
Maximum input values	DC 30 V, 250 mA (passive)
Open-circuit voltage	DC 28.8 V (active)
Voltage drop	For 22.5 mA: ≤ DC 2 V
Output frequency	Configurable: 0 to 1000 Hz
Damping	Configurable: 0 to 999 s
Pulse/pause ratio	1:1
Assignable measured variables	<ul> <li>Mass flow</li> <li>Volume flow</li> <li>Corrected volume flow</li> <li>Density</li> <li>Reference density</li> <li>Temperature</li> <li>The range of options increases if the measuring device has one or more application packages.</li> </ul>

# **Relay output**

Function	Switch output
Version	Relay output, galvanically isolated
Switching behavior	Can be set to: • NO (normally open), factory setting • NC (normally closed)
Maximum switching capacity (passive)	<ul> <li>DC 30 V, 0.1 A</li> <li>AC 30 V, 0.5 A</li> </ul>
Assignable functions	<ul> <li>Off</li> <li>On</li> <li>Diagnostic behavior</li> <li>Limit value <ul> <li>Mass flow</li> <li>Volume flow</li> <li>Corrected volume flow</li> <li>Density</li> <li>Reference density</li> <li>Temperature</li> <li>Totalizer 1-3</li> </ul> </li> <li>Flow direction monitoring</li> <li>Status <ul> <li>Partially filled pipe detection</li> <li>Low flow cut off</li> </ul> </li> <li>The range of options increases if the measuring device has one or more application packages.</li> </ul>

# User-configurable input/output

 ${\bf One}$  specific input or output is assigned to a user-configurable input/output (configurable I/O) during device commissioning.

The following inputs and outputs are available for assignment:

- Choice of current output: 4 to 20 mA (active), 0/4 to 20 mA (passive)
- Pulse/frequency/switch output
- Choice of current input: 4 to 20 mA (active), 0/4 to 20 mA (passive)
- Status input

The technical values correspond to those of the inputs and outputs described in this section.

#### Signal on alarm

Depending on the interface, failure information is displayed as follows:

#### HART current output

Device diagnostics	Device condition can be read out via HART Command 48
--------------------	--

#### **PROFIBUS PA**

Status and alarm messages	Diagnostics in accordance with PROFIBUS PA Profile 3.02
Failure current FDE (Fault Disconnection Electronic)	0 mA

#### PROFIBUS DP

Status and alarm	Diagnostics in accordance with PROFIBUS PA Profile 3.02
messages	

#### EtherNet/IP

Device condition can be read out in Input Assembly

#### PROFINET

Device diagnostics	According to "Application Layer protocol for decentralized periphery", Version 2.3
--------------------	--

# PROFINET with Ethernet-APL

	Device diagnostics	Diagnostics according to PROFINET PA Profile 4
--	--------------------	--

#### **FOUNDATION Fieldbus**

Status and alarm messages	Diagnostics in accordance with FF-891
Failure current FDE (Fault Disconnection Electronic)	0 mA

#### Modbus RS485

Failure mode	Choose from: • NaN value instead of current value • Last valid value

# Current output 0/4 to 20 mA

# 4 to 20 mA

Failure mode	Choose from: • 4 to 20 mA in accordance with NAMUR recommendation NE 43 • 4 to 20 mA in accordance with US • Min. value: 3.59 mA • Max. value: 22.5 mA • Freely definable value between: 3.59 to 22.5 mA • Actual value • Last valid value	
--------------	---	--

# 0 to 20 mA

Failure mode	Choose from:
	<ul> <li>Maximum alarm: 22 mA</li> </ul>
	<ul> <li>Freely definable value between: 0 to 20.5 mA</li> </ul>

# Pulse/frequency/switch output

Pulse output	
Failure mode	Choose from: • Actual value • No pulses
Frequency output	
Failure mode	Choose from: • Actual value • 0 Hz • Defined value (f <sub>max</sub> 2 to 12 500 Hz)
Switch output	
Failure mode	Choose from: • Current status • Open • Closed

# **Relay output**

Failure mode	Choose from:
	<ul> <li>Current status</li> </ul>
	<ul> <li>Open</li> </ul>
	<ul> <li>Closed</li> </ul>

# Local display

Plain text display	With information on cause and remedial measures
Backlight	Red backlighting indicates a device error.




Status signal as per NAMUR recommendation NE 107

#### Interface/protocol

- Via digital communication:
  - HART protocol
  - FOUNDATION Fieldbus
  - PROFIBUS PA
  - PROFIBUS DP
  - Modbus RS485
  - EtherNet/IP
- PROFINET
- PROFINET with Ethernet-APL
- Via service interface
  - CDI-RJ45 service interface
  - WLAN interface

Plain text display	With information on cause and remedial measures



#### Web browser

Plain text display With information on cause an	nd remedial measures
---	----------------------

# Light emitting diodes (LED)

Status information	Status indicated by various light emitting diodes
	The following information is displayed depending on the device version: <ul> <li>Supply voltage active</li> <li>Data transmission active</li> <li>Device alarm/error has occurred</li> <li>EtherNet/IP network available</li> <li>EtherNet/IP connection established</li> <li>PROFINET network available</li> <li>PROFINET connection established</li> <li>PROFINET blinking feature</li> </ul>

Load

Output signal  $\rightarrow \square 15$ 

#### Ex connection data

#### Safety-related values

Order code for "Output; input 1"	Output type	Safety-related values "Output; input 1"	
		26 (+)	27 (-)
Option <b>BA</b>	Current output 4 to 20 mA HART	$U_{N} = 30 V_{DC}$ $U_{M} = 250 V_{AC}$	
Option <b>GA</b>	PROFIBUS PA	$U_{N} = 32 V_{DC}$ $U_{M} = 250 V_{AC}$	
Option <b>LA</b>	PROFIBUS DP	$U_{N} = 32 V_{DC}$ $U_{M} = 250 V_{AC}$	
Option <b>MA</b>	Modbus RS485	$U_{N} = 30 V_{DC}$ $U_{M} = 250 V_{AC}$	
Option SA	FOUNDATION Fieldbus	$U_{N} = 32 V_{DC}$ $U_{M} = 250 V_{AC}$	
Option <b>NA</b>	EtherNet/IP	$U_{N} = 30 V_{DC}$ $U_{M} = 250 V_{AC}$	

Order code for "Output; input 1"	Output type	Safety-related values "Output; input 1"	
		26 (+)	27 (-)
Option <b>RA</b>	PROFINET	$U_{\rm N} = 30 V_{\rm DC}$ $U_{\rm M} = 250 V_{\rm AC}$	
Option <b>RB</b>	PROFINET with Ethernet- APL	APL port profile SLAX SPE PoDL classes 10, 11, 12 $U_N = 30 V_{DC}$ $U_M = 250 V_{AC}$	2

Order code for	Output type		S	afety-rela	ated value	S	
"Output; input 2"; "Output; input 3" "Output; input 4"		Output;	input 2	Output;	input 3	Output 4	t <b>; input</b>
		24 (+)	25 (-)	22 (+)	23 (-)	20 (+)	21 (-)
Option <b>B</b>	Current output 4 to 20 mA	$U_{\rm N} = 30$ V $U_{\rm M} = 250$	20				
Option <b>D</b>	User-configurable input/ output	$U_{\rm N} = 30$ V $U_{\rm M} = 250$	DC				
Option <b>E</b>	Pulse/frequency/switch output	$U_{\rm N} = 30 V_{\rm DC}$ $U_{\rm M} = 250 V_{\rm AC}$					
Option <b>F</b>	Double pulse output	$U_{N} = 30 V_{DC}$ $U_{M} = 250 V_{AC}$					
Option <b>H</b>	Relay output	$ \begin{array}{l} U_{N} = 30 \ V_{DC} \\ I_{N} = 100 \ mA_{DC} / 500 \ mA_{AC} \\ U_{M} = 250 \ V_{AC} \end{array} $					
Option I	Current input 4 to 20 mA	$U_{N} = 30 V_{DC}$ $U_{M} = 250 V_{AC}$					
Option <b>J</b>	Status input	U <sub>N</sub> = 30 V U <sub>M</sub> = 250	DC				

1) The order code "Output; input 4" is only available for the Proline 500 – digital transmitter.

# Intrinsically safe values

Order code "Output; input 1"	Output type	Intrinsically safe values "Output; input 1"		
		26 (+)	27 (-)	
Option CA	Current output 4 to 20 mA HART Ex i passive	$\begin{array}{l} U_i = 30 \ V \\ l_i = 100 \ mA \\ P_i = 1.25 \ W \\ L_i = 0 \ \mu H \\ C_i = 6 \ nF \end{array}$		
Option <b>CC</b>	Current output 4 to 20 mA HART Ex i active	0	Ex ic <sup>2)</sup> $U_0 = 21.8 V$ $l_0 = 90 mA$ $P_0 = 491 mW$ $L_0 = 9 mH (IIC)/39 mH$ (IIB) $C_0 = 600 nF (IIC)/$ 4000 nF (IIB)	

Order code "Output; input 1"	Output type	Intrinsically safe values "Output; input 1"		
		26 (+)	27 (-)	
Option HA	PROFIBUS PA Ex i (FISCO Field Device)	Ex ia <sup>1)</sup> $U_i = 30 V$ $l_i = 570 mA$ $P_i = 8.5 W$ $L_i = 10 \mu H$ $C_i = 5 nF$	<b>Ex ic</b> <sup>2)</sup> $U_i = 32 V$ $l_i = 570 mA$ $P_i = 8.5 W$ $L_i = 10 \mu H$ $C_i = 5 nF$	
Option TA	FOUNDATION Fieldbus Ex i		<b>Ex ic</b> <sup>2)</sup> $U_i = 32 V$ $l_i = 570 mA$ $P_i = 8.5 W$ $L_i = 10 \mu H$ $C_i = 5 nF$	
Option RC	PROFINET with Ethernet- APL Ex i	<b>Ex ia</b> <sup>1)</sup> 2-WISE power load APL port profile SLAA	<b>Ex ic</b> <sup>2)</sup> 2-WISE power load APL port profile SLAC	

1) Only available for Proline 500 transmitter Zone 1; Class I, Division 1.

2) Only available for transmitter Zone 2; Class I, Division 2 and only for Proline 500 – digital transmitter

Order code for	Output type         Intrinsically safe values or NIFW values			s			
"Output; input 2"; "Output; input 3"; "Output; input 4"		Output; input 2 Output; input 3		Output; input 2 Output; input 3 Output;	Output; input 2		input 4
• / •		24 (+)	25 (-)	22 (+)	23 (-)	20 (+)	21 (-)
Option C	Current output 4 to 20 mA Ex i passive	$\begin{array}{l} U_{i} = 30 \ V \\ l_{i} = 100 \ r \\ P_{i} = 1.25 \\ L_{i} = 0 \\ C_{i} = 0 \end{array}$	nA				
Option G	Pulse/frequency/switch output Ex i passive	$\begin{array}{l} U_{i} = 30 \ V \\ l_{i} = 100 \ r \\ P_{i} = 1.25 \\ L_{i} = 0 \\ C_{i} = 0 \end{array}$	nA				

1) The order code "Output; input 4" is only available for the Proline 500 – digital transmitter.

 Low flow cut off
 The switch points for low flow cut off are user-selectable.

 Galvanic isolation
 The outputs are galvanically isolated:

 from the power supply
 from one another
 from the potential equalization (PE) terminal

#### Protocol-specific data

HART

Manufacturer ID	0x11
Device type ID	0x3B
HART protocol revision	7
Device description files (DTM, DD)	Information and files under: www.endress.com
HART load	Min. 250 Ω
System integration	<ul> <li>Information on system integration: Operating Instructions →  <sup>B</sup> 120.</li> <li>Measured variables via HART protocol</li> <li>Burst Mode functionality</li> </ul>

# FOUNDATION Fieldbus

Manufacturer ID	0x452B48 (hex)
Ident number	0x103B (hex)
Device revision	1
DD revision	Information and files under: • www.endress.com
CFF revision	<ul><li>www.fieldcommgroup.org</li></ul>
Interoperability Test Kit (ITK)	Version 6.2.0
ITK Test Campaign Number	Information: • www.endress.com • www.fieldcommgroup.org
Link Master capability (LAS)	Yes
Choice of "Link Master" and "Basic Device"	Yes Factory setting: Basic Device
Node address	Factory setting: 247 (0xF7)
Supported functions	The following methods are supported: • Restart • ENP Restart • Diagnostic • Set to OOS • Set to AUTO • Read trend data • Read event logbook
Virtual Communication Relation	nships (VCRs)
Number of VCRs	44
Number of link objects in VFD	50
Permanent entries	1
Client VCRs	0
Server VCRs	10
Source VCRs	43
Sink VCRs	0
Subscriber VCRs	43
Publisher VCRs	43
Device Link Capabilities	
Slot time	4
Min. delay between PDU	8
Max. response delay	16
System integration	<ul> <li>Information regarding system integration: Operating Instructions →  <sup>(1)</sup> 120.</li> <li>Cyclic data transmission</li> <li>Description of the modules</li> <li>Execution times</li> <li>Methods</li> </ul>

# PROFIBUS DP

Manufacturer ID	0x11
Ident number	0x156F
Profile version	3.02

Device description files (GSD, DTM, DD)	Information and files under: • https://www.endress.com/download On the device product page: PRODUCTS → Product Finder → Links • https://www.profibus.com
Supported functions	<ul> <li>Identification &amp; Maintenance Simplest device identification on the part of the control system and nameplate</li> <li>PROFIBUS upload/download Reading and writing parameters is up to ten times faster with PROFIBUS upload/download</li> <li>Condensed status Simplest and self-explanatory diagnostic information by categorizing diagnostic messages that occur</li> </ul>
Configuration of the device address	<ul><li>DIP switches on the I/O electronics module</li><li>Via operating tools (e.g. FieldCare)</li></ul>
Compatibility with earlier model	If the device is replaced, the measuring device Promass 500 supports the compatibility of the cyclic data with previous models. It is not necessary to adjust the engineering parameters of the PROFIBUS network with the Promass 500 GSD file.
	Previous model: Promass 83 PROFIBUS DP ID No.: 1529 (hex) Extended GSD file: EH3x1529.gsd Standard GSD file: EH3_1529.gsd
	Description of the function scope of compatibility: Operating Instructions $\rightarrow \cong 120$ .
System integration	<ul> <li>Information regarding system integration: Operating Instructions →  <sup>B</sup> 120.</li> <li>Cyclic data transmission</li> <li>Block model</li> <li>Description of the modules</li> </ul>

# PROFIBUS PA

Manufacturer ID	0x11
Ident number	0x156D
Profile version	3.02
Device description files (GSD, DTM, DD)	Information and files under: • https://www.endress.com/download On the device product page: PRODUCTS → Product Finder → Links • https://www.profibus.com
Supported functions	<ul> <li>Identification &amp; Maintenance Simplest device identification on the part of the control system and nameplate</li> <li>PROFIBUS upload/download Reading and writing parameters is up to ten times faster with PROFIBUS upload/download</li> <li>Condensed status Simplest and self-explanatory diagnostic information by categorizing diagnostic messages that occur</li> </ul>
Configuration of the device address	<ul> <li>DIP switches on the I/O electronics module</li> <li>Local display</li> <li>Via operating tools (e.g. FieldCare)</li> </ul>

Compatibility with earlier model	If the device is replaced, the measuring device Promass 500 supports the compatibility of the cyclic data with previous models. It is not necessary to adjust the engineering parameters of the PROFIBUS network with the Promass 500 GSD file.
	Earlier models: • Promass 80 PROFIBUS PA • ID No.: 1528 (hex) • Extended GSD file: EH3x1528.gsd • Standard GSD file: EH3_1528.gsd • Promass 83 PROFIBUS PA • ID No.: 152A (hex) • Extended GSD file: EH3x152A.gsd • Standard GSD file: EH3_152A.gsd
	Description of the function scope of compatibility: Operating Instructions $\rightarrow \textcircled{B}$ 120.
System integration	Information regarding system integration: Operating Instructions $\rightarrow$ 🗎 120.
	<ul><li>Cyclic data transmission</li><li>Block model</li><li>Description of the modules</li></ul>

# Modbus RS485

Protocol	Modbus Applications Protocol Specification V1.1					
Response times	<ul><li>Direct data access: typically 25 to 50 ms</li><li>Auto-scan buffer (data range): typically 3 to 5 ms</li></ul>					
Device type	Slave					
Slave address range	1 to 247					
Broadcast address range	0					
Function codes	<ul> <li>03: Read holding register</li> <li>04: Read input register</li> <li>06: Write single registers</li> <li>08: Diagnostics</li> <li>16: Write multiple registers</li> <li>23: Read/write multiple registers</li> </ul>					
Broadcast messages	Supported by the following function codes: • 06: Write single registers • 16: Write multiple registers • 23: Read/write multiple registers					
Supported baud rate	<ul> <li>1200 BAUD</li> <li>2400 BAUD</li> <li>4800 BAUD</li> <li>9600 BAUD</li> <li>19200 BAUD</li> <li>38400 BAUD</li> <li>57600 BAUD</li> <li>115200 BAUD</li> </ul>					
Data transfer mode	ASCII     RTU					
Data access	Each device parameter can be accessed via Modbus RS485.					

Compatibility with earlier model	If the device is replaced, the measuring device Promass 500 supports the compatibility of the Modbus registers for the process variables and the diagnostic information with the previous model Promass 83. It is not necessary to change the engineering parameters in the automation system. Description of the function scope of compatibility: Operating Instructions $\rightarrow \cong 120$ .
System integration	<ul> <li>Information on system integration: Operating Instructions →  <sup>1</sup> 120.</li> <li>Modbus RS485 information</li> <li>Function codes</li> <li>Register information</li> <li>Response time</li> <li>Modbus data map</li> </ul>

# EtherNet/IP

Protocol	<ul> <li>The CIP Networks Library Volume 1: Common Industrial Protocol</li> <li>The CIP Networks Library Volume 2: EtherNet/IP Adaptation of CIP</li> </ul>
Communication type	<ul><li>10Base-T</li><li>100Base-TX</li></ul>
Device profile	Generic device (product type: 0x2B)
Manufacturer ID	0x000049E
Device type ID	0x103B
Baud rates	Automatic <sup>10</sup> / <sub>100</sub> Mbit with half-duplex and full-duplex detection
Polarity	Auto-polarity for automatic correction of crossed TxD and RxD pairs
Supported CIP connections	Max. 3 connections
Explicit connections	Max. 6 connections
I/O connections	Max. 6 connections (scanner)
Configuration options for measuring device	<ul> <li>DIP switches on the electronics module for IP addressing</li> <li>Manufacturer-specific software (FieldCare)</li> <li>Add-on Profile Level 3 for Rockwell Automation control systems</li> <li>Web browser</li> <li>Electronic Data Sheet (EDS) integrated in the measuring device</li> </ul>
Configuration of the EtherNet interface	<ul><li>Speed: 10 MBit, 100 MBit, auto (factory setting)</li><li>Duplex: half-duplex, full-duplex, auto (factory setting)</li></ul>
Configuration of the device address	<ul> <li>DIP switches on the electronics module for IP addressing (last octet)</li> <li>DHCP</li> <li>Manufacturer-specific software (FieldCare)</li> <li>Add-on Profile Level 3 for Rockwell Automation control systems</li> <li>Web browser</li> <li>EtherNet/IP tools, e.g. RSLinx (Rockwell Automation)</li> </ul>
Device Level Ring (DLR)	Yes
System integration	Information regarding system integration: Operating Instructions $\rightarrow \cong 120$ .
	<ul><li>Cyclic data transmission</li><li>Block model</li><li>Input and output groups</li></ul>

# PROFINET

Protocol	Application layer protocol for decentral device periphery and distributed automation, Version 2.3
Communication type	100 MBit/s
Conformance Class	Conformance Class B
Netload Class	Netload Class 2 0 Mbps

Baud rates	Automatic 100 Mbit/s with full-duplex detection					
Cycle times	From 8 ms					
Polarity	Auto-polarity for automatic correction of crossed TxD and RxD pairs					
Media Redundancy Protocol (MRP)	Yes					
System redundancy support	System redundancy S2 (2 AR with 1 NAP)					
Device profile	Application interface identifier 0xF600 Generic device					
Manufacturer ID	0x11					
Device type ID	0x843B					
Device description files (GSD, DTM, DD)	Information and files under: ■ www.endress.com On the product page for the device: Documents/Software → Device drivers ■ www.profibus.com					
Supported connections	<ul> <li>2 x AR (IO Controller AR)</li> <li>1 x AR (IO-Supervisor Device AR connection allowed)</li> <li>1 x Input CR (Communication Relation)</li> <li>1 x Output CR (Communication Relation)</li> <li>1 x Alarm CR (Communication Relation)</li> </ul>					
Configuration options for measuring device	<ul> <li>DIP switches on the electronics module, for device name assignment (last part)</li> <li>Asset management software (FieldCare, DeviceCare, Field Xpert)</li> <li>Integrated Web server via Web browser and IP address</li> <li>Device master file (GSD), can be read out via the integrated Web server of the measuring device.</li> <li>Onsite operation</li> </ul>					
Configuration of the device name	<ul> <li>DIP switches on the electronics module, for device name assignment (last part)</li> <li>DCP protocol</li> <li>Asset management software (FieldCare, DeviceCare, Field Xpert)</li> <li>Integrated Web server</li> </ul>					
Supported functions	<ul> <li>Identification &amp; Maintenance, simple device identifier via:</li> <li>Control system</li> <li>Nameplate</li> <li>Measured value status The process variables are communicated with a measured value status</li> <li>Blinking feature via the local display for simple device identification and assignment</li> <li>Device operation via asset management software (e.g. FieldCare, DeviceCare, SIMATIC PDM)</li> </ul>					
System integration	<ul> <li>Information regarding system integration: Operating Instructions →  <sup>1</sup> 120.</li> <li>Cyclic data transmission</li> <li>Overview and description of the modules</li> <li>Status coding</li> <li>Startup configuration</li> <li>Factory setting</li> </ul>					

# **PROFINET** with Ethernet-APL

Protocol	Application layer protocol for decentral device periphery and distributed automation, Version 2.4
Communication type	Ethernet Advanced Physical Layer 10BASE-T1L
Conformance Class	Conformance Class B (PA)
Netload Class	Netload Class 2 0 Mbps
Baud rates	10 Mbit/s Full-duplex
Cycle times	64 ms

Polarity	Automatic correction of crossed "APL signal +" and "APL signal -" signal lines
Media Redundancy Protocol (MRP)	Not possible (point-to-point connection to APL field switch)
System redundancy support	System redundancy S2 (2 AR with 1 NAP)
Device profile	PROFINET PA profile 4 (Application interface identifier API: 0x9700)
Manufacturer ID	0x11
Device type ID	0xA43B
Device description files (GSD, DTM, FDI)	Information and files under: • www.endress.com/download On the device product page: PRODUCTS → Product Finder → Links • www.profibus.com
Supported connections	<ul> <li>2x AR (IO Controller AR)</li> <li>2x AR (IO Supervisor Device AR connection allowed)</li> </ul>
Configuration options for measuring device	<ul> <li>DIP switches on the electronics module, for device name assignment (last part)</li> <li>Asset management software (FieldCare, DeviceCare, Field Xpert)</li> <li>Integrated Web server via Web browser and IP address</li> <li>Device master file (GSD), can be read out via the integrated Web server of the measuring device.</li> <li>Onsite operation</li> </ul>
Configuration of the device name	<ul> <li>DIP switches on the electronics module, for device name assignment (last part)</li> <li>DCP protocol</li> <li>Asset management software (FieldCare, DeviceCare, Field Xpert)</li> <li>Integrated Web server</li> </ul>
Supported functions	<ul> <li>Identification &amp; Maintenance, simple device identifier via:</li> <li>Control system</li> <li>Nameplate</li> <li>Measured value status The process variables are communicated with a measured value status</li> <li>Blinking feature via the local display for simple device identification and assignment</li> <li>Device operation via asset management software (e.g. FieldCare, DeviceCare, SIMATIC PDM with FDI package)</li> </ul>
System integration	<ul> <li>Information regarding system integration: Operating Instructions →  <sup>(1)</sup> 120.</li> <li>Cyclic data transmission</li> <li>Overview and description of the modules</li> <li>Status coding</li> <li>Startup configuration</li> <li>Factory setting</li> </ul>

# Power supply

# Terminal assignment

# Transmitter: supply voltage, input/outputs

HART

Supply	Supply voltage Input/output 1		Input/output 2		Input/output 3		Input/output 4				
1 (+)	2 (-)	26 (+)	27 (-)	24 (+)	25 (-)	22 (+)	23 (-)	20 (+)	21 (-)		
		The t	The terminal assignment depends on the specific device version ordered $\rightarrow \square$ 13.								

#### FOUNDATION Fieldbus

Supply	Supply voltage Input/output 1		Input/output 2		Input/output 3		Input/output 4				
1 (+)	2 (-)	26 (A)	27 (B)	24 (+)	25 (-)	22 (+)	23 (-)	20 (+)	21 (-)		
		The t	The terminal assignment depends on the specific device version ordered $\rightarrow \square$ 13.								

#### PROFIBUS DP

Supply	upply voltage Input/output 1		Input/output 2		Input/output 3		Input/output 4			
1 (+)	2 (-)	26 (B)	27 (A)	24 (+)	25 (-)	22 (+)	23 (-)	20 (+)	21 (-)	
		The terminal assignment depends on the specific device version ordered $\rightarrow \square$ 13.								

# PROFIBUS PA

Supply	voltage	ge Input/output 1		Input/output 2		Input/output 3		Input/output 4			
1 (+)	2 (-)	26 (B)	27 (A)	24 (+)	25 (-)	22 (+)	23 (-)	20 (+)	21 (-)		
		The t	The terminal assignment depends on the specific device version ordered $\rightarrow \cong 13$ .								

# Modbus RS485

Supply	ly voltage Input/output 1		Input/output 2		Input/output 3		Input/output 4				
1 (+)	2 (-)	26 (B)	27 (A)	24 (+)	25 (-)	22 (+)	23 (-)	20 (+)	21 (-)		
		The t	The terminal assignment depends on the specific device version ordered $\rightarrow \square$ 13.								

# EtherNet/IP

Sur	oply	voltage	Input/output 1	Input/output 2		Input/output 3		Input/output 4	
1 (	+)	2 (-)	EtherNet/IP	24 (+)	25 (-)	22 (+)	23 (-)	20 (+)	21 (-)
			(RJ45 connector)	The terr	ninal assign	ment depen ordered	*	ecific device	e version

# PROFINET

Supply	voltage	Input/output 1	Input/output 2		Input/output 3		Input/output 4	
1 (+)	2 (-)	PROFINET (RJ45 connector)		I	I	23 (−) .ds on the sp → 🖹 13.	I	21 (–) e version

# PROFINET with Ethernet-APL

Supply	voltage	Input/output 1	Input/output 2		Input/output 3		Input/output 4	
1 (+)	2 (-)	EtherNet/IP	24 (+)	25 (-)	22 (+)	23 (-)	20 (+)	21 (-)
		(RJ45 connector)	The terr	ninal assign	ment depen ordered	ds on the sp $\rightarrow \square 13$ .	ecific device	version

#### Transmitter and sensor connection housing: connecting cable

The sensor and transmitter, which are mounted in separate locations, are interconnected by a connecting cable. The cable is connected via the sensor connection housing and the transmitter housing.

Terminal assignment and connection of the connecting cable:

- Proline 500 digital → 🖺 36
- Proline 500 → 
   <sup>™</sup> 37

-

#### Available device plugs

Device plugs may not be used in hazardous areas!

#### Device plugs for fieldbus systems:

Order code for "Input; output 1"

- Option NA "EtherNet/IP"  $\rightarrow \square$  33
- Option **RA** "PROFINET"  $\rightarrow$   $\cong$  34
- Option **RB** "PROFINET with Ethernet-APL"  $\rightarrow$   $\cong$  34

#### Device plug for connecting to the service interface:

Order code for "Accessory mounted" Option **NB**, adapter RJ45 M12 (service interface)  $\rightarrow \square 35$ 

#### Order code for "Input; output 1", option SA "FOUNDATION Fieldbus"

Order code for	Cable entry/connection $\rightarrow \square 38$			
"Electrical connection"	2	3		
M, 3, 4, 5	7/8" connector	_		

#### Order code for "Input; output 1", option GA "PROFIBUS PA"

Order code for	Cable entry/connection $\rightarrow \square 38$			
"Electrical connection"	2	3		
L, N, P, U	Connector M12 × 1	_		

#### Order code for "Input; output 1", option NA "EtherNet/IP"

Order code for	Cable entry/connection → 🗎 38			
"Electrical connection"	2	3		
L, N, P, U	Connector M12 × 1	-		
R <sup>1)2)</sup> , S <sup>1)2)</sup> , T <sup>1)2)</sup> , V <sup>1)2)</sup>	Connector M12 × 1	Connector M12 × 1		

 Cannot be combined with an external WLAN antenna (order code for "Enclosed accessories", option P8) of an RJ45 M12 adapter for the service interface (order code for "Accessories mounted", option NB) or of the remote display and operating module DKX001

2) Suitable for integrating the device in a ring topology.

#### Order code for "Input; output 1", option RA "PROFINET"

Order code for	Cable entry/connection → 🗎 38			
"Electrical connection"	2	3		
L, N, P, U	Connector M12 × 1	-		
R <sup>1) 2)</sup> , S <sup>1) 2)</sup> , T <sup>1) 2)</sup> , V <sup>1) 2)</sup>	Connector M12 × 1	Connector M12 × 1		

Cannot be combined with an external WLAN antenna (order code for "Enclosed accessories", option P8) of 1) an RJ45 M12 adapter for the service interface (order code for "Accessories mounted", option NB) or of the remote display and operating module DKX001.

2) Suitable for integrating the device in a ring topology.

#### Order code for "Input; output 1", option RB "PROFINET with Ethernet-APL"

Order code	Cable entry/connection $\rightarrow \square 38$			
"Electrical connection"	2	3		
L, N, P, U	M12 plug × 1	-		

#### Order code for "Accessory mounted", option NB "Adapter RJ45 M12 (service interface)"

Order code	Cable entry/coupling $\rightarrow \square 38$	
"Accessory mounted"	Cable entry 2	Cable entry 3
NB	Plug M12 × 1	-

Pin assignment, device plug

#### **FOUNDATION Fieldbus**

Pin		Assignment	Coding	Plug/socket
1	+	Signal +	А	Plug
2	-	Signal –		
3		Grounding		
4		Not assigned		

#### **PROFIBUS PA**

Pin		Assignment	Coding	Plug/socket
1	+	PROFIBUS PA +	А	Plug
2		Grounding		
3	-	PROFIBUS PA -		
4		Not assigned		

- Recommended plug: Binder, series 713, part no. 99 1430 814 04
  - Phoenix, part no. 1413934 SACC-FS-4QO SH PBPA SCO

#### PROFINET

2	Pin		Assignment
	1	+	TD +
	2	+	RD +
	3	-	TD –
	4	-	RD –
4 A0032047	Cod	ling	Plug/socket
	Ι	)	Socket

- Recommended plug: Binder, series 825, part no. 99 3729 810 04 Phoenix, part no. 1543223 SACC-M12MSD-4Q

#### **PROFINET** with Ethernet-APL

Pin	Assignment		Coding	Plug/socket		
1	-	APL signal -	А	Socket		
2	+	APL signal +				
3		Cable shield <sup>1</sup>				
4	Not assigned					
Metal plug housing		Cable shield				
<sup>1</sup> If a cable shield is used						

- Recommended plug: Binder, series 713, part no. 99 1430 814 04
  - Phoenix, part no. 1413934 SACC-FS-4QO SH PBPA SCO

#### EtherNet/IP

	Pin	Assignment			
	1	+	Тх		
	2	+	Rx		
	3	-	Тх		
	4	-	Rx		
4 A0032047	Coding		Plug/socket		
	D		Socket		

- Recommended plug: Binder, series 763, part no. 99 3729 810 04
  - Phoenix, part no. 1543223 SACC-M12MSD-4Q

#### Service interface

Order code for "Accessories mounted", option NB: Adapter RJ45 M12 (service interface)

2	Pin	Assignment			
	1	+	Тх		
	2	+	Rx		
	3	-	Тх		
	4	-	Rx		
4 					

		Coding		Plu	ıg/socket		
		D	Socket				
	<ul> <li>Recommended plug</li> <li>Binder, series 763</li> <li>Phoenix, part no.</li> </ul>	3, part no. 9		2			
Supply voltage	Order code for "Power supply"	Terminal voltage		9	Frequency range		
	Option <b>D</b>		DC 24 V	±20%	-		
	Option <b>E</b>		AC 100 to 240 V	-15 to +10%	50/60 Hz		
			DC 24 V	±20%	-		
	Option I		AC 100 to 240 V	-15 to +10%	50/60 Hz		
Power consumption	Transmitter						
	Max. 10 W (active power)						
	switch-on currentMax. 36 A (<5 ms) as per NAMUR Recommendation NE 21						
Current consumption	Transmitter						
	<ul> <li>Max. 400 mA (24 V)</li> <li>Max. 200 mA (110 V)</li> </ul>	7, 50/60 H	z; 230 V, 50/60	Hz)			
Power supply failure	<ul> <li>Totalizers stop at the last value measured.</li> <li>Depending on the device version, the configuration is retained in the device memoryor in the pluggable data memory (HistoROM DAT).</li> <li>Error messages (incl. total operated hours) are stored.</li> </ul>						
Overcurrent protection element	<ul> <li>The device must be operated with a dedicated circuit breaker, as it does not have an ON/OFF switch of its own.</li> <li>The circuit breaker must be easy to reach and labeled accordingly.</li> <li>Permitted nominal current of the circuit breaker: 2 A up to maximum 10 A.</li> </ul>						
Electrical connection	Connection of connecting cable: Proline 500 – digital						
				+ - B A			

- Terminal connection for potential equalization (PE)
   Connecting cable ISEM communication
- 4 Grounding via ground connection; in the version with a device plug, grounding is ensured through the plug itself

62 61 64 63

+

A B

- 5 Cable entry for cable or connection of device plug on sensor connection housing
- 6 Terminal connection for potential equalization (PE)

Cable entry for cable on transmitter housing

3 5

6

1

A0028198

**E** - 4

 $(\square)$ 

Depending on the device version of the sensor connection housing, the connecting cable is connected via terminals or device plugs.


Sensor connection housing Order code for "Housing"	Connection on connection housing via	Connection on transmitter housing via
Option A: aluminum coated	Terminals	Terminals
Option <b>B</b> : stainless	Terminals	Terminals
Option <b>C</b> : ultra-compact, hygienic, stainless	Device plug	Terminals

Pin assignment, device plug

Device plugs are only available for device version, order code for "Housing": Option **C**: ultra-compact, hygienic, stainless For connection to sensor connection housing.


2	Pin	Color <sup>1)</sup>		Assignment	Connection to terminal
	1	Brown	+	Supply voltage	61
3 + 0 + 1	2	White	А	ISEM communication	64
	3	Blue	В	ISEM COmmunication	63
4	4	Black	-	Supply voltage	62
	5	-		-	-
		Coding		Plug/socket	
		А		Plug	

1) Cable colors of connecting cable



## Connection of the connecting cable: Proline 500

The connecting cable is connected via terminals.

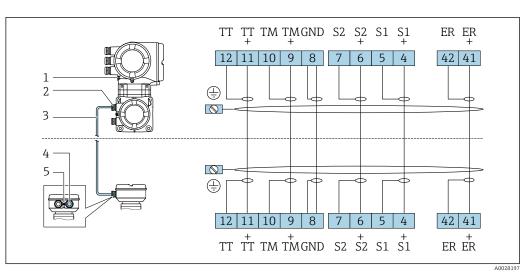


- *1 Terminal connection for potential equalization (PE)*
- 2 Cable entry for connecting cable on transmitter connection housing


3 Connecting cable

- 4 Cable entry for connecting cable on sensor connection housing
- 5 Terminal connection for potential equalization (PE)

### Transmitter connection



Transmitter connection: Proline 500 - digital

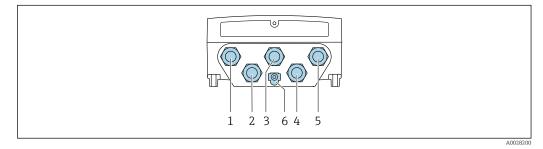

- 1 Terminal connection for supply voltage
- 2 Terminal connection for signal transmission, input/output
- Terminal connection for signal transmission, input/output 3
- 4 Terminal connection for connecting cable between sensor and transmitter
- Terminal connection for signal transmission, input/output or terminal for network connection (DHCP client) 5 via service interface (CDI-RJ45); optional: terminal connection for external WLAN antenna
- 6 Terminal connection for potential equalization (PE)


An adapter for RJ45 to the M12 plug is optionally available: 1 Order code for "Accessories", option NB: "Adapter RJ45 M12 (service interface)"

The adapter connects the service interface (CDI-RJ45) to an M12 plug mounted in the cable entry. Therefore the connection to the service interface can be established via an M12 plug without opening the device.

Network connection (DHCP client) via service interface (CDI-RJ45)  $\rightarrow \cong 103$ 

Connecting the transmitter: Proline 500

H

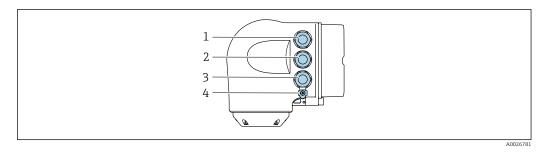

- 1 Terminal connection for supply voltage
- Terminal connection for signal transmission, input/output 2
- 3 Terminal connection for signal transmission, input/output or terminal for network connection (DHCP client) via service interface (CDI-RJ45); optional: terminal connection for external WLAN antenna
- Terminal connection for potential equalization (PE) 4

H


An adapter for RJ45 to the M12 plug is optionally available: Order code for "Accessories", option NB: "Adapter RJ45 M12 (service interface)"

The adapter connects the service interface (CDI-RJ45) to an M12 plug mounted in the cable entry. Therefore the connection to the service interface can be established via an M12 plug without opening the device.

Network connection (DHCP client) via service interface (CDI-RJ45)  $\rightarrow \cong 103$ н


Connecting in a ring topology

Device versions with EtherNet/IP and PROFINET communication protocols can be integrated into a ring topology. The device is integrated via the terminal connection for signal transmission (output 1) and the connection to the service interface (CDI-RJ45).




Integrate the transmitter in a ring topology: + EtherNet/IP PROFINET

Transmitter: Proline 500 - digital

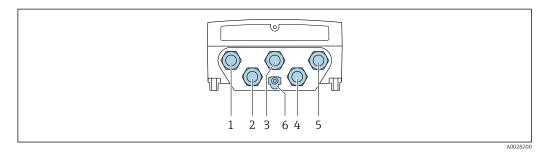

- Terminal connection for supply voltage 1
- 2 Terminal connection for signal transmission, input/output
- Terminal connection for signal transmission: PROFINET or EtherNet/IP (RJ45 plug) 2
- 4 Terminal connection for connecting cable between sensor and transmitter
- 5 Terminal connection to service interface (CDI-RJ45)
- 6 Terminal connection for potential equalization (PE)

Transmitter: Proline 500

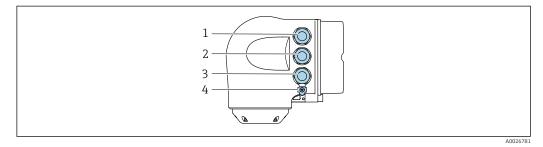


- Terminal connection for supply voltage 1
- *Terminal connection for signal transmission: PROFINET or EtherNet/IP (RJ45 plug)* 2
- 3 Terminal connection to service interface (CDI-RJ45)
- 4 Terminal connection for potential equalization (PE)



If the device has additional inputs/outputs, these are routed in parallel via the cable entry for connection to the service interface.


### **Connection examples**

Current output 4 to 20 mA HART

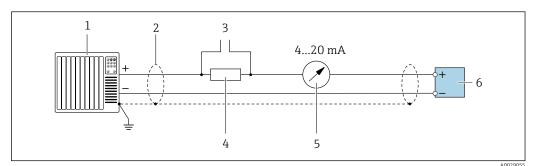


Connection example for 4 to 20 mA HART current output (active)

- 1 Automation system with current input (e.g. PLC)
- 2 Cable shield provided at one end. The cable shield must be grounded at both ends to comply with EMC
- requirements; observe cable specifications  $\rightarrow \mathbb{B}$  49
- 3 Connection for HART operating devices  $\rightarrow \square 97$
- 4 Resistor for HART communication ( $\geq 250 \Omega$ ): observe maximum load  $\rightarrow \square 15$
- 5 Analog display unit: observe maximum load  $\rightarrow \equiv 15$
- 6 Transmitter

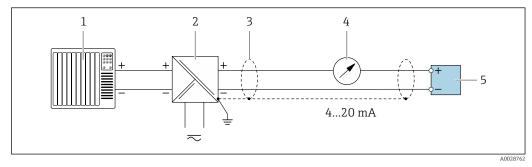


- ☑ 3 Connection example for 4 to 20 mA HART current output (passive)
- 1 Automation system with current input (e.g. PLC)
- 2 Power supply
- 3 Cable shield provided at one end. The cable shield must be grounded at both ends to comply with EMC requirements; observe cable specifications  $\rightarrow \cong 49$
- 4 Analog display unit: observe maximum load  $\rightarrow \cong 15$
- 5 Transmitter

### HART input

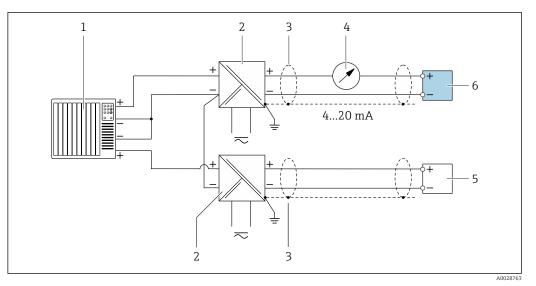


- Connection example for HART input with a common negative (passive)
- 1 Automation system with HART output (e.g. PLC)
- 2 Active barrier for power supply (e.g. RN221N)
- 3 Cable shield provided at one end. The cable shield must be grounded at both ends to comply with EMC requirements; observe cable specifications
- 4 Analog display unit: observe maximum load  $\rightarrow \square 15$
- 5 Pressure transmitter (e.g. Cerabar M, Cerabar S): see requirements
- 6 Transmitter

# PROFIBUS PA

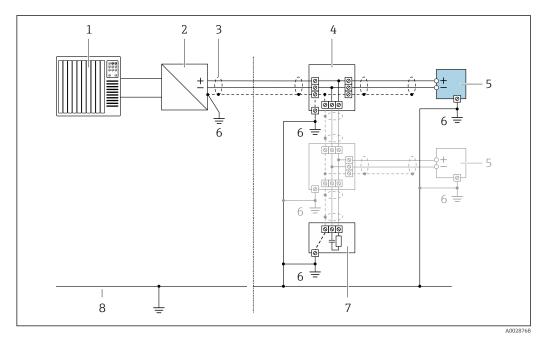

- 5 Connection example for PROFIBUS PA
- 1 Control system (e.g. PLC)
- 2 PROFIBUS PA segment coupler
- 3 Cable shield provided at one end. The cable shield must be grounded at both ends to comply with EMC requirements; observe cable specifications
- 4 T-box
- 5 Measuring device
- 6 Local grounding
- 7 Bus terminator
- 8 Potential matching line

### PROFIBUS DP

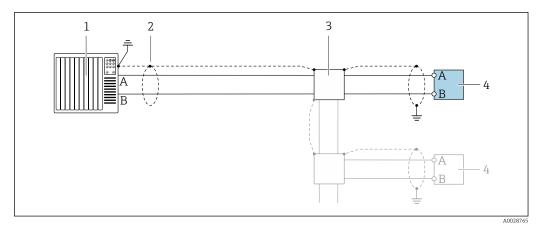


☑ 6 Connection example for PROFIBUS DP, non-hazardous area and Zone 2/Div. 2

- 1 Control system (e.g. PLC)
- 2 Cable shield provided at one end. The cable shield must be grounded at both ends to comply with EMC requirements; observe cable specifications
- 3 Distribution box
- 4 Transmitter


If baud rates > 1.5 MBaud an EMC cable entry must be used and the cable shield must continue as far as the terminal wherever possible.

### EtherNet/IP

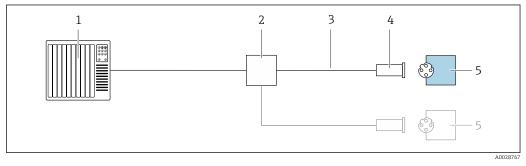


- ☑ 7 Connection example for EtherNet/IP
- 1 Control system (e.g. PLC)
- 2 Ethernet switch
- *3 Observe cable specifications*
- 4 Device plug
- 5 Transmitter

### EtherNet/IP: DLR (Device Level Ring)

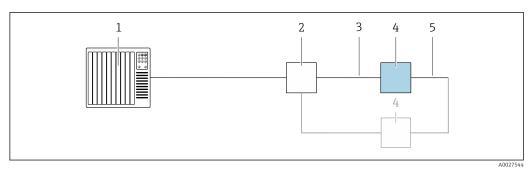


- 1 Control system (e.g. PLC)
- 2 Ethernet switch
- 3  $\textit{Observe cable specifications} \rightarrow \ \textcircled{B} \ 49$
- 4 Transmitter
- 5 Connecting cable between the two transmitters

### PROFINET

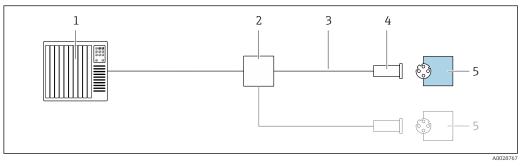

- 8 Connection example for PROFINET
- Control system (e.g. PLC) 1
- 2 Ethernet switch
- Observe cable specifications 3
- -4 5 Device plug
- Transmitter


# PROFINET with Ethernet-APL

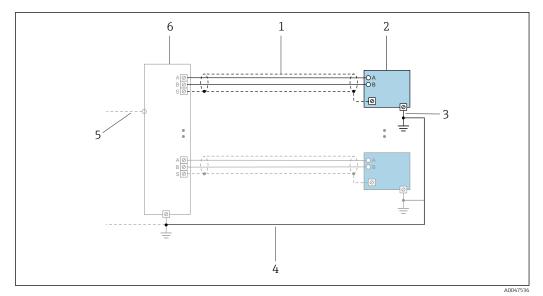

💽 9 Connection example for PROFINET with Ethernet-APL


- 1 Cable shield
- 2 Measuring device
- 3 Local grounding
- Potential equalization Trunk or TCP 4
- 5
- 6 Field switch

## PROFINET: MRP (Media Redundancy Protocol)

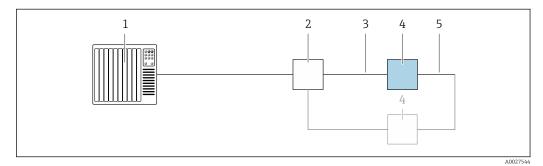

- Control system (e.g. PLC) Ethernet switch 1
- 2
- 3 *Observe cable specifications*  $\rightarrow \square 49$
- Transmitter 4
- 5 Connecting cable between the two transmitters


### PROFINET: system redundancy S2

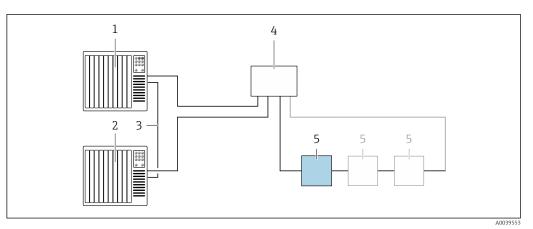

*10* Connection example for system redundancy S2


- Control system 1 (e.g. PLC) 1
- Synchronization of control systems 2
- 3 Control system 2 (e.g. PLC)
- Industrial Ethernet Managed Switch 4
- 5 Transmitter

### FOUNDATION Fieldbus

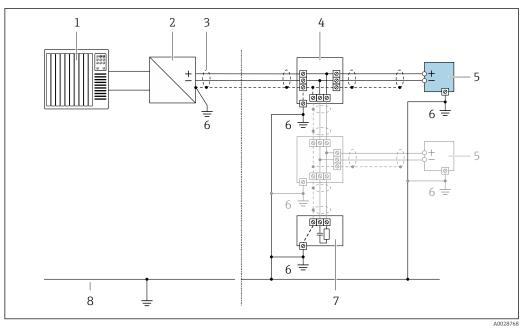

- 🖻 11 Connection example for FOUNDATION Fieldbus
- 1
- Control system (e.g. PLC) Power Conditioner (FOUNDATION Fieldbus) 2
- 3 Cable shield provided at one end. The cable shield must be grounded at both ends to comply with EMC requirements; observe cable specifications
- 4 T-box
- 5 Measuring device
- Local grounding 6
- Bus terminator 7
- 8 Potential matching line


Modbus RS485

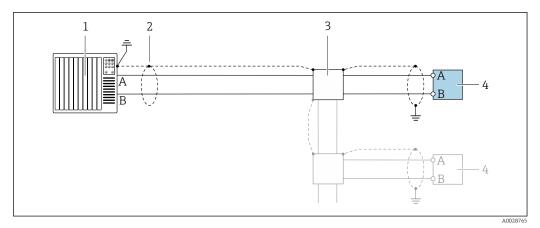

I2 Connection example for Modbus RS485, non-hazardous area and Zone 2; Class I, Division 2


- 1 Control system (e.g. PLC)
- 2 Cable shield provided at one end. The cable shield must be grounded at both ends to comply with EMC requirements; observe cable specifications
- 3 Distribution box
- 4 Transmitter

Current output 4-20 mA

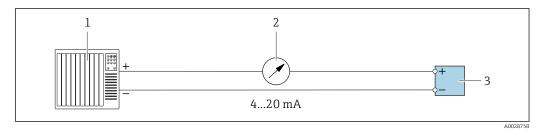

■ 13 Connection example for 4-20 mA current output (active)


- 1 Automation system with current input (e.g. PLC)
- *2* Analog display unit: observe maximum load  $\rightarrow \square 15$
- 3 Transmitter

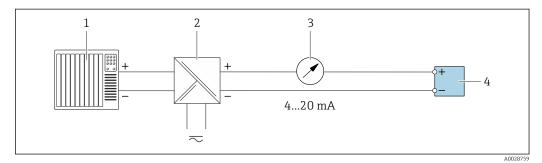

14 Connection example for 4-20 mA current output (passive)

- 1 Automation system with current input (e.g. PLC)
- 2 Active barrier for power supply (e.g. RN221N)
- 3 Analog display unit: observe maximum load  $\rightarrow \square 15$
- 4 Transmitter

### Pulse/frequency output

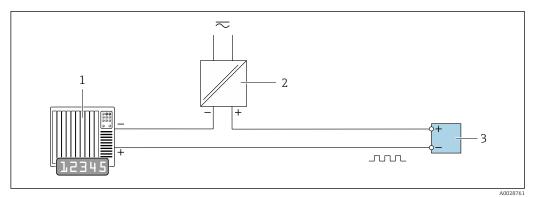


■ 15 Connection example for pulse/frequency output (passive)

- Automation system with pulse/frequency input (e.g. PLC with 10 k $\Omega$  pull-up or pull-down resistor)
- 2 Power supply
- 3 Transmitter: observe input values  $\rightarrow \square 18$

### Switch output


1

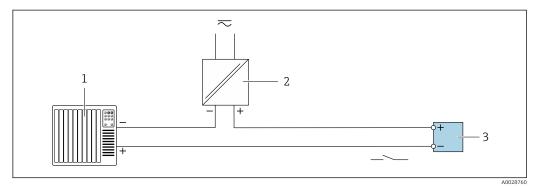


### ☑ 16 Connection example for switch output (passive)

- 1 Automation system with switch input (e.g. PLC with a 10 k $\Omega$  pull-up or pull-down resistor)
- 2 Power supply
- 3 Transmitter: observe input values  $\rightarrow \square 18$

### Double pulse output

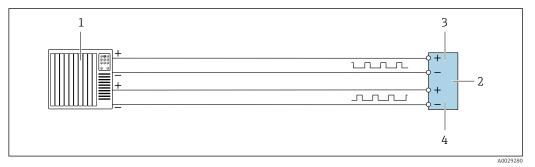


- 17 Connection example for double pulse output (active)
- 1 Automation system with double pulse input (e.g. PLC)
- 2 Transmitter: observe input values  $\rightarrow \triangleq 20$
- 3 Double pulse output
- 4 Double pulse output (slave), phase-shifted

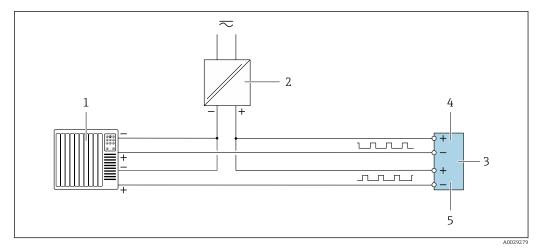

18 Connection example for double pulse output (passive)

- 1 Automation system with double pulse input (e.g. PLC with a 10 k $\Omega$  pull-up or pull-down resistor)
- 2 Power supply
- 3 Transmitter: observe input values  $\rightarrow \cong 20$
- 4 Double pulse output
- 5 Double pulse output (slave), phase-shifted


# Relay output

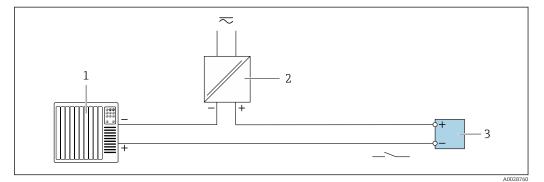

Connection example for relay output (passive)

- 1 Automation system with relay input (e.g. PLC)
- 2 Power supply
- 3 Transmitter: observe input values  $\rightarrow \cong 20$

# Current input

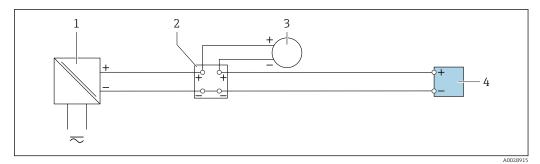

☑ 20 Connection example for 4 to 20 mA current input

- 1 Power supply
- 2 Terminal box
- 3 External measuring device (to read in pressure or temperature, for instance)
- 4 Transmitter

# Status input

	Image: Connection example for status input Automation system with status output (e.g. PLC) Power supply Transmitter
Potential equalization	Requirements
	<ul> <li>For potential equalization:</li> <li>Pay attention to in-house grounding concepts</li> <li>Take account of operating conditions like the pipe material and grounding</li> <li>Connect the medium, sensor and transmitter to the same electrical potential</li> <li>Use a ground cable with a minimum cross-section of 6 mm<sup>2</sup> (0.0093 in<sup>2</sup>) and a cable lug for potential equalization connections</li> <li>For devices intended for use in hazardous locations, please observe the guidelines in the Ex documentation (XA).</li> </ul>
Terminals	Spring-loaded terminals: Suitable for strands and strands with ferrules. Conductor cross-section 0.2 to 2.5 mm <sup>2</sup> (24 to 12 AWG).
Cable entries	<ul> <li>Cable gland: M20 × 1.5 with cable Ø 6 to 12 mm (0.24 to 0.47 in)</li> <li>Thread for cable entry: <ul> <li>NPT <sup>1</sup>/<sub>2</sub>"</li> <li>G <sup>1</sup>/<sub>2</sub>"</li> <li>M20</li> </ul> </li> <li>Device plug for digital communication: M12 Only available for certain device versions →  <sup>(1)</sup>/<sub>2</sub> 33.</li> <li>Device plug for connecting cable: M12 A device plug is always used for the device version with the order code for "Sensor connection housing", option <b>C</b> "Ultra-compact, hygienic, stainless".</li> </ul>
Cable specification	Permitted temperature range
	<ul><li>The installation guidelines that apply in the country of installation must be observed.</li><li>The cables must be suitable for the minimum and maximum temperatures to be expected.</li></ul>
	Power supply cable (incl. conductor for the inner ground terminal)
	Standard installation cable is sufficient.
	Protective grounding cable for the outer ground terminal
	Conductor cross-section < 2.1 mm <sup>2</sup> (14 AWG)
	The use of a cable lug enables the connection of larger cross-sections.
	The grounding impedance must be less than 2 $\Omega$ .
	Signal cable
	<b>Signal cable</b> Current output 4 to 20 mA HART

### PROFIBUS PA

Twisted, shielded two-wire cable. Cable type A is recommended .

For further information on planning and installing PROFIBUS networks see:

- Operating Instructions "PROFIBUS DP/PA: Guidelines for planning and commissioning" (BA00034S)
- PNO Directive 2.092 "PROFIBUS PA User and Installation Guideline"
- IEC 61158-2 (MBP)

### PROFIBUS DP

The IEC 61158 standard specifies two types of cable (A and B) for the bus line which can be used for every transmission rate. Cable type A is recommended.

Cable type	A
Characteristic impedance	135 to 165 $\Omega$ at a measuring frequency of 3 to 20 MHz
Cable capacitance	< 30 pF/m
Wire cross-section	> 0.34 mm <sup>2</sup> (22 AWG)
Cable type	Twisted pairs
Loop resistance	<110 Ω/km
Signal damping	Max. 9 dB over the entire length of the cable cross-section
Shield	Copper braided shielding or braided shielding with foil shield. When grounding the cable shield, observe the grounding concept of the plant.

For further information on planning and installing PROFIBUS networks see:

- Operating Instructions "PROFIBUS DP/PA: Guidelines for planning and commissioning" (BA00034S)
- PNO Directive 2.092 "PROFIBUS PA User and Installation Guideline"
- IEC 61158-2 (MBP)

#### EtherNet/IP

The standard ANSI/TIA/EIA-568-B.2 Annex specifies CAT 5 as the minimum category for a cable used for EtherNet/IP. CAT 5e and CAT 6 are recommended.

For more information on planning and installing EtherNet/IP networks, please refer to the "Media Planning and Installation Manual. EtherNet/IP" of ODVA Organization

### PROFINET

Standard IEC 61156-6 specifies CAT 5 as the minimum category for a cable used for PROFINET. CAT 5e and CAT 6 are recommended.

For more information on planning and installing PROFINET networks, see: "PROFINET Cabling and Interconnection Technology", Guideline for PROFINET

### PROFINET with Ethernet-APL

The reference cable type for APL segments is fieldbus cable type A, MAU type 1 and 3 (specified in IEC 61158-2). This cable meets the requirements for intrinsically safe applications according to IEC TS 60079-47 and can also be used in non-intrinsically safe applications.

Cable type	A
Cable capacitance	45 to 200 nF/km
Loop resistance	15 to 150 Ω/km
Cable inductance	0.4 to 1 mH/km

Further details are provided in the Ethernet-APL Engineering Guideline (https://www.ethernet-apl.org).

### FOUNDATION Fieldbus

Twisted, shielded two-wire cable.

For further information on planning and installing FOUNDATION Fieldbus networks see:

- Operating Instructions for "FOUNDATION Fieldbus Overview" (BA00013S)
- FOUNDATION Fieldbus Guideline
- IEC 61158-2 (MBP)

# Modbus RS485

The EIA/TIA-485 standard specifies two types of cable (A and B) for the bus line which can be used for every transmission rate. Cable type A is recommended.

Cable type	A
Characteristic impedance	135 to 165 $\Omega$ at a measuring frequency of 3 to 20 MHz
Cable capacitance	< 30 pF/m
Wire cross-section	> 0.34 mm <sup>2</sup> (22 AWG)
Cable type	Twisted pairs
Loop resistance	≤110 Ω/km
Signal damping	Max. 9 dB over the entire length of the cable cross-section
Shield	Copper braided shielding or braided shielding with foil shield. When grounding the cable shield, observe the grounding concept of the plant.

Current output 0/4 to 20 mA

Standard installation cable is sufficient

Pulse /frequency /switch output

Standard installation cable is sufficient

Double pulse output Standard installation cable is sufficient


*Relay output* Standard installation cable is sufficient.

*Current input 0/4 to 20 mA* Standard installation cable is sufficient

Status input Standard installation cable is sufficient

### Choice of connecting cable between the transmitter and sensor

Depends on the type of transmitter and the installation zones

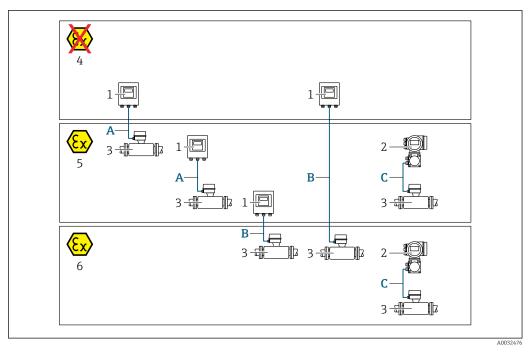

- 1 Proline 500 digital transmitter
- 2 Proline 500 transmitter
- 3 Sensor Promass
- 4 Non-hazardous area
- 5 Hazardous area: Zone 2; Class I, Division 2
- 6 Hazardous area: Zone 1; Class I, Division 1
- A Standard cable to 500 digital transmitter → 
  <sup>B</sup> 52
  Transmitter installed in the non-hazardous area or hazardous area: Zone 2; Class I, Division 2 / sensor
  installed in the hazardous area: Zone 2; Class I, Division 2
- B Standard cable to 500 digital transmitter → 🗎 53 Transmitter installed in the hazardous area: Zone 2; Class I, Division 2 / sensor installed in the hazardous area: Zone 1; Class I, Division 1
- C Signal cable to 500 transmitter → 🗎 55 Transmitter and sensor installed in the hazardous area: Zone 2; Class I, Division 2 or Zone 1; Class I, Division 1

A: Connecting cable between sensor and transmitter: Proline 500 – digital

### Standard cable

A standard cable with the following specifications can be used as the connecting cable.

Design	4 cores (2 pairs); uninsulated stranded CU wires; pair-stranded with common shield
Shielding	Tin-plated copper braid, optical cover $\geq$ 85 %
Loop resistance	Power supply line (+, –): maximum 10 $\Omega$
Cable length	Maximum 300 m (900 ft), see the following table.

Cross-section	Cable length [max.]
0.34 mm <sup>2</sup> (AWG 22)	80 m (240 ft)
0.50 mm <sup>2</sup> (AWG 20)	120 m (360 ft)
0.75 mm <sup>2</sup> (AWG 18)	180 m (540 ft)
1.00 mm <sup>2</sup> (AWG 17)	240 m (720 ft)
1.50 mm <sup>2</sup> (AWG 15)	300 m (900 ft)

### Optionally available connecting cable

Design	$2 \times 2 \times 0.34 \text{ mm}^2$ (AWG 22) PVC cable <sup>1)</sup> with common shield (2 pairs, uninsulated stranded CU wires; pair-stranded)
Flame resistance	According to DIN EN 60332-1-2
Oil-resistance	According to DIN EN 60811-2-1
Shielding	Tin-plated copper braid, optical cover $\geq$ 85 %
Operating temperature	When mounted in a fixed position: –50 to +105 $^\circ$ C (–58 to +221 $^\circ$ F); when cable can move freely: –25 to +105 $^\circ$ C (–13 to +221 $^\circ$ F)
Available cable length	Fixed: 20 m (60 ft); variable: up to maximum 50 m (150 ft)

1) UV radiation can impair the cable outer sheath. Protect the cable from direct sunshine where possible.

# B: Connecting cable between sensor and transmitter: Proline 500 - digital

# Standard cable

A standard cable with the following specifications can be used as the connecting cable.

Design	4, 6, 8 cores (2, 3, 4 pairs); uninsulated stranded CU wires; pair-stranded with common shield
Shielding	Tin-plated copper braid, optical cover $\geq$ 85 %
Capacitance C	Maximum 760 nF IIC, maximum 4.2 µF IIB
Inductance L	Maximum 26 µH IIC, maximum 104 µH IIB
Inductance/resistance ratio (L/R)	Maximum 8.9 $\mu H/\Omega$ IIC, maximum 35.6 $\mu H/\Omega$ IIB (e.g. according to IEC 60079-25)
Loop resistance	Power supply line (+, –): maximum 5 $\Omega$
Cable length	Maximum 150 m (450 ft), see the following table.

Cross-section	Cable length [max.]	Termination
2 x 2 x 0.50 mm <sup>2</sup> (AWG 20)	50 m (150 ft)	2 x 2 x 0.50 mm <sup>2</sup> (AWG 20)
(AWG 20)		BN WT YE GN - - A B GY
		<ul> <li>+, - = 0.5 mm<sup>2</sup></li> <li>A, B = 0.5 mm<sup>2</sup></li> </ul>
3 x 2 x 0.50 mm <sup>2</sup> (AWG 20)	100 m (300 ft)	3 x 2 x 0.50 mm <sup>2</sup> (AWG 20)
		BN WT GY PK YE GN + - A B GY
		<ul> <li>+, -= 1.0 mm<sup>2</sup></li> <li>A, B = 0.5 mm<sup>2</sup></li> </ul>
4 x 2 x 0.50 mm <sup>2</sup> (AWG 20)	150 m (450 ft)	4 x 2 x 0.50 mm <sup>2</sup> (AWG 20)
(AWU 20)		BN WT GY PK RDBU + - - GY YE GN
		<ul> <li>+, - = 1.5 mm<sup>2</sup></li> <li>A, B = 0.5 mm<sup>2</sup></li> </ul>

Optionally available connecting cable

Connecting cable for	Zone 1; Class I, Division 1
Standard cable	$2\times2\times0.5~mm^2$ (AWG 20) PVC cable $^{1)}$ with common shield (2 pairs, pair-stranded)
Flame resistance	According to DIN EN 60332-1-2
Oil-resistance	According to DIN EN 60811-2-1
Shielding	Tin-plated copper braid, optical cover $\geq$ 85 %
Operating temperature	When mounted in a fixed position: –50 to +105 $^\circ C$ (–58 to +221 $^\circ F); when cable can move freely: –25 to +105 ^\circ C (–13 to +221 ^\circ F)$
Available cable length	Fixed: 20 m (60 ft); variable: up to maximum 50 m (150 ft)

1) UV radiation can impair the cable outer sheath. Protect the cable from direct sunshine where possible.

C: Connecting cable between sensor and transmitter: Proline 500

Design	$6 \times 0.38 \text{ mm}^2 \text{ PVC cable}^{1)}$ with individual shielded cores and common copper shield
Conductor resistance	$\leq$ 50 $\Omega/km$ (0.015 $\Omega/ft$ )
Capacitance: core/shield	< 420 pF/m (128 pF/ft)
Cable length (max.)	20 m (60 ft)
Cable lengths (available for order)	5 m (15 ft), 10 m (30 ft), 20 m (60 ft)
Cable diameter	11 mm (0.43 in) ± 0.5 mm (0.02 in)
Continuous operating temperature	Max. 105 °C (221 °F)

UV radiation can impair the cable outer sheath. Protect the cable from direct sunshine where possible. 1)

### **Overvoltage protection**

Mains voltage fluctuations	→ 🗎 36
Overvoltage category	Overvoltage category II
Short-term, temporary overvoltage	Up to 1200 V between cable and ground, for max. 5 s
Long-term, temporary overvoltage	Up to 500 V between cable and ground

# **Performance characteristics**

Reference operating conditions	<ul> <li>Error limits based on ISO 11631</li> <li>Water with +15 to +45 °C (+59 to +113 °F) at 2 to 6 bar (29 to 87 psi)</li> <li>Specifications as per calibration protocol</li> <li>Accuracy based on accredited calibration rigs that are traced to ISO 17025.</li> <li>To obtain measured errors, use the <i>Applicator</i> sizing tool → 🗎 119</li> </ul>
Maximum measured error	o.r. = of reading; 1 g/cm <sup>3</sup> = 1 kg/l; T = medium temperature
	Base accuracy
	Design fundamentals → 🗎 58
	Mass flow and volume flow (liquids)
	±0.10 % o.r.
	Density (liquids)

Under reference conditions	Standard density calibration <sup>1)</sup>	Wide-range Density specification <sup>2) 3)</sup>
[g/cm³]	[g/cm³]	[g/cm³]
±0.0005	±0.01	±0.002

Valid over the entire temperature and density range 1)

2) 3) Valid range for special density calibration: 0 to 2 g/cm³, +10 to +80  $^\circ C$  (+50 to +176  $^\circ F)$ 

order code for "Application package", option EE "Special density"

### Temperature

 $\pm 0.5 \ ^{\circ}C \pm 0.005 \cdot T \ ^{\circ}C \ (\pm 0.9 \ ^{\circ}F \pm 0.003 \cdot (T - 32) \ ^{\circ}F)$ 

# Zero point stability

D	N	Zero point stability		
[mm]	[in]	[kg/h]	[lb/min]	
8	3⁄8	0.20	0.007	
15	1/2	0.65	0.024	
25	1	1.80	0.066	
40	1½	4.50	0.165	
50	2	7.0	0.257	

# Flow values

Flow values as turndown parameters depending on the nominal diameter.

SI units

DN	1:1	1:10	1:20	1:50	1:100	1:500
[mm]	[kg/h]	[kg/h]	[kg/h]	[kg/h]	[kg/h]	[kg/h]
8	2 000	200	100	40	20	4
15	6500	650	325	130	65	13
25	18000	1800	900	360	180	36
40	45 000	4500	2 2 5 0	900	450	90
50	70000	7 000	3 500	1400	700	140

US units

DN	1:1	1:10	1:20	1:50	1:100	1:500
[inch]	[lb/min]	[lb/min]	[lb/min]	[lb/min]	[lb/min]	[lb/min]
3/8	73.50	7.350	3.675	1.470	0.735	0.147
1/2	238.9	23.89	11.95	4.778	2.389	0.478
1	661.5	66.15	33.08	13.23	6.615	1.323
1½	1654	165.4	82.70	33.08	16.54	3.308
2	2 5 7 3	257.3	128.7	51.46	25.73	5.146

# Accuracy of outputs

The outputs have the following base accuracy specifications.

Current output

Accuracy	±5 µA
----------	-------

Pulse/frequency output

o.r. = of reading

Accuracy Max. ±50 ppm o.r. (over the entire ambient temperature range)
--

Repeatability

o.r. = of reading;  $1 \text{ g/cm}^3 = 1 \text{ kg/l}$ ; T = medium temperature

	Base repeatability		
	Design fundamentals → 🗎 58		
	Mass flow and volume flow (liquids) ±0.05 % o.r.		
	Density (liquids) ±0.00025 g/cm <sup>3</sup>		
	<i>Temperature</i> ±0.25 °C ± 0.0025 · T °C (±0.45 °F ± 0.0015 · (T−32) °F)		
Response time	The response time depends on the configuration (damping).		
Influence of ambient temperature	Current output		
	Temperature coefficient     Max. 1 µA/°C		
	Pulse/frequency output		
	Temperature coefficient         No additional effect. Included in accuracy.		
fluence of medium imperatureMass flow and volume flowo.f.s. = of full scale valueIf there is a difference between the temperature during zero adjustment and the proce temperature, the additional measured error of the sensors is typically $\pm 0.0002$ %o.f.s. o.f.s./°F).The influence is reduced when the zero adjustment is performed at process temperatureDensity If there is a difference between the density calibration temperature and the process tem measured error of the sensors is typically $\pm 0.0001$ g/cm <sup>3</sup> /°C ( $\pm 0.00005$ g/cm <sup>3</sup> /°F). Fid adjustment is possible.Wide-range density specification (special density calibration) If the process temperature is outside the valid range ( $\Rightarrow \boxdot 55$ ) the measured error is $\pm 0.0001$ g/cm <sup>3</sup> /°C ( $\pm 0.00005$ g/cm <sup>3</sup> /°F)			
	1       1		

Field density adjustment, for
 Special density calibration

# Temperature

±0.005 · T °C (± 0.005 · (T – 32) °F)

Influence of medium pressure

The tables below show the effect that a difference in pressure between the calibration pressure and the process pressure has on the accuracy in the case of the mass flow and density.

o.r. = of reading

- It is possible to compensate for the effect by:
  - Reading in the current pressure measured value via the current input or a digital input.Specifying a fixed value for the pressure in the device parameters.
- Operating Instructions  $\rightarrow \square$  120.

DN		[% o.r./bar]	[% o.r./psi]
[mm]	[in]		
8	3⁄8	-0.002	-0.0001
15	1/2	-0.006	-0.0004
25	1	-0.005	-0.0003
40	11/2	-0.007	-0.0005
50	2	-0.006	-0.0004

# Design fundamentals

o.r. = of reading, o.f.s. = of full scale value

BaseAccu = base accuracy in % o.r., BaseRepeat = base repeatability in % o.r.

MeasValue = measured value; ZeroPoint = zero point stability


Calculation of the maximum measured error as a function of the flow rate

Flow rate	Maximum measured error in % o.r.
$\geq \frac{\text{ZeroPoint}}{\text{BaseAccu}} \cdot 100$	± BaseAccu
A0021332	
$< rac{ ext{ZeroPoint}}{ ext{BaseAccu}} \cdot 100$	$\pm \frac{\text{ZeroPoint}}{\text{MeasValue}} \cdot 100$
A0021333	A0021334

Calculation of the maximum repeatability as a function of the flow rate

Flow rate	Maximum repeatability in % o.r.
$\geq \frac{\frac{1}{2} \cdot \text{ZeroPoint}}{\text{BaseRepeat}} \cdot 100$	± BaseRepeat
A0021335	
$< \frac{\frac{1}{2} \cdot \text{ZeroPoint}}{\text{BaseRepeat}} \cdot 100$	$\pm \frac{1}{2} \cdot \frac{\text{ZeroPoint}}{\text{MeasValue}} \cdot 100$
A0021336	A0021337


### Example of maximum measured error

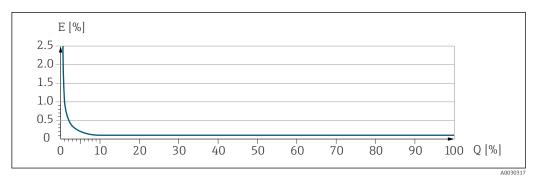


*E* Maximum measured error in % o.r. (example)

*Q* Flow rate in % of maximum full scale value

# Installation



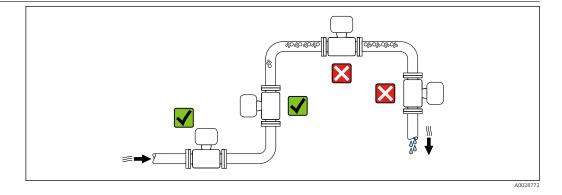


To prevent measuring errors arising from accumulation of gas bubbles in the measuring pipe, avoid the following mounting locations in the piping:

- Highest point of a pipeline.
- Directly upstream of a free pipe outlet in a down pipe.

### Installation in down pipes

However, the following installation suggestion allows for installation in an open vertical pipeline. Pipe restrictions or the use of an orifice with a smaller cross-section than the nominal diameter prevent the sensor running empty while measurement is in progress.

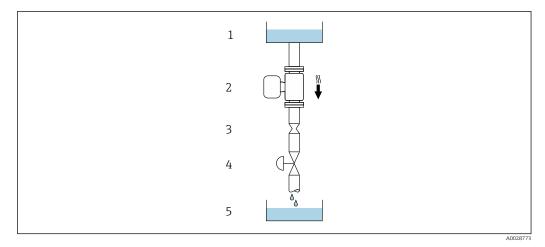

*■* 22 Installation in a down pipe (e.g. for batching applications)

1 Supply tank

2 Sensor

3 Orifice plate, pipe restriction

4 Valve

5 Batching tank

DN		Ø orifice plate, pipe restriction		
[mm]	[in]	[mm]	[in]	
8	3⁄8	6	0.24	
15	1/2	10	0.40	
25	1	14	0.55	
40	11/2	22	0.87	
50	2	28	1.10	

### Orientation


The direction of the arrow on the sensor nameplate helps you to install the sensor according to the flow direction (direction of medium flow through the piping).

	Orientatio	Recommendation	
A	Vertical orientation	A0015591	<b>V V</b> <sup>1)</sup>
В	Horizontal orientation, transmitter at top	A0015589	$\blacksquare \blacksquare 2^{2}$ Exception: → $\blacksquare 23, \blacksquare 61$
С	Horizontal orientation, transmitter at bottom	A0015590	$\blacksquare \blacksquare 23, а 100 € 61$
D	Horizontal orientation, transmitter at side	A0015592	

1) This orientation is recommended to ensure self-draining.

2) Applications with low process temperatures may reduce the ambient temperature. To maintain the minimum ambient temperature for the transmitter, this orientation is recommended.

 Applications with high process temperatures may increase the ambient temperature. To maintain the maximum ambient temperature for the transmitter, this orientation is recommended. If a sensor is installed horizontally with a curved measuring tube, match the position of the sensor to the fluid properties.

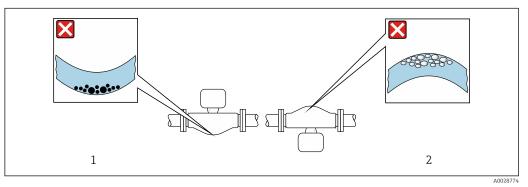

■ 23 Orientation of sensor with curved measuring tube

Avoid this orientation for fluids with entrained solids: Risk of solids accumulating.

2 Avoid this orientation for outgassing fluids: Risk of gas accumulating.

Inlet and outlet runs


1

No special precautions need to be taken for fittings which create turbulence, such as valves, elbows or T-pieces, as long as no cavitation occurs  $\rightarrow \textcircled{B} 71$ .

# Mounting the transmitter housing


### Proline 500 – digital transmitter

### Post mounting

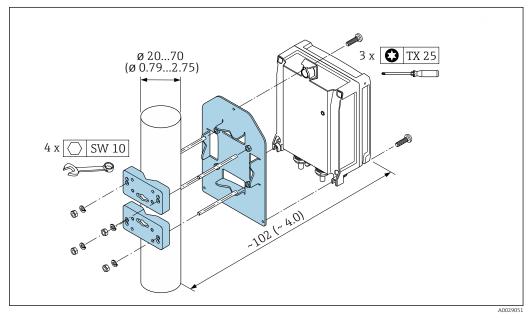

🖻 24 Engineering unit mm (in)

# Wall mounting

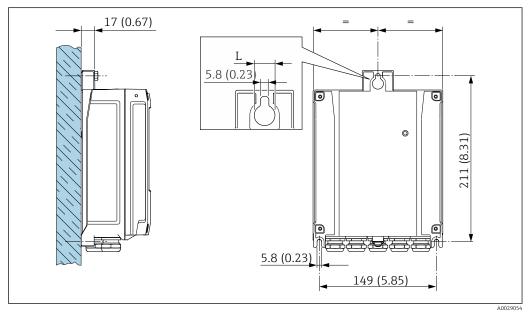

🗟 25 Engineering unit mm (in)


L Depends on order code for "Transmitter housing"

Order code for "Transmitter housing"

- Option **A**, aluminum, coated: L = 14 mm (0.55 in)
- Option **D**, polycarbonate: L = 13 mm (0.51 in)


### Proline 500 transmitter

#### Post mounting

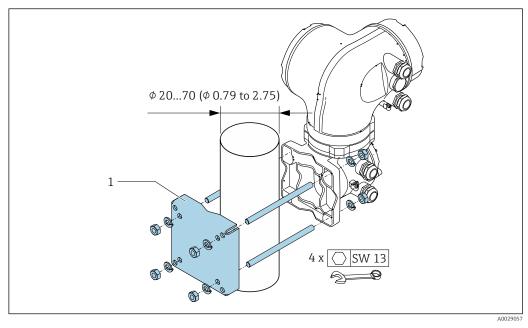

🖻 26 Engineering unit mm (in)

### Wall mounting

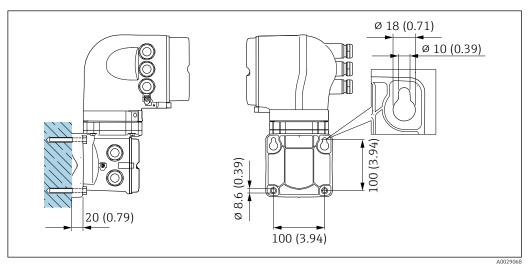



# Special mounting instructions

### Drainability

When installed vertically, the measuring tubes can be drained completely and protected against buildup.


### Hygienic compatibility

When installing in hygienic applications, please refer to the information in the "Certificates and approvals/hygienic compatibility" section → 🗎 112

### Securing with mounting clamp in the case of hygiene connections


It is not necessary to provide additional support for the sensor for operational performance purposes. If, however, additional support is required for installation purposes, the following dimensions must be observed.

Use mounting clamp with lining between clamp and measuring instrument.

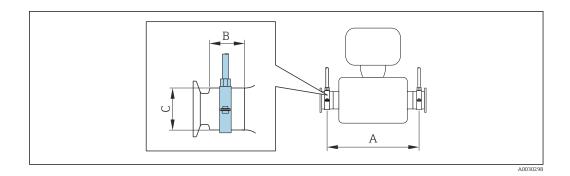


DN		А		В		С	
[mm]	[in]	[mm]	[in]	[mm]	[in]	[mm]	[in]
8	3/8	298	11.73	33	1.3	28	1.1
15	1/2	402	15.83	33	1.3	28	1.1
25	1	542	21.34	33	1.3	38	1.5
40	1 1⁄2	658	25.91	36.5	1.44	56	2.2
50	2	772	30.39	44.1	1.74	75	2.95

# Weather protection cover

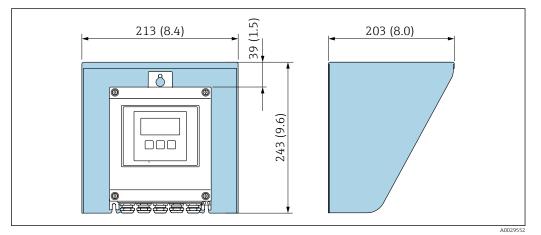

🖻 28 Weather protection cover for Proline 500 – digital; engineering unit mm (in)

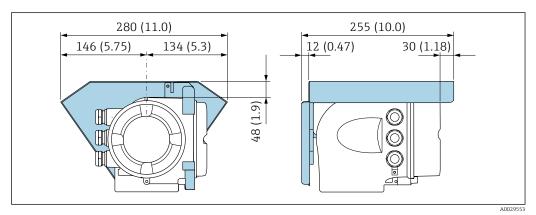

🖻 29 Weather protection cover for Proline 500; engineering unit mm (in)


		1				
Ambient temperature range	Measuring device	<ul> <li>-40 to +60 °C (-40 to +140 °F)</li> <li>Order code for "Test, certificate", option JP: -50 to +60 °C (-58 to +140 °F)</li> </ul>				
	Readability of the local display	$-20$ to +60 $^\circ\text{C}$ (-4 to +140 $^\circ\text{F}$ ) The readability of the display may be impaired at temperatures outside the temperature range.				
	Dependency of am	bient temperature on medium temperature $\rightarrow \ \ \ \ \ \ \ \ \ \ \ \ \ \ \ \ \ \ $				
	<ul> <li>If operating outdoors: Avoid direct sunlight, particularly in warm climatic regions.</li> </ul>					
	You can order a we	ather protection cover from Endress+Hauser. $\rightarrow \square$ 117.				
Storage temperature	–50 to +80 °C (–58 to +176 °F)					
Climate class	DIN EN 60068-2-38 (test Z/AD)					
Relative humidity	The device is suitable for use in outdoor and indoor areas with a relative humidity of 4 to 95%.					
Operating height	According to EN 61010-1 • ≤ 2 000 m (6 562 ft) • > 2 000 m (6 562 ft) with additional overvoltage protection (e.g. Endress+Hauser HAW Series)					
Degree of protection	Transmitter					
	<ul> <li>IP66/67, Type 4X enclosure, suitable for pollution degree 4</li> <li>When the housing is open: IP20, Type 1 enclosure, suitable for pollution degree 2</li> <li>Display module: IP20, Type 1 enclosure, suitable for pollution degree 2</li> </ul>					
	Sensor					
	<ul> <li>IP66/67, Type 4X enclosure, suitable for pollution degree 4</li> <li>When the housing is open: IP20, Type 1 enclosure, suitable for pollution degree 2</li> </ul>					
	Optional					
	Order code for "Sensor options", option CM "IP69					
	External WLAN antenna					
	IP67					
/ibration- and shock-	Vibration sinusoidal, in accordance with IEC 60068-2-6					
resistance	Sensor • 2 to 8.4 Hz, 3.5 mm peak • 8.4 to 2 000 Hz, 1 g peak					
	Transmitter • 2 to 8.4 Hz, 7.5 mm peak • 8.4 to 2 000 Hz, 2 g peak					
	Vibration broad-band random, according to IEC 60068-2-64					
	Sensor • 10 to 200 Hz, 0.003 g <sup>2</sup> /Hz • 200 to 2 000 Hz, 0.001 g <sup>2</sup> /Hz • Total: 1.54 g rms					

# Environment

	Transmitter • 10 to 200 Hz, 0.01 g <sup>2</sup> /Hz • 200 to 2 000 Hz, 0.003 g <sup>2</sup> /Hz • Total: 2.70 g rms
	Shock half-sine, according to IEC 60068-2-27
	<ul> <li>Sensor</li> <li>6 ms 30 g</li> <li>Transmitter</li> <li>6 ms 50 g</li> </ul>
	Rough handling shocks, according to IEC 60068-2-31
Interior cleaning	<ul> <li>Cleaning in place (CIP)</li> <li>Sterilization in place (SIP)</li> <li>Cleaning with pigs</li> </ul>
	<b>Options</b> Oil- and grease-free version for wetted parts, without declaration Order code for "Service", option HA
Mechanical load	<ul><li>Transmitter housing and sensor connection housing:</li><li>Protect against mechanical effects, such as shock or impact</li><li>Do not use as a ladder or climbing aid</li></ul>
Electromagnetic compatibility (EMC)	<ul> <li>As per IEC/EN 61326 and NAMUR Recommendation 21 (NE 21)</li> <li>Device version with PROFIBUS DP: Complies with emission limits for industry as per EN 50170 Volume 2, IEC 61784</li> </ul>
	The following applies for PROFIBUS DP: If baud rates > 1.5 MBaud, an EMC cable entry must be used and the cable shield must continue as far as the terminal wherever possible.
	Details are provided in the Declaration of Conformity.
	This unit is not intended for use in residential environments and cannot guarantee adequate protection of the radio reception in such environments.
	Drocoss

Process

Medium temperature range -50 to +150 °C (-58 to +302 °F)

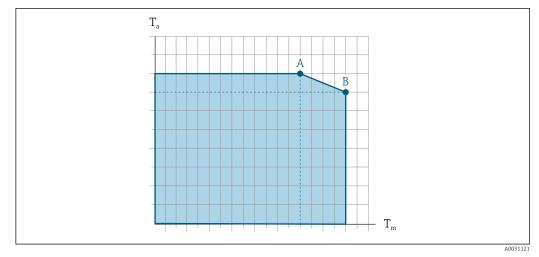

### Dependency of ambient temperature on medium temperature

🛃 30 Exemplary representation, values in the table below.

Ambient temperature Ta

*T<sub>m</sub>* Medium temperature

- Α Maximum permitted medium temperature  $T_m$  at  $T_{a max}$  = 60 °C (140 °F); higher medium temperatures  $T_m$ require a reduction in the ambient temperature  $T_a$
- В Maximum permitted ambient temperature  $T_a$  for the maximum specified medium temperature  $T_m$  of the sensor

Values for devices that are used in the hazardous area: Separate Ex documentation (XA) for the device  $\rightarrow$  🗎 121.

	Not insulated			Insulated				
	A		B		A		В	
Version	T <sub>a</sub>	T <sub>m</sub>	Ta	T <sub>m</sub>	T <sub>a</sub>	T <sub>m</sub>	T <sub>a</sub>	T <sub>m</sub>
Promass S 500 – digital	60 ℃ (140 ℉)	150 °C (302 °F)	-	-	60 °C (140 °F)	90 °C (194 °F)	45 ℃ (113 °F)	150 °C (302 °F)
Promass S 500								


Density


ratings

0 to 5000 kg/m $^3$  (0 to 312 lb/cf)


The following pressure/temperature diagrams apply to all pressure-bearing parts of the device and **Pressure-temperature** not just the process connection. The diagrams show the maximum permissible medium pressure depending on the specific medium temperature.

# Flange according to EN 1092-1 (DIN 2501)

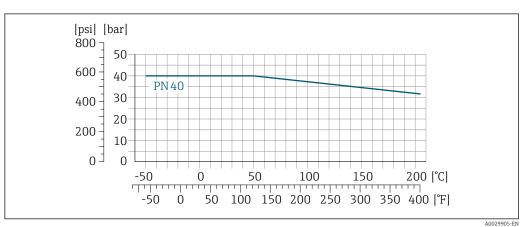





# Flange according to ASME B16.5

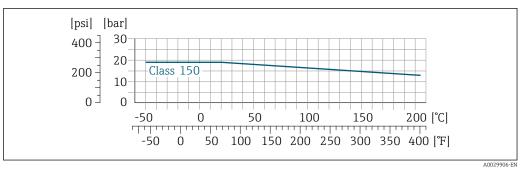



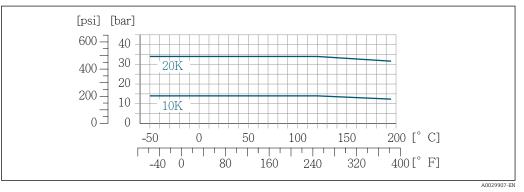


■ 33 With flange material 1.4404 (F316/F316L)

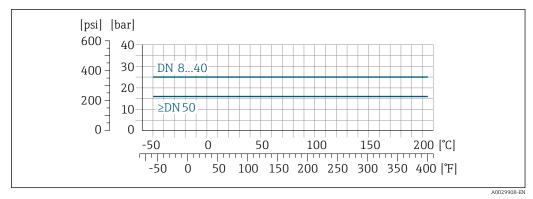

Flange DIN 11864-2 Form A

34 With flange material 1.4435 (316L)


# Thread DIN 11851

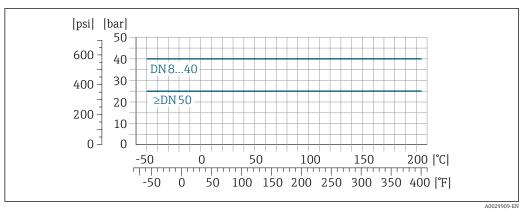

🗟 35 With flange material 1.4435 (316L)


DIN 11851 allows for applications up to +140  $^{\circ}$ C (+284  $^{\circ}$ F) if suitable sealing materials are used. Please take this into account when selecting seals and counterparts, as these components can limit the pressure and temperature range.

# Thread DIN 11864-1 Form A

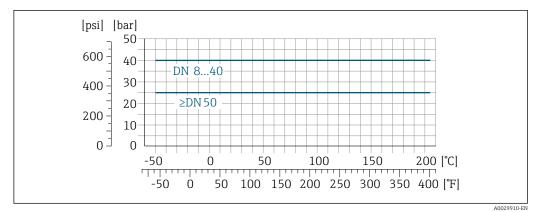


■ 36 With connection material 1.4435 (316L)

# Thread ISO 2853

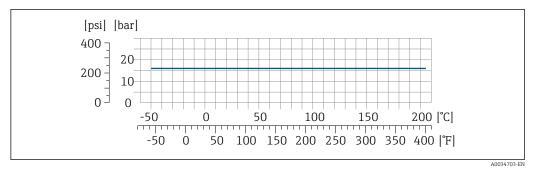


■ 37 With connection material 1.4435 (316L)


### Thread SMS 1145

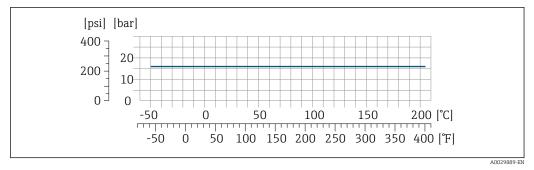

38 With connection material 1.4435 (316L)

SMS 1145 allows for applications up to 6 bar (87 psi) if suitable sealing materials are used. Please take this into account when selecting seals and counterparts, as these components can limit the pressure and temperature range.

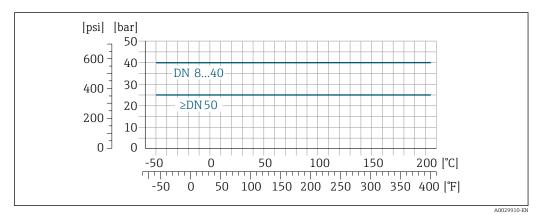



39 With connection material 1.4435 (316L)

### Tri-Clamp

The clamp connections are suitable up to a maximum pressure of 16 bar (232 psi). Please observe the operating limits of the clamp and seal used as they can be over 16 bar (232 psi). The clamp and seal are not included in the scope of supply.

#### Sensor housing

The sensor housing is filled with dry nitrogen gas and protects the electronics and mechanics inside.

If a measuring tube fails (e.g. due to process characteristics like corrosive or abrasive fluids), the fluid will initially be contained by the sensor housing.

If the sensor is to be purged with gas (gas detection), it should be equipped with purge connections.

Do not open the purge connections unless the containment can be filled immediately with a dry, inert gas. Use only low pressure to purge.

Maximum pressure: 5 bar (72.5 psi)

### Burst pressure of the sensor housing

The following sensor housing burst pressures are only valid for standard devices and/or devices equipped with closed purge connections (not opened/as delivered).

If a device fitted with purge connections (order code for "Sensor option", option CH "Purge connection") is connected to the purge system, the maximum pressure is determined by the purge system itself or by the device, depending on which component has the lower pressure classification.

The sensor housing burst pressure refers to a typical internal pressure which is reached prior to mechanical failure of the sensor housing and which was determined during type testing. The


corresponding type test declaration can be ordered with the device (order code for "Additional approval", option LN "Sensor housing burst pressure, type test").

DN		Sensor housing burst pressure		
[mm]	[in]	[bar]	[psi]	
8	3⁄8	190	2 755	
15	1/2	175	2 538	
25	1	165	2 392	
40	11/2	152	2204	
50	2	103	1494	

For information on the dimensions: see the "Mechanical construction" section  $\rightarrow$   $\square$  73

Flow limit	Select the nominal diameter by optimizing between the required flow range and permissible pressure loss.
	For an overview of the full scale values for the measuring range, see the "Measuring range" section $\rightarrow \cong 11$
	<ul> <li>The minimum recommended full scale value is approx. 1/20 of the maximum full scale value</li> <li>In most applications, 20 to 50 % of the maximum full scale value can be considered ideal</li> <li>A low full scale value must be selected for abrasive media (such as liquids with entrained solids): flow velocity &lt; 1 m/s (&lt; 3 ft/s).</li> </ul>
	To calculate the flow limit, use the <i>Applicator</i> sizing tool $\rightarrow \square$ 119
Pressure loss	To calculate the pressure loss, use the <i>Applicator</i> sizing tool $\rightarrow \cong 119$
System pressure	It is important that cavitation does not occur, or that gases entrained in the liquids do not outgas. This is prevented by means of a sufficiently high system pressure.
	<ul> <li>For this reason, the following mounting locations are recommended:</li> <li>At the lowest point in a vertical pipe</li> <li>Downstream from pumps (no danger of vacuum)</li> </ul>
Thermal insulation	In the case of some fluids, it is important to keep the heat radiated from the sensor to the
mermai msulation	transmitter to a low level. A wide range of materials can be used for the required insulation.
	The following device versions are recommended for versions with thermal insulation: Version with extended neck for insulation: Order code for "Sensor option", option CG with an extended neck length of 105 mm (4.13 in).
	<ul> <li>NOTICE</li> <li>Electronics overheating on account of thermal insulation!</li> <li>Recommended orientation: horizontal orientation, sensor connection housing pointing downwards.</li> <li>Do not insulate the sensor connection housing.</li> <li>Maximum permissible temperature at the lower end of the sensor connection housing: 80 °C (176 °F)</li> <li>Thermal insulation with not isolated extended neck: We recommend that you do not insulate the</li> </ul>

extended neck in order to ensure optimum dissipation of heat.

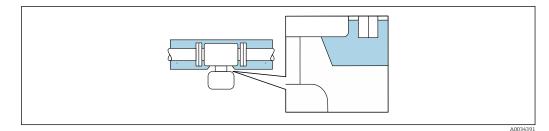

Intermal insulation with not isolated extended neck

Some fluids require suitable measures to avoid loss of heat at the sensor.

### Heating options

- Electrical heating, e.g. with electric band heaters <sup>1)</sup>
- Via pipes carrying hot water or steam
- Via heating jackets

Heating jackets for the sensors can be ordered as accessories from Endress+Hauser  $\rightarrow \square$  118.

# NOTICE

### Danger of overheating when heating

- Ensure that the temperature at the lower end of the transmitter housing does not exceed 80 °C (176 °F).
- Ensure that sufficient convection takes place at the transmitter neck.
- Ensure that a sufficiently large area of the transmitter neck remains exposed. The uncovered part serves as a radiator and protects the electronics from overheating and excessive cooling.
- When using in potentially explosive atmospheres, observe the information in the device-specific Ex documentation. For detailed information on the temperature tables, see the separate document entitled "Safety Instructions" (XA) for the device.

The high oscillation frequency of the measuring tubes ensures that the correct operation of the measuring system is not influenced by plant vibrations.

Heating

Vibrations


<sup>1)</sup> The use of parallel electric band heaters is generally recommended (bidirectional electricity flow). Particular considerations must be made if a single-wire heating cable is to be used. Additional information is provided in the document EA01339D "Installation instructions for electrical trace heating systems" → 🗎 121

## Mechanical construction

#### **Dimensions in SI units**

## Housing of Proline 500 – digital transmitter

## Non-hazardous area or hazardous area: Zone 2; Class I, Division 2

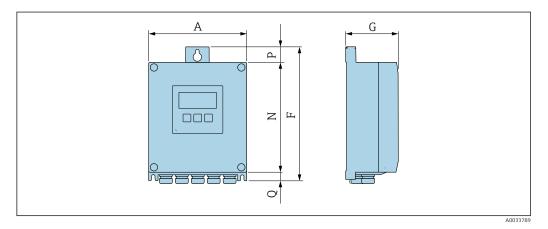

Order code for "Transmitter housing", option A "Aluminum, coated" and order code for "Integrated ISEM electronics", option A "Sensor"


A	F	G	N	P	Q
[mm]	[mm]	[mm]	[mm]	[mm]	[mm]
167	232	89	187	24	21

Order code for "Transmitter housing", option D "Polycarbonate" and order code for "Integrated ISEM electronics", option A "Sensor"

A	F	G	N	P	Q
[mm]	[mm]	[mm]	[mm]	[mm]	[mm]
177	234	89	197	17	

## Housing of Proline 500 transmitter


Hazardous area: Zone 2; Class I, Division 2 or Zone 1; Class I, Division 1

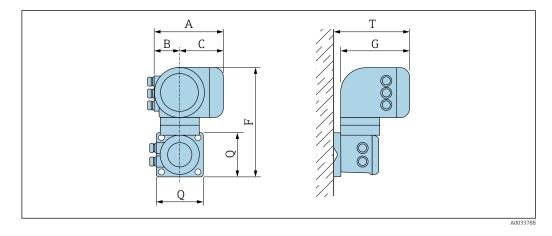

Order code for "Transmitter housing", option A "Aluminum, coated" and order code for "Integrated ISEM electronics", option B "Transmitter"

A	B	C	F	G	Q	T
[mm]						
188	85	103	318	217	130	

#### Sensor connection housing

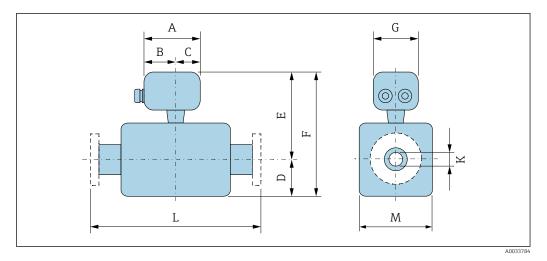

Order code for "Sensor connection housing", option A "Aluminum, coated"

DN	A 1)	B 1)	С	D	E <sup>2)</sup>	F <sup>2)</sup>	G	К	L	М
[mm]	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]
8	148	94	54	108	191	299	136	8.31	3)	92
15	148	94	54	108	191	299	136	12.0	3)	92
25	148	94	54	121	191	312	136	17.6	3)	92
40	148	94	54	176	222	398	136	25.8	3)	142
50	148	94	54	260	235	495	136	37.8	3)	169

1) Depending on the cable gland used: values up to + 30 mm

2) With order code for "Sensor option", option CG: values +70 mm

3) Depending on the process connection

Order code for "Sensor connection housing	, option B "Stainless"
---	------------------------

DN	A 1)	В	С	D	E <sup>2)</sup>	F <sup>2)</sup>	G	К	L	М
[mm]	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]
8	137	78	59	108	186	294	134	8.31	3)	92
15	137	78	59	108	186	294	134	12.0	3)	92
25	137	78	59	121	186	307	134	17.6	3)	92
40	137	78	59	176	217	393	134	25.8	3)	142
50	137	78	59	260	230	490	134	37.8	3)	169

1) 2) Depending on the cable gland used: values up to + 30 mm With order code for "Sensor option", option CG: values +70 mm

3) Depending on the process connection

Order code for "Sensor connection housing", option C "Ultra-compact hygienic, stainless"


DN	A 1)	В	С	D	E <sup>2)</sup>	F <sup>2)</sup>	G	К	L	М
[mm]	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]
8	124	68	56	108	186	294	112	8.31	3)	92
15	124	68	56	108	186	294	112	12.0	3)	92
25	124	68	56	121	186	307	112	17.6	3)	92


DN	A <sup>1)</sup>	В	С	D	E <sup>2)</sup>	F <sup>2)</sup>	G	К	L	М
[mm]	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]
40	124	68	56	176	217	393	112	25.8	3)	142
50	124	68	56	260	230	490	112	37.8	3)	169

Depending on the cable gland used: values up to + 30 mm1)

2) 3) With order code for "Sensor option", option CG: values +70 mm Depending on the process connection

## Flange connections



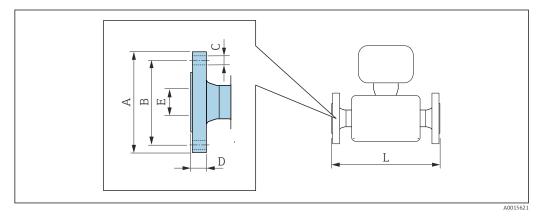

Length tolerance for dimension L in mm: $+1.5 / -2.0$
+1.5 / -2.0

Flange according to EN 1092-1 (DIN 2501): PN 40 1.4404 (F316/F316L) Order code for "Process connection", option D2W											
DN [mm]	A [mm]	B [mm]	C [mm]	D [mm]	E [mm]	L [mm]					
8 <sup>1)</sup>	95	65	4ר14	17.0	17.3	336					
15	95	65	4ר14	20	17.3	440					
25	115	85	$4 \times Ø14$	19.0	28.5	580					
40	150	110	4ר18	21.0	43.1	707					
50	165	125	4ר18	25.0	54.5	828					
Surface roughr	ness (flange): EN	1092-1 Form E	31 (DIN 2526 Form	n C), Ra 3.2 to 12	2.5 µm						

DN 8 with DN 15 flanges as standard 1)

Flange according to ASME B16.5, Cl 150         1.4404 (F316/F316L)         Order code for "Process connection", option AAW											
DN [mm]	A [mm]	B [mm]	C [mm]	D [mm]	E [mm]	L [mm]					
8 <sup>1)</sup>	90	60.3	4 × Ø15.7	17.1	15.7	336					
15	90	60.3	4 × Ø15.7	17.1	15.7	440					
25	110	79.4	4 × Ø15.7	17.6	26.7	580					
40	125	98.4	4 × Ø15.7	18.6	40.9	707					

Flange according to ASME B16.5, Cl 150 1.4404 (F316/F316L) Order code for "Process connection", option AAW										
DN [mm]	A [mm]	B [mm]	C [mm]	D [mm]	E [mm]	L [mm]				
50	150	120.7	4 × Ø19.1	25.1	52.6	828				
Surface rough	Surface roughness (flange): Ra 3.2 to 6.3 µm									


1) DN 8 with DN 15 flanges as standard

Flange JIS B2220, 10K 1.4404 (F316/F316L) Order code for "Process connection", option NDW						
DN [mm]	A [mm]	B [mm]	C [mm]	D [mm]	E [mm]	L [mm]
50	155	120	4 × Ø19.0	16	50	828
Surface rough	Surface roughness (flange): Ra 3.2 to 6.3 µm					

Flange JIS B2220, 20K 1.4404 (F316/F316L) Order code for "Process connection", option NEW						
DN [mm]	A [mm]	B [mm]	C [mm]	D [mm]	E [mm]	L [mm]
8 <sup>1)</sup>	95	70	4 × Ø15	16.0	15	336
15	95	70	4 × Ø15	16.0	15	440
25	125	90	4 × Ø19	17.5	25	580
40	140	105	4 × Ø19	20.0	40	707
50	155	120	8 × Ø19	27.5	50	828
Surface roughr	ness (flange): Ra	a 3.2 to 6.3 µm				

1) DN 8 with DN 15 flanges as standard

Fixed flange DIN 11864-2

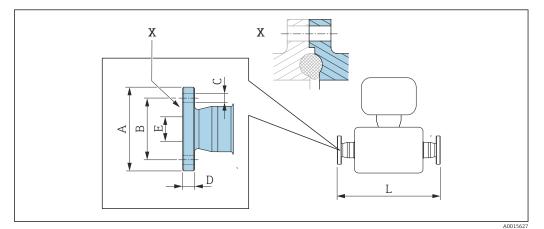

■ 41 Detail X: Asymmetrical process connection; the part shown in gray is provided by the supplier.

Length tolerance for dimension L in mm: +1.5 / -2.0

# Flange DIN 11864-2 Form A, for pipe according to DIN11866 series A, flange with notch 1.4435 (316L)


Order code for "Process connection", option KKW


- 1	,		, I				
	DN [mm]	A [mm]	B [mm]	C [mm]	D [mm]	E [mm]	L [mm]
	8	59.0	42	4 × Ø9	10	16.00	384
	15	59.0	42	4 × Ø9	10	16.00	488
	25	70	53	4 × Ø9	10	26.00	626
	40	82	65	4 × Ø9	10	38.00	753
	50	94	77	4 × Ø9	10	50.00	877

3-A version: order code for "Additional approval", option LP

## **Clamp connections**

Tri-Clamp

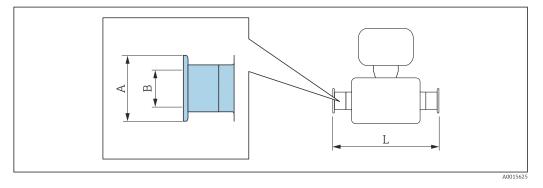




<sup>3</sup> / <sub>4</sub> " Tri-Clamp, for pipe according to DIN11866 series C         1.4435 (316L)         Order code for "Process connection", option FEW				
DN [mm]	Clamp [in]	A [mm]	B [mm]	L [mm]
8	3⁄4	25.0	16.00	362
3-A version: order code for "Additional approval", option LP				

<sup>1</sup> / <sub>2</sub> " Tri-Clamp, for pipe according to DIN11866 series C 1.4435 (316L) Order code for "Process connection", option FBW				
DN [mm]	Clamp [in]	A [mm]	B [mm]	L [mm]
15	1/2	25.0	9.50	466
3-A version: order code for "Additional approval", option LP				

1" Tri-Clamp, for pipe according to DIN11866 series C 1.4435 (316L) Order code for "Process connection", option FNW				
DN [mm]	Clamp [in]	A [mm]	B [mm]	L [mm]
8	1	50.4	22.10	362
15	1	50.4	22.10	466
3-A version: order code for "Additional approval", option LP				

1", 1½", 2" Tri-Clamp, for pipe according to DIN11866 series C 1.4435 (316L) Order code for "Process connection", option FTW					
DN [mm]	Clamp [in]	A [mm]	B [mm]	L [mm]	
8	1/2	25.0	9.50	362	
15	3/4	25.0	16.00	466	
25	1	50.4	22.10	606	
40	11/2	50.4	34.80	731	
50 2 63.9 47.50 853					
3-A version: order coo	de for "Additional approv	val", option LP			

Clamp connection DIN 11864-3

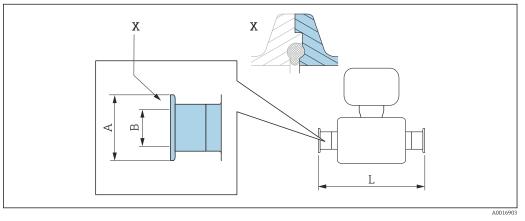


42 Detail X: Asymmetrical process connection; the part shown in gray is provided by the supplier.


Length tolerance for dimension L in mm: +1.5 / -2.0

Clamp DIN 11864-3 Form A, with notch, for pipe according to DIN11866 series A 1.4435 (316L) Order code for "Process connection", option KMW				
DN [mm]	A [mm]	B [mm]	L [mm]	
8	34.0	16.05	370	
15	34.0	16.05	474	
25	50.5	26.05	614	
40	64.0	38.05	738	

Clamp DIN 11864-3 Form A, with notch, for pipe according to DIN11866 series A 1.4435 (316L) Order code for "Process connection", option KMW				
DN [mm]	A [mm]	B [mm]	L [mm]	
50	77.5	50.05	853	

Clamp connection DIN 32676, ISO 2852

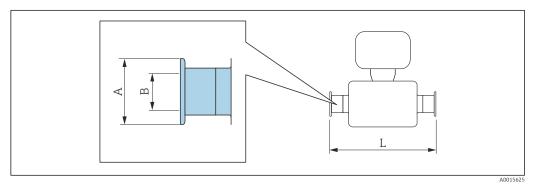




Clamp DIN 32676, for pipe according to DIN11866 series A 1.4435 (316L) Order code for "Process connection", option KQW				
DN [mm]	A [mm]	B [mm]	L [mm]	
8	34.0	16.00	362	
15	34.0	16.00	466	
25	50.5	26.00	606	
40	50.5	38.00	732	
50	64.0	50.00	854	

3-A version: order code for "Additional approval", option LP

Clamp ISO 2852 , for pipe according to ISO 2037 1.4435 (316L) Order code for "Process connection", option JSA					
DN [mm]	A [mm]	B [mm]	L [mm]		
8	50.5	22.6	362		
15	50.5	22.6	466		
25	50.5	22.6	606		
40	50.5	35.6	731		
50 64.0 48.6 853					
3-A version: order code for	"Additional approval", option	LP			

## Couplings

Thread DIN 11851, DIN 11864-1, SMS 1145

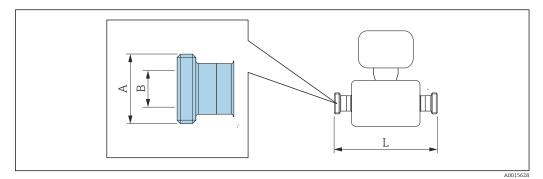



Length tolerance for dimension L in mm: +1.5 / -2.0


Thread DIN 11851, Rd 28 × ¼, for pipe according to DIN11866 series A         1.4435 (316L)         Order code for "Process connection", option KAW				
DN A B L [mm] [mm] [mm] [mm]				
8	Rd 28 × <sup>1</sup> / <sub>8</sub>	10.00	362	
15 Rd 28 × <sup>1</sup> / <sub>8</sub> 10.00 466				
3-A version: order code for "Additional approval", option LP				

Thread DIN 11851, ≥ Rd 34 × ¼, for pipe according to DIN11866 series A         1.4435 (316L)         Order code for "Process connection", option KCW										
DN A B L [mm] [mm] [mm] [mm]										
8	Rd 34 × <sup>1</sup> / <sub>8</sub>	16	362							
15	Rd 34 × <sup>1</sup> / <sub>8</sub>	16	466							
25	Rd 52 × ¼	26	606							
40	Rd 65 × 1/6	38	738							
50	Rd 78 × ¼	50	864							
3-A version: order code fo	or "Additional approval", option LP	1								

Thread DIN 11864-1 Form A, for pipe according to DIN11866 series A 1.4435 (316L) Order code for "Process connection", option KHW DN В L Α [mm] [mm] [mm] [mm] 8 Rd 28 ×  $\frac{1}{8}$ 16.00 362 15 Rd 34 ×  $\frac{1}{8}$ 16.00 466 25 Rd 52  $\times \frac{1}{6}$ 26.00 620 40 Rd 65 ×  $\frac{1}{6}$ 38.00 738 50 Rd 78 ×  $\frac{1}{6}$ 50.00 864 3-A version: order code for "Additional approval", option LP

1.4435 (316L) Order code for "Process connection", option SAW								
DN [mm]	A [mm]	B [mm]	L [mm]					
8	Rd 40 × 1/ <sub>6</sub>	22.5	362					
15	Rd 40 × 1/ <sub>6</sub>	22.5	466					
25	Rd 40 × 1/ <sub>6</sub>	22.5	606					
40	Rd 60 × 1/ <sub>6</sub>	35.5	742					
50	Rd 70 × <sup>1</sup> / <sub>6</sub>	48.5	864					

## Thread ISO 2853

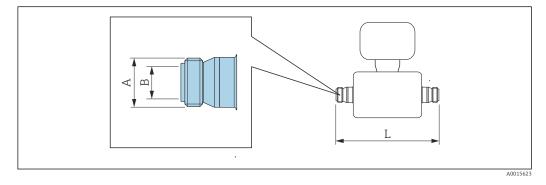


Length tolerance for dimension L in mm: +1.5 / -2.0

Thread ISO 2853, for pipe according to ISO 2037 1.4435 (316L) Order code for "Process connection", option JSE									
DN A B L [mm] [mm] [mm] [mm]									
8	37.13	22.60	370						
15	37.13	22.60	474						
25	37.13	22.60	614						
40	50.65	35.60	742						
50	64.10	48.60	864						
3-A version: order code for	"Additional approval", option	LP							

## Accessories

Rinse connections

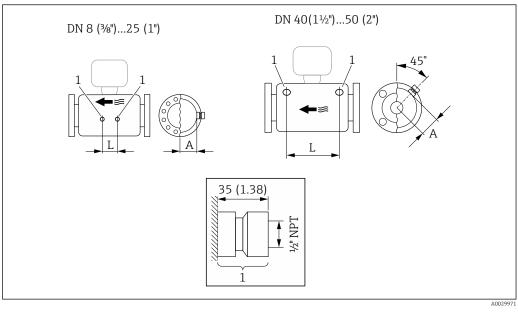


## 43


1 Connection nipple for purge connections: order code for "Sensor options", option CH "Purge connection"

DN	А	L		
[mm]	[mm]	[mm]		
8	47	110		
15	47	204		
25	47	348		
40	68.15	418		
50	81.65	473		

Weather protection cover

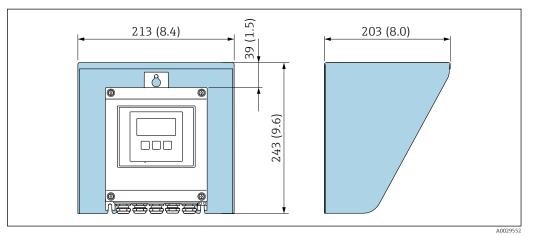

🗉 44 Weather protection cover for Proline 500 – digital; engineering unit mm (in)

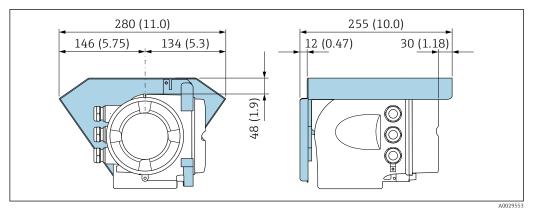

45 Weather protection cover for Proline 500; engineering unit mm (in)


External WLAN antenna



The external WLAN antenna is not suitable for use in hygienic applications.

Proline 500 – digital


External WLAN antenna mounted on device

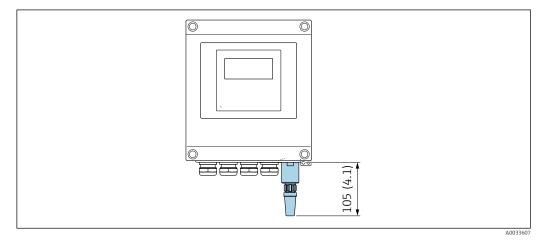

☑ 46 Engineering unit mm (in)

External WLAN antenna mounted with cable


The external WLAN antenna can be mounted separately from the transmitter if the transmission/ reception conditions at the transmitter mounting location are poor.

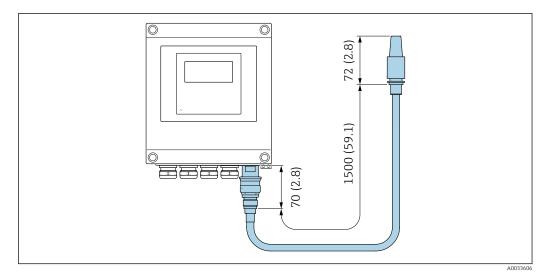



#### Proline 500


External WLAN antenna mounted on device

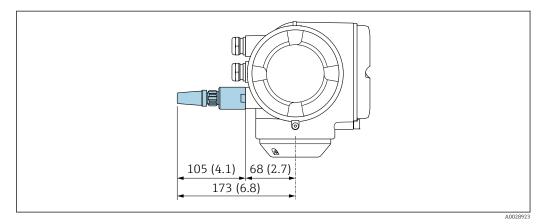

🗷 48 Engineering unit mm (in)

External WLAN antenna mounted with cable

The external WLAN antenna can be mounted separately from the transmitter if the transmission/ reception conditions at the transmitter mounting location are poor.

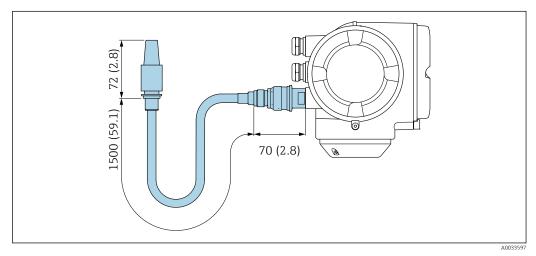


E 49 Engineering unit mm (in)

## Dimensions in US units

## Housing of Proline 500 – digital transmitter

Non-hazardous area or hazardous area: Zone 2; Class I, Division 2

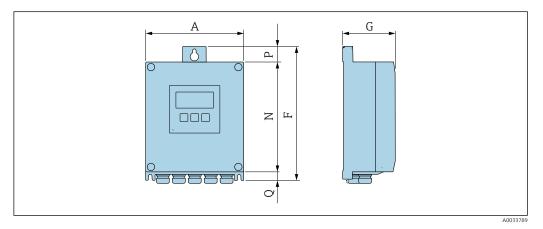

Order code for "Transmitter housing", option A "Aluminum, coated" and order code for "Integrated ISEM electronics", option A "Sensor"


A	F	G	N	P	Q
[in]	[in]	[in]	[in]	[in]	[in]
6.57	9.13	3.50	7.36	0.94	0.83

Order code for "Transmitter housing", option D "Polycarbonate" and order code for "Integrated ISEM electronics", option A "Sensor"

A	F	G	N	P	Q
[in]	[in]	[in]	[in]	[in]	[in]
6.97	9.21	3.50	7.76	0.67	0.87

#### Housing of Proline 500 transmitter


Hazardous area: Zone 2; Class I, Division 2 or Zone 1; Class I, Division 1

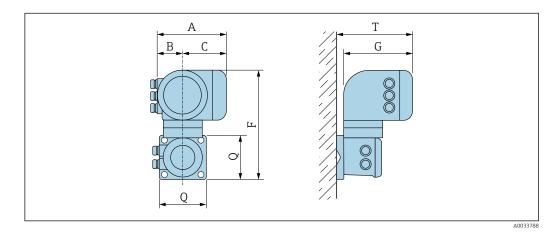

Order code for "Transmitter housing", option A "Aluminum, coated" and order code for "Integrated ISEM electronics", option B "Transmitter"

A	B	C	F	G	Q	T
[in]						
7.40	3.35	4.06	12.5	8.54	5.12	9.41

## Sensor connection housing

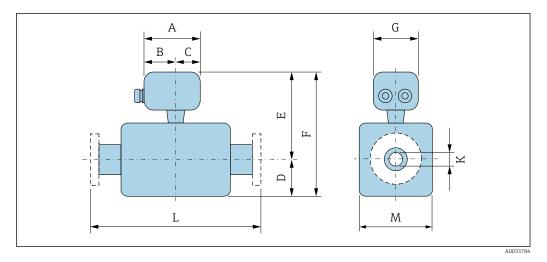

Order code for "Sensor connection housing", option A "Aluminum, coated"

DN	A 1)	B 1)	С	D	E <sup>2)</sup>	F <sup>2)</sup>	G	К	L	М
[in]	[in]	[in]	[in]	[in]	[in]	[in]	[in]	[in]	[in]	[in]
3/8	5.83	3.70	2.13	4.25	7.52	11.77	5.35	0.33	3)	3.62
1/2	5.83	3.70	2.13	4.25	7.52	11.77	5.35	0.47	3)	3.62
1	5.83	3.70	2.13	4.76	7.52	12.28	5.35	0.69	3)	3.62
1½	5.83	3.70	2.13	6.93	8.74	15.67	5.35	1.023	3)	5.59
2	5.83	3.70	2.13	10.24	9.25	19.49	5.35	1.49	3)	6.65

1) Depending on the cable gland used: values up to  $\pm 1.18$  in

2) With order code for "Sensor option", option CG: values +2.76 in

3) Depending on the process connection

Order code for "Ser	sor connection	housing", op	tion B "Stainless"
01 401 00 40 101 001		,	

DN	A 1)	В	С	D	E <sup>2)</sup>	F <sup>2)</sup>	G	К	L	М
[in]	[in]	[in]	[in]	[in]	[in]	[in]	[in]	[in]	[in]	[in]
3/8	5.39	3.07	2.32	4.25	7.32	11.57	5.28	0.33	3)	3.62
1/2	5.39	3.07	2.32	4.25	7.32	11.57	5.28	0.47	3)	3.62
1	5.39	3.07	2.32	4.76	7.32	12.09	5.28	0.69	3)	3.62
1½	5.39	3.07	2.32	6.93	8.54	15.47	5.28	1.023	3)	5.59
2	5.39	3.07	2.32	10.24	9.06	19.29	5.28	1.49	3)	6.65

1) 2)

Depending on the cable gland used: values up to +1.18 in With order code for "Sensor option", option CG: values +2.76 in

3) Depending on the process connection

Order code for "Sensor connection housing", option C "Ultra-compact hygienic, stainless"


DN	A 1)	В	С	D	E <sup>2)</sup>	F <sup>2)</sup>	G	К	L	М
[in]	[in]	[in]	[in]	[in]	[in]	[in]	[in]	[in]	[in]	[in]
3/8	4.88	2.68	2.20	4.25	7.32	11.57	4.41	0.33	3)	3.62
1/2	4.88	2.68	2.20	4.25	7.32	11.57	4.41	0.47	3)	3.62
1	4.88	2.68	2.20	4.76	7.32	12.09	4.41	0.69	3)	3.62

DN	A <sup>1)</sup>	В	С	D	E <sup>2)</sup>	F <sup>2)</sup>	G	К	L	М
[in]	[in]	[in]	[in]	[in]	[in]	[in]	[in]	[in]	[in]	[in]
11/2	4.88	2.68	2.20	6.93	8.54	15.47	4.41	1.02	3)	5.59
2	4.88	2.68	2.20	10.24	9.06	19.29	4.41	1.49	3)	6.65

Depending on the cable gland used: values up to  $\pm 1.18$  in 1)

2) 3) With order code for "Sensor option", option CG: values +2.76 in Depending on the process connection

## Flange connections ASME B16.5

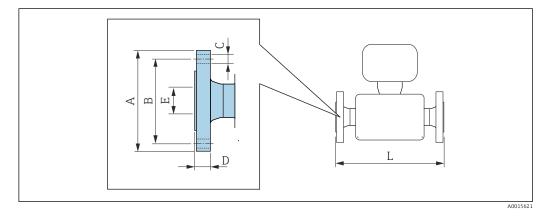


Length tolerance for dimension L in inch: +0.06 / -0.08 -

Flange according to ASME B16.5, Cl 150 1.4404 (316/316L) Order code for "Process connection", option AAW						
DN [in]	A [in]	B [in]	C [in]	D [in]	E [in]	L [in]
3/8 1)	3.54	2.37	4 × Ø0.62	0.67	0.62	13.23
1/2	3.54	2.37	4 × Ø0.62	0.67	0.62	17.32
1	4.33	3.13	4 × Ø0.62	0.69	1.05	22.83
11/2	4.92	3.87	4 × Ø0.62	0.73	1.61	27.83
2	5.91	4.75	4 × Ø0.75	0.99	2.07	32.6
Surface roug	Surface roughness (flange): Ra 126 to 248 µin					

DN  $^3\!\!/_8$  with DN  $^1\!\!/_2$  flanges as standard 1)

## Tri-Clamp

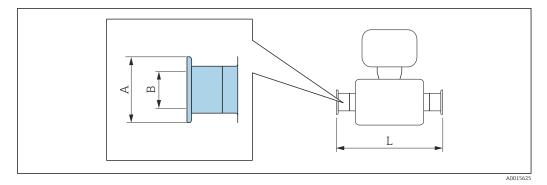

Length tolerance for dimension L in inch: +0.06 / -0.08

<sup>3</sup> / <sub>4</sub> " Tri-Clamp, for pipe according to DIN 11866 series C         1.4435 (316L)         Order code for "Process connection", option FEW				
DN Clamp A B L [in] [in] [in] [in] [in]				
<sup>3</sup> / <sub>8</sub> <sup>3</sup> / <sub>4</sub> 0.98 0.63 14.25				
3-A version: order code for "Additional approval", option LP				

½" Tri-Clamp, for pipe according to DIN 11866 series C         1.4435 (316L)         Order code for "Process connection", option FBW				
DN Clamp A B L [in] [in] [in] [in] [in]				
½         ½         0.98         0.37         18.35				
3-A version: order code for "Additional approval", option LP				


3-A version: order code for "Additional approval", option LF

1" Tri-Clamp, for pipe according to DIN 11866 series C 1.4435 (316L) Order code for "Process connection", option FNW				
DN [in]	Clamp [in]	A [in]	B [in]	L [in]
3⁄8	1	1.98	0.87	14.25
<sup>1</sup> / <sub>2</sub> 1 1.98 0.87 18.35				
3-A version: order code for "Additional approval", option LP				

1", 1½", 2" Tri-Clamp, for pipe according to DIN 11866 series C 1.4435 (316L) Order code for "Process connection", option FTW				
DN [in]	Clamp [in]	A [in]	B [in]	L [in]
3/8	1/2	0.98	0.37	14.25
1/2	3⁄4	0.98	0.63	18.35
1	1	1.98	0.87	23.86
11/2	11/2	1.98	1.37	28.78

1", 1½", 2" Tri-Clamp, for pipe according to DIN 11866 series C 1.4435 (316L) Order code for "Process connection", option FTW				
DN [in]	Clamp [in]	A [in]	B [in]	L [in]
2 2 2.52 1.87 33.58				
3-A version: order code for "Additional approval", option LP				

## Threaded connections SMS 1145

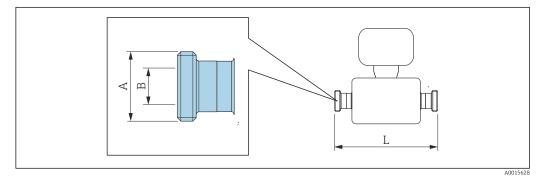




Length tolerance for dimension L in inch: +0.06 / -0.08

Thread SMS 1145 1.4435 (316L) Order code for "Process connection", option SAW				
DN [in]	A [in]	B [in]	L [in]	
3/8	Rd 40 × 1/ <sub>6</sub>	0.89	14.25	
1/2	Rd 40 × 1/ <sub>6</sub>	0.89	18.35	
1	Rd 40 × 1/ <sub>6</sub>	0.89	23.86	
11/2	Rd 60 × 1/6	1.4	29.21	
2	Rd 70 × 1/ <sub>6</sub>	1.91	34.02	
3-A version: order code	e for "Additional approval", option LP	1	1	

## Accessories

Rinse connections

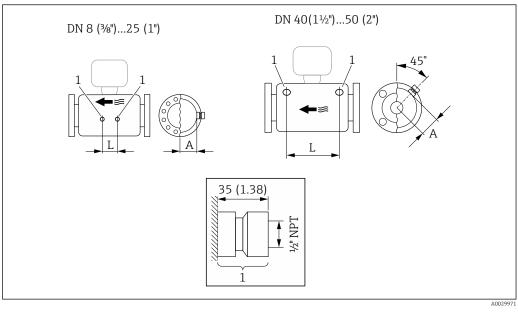


## 🖻 50


1 Connection nipple for purge connections: order code for "Sensor options", option CH "Purge connection"

DN	А	L
[in]	[in]	[in]
3/8	1.85	4.33
1/2	1.85	8.03
1	1.85	13.7
1½	2.683	16.46
2	3.215	18.62

Weather protection cover

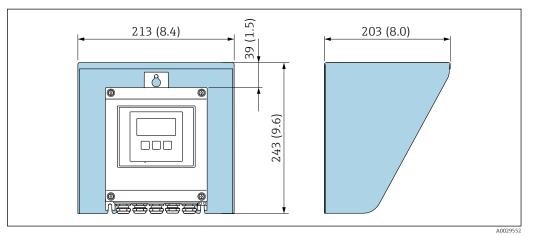


☑ 51 Weather protection cover for Proline 500 - digital; engineering unit mm (in)

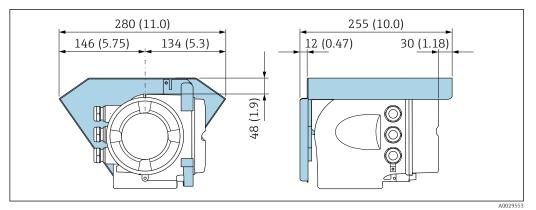


☑ 52 Weather protection cover for Proline 500; engineering unit mm (in)

External WLAN antenna



Proline 500 – digital


External WLAN antenna mounted on device

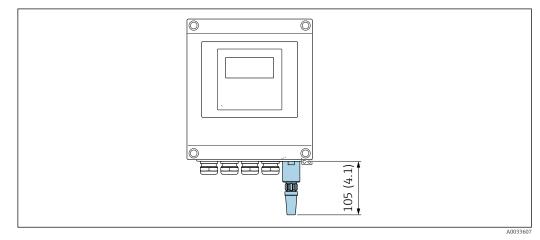

Engineering unit mm (in)

External WLAN antenna mounted with cable


The external WLAN antenna can be mounted separately from the transmitter if the transmission/ reception conditions at the transmitter mounting location are poor.

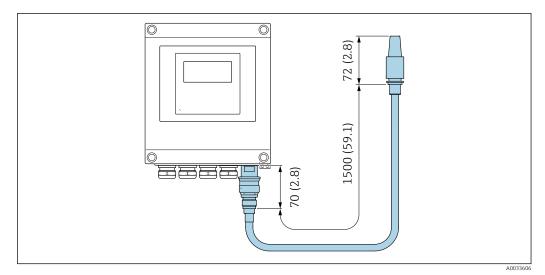



## Proline 500


External WLAN antenna mounted on device

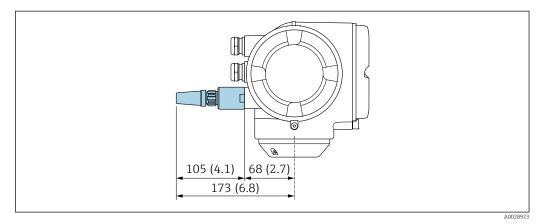

🗷 55 Engineering unit mm (in)

External WLAN antenna mounted with cable

The external WLAN antenna can be mounted separately from the transmitter if the transmission/ reception conditions at the transmitter mounting location are poor.

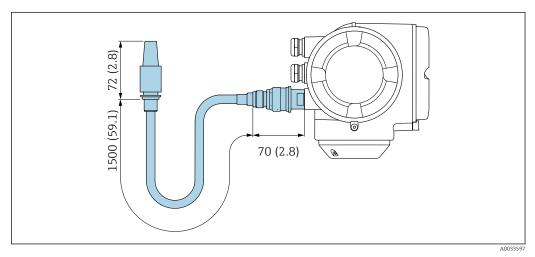

☑ 56 Engineering unit mm (in)

## Weight

## All values (weight exclusive of packaging material) refer to devices with EN/DIN PN 40 flanges.

#### Transmitter

- Proline 500 digital polycarbonate: 1.4 kg (3.1 lbs)
- Proline 500 digital aluminum: 2.4 kg (5.3 lbs)
- Proline 500 aluminum: 6.5 kg (14.3 lbs)

#### Sensor

Sensor with aluminum connection housing version:

#### Weight in SI units

DN [mm]	Weight [kg]
8	11
15	13
25	19
40	35
50	58

#### Weight in US units

DN [in]	Weight [lbs]
3/8	24
1/2	29
1	42
1½	77
2	128

## Materials

## Transmitter housing

Housing of Proline 500 – digital transmitter

Order code for "Transmitter housing":

- Option A "Aluminum coated": aluminum, AlSi10Mg, coated
- Option **D** "Polycarbonate": polycarbonate

## Housing of Proline 500 transmitter

Order code for "Transmitter housing": Option **A** "Aluminum coated": aluminum, AlSi10Mg, coated

### Window material

Order code for "Transmitter housing":

- Option **A** "Aluminum, coated": glass
- Option **D** "Polycarbonate": plastic

#### Fastening components for mounting on a post


- Screws, threaded bolts, washers, nuts: stainless A2 (chrome-nickel steel)
- Metal plates: stainless steel, 1.4301 (304)

#### Sensor connection housing

Order code for "Sensor connection housing":

- Option A "Aluminum coated": aluminum, AlSi10Mg, coated
- Option **B** "Stainless":
  - Stainless steel 1.4301 (304)
  - Optional: Order code for "Sensor feature", option **CC** "Hygienic version, for maximum corrosion resistance": stainless steel, 1.4404 (316L)
- Option **C** "Ultra-compact, stainless":
  - Stainless steel 1.4301 (304)
  - Optional: Order code for "Sensor feature", option **CC** "Hygienic version, for maximum corrosion resistance": stainless steel, 1.4404 (316L)

## Cable entries/cable glands

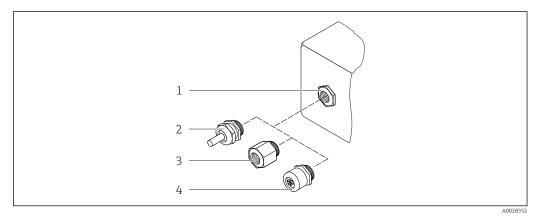

☑ 57 Possible cable entries/cable glands

- 1 Female thread M20 × 1.5
- 2 Cable gland M20 × 1.5
- 3 Adapter for cable entry with female thread G  $\frac{1}{2}$  or NPT  $\frac{1}{2}$
- 4 Device plug

Cable entries and adapters	Material
Cable gland M20 × 1.5	Plastic
<ul> <li>Adapter for cable entry with female thread G <sup>1</sup>/<sub>2</sub>"</li> <li>Adapter for cable entry with female thread NPT <sup>1</sup>/<sub>2</sub>"</li> </ul>	Nickel-plated brass
<ul> <li>Only available for certain device versions:</li> <li>Order code for "Transmitter housing":</li> <li>Option A "Aluminum, coated"</li> <li>Option D "Polycarbonate"</li> <li>Order code for "Sensor connection housing":</li> <li>Proline 500 - digital: Option A "Aluminum coated"</li> <li>Option A "Aluminum coated"</li> <li>Option B "Stainless"</li> <li>Proline 500: Option B "Stainless"</li> </ul>	
Adapter for device plug	Stainless steel, 1.4404 (316L)
<ul> <li>Device plug for digital communication: Only available for certain device versions →          <sup>(1)</sup> 33.</li> <li>Device plug for connecting cable: A device plug is always used for the device version, order code for "Sensor connection housing", option C (ultra- compact, hygienic, stainless).</li> </ul>	

#### Device plug

Electrical connection	Material
Plug M12x1	<ul><li>Socket: Stainless steel, 1.4404 (316L)</li><li>Contact housing: Polyamide</li><li>Contacts: Gold-plated brass</li></ul>

#### **Connecting cable**

UV rays can impair the cable outer sheath. Protect the cable from exposure to sun as much as possible.

Connecting cable for sensor - Proline 500 - digital transmitter

PVC cable with copper shield

Connecting cable for sensor - Proline 500 transmitter

PVC cable with copper shield

#### Sensor housing

- Acid and alkali-resistant outer surface
- Stainless steel 1.4301 (304)

## Measuring tubes

Stainless steel, 1.4435 (316L)

#### **Process connections**

Flange according to EN 1092-1 (DIN 2501)/ASME B16.5/JIS B2220:	Stainless steel, 1.4404 (316/316L)
All other process connections:	Stainless steel, 1.4435 (316L)



Available process connections  $\rightarrow \square 96$ 

#### Seals

Welded process connections without internal seals

#### Accessories

Protective cover

Stainless steel, 1.4404 (316L)

External WLAN antenna

- Antenna: ASA plastic (acrylic ester-styrene-acrylonitrile) and nickel-plated brass
- Adapter: Stainless steel and nickel-plated brass
- Cable: Polyethylene
- Plug: Nickel-plated brass
- Angle bracket: Stainless steel

Process connections	<ul> <li>Fixed flange connections:</li> <li>EN 1092-1 (DIN 2501) flange</li> <li>EN 1092-1 (DIN 2512N) flange</li> <li>ASME B16.5 flange</li> <li>JIS B2220 flange</li> <li>DIN 11864-2 Form A flange, DIN 11866 series A, flange with notch</li> <li>Clamp connections:</li> <li>Tri-Clamp (OD tubes), DIN 11866 series C</li> <li>DIN 11864-3 Form A clamp, DIN 11866 series A, with notch</li> <li>DIN 32676 clamp, DIN 11866 series A</li> <li>ISO 2852 clamp, ISO 2037</li> <li>Thread:</li> <li>DIN 11851 thread, DIN 11866 series A</li> <li>SMS 1145 thread</li> <li>ISO 2853 thread, ISO 2037</li> <li>DIN 11864-1 Form A thread, DIN 11866 series A</li> </ul>
Surface roughness	All data refer to parts in contact with the medium. The following surface roughness categories can be ordered. • $Ra_{max} = 0.76 \ \mu m \ (30 \ \mu in)$ • $Ra_{max} = 0.38 \ \mu m \ (15 \ \mu in)$
	Operability
Operating concept	Operator-oriented menu structure for user-specific tasks <ul> <li>Commissioning</li> <li>Operation</li> <li>Diagnostics</li> <li>Expert level</li> </ul>
	<ul> <li>Fast and safe commissioning</li> <li>Guided menus ("Make-it-run" wizards) for applications</li> <li>Menu guidance with brief descriptions of the individual parameter functions</li> <li>Access to the device via Web server</li> </ul>

• WLAN access to the device via mobile handheld terminal, tablet or smart phone

#### Reliable operation

- Operation in local language
- Uniform operating philosophy applied to device and operating tools
- If replacing electronic modules, transfer the device configuration via the integrated memory (HistoROM backup) which contains the process and measuring device data and the event logbook. No need to reconfigure.

## Efficient diagnostic behavior increases measurement availability

- Troubleshooting measures can be called up via the device and in the operating tools
- Diverse simulation options, logbook for events that occur and optional line recorder functions

Languages

Can be operated in the following languages:


- Via local operation English, German, French, Spanish, Italian, Dutch, Portuguese, Polish, Russian, Turkish, Chinese, Japanese, Korean, Vietnamese, Czech, Swedish
  Via Web browser
- English, German, French, Spanish, Italian, Dutch, Portuguese, Polish, Russian, Turkish, Chinese, Japanese, Vietnamese, Czech, Swedish
- Via "FieldCare", "DeviceCare" operating tool: English, German, French, Spanish, Italian, Chinese, Japanese

## Local operation

#### Via display module

- Equipment:
- Order code for "Display; operation", option F "4-line, illuminated, graphic display; touch control"
   Order code for "Display; operation", option G "4-line, illuminated, graphic display; touch control + WLAN"

🛐 Information about WLAN interface  $\rightarrow \square$  104

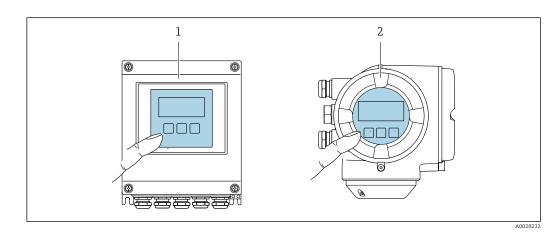

- ☑ 58 Operation with touch control
- 1 Proline 500 digital
- 2 Proline 500

#### Display elements

- 4-line, illuminated, graphic display
- White background lighting; switches to red in event of device errors
- Format for displaying measured variables and status variables can be individually configured
- Permitted ambient temperature for the display: -20 to +60 °C (-4 to +140 °F)
   The readability of the display may be impaired at temperatures outside the temperature range.


#### **Operating elements**

- External operation via touch control (3 optical keys) without opening the housing: 🕀, 🖃, 🗉
- Operating elements also accessible in the various zones of the hazardous area

**Remote operation** 


## Via HART protocol

This communication interface is available in device versions with a HART output.

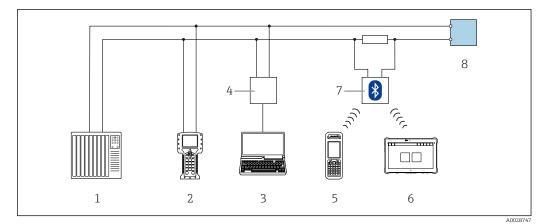

☑ 59 Options for remote operation via HART protocol (active)

- 1 Control system (e.g. PLC)
- 2 Field Communicator 475
- 3 Computer with Web browser (e.g. Internet Explorer) for accessing the integrated device Web server or computer with operating tool (e.g. FieldCare, DeviceCare, AMS Device Manager, SIMATIC PDM) with COM DTM "CDI Communication TCP/IP"
- 4 Commubox FXA195 (USB)
- 5 Field Xpert SFX350 or SFX370
- 6 Field Xpert SMT70
- 7 VIATOR Bluetooth modem with connecting cable
- 8 Transmitter

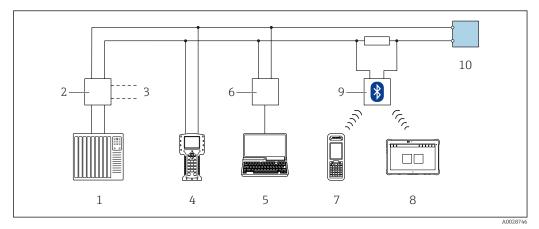


60 Options for remote operation via HART protocol (passive)

- 1 Control system (e.q. PLC)
- 2 Transmitter power supply unit, e.g. RN221N (with communication resistor)
- 3 Connection for Commubox FXA195 and Field Communicator 475
- 4 Field Communicator 475
- 5 Computer with Web browser (e.g. Internet Explorer) for accessing the integrated device Web server or computer with operating tool (e.g. FieldCare, DeviceCare, AMS Device Manager, SIMATIC PDM) with COM DTM "CDI Communication TCP/IP"
- 6 Commubox FXA195 (USB)
- 7 Field Xpert SFX350 or SFX370
- 8 Field Xpert SMT70
- 9 VIATOR Bluetooth modem with connecting cable
- 10 Transmitter

#### Via FOUNDATION Fieldbus network

This communication interface is available in device versions with FOUNDATION Fieldbus.

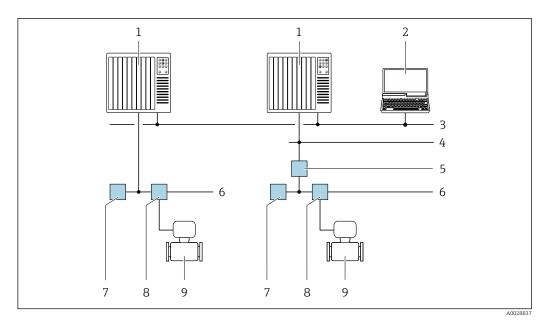


61 Options for remote operation via FOUNDATION Fieldbus network

- 1 Automation system
- 2 Computer with FOUNDATION Fieldbus network card
- 3 Industry network
- 4 High Speed Ethernet FF-HSE network
- 5 Segment coupler FF-HSE/FF-H1
- 6 FOUNDATION Fieldbus FF-H1 network
- 7 Power supply FF-H1 network
- 8 T-box
- 9 Measuring device

#### Via PROFIBUS DP network

This communication interface is available in device versions with PROFIBUS DP.

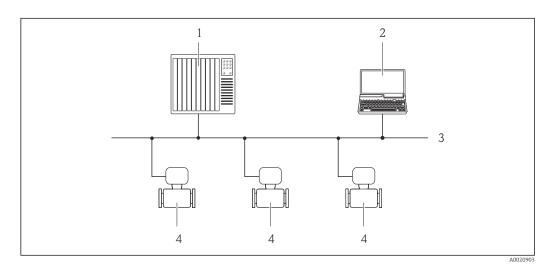


62 Options for remote operation via PROFIBUS DP network

- 1 Automation system
- 2 Computer with PROFIBUS network card
- 3 PROFIBUS DP network
- 4 Measuring device

#### Via PROFIBUS PA network

This communication interface is available in device versions with PROFIBUS PA.

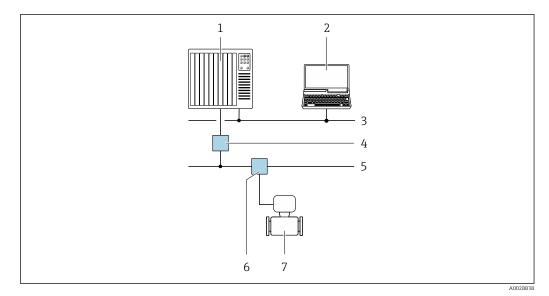


63 Options for remote operation via PROFIBUS PA network

- 1 Automation system
- 2 Computer with PROFIBUS network card
- 3 PROFIBUS DP network
- 4 Segment coupler PROFIBUS DP/PA
- 5 PROFIBUS PA network
- 6 T-box
- 7 Measuring device

## Via Modbus RS485 protocol

This communication interface is available in device versions with a Modbus-RS485 output.

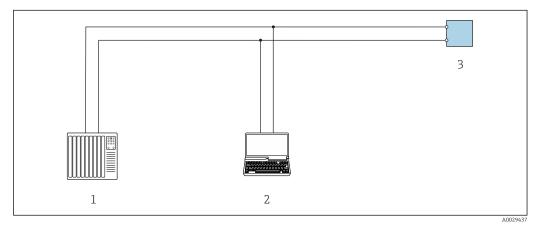


64 Options for remote operation via Modbus-RS485 protocol (active)

- 1 Control system (e.g. PLC)
- 2 Computer with Web browser (e.g. Internet Explorer) for accessing the integrated device Web server or with operating tool (e.g. FieldCare, DeviceCare) with COM DTM "CDI Communication TCP/IP" or Modbus DTM
- 3 Transmitter

#### Via EtherNet/IP network

This communication interface is available in device versions with EtherNet/IP.

#### Star topology

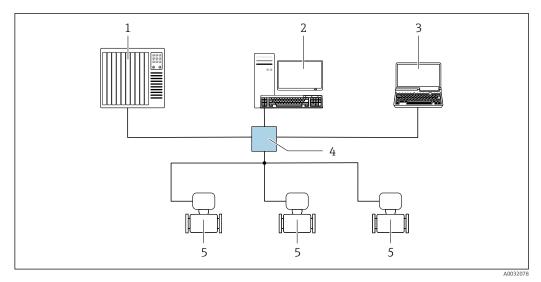


65 Options for remote operation via EtherNet/IP network: star topology

- 1 Automation system, e.g. "RSLogix" (Rockwell Automation)
- 2 Workstation for measuring device operation: with Custom Add-On Profile for "RSLogix 5000" (Rockwell Automation) or with Electronic Data Sheet (EDS)
- 3 Computer with Web browser (e.g. Internet Explorer) for accessing the integrated Web server or computer with operating tool (e.g. FieldCare, DeviceCare) with COM DTM "CDI Communication TCP/IP"
- 4 Standard Ethernet switch, e.g. Scalance X204 (Siemens)
- 5 Measuring device

#### Ring topology

The device is integrated via the terminal connection for signal transmission (output 1) and the service interface (CDI-RJ45).

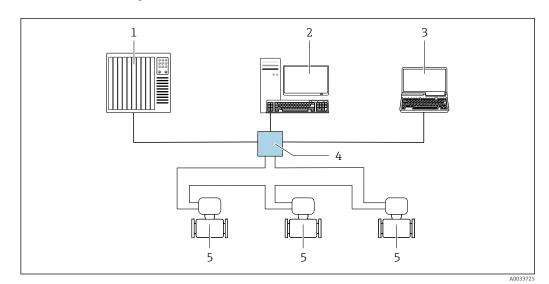


66 Options for remote operation via EtherNet/IP network: ring topology

- *1* Automation system, e.q. "RSLoqix" (Rockwell Automation)
- 2 Workstation for measuring device operation: with Custom Add-On Profile for "RSLogix 5000" (Rockwell Automation) or with Electronic Data Sheet (EDS)
- 3 Computer with Web browser (e.g. Internet Explorer) for accessing the integrated Web server or computer with operating tool (e.g. FieldCare, DeviceCare) with COM DTM "CDI Communication TCP/IP"
- 4 Standard Ethernet switch, e.g. Scalance X204 (Siemens)
- 5 Measuring device

#### Via PROFINET network

This communication interface is available in device versions with PROFINET.

## Star topology

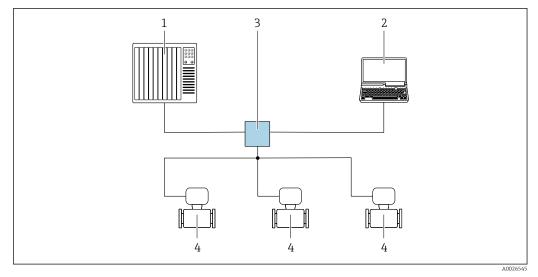


67 Options for remote operation via PROFINET network: star topology

1 Automation system, e.g. Simatic S7 (Siemens)

- 2 Computer with Web browser (e.g. Internet Explorer) for accessing the integrated Web server or computer with operating tool (e.g. FieldCare, DeviceCare, SIMATIC PDM) with COM DTM "CDI Communication TCP/IP"
- 3 Standard Ethernet switch, e.g. Scalance X204 (Siemens)
- 4 Measuring device

## Ring topology

The device is integrated via the terminal connection for signal transmission (output 1) and the service interface (CDI-RJ45).

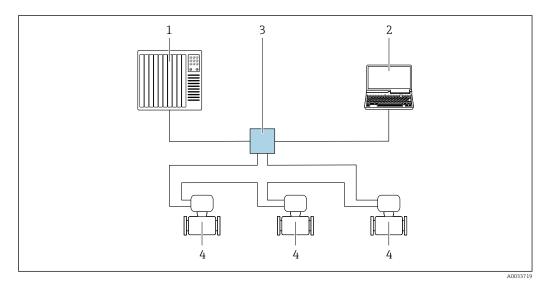


68 Options for remote operation via PROFINET network: ring topology

1 Automation system, e.g. Simatic S7 (Siemens)

- 2 Computer with Web browser (e.g. Internet Explorer) for accessing the integrated Web server or computer with operating tool (e.g. FieldCare, DeviceCare, SIMATIC PDM) with COM DTM "CDI Communication TCP/IP"
- 3 Standard Ethernet switch, e.g. Scalance X204 (Siemens)
- 4 Measuring device

#### Via APL network

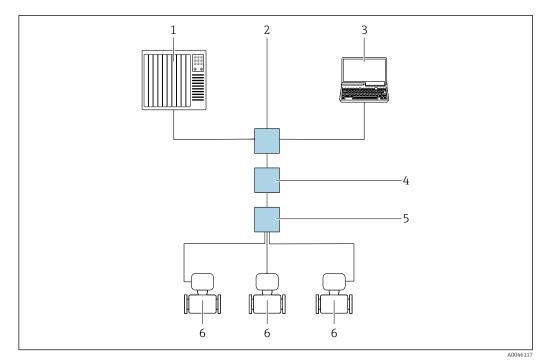

#### 69 Options for remote operation via APL network

- 1 Automation system, e.g. Simatic S7 (Siemens)
- 2 Ethernet switch, e.g. Scalance X204 (Siemens)
- Computer with Web browser (e.g. Internet Explorer) for access to integrated Web server or computer with operating tool (e.g. FieldCare or DeviceCare with PROFINET COM DTM or SIMATIC PDM with FDI-Package)
   APL power switch (optional)
- 5 APL field switch
- 6 Measuring device

Service interface

#### Via service interface (CDI-RJ45)

A point-to-point connection can be established via onsite device configuration. With the housing open, the connection is established directly via the service interface (CDI-RJ45) of the device.




An adapter for RJ45 to the M12 plug is optionally available:

Order code for "Accessories", option  $\ensuremath{\textbf{NB}}\xspace$ : "Adapter RJ45 M12 (service interface)"

The adapter connects the service interface (CDI-RJ45) to an M12 plug mounted in the cable entry. The connection to the service interface can be established via an M12 plug without opening the device.


Proline 500 – digital transmitter

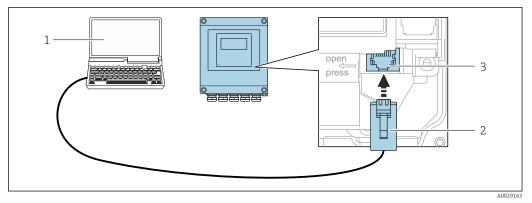

☑ 70 Connection via service interface (CDI-RJ45)

- 1 Computer with Web browser (e.g. Microsoft Internet Explorer, Microsoft Edge) for accessing the integrated Web server or with "FieldCare", "DeviceCare" operating tool with COM DTM "CDI Communication TCP/IP" or Modbus DTM
- 2 Standard Ethernet connecting cable with RJ45 plug
- 3 Service interface (CDI-RJ45) of the measuring device with access to the integrated Web server

#### Proline 500 transmitter

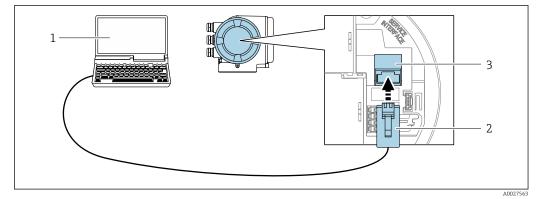


☑ 71 Connection via service interface (CDI-RJ45)

- 1 Computer with Web browser (e.g. Microsoft Internet Explorer, Microsoft Edge) for accessing the integrated Web server or with "FieldCare", "DeviceCare" operating tool with COM DTM "CDI Communication TCP/IP" or Modbus DTM
- 2 Standard Ethernet connecting cable with RJ45 plug
- 3 Service interface (CDI-RJ45) of the measuring device with access to the integrated Web server

## Via WLAN interface

The optional WLAN interface is available on the following device version: Order code for "Display; operation", option G "4-line, illuminated; touch control + WLAN"

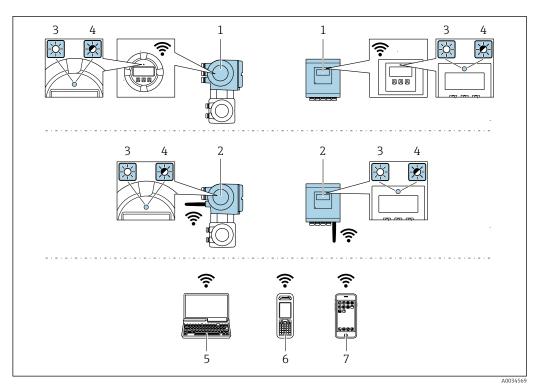

- 1 Transmitter with integrated WLAN antenna
- 2 Transmitter with external WLAN antenna
- 3 LED lit constantly: WLAN reception is enabled on measuring device
- 4 LED flashing: WLAN connection established between operating unit and measuring device
- 5 Computer with WLAN interface and Web browser (e.g. Microsoft Internet Explorer, Microsoft Edge) for accessing the integrated device Web server or with operating tool (e.g. FieldCare, DeviceCare)
- 6 Mobile handheld terminal with WLAN interface and Web browser (e.g. Microsoft Internet Explorer, Microsoft Edge) for accessing the integrated device Web server or operating tool (e.g. FieldCare, DeviceCare)
- 7 Smart phone or tablet (e.g. Field Xpert SMT70)

Function	WLAN: IEEE 802.11 b/g (2.4 GHz) • Access Point with DHCP server (factory setting) • Network
Encryption	WPA2-PSK AES-128 (in accordance with IEEE 802.11i)
Configurable WLAN channels	1 to 11
Degree of protection	IP67
Available antennas	<ul> <li>Internal antenna</li> <li>External antenna (optional) In the event of poor transmission/reception conditions at the place of installation. Available as an accessory .</li> <li>Only 1 antenna is active at any one time!</li> </ul>
Range	<ul> <li>Internal antenna: typically 10 m (32 ft)</li> <li>External antenna: typically 50 m (164 ft)</li> </ul>
Materials (external antenna)	<ul> <li>Antenna: ASA plastic (acrylic ester-styrene-acrylonitrile) and nickel- plated brass</li> <li>Adapter: Stainless steel and nickel-plated brass</li> <li>Cable: Polyethylene</li> <li>Plug: Nickel-plated brass</li> <li>Angle bracket: Stainless steel</li> </ul>


#### Network integration

Network integration is only available for the HART communication protocol.

With the optional "OPC-UA Server" application package, the device can be integrated into an Ethernet network via the service interface (CDI-RJ45 and WLAN) and communicate with OPC-UA clients. If the device is used in this way, IT security must be considered.

Transmitters with an Ex de approval may **not** be connected via the service interface (CDI-RJ45)! Order code for "Approval transmitter + sensor", options (Ex de): BA, BB, C1, C2, GA, GB, MA, MB, NA, NB

For permanent access to device data and for device configuration via the Web server, the device is incorporated directly in a network via the service interface (CDI-RJ45). In this way, the device can be accessed any time from the control station. The measured values are processed separately via the inputs and outputs through the automation system.

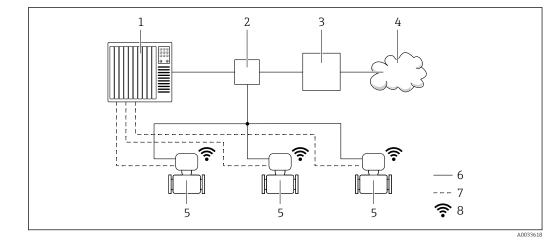

- 1 Automation system, e.g. Simatic S7 (Siemens)
- 2 Ethernet switch
- 3 Edge Gateway
- 4 Cloud
- 5 Measuring device
- 6 Ethernet network
- 7 Measured values via inputs and outputs
- 8 Optional WLAN interface

The optional WLAN interface is available on the following device version: Order code for "Display; operation", option **G** "4-line, backlit, graphic display; touch control + WLAN"

Special Documentation for the OPC-UA Server application package  $\rightarrow \square$  121.

#### Supported operating tools

Different operating tools can be used for local or remote access to the measuring device. Depending on the operating tool used, access is possible with different operating units and via a variety of interfaces.

Supported operating tools	Operating unit	Interface	Additional information
Web browser	Notebook, PC or tablet with Web browser	<ul> <li>CDI-RJ45 service interface</li> <li>WLAN interface</li> <li>Ethernet-based fieldbus (EtherNet/IP, PROFINET)</li> </ul>	Special Documentation for the device → 🗎 121
DeviceCare SFE100	Notebook, PC or tablet with Microsoft Windows system	<ul><li>CDI-RJ45 service interface</li><li>WLAN interface</li><li>Fieldbus protocol</li></ul>	→ 🗎 119
FieldCare SFE500	Notebook, PC or tablet with Microsoft Windows system	<ul><li>CDI-RJ45 service interface</li><li>WLAN interface</li><li>Fieldbus protocol</li></ul>	→ 🗎 119

Supported operating tools	Operating unit	Interface	Additional information
Field Xpert	SMT70/77/50	<ul> <li>All fieldbus protocols</li> <li>WLAN interface</li> <li>Bluetooth</li> <li>CDI-RJ45 service interface</li> </ul>	Operating Instructions BA01202S Device description files: Use update function of handheld terminal
SmartBlue app	Smart phone or tablet with iOs or Android	WLAN	→ 🗎 119

Other operating tools based on FDT technology with a device driver such as DTM/iDTM or DD/EDD can be used for device operation. These operating tools are available from the individual manufacturers. Integration into the following operating tools, among others, is supported:

- FactoryTalk AssetCentre (FTAC) from Rockwell Automation → www.rockwellautomation.com
- Process Device Manager (PDM) from Siemens → www.siemens.com
- Asset Management Solutions (AMS) from Emerson → www.emersonprocess.com
- FieldCommunicator 375/475 from Emerson → www.emersonprocess.com
- Field Device Manager (FDM) from Honeywell → www.process.honeywell.com
- FieldMate from Yokogawa → www.yokogawa.com
- PACTWare → www.pactware.com

The related device description files are available: www.endress.com  $\rightarrow$  Downloads

#### Web server

Thanks to the integrated Web server the device can be operated and configured via a Web browser and via the service interface (CDI-RJ45) or via the WLAN interface. The structure of the operating menu is the same as for the local display. In addition to the measured values, device status information is also displayed and allows users to monitor the status of the device. Furthermore the device data can be managed and the network parameters can be configured.

A device that has a WLAN interface (can be ordered as an option) is required for the WLAN connection: order code for "Display; operation", option G "4-line, illuminated; touch control + WLAN". The device acts as an Access Point and enables communication by computer or a mobile handheld terminal.

#### Supported functions

Data exchange between the operating unit (such as a notebook for example) and the measuring device:

- Upload the configuration from the measuring device (XML format, configuration backup)
- Save the configuration to the measuring device (XML format, restore configuration)
- Export event list (.csv file)
- Export parameter settings (.csv file or PDF file, document the measuring point configuration)
- Export the Heartbeat verification log (PDF file, only available with the "Heartbeat Verification" application package)
- Flash firmware version for device firmware upgrade, for instance
- Download driver for system integration
- Visualize up to 1000 saved measured values (only available with the Extended HistoROM application package → 
   <sup>(1)</sup>
   <sup>(2)</sup>
   <sup>(2)</sup>

Web server special documentation  $\rightarrow \cong 121$ 

**HistoROM data management** The measuring device features HistoROM data management. HistoROM data management comprises both the storage and import/export of key device and process data, making operation and servicing far more reliable, secure and efficient.



When the device is delivered, the factory settings of the configuration data are stored as a backup in the device memory. This memory can be overwritten with an updated data record, for example after commissioning.

## Additional information on the data storage concept

*There are different types of data storage units in which device data are stored and used by the device:* 

	HistoROM backup	T-DAT	S-DAT
Available data	<ul> <li>Event logbook such as diagnostic events for example</li> <li>Parameter data record backup</li> <li>Device firmware package</li> <li>Driver for system integration for exporting via Web server, e.g:</li> <li>GSD for PROFIBUS DP</li> <li>GSD for PROFIBUS PA</li> <li>GSDML for PROFINET</li> <li>EDS for EtherNet/IP</li> <li>DD for FOUNDATION Fieldbus</li> </ul>	<ul> <li>Measured value logging ("Extended HistoROM" order option)</li> <li>Current parameter data record (used by firmware at run time)</li> <li>Maximum indicators (min/max values)</li> <li>Totalizer values</li> </ul>	<ul> <li>Sensor data: nominal diameter etc.</li> <li>Serial number</li> <li>Calibration data</li> <li>Device configuration (e.g. SW options, fixed I/O or multi I/O)</li> </ul>
Storage location	Fixed on the user interface board in the connection compartment	Attachable to the user interface board in the connection compartment	In the sensor plug in the transmitter neck part

## Data backup

## Automatic

- The most important device data (sensor and transmitter) are automatically saved in the DAT modules
- If the transmitter or measuring device is replaced: once the T-DAT containing the previous device data has been exchanged, the new measuring device is ready for operation again immediately without any errors
- If the sensor is replaced: once the sensor has been replaced, new sensor data are transferred from the S-DAT in the measuring device and the measuring device is ready for operation again immediately without any errors
- If exchanging the electronics module (e.g. I/O electronics module): Once the electronics module has been replaced, the software of the module is compared against the current device firmware. The module software is upgraded or downgraded where necessary. The electronics module is available for use immediately afterwards and no compatibility problems occur.

## Manual

Additional parameter data record (complete parameter settings) in the integrated device memory HistoROM backup for:

- Data backup function
  - Backup and subsequent restoration of a device configuration in the device memory HistoROM backup
- Data comparison function Comparison of the current device configuration with the device configuration saved in the device memory HistoROM backup

## Data transmission

## Manual

- Transfer of a device configuration to another device using the export function of the specific operating tool, e.g. with FieldCare, DeviceCare or Web server: to duplicate the configuration or to store in an archive (e.g. for backup purposes)
- Transmission of the drivers for system integration via Web server, e.g.:
  - GSD for PROFIBUS DP
  - GSD for PROFIBUS PA
  - GSDML for PROFINET
  - EDS for EtherNet/IP
  - DD for FOUNDATION Fieldbus

### Event list

#### Automatic

- Chronological display of up to 20 event messages in the events list
- If the **Extended HistoROM** application package (order option) is enabled: up to 100 event messages are displayed in the events list along with a time stamp, plain text description and remedial measures
- The events list can be exported and displayed via a variety of interfaces and operating tools e.g. DeviceCare, FieldCare or Web server

### Data logging

#### Manual

- If the Extended HistoROM application package (order option) is enabled:
- Record up to 1000 measured values via 1 to 4 channels
- User configurable recording interval
- Record up to 250 measured values via each of the 4 memory channels
- Export the measured value log via a variety of interfaces and operating tools e.g. FieldCare, DeviceCare or web server

# **Certificates and approvals**

Current certificates and approvals that are available for the product can be selected via the Product Configurator at www.endress.com:

- 1. Select the product using the filters and search field.
- 2. Open the product page.
- 3. Select **Configuration**.

CE mark	The device meets the legal requirements of the applicable EU Directives. These are listed in the corresponding EU Declaration of Conformity along with the standards applied.
	Endress+Hauser confirms successful testing of the device by affixing to it the CE mark.
UKCA marking	The device meets the legal requirements of the applicable UK regulations (Statutory Instruments). These are listed in the UKCA Declaration of Conformity along with the designated standards. By selecting the order option for UKCA marking, Endress+Hauser confirms a successful evaluation and testing of the device by affixing the UKCA mark.
	Contact address Endress+Hauser UK: Endress+Hauser Ltd. Floats Road Manchester M23 9NF United Kingdom www.uk.endress.com
RCM mark	The measuring system meets the EMC requirements of the "Australian Communications and Media Authority (ACMA)".
Ex approval	The measuring device is certified for use in hazardous areas and the relevant safety instructions are provided in the separate "Safety Instructions" (XA) document. Reference is made to this document on the nameplate.
	<ul> <li>The following devices have equipment protection level (EPL) Ga/Gb (Zone 0 in the measuring tube):</li> <li>Device versions with the order code for "Integrated ISEM electronics", option A and the order code for "Approval; transmitter; sensor", option BI, BJ, BM or BN.</li> <li>Device versions with the order code for "Integrated ISEM electronics", option B and the order code for "Approval; transmitter; sensor", option BA, BB, BC or BD.</li> </ul>
	The separate Ex documentation (XA) containing all the relevant explosion protection data is available from your Endress+Hauser sales center.

# Proline 500 – digital

## ATEX/IECEx

Currently, the following versions for use in hazardous areas are available:

## Ex ia

Transmitter		Sensor	
Category	Type of protection	Category	Type of protection
II(1)G	[Ex ia] IIC	II1/2G	Ex ia IIC T6T1 Ga/Gb Ex ia IIB T6T1 Ga/Gb
II(1)G	[Ex ia] IIC	II2G	Ex ia IIC T6T1 Gb Ex ia IIB T6T1 Gb
II3(1)G	Ex ec [ia Ga] IIC T5T4 Gc	II1/2G	Ex ia IIC T6T1 Ga/Gb Ex ia IIB T6T1 Ga/Gb
II3(1)G	Ex ec [ia Ga] IIC T5T4 Gc	II2G	Ex ia IIC T6T1 Gb Ex ia IIB T6T1 Gb

# Ex tb

Transmitter		Sensor	
Category	Type of protection	Category	Type of protection
II(1)D	[Ex ia] IIIC	II2D	Ex ia tb IIIC T** °C Db

### Non-Ex / Ex ec

Transmitter		Sensor	
Category	Type of protection	Category	Type of protection
Non - Ex	Non-Ex	II3G	Ex ec IIC T5T1 Gc
II3G	Ex ec IIC T5T4 Gc	II3G	Ex ec IIC T5T1 Gc

## $_{C}CSA_{US}$

Currently, the following versions for use in hazardous areas are available:

# IS (Ex nA, Ex i)

Transmitter	Sensor
Class I Division 2 Groups A - D	Class I, II, III Division 1 Groups A-G
Class I Division 2 Groups A - D	Class I, II, III Division 1 Groups C-G

# NI (Ex nA)

Transmitter	Sensor
Class I Division 2 Groups A - D	

# Ex nA / Ex i

Transmitter	Sensor
Class I, Zone 2 AEx/ Ex nA [ia Ga] IIC T5T4 Gb	Class I, Zone 1 AEx/ Ex ia IIC T6T1 Ga/Gb Class I, Zone 1 AEx/ Ex ia IIB T6T1 Ga/Gb
Class I, Zone 2 AEx/ Ex nA [ia Ga] IIC T5T4 Gb	Class I, Zone 1 AEx/ Ex ia IIC T6T1 Gb Class I, Zone 1 AEx/ Ex ia IIB T6T1 Gb

#### Ex nA

Transmitter	Sensor
Class I, Zone 2 AEx/ Ex nA IIC T5T4 Gc	Class I, Zone 2 AEx/ Ex nA IIC T5T1 Gc

### Ex tb

Transmitter	Sensor
[AEx / Ex ia ] IIIC	Zone 21 AEx/ Ex ia tb IIIC T** °C Db

### Proline 500

### ATEX/IECEx

Currently, the following versions for use in hazardous areas are available:

### Ex db eb

Transmitter		Sensor	
Category	Type of protection	Category	Type of protection
II2G	Ex db eb ia IIC T6T4 Gb	II1/2G	Ex ia IIC T6T1 Ga/Gb
II2G	Ex db eb ia IIB T6T4 Gb	II1/2G	Ex ia IIB T6T1 Ga/Gb
II2G	Ex db eb ia IIC T6T4 Gb	II2G	Ex ia IIC T6T1 Gb
II2G	Ex db eb ia IIB T6T4 Gb	II2G	Ex ia IIB T6T1 Gb

#### Ex db

Transmitter		Sensor	
Category	Type of protection	Category	Type of protection
II2G	Ex db ia IIC T6T4 Gb	II1/2G	Ex ia IIC T6T1 Ga/Gb
II2G	Ex db ia IIB T6T4 Gb	II1/2G	Ex ia IIB T6T1 Ga/Gb
II2G	Ex db ia IIC T6T4 Gb	II2G	Ex ia IIC T6T1 Gb
II2G	Ex db ia IIB T6T4 Gb	II2G	Ex ia IIB T6T1 Gb

#### Ex tb

Category	Type of protection		
	Transmitter Sensor		
II2D	Ex tb IIIC T85°C Db	Ex ia tb IIIC T** °C Db	

### Ех ес

Category	Type of protection		
	Transmitter	Sensor	
II3G	Ex ec IIC T5T4 Gc	Ex ec IIC T5T1 Gc	

# $_{C}CSA_{US}$

Currently, the following versions for use in hazardous areas are available:

## IS (Ex i) and XP (Ex d)

Transmitter	Sensor	
Class I, II, III Division 1 Groups A-G		
Class I, II, III Division 1 Groups C-G		

### NI (Ex nA)

Transmitter	Sensor
Class I Division 2 Groups ABCD	

### Ex de

Transmitter	Sensor
Class I, Zone 1 AEx/ Ex de ia IIC T6T4 Gb	Class I, Zone 1 AEx/ Ex ia IIC T6T1 Ga/Gb
Class I, Zone 1 AEx/ Ex de ia IIB T6T4 Gb	Class I, Zone 1 AEx/ Ex ia IIB T6T1 Ga/Gb
Class I, Zone 1 AEx/ Ex de ia IIC T6T4 Gb	Class I, Zone 1 AEx/ Ex ia IIC T6T1 Gb
Class I, Zone 1 AEx/ Ex de ia IIB T6T4 Gb	Class I, Zone 1 AEx/ Ex ia IIB T6T1 Gb

## Ex d

Transmitter	Sensor
Class I, Zone 1 AEx/ Ex d ia IIC T6T4 Gb	Class I, Zone 1 AEx/ Ex ia IIC T6T1 Ga/Gb
Class I, Zone 1 AEx/ Ex d ia IIB T6T4 Gb	Class I, Zone 1 AEx/ Ex ia IIB T6T1 Ga/Gb
Class I, Zone 1 AEx/ Ex d ia IIC T6T4 Gb	Class I, Zone 1 AEx/ Ex ia IIC T6T1 Gb
Class I, Zone 1 AEx/ Ex d ia IIB T6T4 Gb	Class I, Zone 1 AEx/ Ex ia IIB T6T1 Gb

### Ex nA

Transmitter	Sensor
Class I, Zone 2 AEx/ Ex nA IIC T5T4 Gc	Class I, Zone 2 AEx/ Ex nA IIC T5T1 Gc

### Ex tb

3-A approval

Transmitter	Sensor
Zone 21 AEx/ Ex tb IIIC T85°C Db	Zone 21 AEx/ Ex ia tb IIIC T** °C Db

## Hygienic compatibility

- Only measuring devices with the order code for "Additional approval", option LP "3A" have 3-A approval.
- The 3-A approval refers to the measuring device.
- When installing the measuring device, ensure that no liquid can accumulate on the outside of the measuring device.
  - A remote display module must be installed in accordance with the 3-A Standard.
- Accessories (e.g. heating jacket, weather protection cover, wall holder unit) must be installed in accordance with the 3-A Standard.
- Each accessory can be cleaned. Disassembly may be necessary under certain circumstances. • EHEDG-tested
- Only devices with the order code for "Additional approval", option LT "EHEDG" have been tested and meet the requirements of the EHEDG.
- To meet the requirements for EHEDG certification, the device must be used with process connections in accordance with the EHEDG position paper entitled "Easy cleanable Pipe couplings and Process connections" (www.ehedg.org).
- FDA
- Food Contact Materials Regulation (EC) 1935/2004

Pharmaceutical compatibility	<ul> <li>FDA 21 CFR 177</li> <li>USP &lt;87&gt;</li> <li>USP &lt;88&gt; Class VI 121 °C</li> <li>TSE/BSE Certificate of Suitability</li> </ul>
	<ul> <li>cGMP</li> <li>Devices with the order code for "Test, certificate", option JG "Conformity with cGMP-derived requirements, declaration" comply with the requirements of cGMP with regard to the surfaces of parts in contact with the medium, design, FDA 21 CFR material conformity, USP Class VI tests and TSE/BSE conformity.</li> <li>A serial number-specific declaration is generated.</li> </ul>
Functional safety	The measuring device can be used for flow monitoring systems (min., max., range) up to SIL 2 (single-channel architecture; order code for "Additional approval", option LA) and SIL 3 (multi- channel architecture with homogeneous redundancy) and is independently evaluated and certified in accordance with IEC 61508.
	<ul> <li>The following types of monitoring in safety equipment are possible:</li> <li>Mass flow</li> <li>Volume flow</li> <li>Density</li> </ul>
	Functional Safety Manual with information on the SIL device $\rightarrow \square$ 121
HART certification	HART interface
	The measuring device is certified and registered by the FieldComm Group. The measuring system meets all the requirements of the following specifications: • Certified according to HART 7
	<ul> <li>The device can also be operated with certified devices of other manufacturers (interoperability)</li> </ul>
FOUNDATION Fieldbus certification	<ul> <li>FOUNDATION Fieldbus interface</li> <li>The measuring device is certified and registered by the FieldComm Group. The measuring system meets all the requirements of the following specifications:</li> <li>Certified in accordance with FOUNDATION Fieldbus H1</li> </ul>
	<ul> <li>Certified in accordance with FOONDATION Fieldbus FT</li> <li>Interoperability Test Kit (ITK), revision version 6.2.0 (certificate available on request)</li> <li>Physical Layer Conformance Test</li> <li>The device can also be operated with certified devices of other manufacturers (interoperability)</li> </ul>
Certification PROFIBUS	PROFIBUS interface
	The measuring device is certified and registered by the PNO (PROFIBUS Nutzerorganisation e.V./ PROFIBUS User Organization). The measuring system meets all the requirements of the following specifications: • Certified according to PA Profile 3.02
	• The device can also be operated with certified devices of other manufacturers (interoperability)
EtherNet/IP certification	<ul> <li>The measuring device is certified and registered by the ODVA (Open Device Vendor Association).</li> <li>The measuring system meets all the requirements of the following specifications:</li> <li>Certified in accordance with the ODVA Conformance Test</li> <li>EtherNet/IP Performance Test</li> <li>EtherNet/IP PlugFest compliance</li> </ul>
	<ul> <li>The device can also be operated with certified devices of other manufacturers (interoperability)</li> </ul>
Certification PROFINET	PROFINET interface
	<ul> <li>The measuring device is certified and registered by the PNO (PROFIBUS Nutzerorganisation e.V. / PROFIBUS User Organization). The measuring system meets all the requirements of the following specifications:</li> <li>Certified according to: <ul> <li>Test specification for PROFINET devices</li> <li>PROFINET Security Level 2 - Netload Class 2 0 Mbps</li> </ul> </li> <li>The device can also be operated with certified devices of other manufacturers (interoperability)</li> <li>The device supports PROFINET S2 system redundancy.</li> </ul>

Certification PROFINET with	PROFINET interface	
Ethernet-APL	<ul> <li>The measuring device is certified and registered by the PNO (PROFIBUS Nutzerorganisation e.V. / PROFIBUS User Organization). The measuring system meets all the requirements of the following specifications:</li> <li>Certified according to: <ul> <li>Test specification for PROFINET devices</li> <li>PROFINET PA Profile 4</li> <li>PROFINET Security Level 2- Netload Class 2 0 Mbps</li> <li>APL conformance test</li> </ul> </li> <li>The device can also be operated with certified devices of other manufacturers (interoperability)</li> <li>The device supports PROFINET S2 system redundancy.</li> </ul>	
Pressure Equipment Directive	The devices can be ordered with or without a PED or UKCA approval. If a device with a PED or UKCA approval is required, this must be explicitly stated in the order. For devices with nominal diameters less than or equal to DN 25 (1"), this is neither possible nor necessary. A UK Ex approval must be selected for UKCA.	
	<ul> <li>With the marking: <ul> <li>a) PED/G1/x (x = category) or</li> <li>b) UK/G1/x (x = category)</li> <li>on the sensor nameplate, Endress+Hauser confirms compliance with the "Essential Safety Requirements"</li> <li>a) specified in Annex I of the Pressure Equipment Directive 2014/68/EU or</li> <li>b) Schedule 2 of Statutory Instruments 2016 No. 1105.</li> </ul> </li> <li>Devices bearing this marking (PED or UKCA) are suitable for the following types of medium: <ul> <li>Media in Group 1 and 2 with a vapor pressure greater than, or smaller and equal to 0.5 bar (7.3 psi)</li> </ul> </li> </ul>	
	<ul> <li>Unstable gases</li> <li>Devices not bearing this marking (without PED or UKCA) are designed and manufactured according to sound engineering practice. They meet the requirements of <ul> <li>a) Art. 4 Para. 3 of the Pressure Equipment Directive 2014/68/EU or</li> <li>b) Part 1, Para. 8 of Statutory Instruments 2016 No. 1105.</li> </ul> </li> <li>The scope of application is indicated <ul> <li>a) in diagrams 6 to 9 in Annex II of the Pressure Equipment Directive 2014/68/EU or</li> <li>b) Schedule 3, Para. 2 of Statutory Instruments 2016 No. 1105.</li> </ul> </li> </ul>	
Radio approval	The measuring device has radio approval.	
Additional certification	CRN approval	
	Some device versions have CRN approval. A CRN-approved process connection with a CSA approval must be ordered for a CRN-approved device.	
	Tests and certificates	
	<ul> <li>EN10204-3.1 material certificate, wetted parts and sensor housing</li> <li>Pressure test, internal process, inspection certificate</li> <li>PMI test (XRF), internal procedure, wetted parts, test report</li> <li>Compliance with requirements derived from cGMP, Declaration</li> <li>EN10204-2.1 confirmation of compliance with the order and EN10204-2.2 test report</li> </ul>	
Other standards and guidelines	<ul> <li>EN 60529 Degrees of protection provided by enclosures (IP code) </li> <li>IEC/EN 60068-2-6 Environmental influences: Test procedure - Test Fc: vibrate (sinusoidal). </li> <li>IEC/EN 60068-2-31 Environmental influences: Test procedure - Test Ec: shocks due to rough handling, primarily for devices. </li> <li>EN 61010-1 Safety requirements for electrical equipment for measurement, control and laboratory use - general requirements</li></ul>	

- IEC/EN 61326-2-3
  - Emission in accordance with Class A requirements. Electromagnetic compatibility (EMC requirements).
- NAMUR NE 21
- Electromagnetic compatibility (EMC) of industrial process and laboratory control equipment NAMUR NE 32
- Data retention in the event of a power failure in field and control instruments with microprocessors
- NAMUR NE 43
- Standardization of the signal level for the breakdown information of digital transmitters with analog output signal.
- NAMUR NE 53
- Software of field devices and signal-processing devices with digital electronics NAMUR NE 80
- The application of the pressure equipment directive to process control devices NAMUR NE 105
- Specifications for integrating fieldbus devices in engineering tools for field devices NAMUR NE 107
- Self-monitoring and diagnosis of field devices
- NAMUR NE 131
- Requirements for field devices for standard applications
- NAMUR NE 132
  - Coriolis mass meter

# Ordering information

Detailed ordering information is available from your nearest sales organization www.addresses.endress.com or in the Product Configurator at www.endress.com:

- 1. Select the product using the filters and search field.
- 2. Open the product page.
- 3. Select **Configuration**.


### Product Configurator - the tool for individual product configuration

- Up-to-the-minute configuration data
- Depending on the device: Direct input of measuring point-specific information such as measuring range or operating language
- Automatic verification of exclusion criteria
- Automatic creation of the order code and its breakdown in PDF or Excel output format
- Ability to order directly in the Endress+Hauser Online Shop

# Application packages

Many different application packages are available to enhance the functionality of the device. Such packages might be needed to address safety aspects or specific application requirements.

The application packages can be ordered with the device or subsequently from Endress+Hauser. Detailed information on the order code in question is available from your local Endress+Hauser sales center or on the product page of the Endress+Hauser website: www.endress.com.



Detailed information on the application packages: Special Documentation for the device  $\rightarrow \square 121$ 

**Diagnostic functionality** Order code for "Application package", option EA "Extended HistoROM" Comprises extended functions concerning the event log and the activation of the measured value

memory. Event log: Memory volume is extended from 20 message entries (standard version) to up to 100 entries.

	<ul> <li>Data logging (line recorder):</li> <li>Memory capacity for up to 1000 measured values is activated.</li> <li>250 measured values can be output via each of the 4 memory channels. The recording interval can be defined and configured by the user.</li> <li>Measured value logs can be accessed via the local display or operating tool e.g. FieldCare, DeviceCare or Web server.</li> <li>For detailed information, see the Operating Instructions for the device.</li> </ul>
Heartbeat Technology	Order code for "Application package", option EB "Heartbeat Verification + Monitoring"
Heartbeat Technology	<ul> <li>Heartbeat Verification</li> <li>Meets the requirement for traceable verification to DIN ISO 9001:2008 Chapter 7.6 a) "Control of monitoring and measuring equipment".</li> <li>Functional testing in the installed state without interrupting the process.</li> <li>Traceable verification results on request, including a report.</li> <li>Simple testing process via local operation or other operating interfaces.</li> <li>Clear measuring point assessment (pass/fail) with high test coverage within the framework of manufacturer specifications.</li> <li>Extension of calibration intervals according to operator's risk assessment.</li> </ul>
	<ul> <li>Heartbeat Monitoring Continuously supplies data, which are characteristic of the measuring principle, to an external condition monitoring system for the purpose of preventive maintenance or process analysis. These data enable the operator to: <ul> <li>Draw conclusions - using these data and other information - about the impact the process influences (e.g. corrosion, abrasion, formation of buildup etc.) have on measuring performance over time.</li> <li>Schedule servicing in time.</li> <li>Monitor the process or product quality, e.g. gas pockets.</li> </ul> For detailed information, see the Special Documentation for the device.</li></ul>
Concentration measurement	Order code for "Application package", option ED "Concentration"
	Calculation and outputting of fluid concentrations.
	<ul> <li>The measured density is converted to the concentration of a substance of a binary mixture using the "Concentration" application package:</li> <li>Choice of predefined fluids (e.g. various sugar solutions, acids, alkalis, salts, ethanol etc.).</li> <li>Common or user-defined units ("Brix, "Plato, % mass, % volume, mol/l etc.) for standard applications.</li> <li>Concentration calculation from user-defined tables.</li> <li>For detailed information, see the Special Documentation for the device.</li> </ul>
	For detailed information, see the Special Documentation for the device.
Special density	Order code for "Application package", option EE "Special density"
	Many applications use density as a key measured value for monitoring quality or controlling processes. The device measures the density of the fluid as standard and makes this value available to the control system.
	The "Special Density" application package offers high-precision density measurement over a wide density and temperature range particularly for applications subject to varying process conditions.
	For detailed information, see the Operating Instructions for the device.
OPC-UA Server	Order code for "Application package", option EL "OPC-UA Server"
	The application package provides an integrated OPC-UA server for comprehensive device services for IoT and SCADA applications.
	For detailed information, see the Special Documentation for the device.

# Accessories

Various accessories, which can be ordered with the device or subsequently from Endress+Hauser, are available for the device. Detailed information on the order code in question is available from your local Endress+Hauser sales center or on the product page of the Endress+Hauser website: www.endress.com.

Accessories	Description
Transmitter • Proline 500 – digital • Proline 500	Transmitter for replacement or storage. Use the order code to define the following specifications: • Approvals • Output • Input • Display/operation • Housing • Software • Proline 500 - digital transmitter: Order number: 8X5BXX-*****A • Proline 500 transmitter:
	Order number: 8X5BXX-*****B Proline 500 transmitter for replacement: It is essential to specify the serial number of the current transmitter when ordering. On the basis of the serial number, the device-specific data (e.g. calibration factors) of the replaced device can be used for the new transmitter.
	<ul> <li>Proline 500 - digital transmitter: Installation Instructions EA01151D</li> <li>Proline 500 transmitter: Installation Instructions EA01152D</li> </ul>
External WLAN antenna	External WLAN antenna with 1.5 m (59.1 in) connecting cable and two angle brackets. Order code for "Accessory enclosed", option P8 "Wireless antenna wide area".
	<ul> <li>The external WLAN antenna is not suitable for use in hygienic applications.</li> <li>Additional information regarding the WLAN interface →</li></ul>
	Order number: 71351317
	Installation Instructions EA01238D
Pipe mounting set	Pipe mounting set for transmitter.
	Proline 500 – digital transmitter Order number: 71346427
	Installation Instructions EA01195D
	Proline 500 transmitter Order number: 71346428
Weather protection cover Transmitter • Proline 500 – digital • Proline 500	Is used to protect the measuring device from the effects of the weather: e.g. rainwater, excess heating from direct sunlight.   Proline 500 – digital transmitter Order number: 71343504 Proline 500 transmitter
	Order number: 71343505 Installation Instructions EA01191D
Display guard Proline 500 – digital	Is used to protect the display against impact or scoring, for example from sand in desert areas.
	Order number: 71228792
	Installation Instructions EA01093D

# Device-specific accessories Fo

Connecting cable Proline 500 – digital Sensor – Transmitter	The connecting cable can be ordered directly with the measuring device (order code for "Cable, sensor connection) or as an accessory (order number DK8012). The following cable lengths are available: order code for "Cable, sensor connection" • Option B: 20 m (65 ft) • Option E: User-configurable up to max. 50 m • Option F: User-configurable up to max. 165 ft Maximum possible cable length for a Proline 500 – digital connecting cable: 300 m (1000 ft)
Connecting cable Proline 500 Sensor – Transmitter	The connecting cable can be ordered directly with the measuring device (order code for "Cable, sensor connection") or as an accessory (order number DK8012). The following cable lengths are available: order code for "Cable, sensor connection" • Option 1: 5 m (16 ft) • Option 2: 10 m (32 ft) • Option 3: 20 m (65 ft) Possible cable length for a Proline 500 connecting cable: max. 20 m (65 ft)

## For the sensor

Accessories	Description		
Heating jacket	Is used to stabilize the temperature of the fluids in the sensor. Water, water vapor and other non-corrosive liquids are permitted for use as fluids.		
	If using oil as a heating medium, please consult with Endress+Hauser.		
	Use the order code with the product root DK8003.		
	Special Documentation SD02162D		

Communication-specific accessories	Accessories	Description
	Commubox FXA195 HART	For intrinsically safe HART communication with FieldCare via the USB interface.
	HART Loop Converter HMX50	Is used to evaluate and convert dynamic HART process variables to analog current signals or limit values.
	Fieldgate FXA42	Is used to transmit the measured values of connected 4 to 20 mA analog measuring devices, as well as digital measuring devices • Technical Information TI01297S • Operating Instructions BA01778S • Product page: www.endress.com/fxa42
	Field Xpert SMT50	The Field Xpert SMT70 tablet PC for device configuration enables mobile plant asset management in non-hazardous areas. It is suitable for commissioning and maintenance staff to manage field instruments with a digital communication interface and to record progress. This tablet PC is designed as an all-in-one solution with a preinstalled driver library and is an easy-to-use, touch-sensitive tool which can be used to manage field instruments throughout their entire life cycle.
		<ul> <li>Technical Information TI01342S</li> <li>Operating Instructions BA01709S</li> <li>Product page: www.endress.com/smt50</li> </ul>

(	
Field Xpert SMT70	<ul> <li>The Field Xpert SMT70 tablet PC for device configuration enables mobile plant asset management in hazardous and non-hazardous areas. It is suitable for commissioning and maintenance staff to manage field instruments with a digital communication interface and to record progress.</li> <li>This tablet PC is designed as an all-in-one solution with a preinstalled driver library and is an easy-to-use, touch-sensitive tool which can be used to manage field instruments throughout their entire life cycle.</li> </ul>
	<ul> <li>Technical Information TI01342S</li> <li>Operating Instructions BA01709S</li> <li>Product page: www.endress.com/smt70</li> </ul>
Field Xpert SMT77	The Field Xpert SMT77 tablet PC for device configuration enables mobile plant asset management in areas categorized as Ex Zone 1.
	<ul> <li>Technical Information TI01418S</li> <li>Operating Instructions BA01923S</li> <li>Product page: www.endress.com/smt77</li> </ul>

Service-specific accessories	Accessory	Description
	Applicator	<ul> <li>Software for selecting and sizing Endress+Hauser measuring devices:</li> <li>Choice of measuring devices with industrial requirements</li> <li>Calculation of all the necessary data for identifying the optimum flowmeter:</li> <li>e.g. nominal diameter, pressure loss, flow velocity and accuracy.</li> <li>Graphic illustration of the calculation results</li> <li>Determination of the partial order code, administration, documentation and access to all project-related data and parameters over the entire life cycle of a project.</li> </ul>
		<ul> <li>Applicator is available:</li> <li>Via the Internet: https://portal.endress.com/webapp/applicator</li> <li>As a downloadable DVD for local PC installation.</li> </ul>
	W@M	<ul> <li>W@M Life Cycle Management</li> <li>Improved productivity with information at your fingertips. Data relevant to a plant and its components is generated from the first stages of planning and during the asset's complete life cycle.</li> <li>W@M Life Cycle Management is an open and flexible information platform with online and on-site tools. Instant access for your staff to current, in-depth data shortens your plant's engineering time, speeds up procurement processes and increases plant uptime.</li> <li>Combined with the right services, W@M Life Cycle Management boosts productivity in every phase. For more information, see:</li> <li>www.endress.com/lifecyclemanagement</li> </ul>
	FieldCare	FDT-based plant asset management tool from Endress+Hauser. It can configure all smart field units in your system and helps you manage them. By using the status information, it is also a simple but effective way of checking their status and condition. Operating Instructions BA00027S and BA00059S
	DeviceCare	Tool for connecting and configuring Endress+Hauser field devices.

System components	Accessories	Description
	Memograph M graphic data manager	The Memograph M graphic data manager provides information on all the relevant measured variables. Measured values are recorded correctly, limit values are monitored and measuring points analyzed. The data are stored in the 256 MB internal memory and also on a SD card or USB stick.
		<ul> <li>Technical Information TI00133R</li> <li>Operating Instructions BA00247R</li> </ul>
	Cerabar M	The pressure transmitter for measuring the absolute and gauge pressure of gases, steam and liquids. It can be used to read in the operating pressure value.
		<ul> <li>Technical Information TI00426P and TI00436P</li> <li>Operating Instructions BA00200P and BA00382P</li> </ul>

Accessories	Description
Cerabar S	The pressure transmitter for measuring the absolute and gauge pressure of gases, steam and liquids. It can be used to read in the operating pressure value.
	<ul> <li>Technical Information TI00383P</li> <li>Operating Instructions BA00271P</li> </ul>
ITEMP	The temperature transmitters can be used in all applications and are suitable for the measurement of gases, steam and liquids. They can be used to read in the medium temperature.
	Fields of Activity'' document FA00006T

# Documentation

For an overview of the scope of the associated Technical Documentation, refer to the following: • Device Viewer (www.endress.com/deviceviewer): Enter serial number from nameplate.

Device viewer (www.endress.com/deviceviewer). Enter serial number from nameplate.
 Endress+Hauser Operations app: Enter serial number from nameplate or scan matrix code on nameplate.

### Standard documentation Brief

**Brief Operating Instructions** 

*Brief Operating Instructions for the sensor* 

Measuring device	Documentation code
Proline Promass S	KA01287D

## Brief Operating Instructions for the transmitter

	Documentation code							
Measuring device	HART	FOUNDATIO N Fieldbus	PROFIBUS PA	PROFIBUS DP	Modbus RS485	EtherNet/IP	PROFINET	PROFINET with Ethernet- APL
Proline 500 – digital	KA01315D	KA01233D	KA01392D	KA01390D	KA01319D	KA01346D	KA01351D	KA01521D
Proline 500	KA01314D	KA01291D	KA01391D	KA01389D	KA01318D	KA01347D	KA01350D	KA01520D

## **Operating Instructions**

Measuring device	Documentatio	Documentation code						
	HART	FOUNDATIO N Fieldbus	PROFIBUS PA	PROFIBUS DP	Modbus RS485	EtherNet/IP	PROFINET	PROFINET with Ethernet- APL
Promass S 500	BA01535D	BA01568D	BA01557D	BA01879D	BA01546D	BA01756D	BA01767D	BA02130D

# **Description of Device Parameters**

	Documentation code							
Measuring device	HART	FOUNDATIO N Fieldbus	PROFIBUS PA	PROFIBUS DP	Modbus RS485	EtherNet/IP	PROFINET	PROFINET with Ethernet- APL
Promass 500	GP01060D	GP01096D	GP01061D	GP01137D	GP01062D	GP01120D	GP01121D	GP01173D

## Supplementary devicedependent documentation

# Safety instructions

Safety instructions for electrical equipment for hazardous areas.

Contents	Documentation code
	Measuring device
ATEX/IECEx Ex i	XA01473D
ATEX/IECEx Ex ec	XA01474D
cCSAus IS	XA01475D
cCSAus Ex i	XA01509D
cCSAus Ex nA	XA01510D
INMETRO Ex i	XA01476D
INMETRO Ex ec	XA01477D
NEPSI Ex i	XA01478D
NEPSI Ex nA	XA01479D
NEPSI Ex i	XA01658D
NEPSI Ex nA	XA01659D
JPN	XA01780D

# Functional Safety Manual

Contents	Documentation code
Proline Promass 500	SD01729D

## Special Documentation

Contents	Documentation code
Information on the Pressure Equipment Directive	SD01614D
Radio approvals for WLAN interface for A309/A310 display module	SD01793D
OPC-UA server 1)	SD02040D

1) This Special Documentation is only available for device versions with a HART output.

Contents	Documentation code							
	HART	FOUNDATIO N Fieldbus	PROFIBUS PA	PROFIBUS DP	Modbus RS485	PROFINET	EtherNet/IP	PROFINET with Ethernet- APL
Web server	SD01666D	SD01669D	SD01668D	SD02232D	SD01667D	SD01971D	SD01970D	SD02769D
Heartbeat Technology	SD01643D	SD01608D	SD01705D	SD02203D	SD01704D	SD01989D	SD01983D	SD02732D
Concentration measurement	SD01645D	SD01709D	SD01711D	SD02213D	SD01710D	SD02007D	SD02006D	SD02736D
Gas Fraction Handler	SD02584D	-	-	-	SD02584D	SD02584D	-	SD02584D

## Installation Instructions

Contents	Comment
Installation instructions for spare part sets and accessories	Documentation code: specified for each individual accessory $\rightarrow \square$ 117.

# **Registered trademarks**

### HART®

Registered trademark of the FieldComm Group, Austin, Texas, USA

### **PROFIBUS®**

Registered trademark of the PROFIBUS Nutzerorganisation e.V. (PROFIBUS User Organization), Karlsruhe, Germany

### **FOUNDATION™** Fieldbus

Registration-pending trademark of the FieldComm Group, Austin, Texas, USA

### Modbus®

Registered trademark of SCHNEIDER AUTOMATION, INC.

### EtherNet/IP™

Trademark of ODVA, Inc.

### Ethernet-APL™

Registered trademark of the PROFIBUS Nutzerorganisation e.V. (PROFIBUS User Organization), Karlsruhe, Germany

### **PROFINET®**

Registered trademark of the PROFIBUS Nutzerorganisation e.V. (PROFIBUS User Organization), Karlsruhe, Germany

### TRI-CLAMP®

Registered trademark of Ladish & Co., Inc., Kenosha, USA



# www.addresses.endress.com

