

Technical Information Liquiphant FTL51B Density with Density Computer FML621

Vibronic



Density computer for liquids
Also for use in hazardous areas

Application

The density measuring line can be used in liquid media. It is used for the following purposes:

- Density measurement
- Intelligent medium detection
- Reference density calculation
- To calculate the concentration of a liquid
- To convert values to different units such as °Brix, °Baumé, °API etc.

Advantages

- Measurement used directly in tanks or pipes without the need for additional pipework
- Integration of existing temperature measurements for temperature compensation
- Additional calculations, such as the concentration of a product, can be performed in the Density Computer FML621.

Table of contents

About this document	4	Performance characteristics	28
Symbols	4	Reference operating conditions	28
Application	4	Performance characteristics	28
Density measurement	4	Mounting	29
Function and system design	7	Installation instructions for Liquiphant Density	29
Measuring principle	7	Density Computer FML621	33
System design	7	Environment	33
Specific density applications	7	Liquiphant Density	33
Measuring system	8	Density Computer FML621	34
Modularity	9	Process: Liquiphant Density	35
Electronic insert for density measurement	9	Process temperature range	35
Density Computer FML621	9	Thermal shock	35
Input of Liquiphant Density	9	Process pressure range	35
Measured variable	9	Pressure tightness	35
Measuring range	9	Solids contents	35
Output of Liquiphant Density	9	Mechanical construction: Liquiphant Density	35
Output and input variants	9	Design, dimensions	35
Ex connection data	10	Dimensions	36
Input of Density Computer FML621	10	Weight	44
Measured variable	10	Materials	44
Measuring range	10	Surface roughness	45
Galvanic isolation	12	Mechanical construction: Density Computer	
Output of Density Computer FML621	12	FML621	46
Output signal	12	Terminal	46
Galvanic isolation	12	Dimensions	46
Current output, pulse output	12	Slots with extension cards	46
Switch output	13	Weight	46
Transmitter power supply and external power supply	13	Materials	46
Power supply of Liquiphant Density	13	Operability: Density Computer FML621	47
Terminal assignment	13	Display elements	47
Supply voltage	14	Operating elements	48
Power consumption	14	Remote operation	48
Current consumption	14	Real-time clock	48
Overvoltage protection	14	Certificates and approvals	48
Pulse signal in case of alarm	14	CE mark	48
Adjustment	14	Ex approval	48
Power supply of Density Computer FML621	15	Other standards and guidelines	48
Density Computer terminal assignment	15	Ordering information	48
Supply voltage	17	TAG	48
Power consumption	17	Test reports, declarations and inspection certificates	49
Power supply connection	17	Accessories for Liquiphant Density	49
Interface connection data	18	Device Viewer	49
Slots, extension cards	19	Weather protection cover for dual compartment housing, aluminum	49
Endress+Hauser-specific devices	19	Weather protection cover for single compartment housing, aluminum or 316L, cast	49
Connection of outputs	21	M12 socket	50
Ethernet option	21		
Extension cards (optional)	22		
Connecting the remote display and operating unit	27		

Sliding sleeves for unpressurized operation 50

High pressure sliding sleeves 51

Accessories for Density Computer FML621 52

Device Viewer 52

General 52

Extension cards 52

PROFINET® Interface 53

Supplementary documentation 53

Standard documentation 53

Supplementary device-dependent documentation 53

About this document

Symbols

Safety symbols



This symbol alerts you to a dangerous situation. Failure to avoid this situation will result in serious or fatal injury.



This symbol alerts you to a dangerous situation. Failure to avoid this situation can result in serious or fatal injury.




This symbol alerts you to a dangerous situation. Failure to avoid this situation can result in minor or medium injury.



This symbol contains information on procedures and other facts which do not result in personal injury.

Electrical symbols




Grounded clamp, which is grounded via a grounding system.



Ground terminals, which must be grounded prior to establishing any other connections. The ground terminals are located on the inside and outside of the device.

Tool symbols



Symbols for certain types of information



Procedures, processes or actions that are permitted.



Procedures, processes or actions that are forbidden.



Indicates additional information



Reference to another section



Symbols in graphics

A, B, C ... View

1, 2, 3 ... Item numbers



Safe area (non-hazardous area)

Application

Density measurement

The Liquiphant Density measures the density of a liquid medium in pipes and tanks. The device is suitable for all Newtonian - ideal viscous - fluids. The device is also suitable for use in hazardous areas.



- 1 *Liquiphant Density → Pulse output*
- 2 *Temperature sensor - e.g. 4 to 20 mA output*
- 3 *Pressure transmitter 4 to 20 mA output required for pressure changes >6 bar*
- 4 *Liquiphant Density Computer FML621 with display and operating unit*
- 5 *PLC*

- Air bubbles at the sensor
- Unit not fully covered by medium
- Solid media buildup on sensor
- High flow velocity in pipes
- Severe turbulence in the pipe due to inlet and outlet runs that are too short
- Corrosion of the fork
- Non-Newtonian - non-ideal viscous - behavior of the fluids

1 density measuring line, pressure and temperature-compensated

- 2 density measuring lines, temperature-compensated

- 2 Liquiphant with FEL60D
- 2 temperature transmitters 4 to 20 mA
- 1 output: density 4 to 20 mA
- 1 output: temperature 4 to 20 mA

- **Product structure:** FML621-xxxAAxxxx
- **Number of inputs:** 4x pulse input, 0 to 20 mA or 4 to 20 mA
- **Number of outputs:** 1x SPST relay, 2x 0 to 20 mA or 4 to 20 mA

Application examples: basic unit + 2 extension cards

3 density measuring lines, 2 x temperature-compensated, 1 x pressure- and temperature-compensated

- 3 Liquiphant with FEL60D
- 3 temperature transmitters 4 to 20 mA
- 1 pressure transmitter 4 to 20 mA
- 3 outputs: density 4 to 20 mA
- 3 outputs: temperature 4 to 20 mA
- 1 relay for medium detection
- **Product structure:** FML621-xxxBBxxxx
- **Number of inputs:** 8 x pulse input, 0 to 20 mA or 4 to 20 mA
- **Number of outputs:** 5 x SPST relay, 6x 0 to 20 mA or 4 to 20 mA

Application examples: medium detection

Distinguish between 2 media

- **Product structure:** FML621-xxxAAxxxx basic unit
- **Use of inputs:**
 - 1x FEL60D
 - 1x temperature 4 to 20 mA
- **Information content:**
 - 1 output: density 4 to 20 mA
 - 1 output: temperature 4 to 20 mA
 - 1 Relay



The medium detection can refer to concentrations or phase transitions

Distinguish between 3 media

- **Product structure:** FML621-xxxBAxxxx basic unit with additional relay card
- **Use of inputs:**
 - 1x FEL60D
 - 1x temperature 4 to 20 mA
- **Information content:**
 - 1 output: density 4 to 20 mA
 - 1 output: temperature 4 to 20 mA
 - 1 relay: display product 1
 - 1 relay: display product 2
 - 1 relay: display product 3



The relays can activate subsequent processes by triggering actuators.

Applications: density

Density measurement or concentration calculation with pump protection

- **Product structure:** FML621-xxxBAxxxx basic unit
- **Use of inputs:**
 - 1x FEL60D
 - 1x temperature 4 to 20 mA
- **Information content:**
 - 1 output: density 4 to 20 mA
 - 1 output: temperature 4 to 20 mA
 - 1 relay to switch off the pump




In addition to determining the density and concentration, pump protection can also be implemented by setting the appropriate switching frequency.

Function and system design

Measuring principle

A piezoelectric drive causes the tuning fork of the Liquiphant Density to vibrate at its resonance frequency. If the density of the liquid medium changes, the resonance frequency of the tuning fork also changes. The density of the medium has a direct impact on the resonance frequency of the tuning fork. As specific medium properties and mathematic relations are preprogrammed in the system, the Density Computer calculates the exact concentration of a medium.

System design

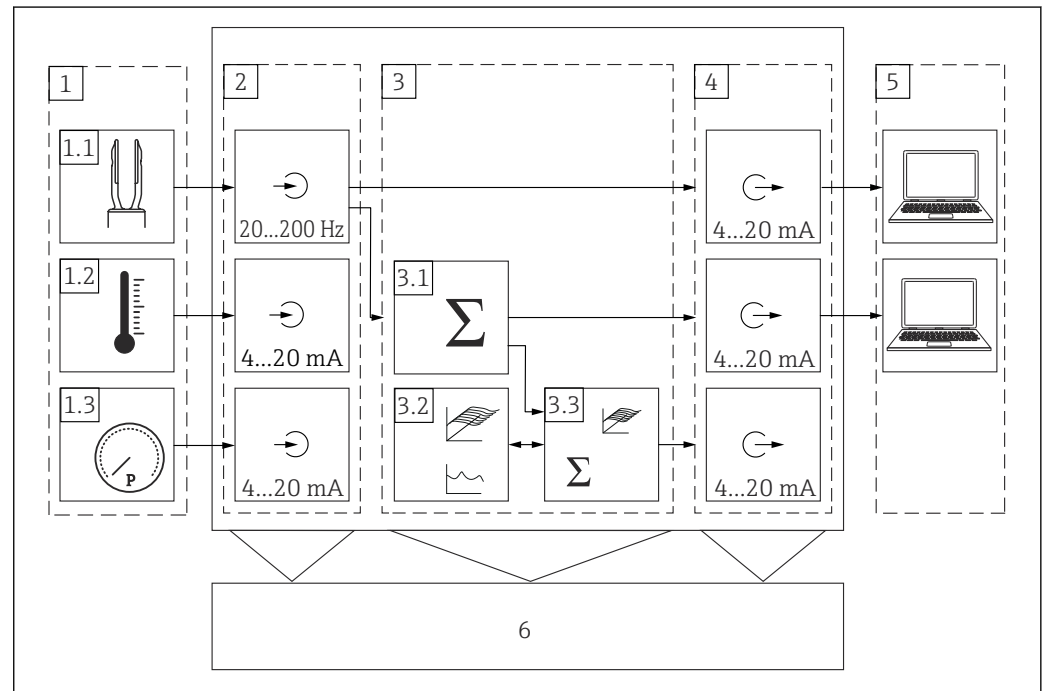

A0039647

2 Density Computer FML621 modular construction - diagram

- 1 External sensors
- 1.1 Liquiphant Density
- 1.2 Temperature sensor
- 1.3 Pressure sensor
- 2 Input modules, Density Computer FML621
- 3 Computing module, Density Computer FML621
- 3.1 Mathematic functions, e. g. density
- 3.2 2D, 3D curve
- 3.3 Mathematic functions, e. g. concentration, 3D linearization
- 4 Output modules, Density Computer FML621
- 5 Information processing - control room
- 6 Additional display

Specific density applications

The software modules available calculate the density from the frequency, temperature and pressure input variables.


Operating principle

The vibrating frequency of the tuning fork is reduced when the tuning fork is completely covered with liquid. Using additional information, such as temperature and pressure, it is possible to calculate the corresponding density of the medium. If the value by which the density has changed is known, the concentration of the medium can be determined using a function stored in the system. This value can be determined empirically or using existing tables, for example. The tables for converting density to concentration must be provided by the customer.

Additional software modules can calculate the density at reference temperature, compute the concentrations or detect media.

Reference density

In this module, the system is based on a reference temperature, such as 15 °C (59 °F) or 20 °C (68 °F). It must be known how the density of the medium changes at different temperatures.

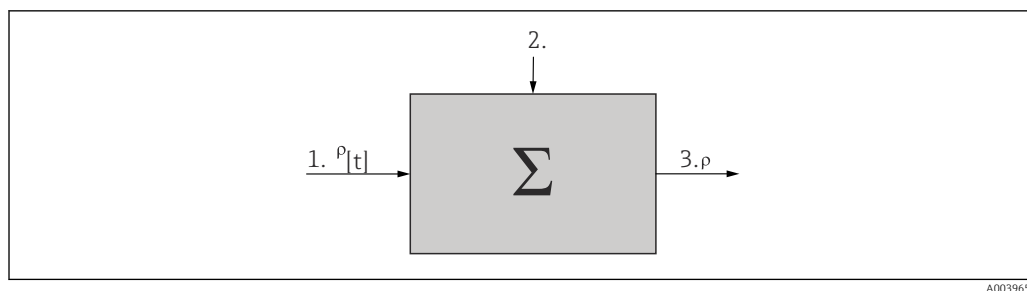


A0039650

- 1 Input data: Table ρ [t]
- 2 Measured liquid medium: Temperature and density
- 3 Output: Calculated density ρ [standard]

Concentration

Using density and concentration curves already available or determined empirically, it is possible to determine the concentration when substances are continuously dissolved in a medium.

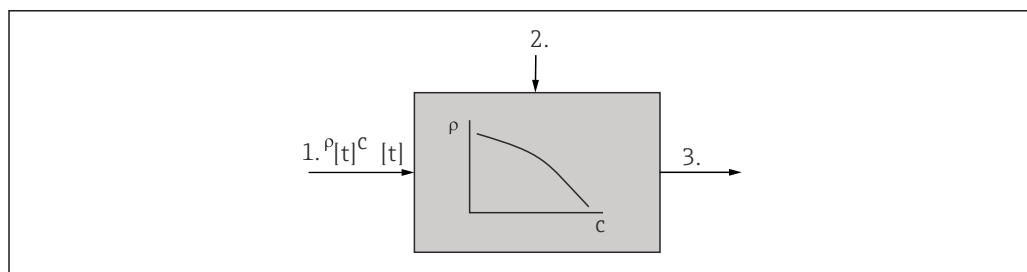


A0039651

- 1 Input data: Table ρ, c [t]
- 2 Measured liquid medium: Temperature and density
- 3 Output: Calculated concentration

Medium detection

To be able to distinguish between two media, the density function - as a function of the temperature - can be stored for several media. This allows the system to differentiate between two media.

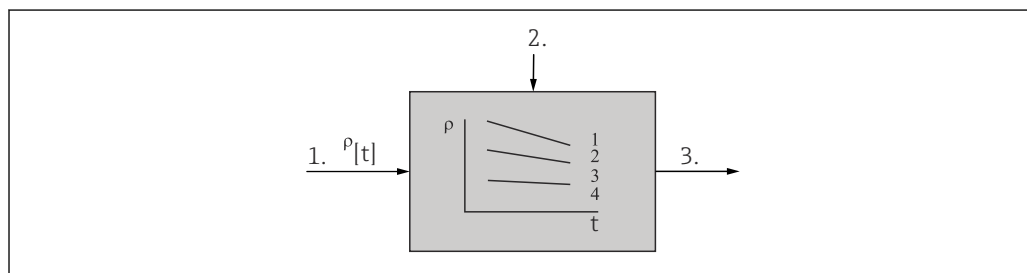

A0039652

- 1 Input data: Tables ρ [t] for two liquid media
- 2 Measured liquid medium: Temperature and density
- 3 Output: device relay output

Measuring system

The Density Computer FML621 supplies power directly to connected two-wire transmitters. Intrinsically safe inputs and transmitter power supply units for current cards are optionally available for applications in hazardous areas. The inputs, outputs, limit values and display as well as commissioning and maintenance of the device are performed via a dot-matrix display with eight soft keys and a backlight as well as an RS232 or RS485 interface or ReadWin® 2000 PC software. In addition, it is possible to extend the device using additional extension cards.

A change in the background color indicates alarms or limit value violations. It is possible to configure the background color.

To use the telealarm function, we recommend common industrial modems that have an RS232 interface. The measured values and events or alarms are encoded and transmitted in accordance with the serial protocol. It is possible to query the protocol type.



The number of inputs, outputs, relays and transmitter power supply units contained in the basic unit can be individually extended using a maximum of three plug-in cards.

Modularity

- Measuring density of a liquid medium
- Liquiphant with electronic insert FEL60D and Density Computer FML621
- Also for hazardous areas
- Up to 5 density measuring lines can be operated with the Density Computer FML621. All slots must be fitted with plug-in cards.

Density Computer FML621 - specification

- **Input**
 - FEL60D sensor
 - 0 to 20 mA or 4 to 20 mA analog inputs
 - 0 to 18 digital inputs
 - 4 to 10 pulse inputs
 - Temperature sensors (mA, mV, V, TC, RTD)
- **Output**
 - 2 to 8 Analog outputs 0 to 20 mA or 4 to 20 mA
 - 2 to 8 Pulse outputs - active or passive
 - 1 to 19 relays SPST, AC or DC
- **Communication**
 - Ethernet IP
 - PSTN or GSM modem
 - Serial bus RS232, RS485
 - PROFIBUS® via coupler
 - PROFINET® via coupler
 - ReadWin® 2000 PC software
- **Power supply mode**
 - 4 - 10 devices, max. current consumption 30 mA
 - 1 device, max. current consumption 80 mA
- **Internal memory**
 - 512 kB
- **Calculating functions**
 - Pre-defined or editable

Electronic insert for density measurement

Electronic insert FEL60D

Density Computer FML621

Two-wire pulse output: Current pulses, superimposed on the power supply along the two-wire cabling

Input of Liquiphant Density

Measured variable

Density of liquids

Measuring range

Density range: 0.3 to 2 g/cm³ (0.3 to 2 SGU)

Output of Liquiphant Density

Output and input variants

2-wire density (FEL60D) for density measurement
Connection to Density Computer FML621



For additional information, see the Technical Information.

Ex connection data

See safety instructions (XA): All data relating to explosion protection are provided in separate Ex documentation and are available from the Downloads Area of the Endress+Hauser-website. The Ex documentation is supplied as standard with all Ex devices.

Input of Density Computer FML621

Measured variable

- Voltage (analog and digital input)
- Current (analog input)
- PFM
- Pulse input

The following measured variables are implemented as an analog signal or pulse signal:

- Flow
- Level
- Pressure
- Temperature
- Density



Only Endress+Hauser flow sensors can be connected to the PFM input.

Not suitable for level and pressure measuring instruments.

Measuring range**Current input**

- 0 to 20 mA or 4 to 20 mA +10 % overrange
- Max. input current: 150 mA
- Input impedance: <10 Ω
- Accuracy 0.1 % of full scale value
- Temperature drift: 0.04 % / K (0.022 % / °F)
- Signal damping first-order low-pass filter, adjustable filter constants 0 to 99 s
- Resolution: 13 bit

Current input (U-I-TC card with intrinsically safe inputs)

- 0 to 20 mA or 4 to 20 mA +10 % overrange
- Max. input current: 80 mA
- Input impedance: =10 Ω
- Accuracy: 0.1 % of full scale value
- Temperature drift: 0.01 % / K 0.01 % / K (0.0056 % / °F)

PFM/pulse input

- Frequency range: 0.01 to 18 kHz
- Signal level - with approx. 1.3 kΩ series resistor at max. 24 V voltage level:
 - Low: 2 to 7 mA
 - High: 13 to 19 mA
- Measurement method: Period length or frequency measurement
- Accuracy: 0.01 % of reading
- Temperature drift: 0.01 % Over entire temperature range

Voltage input (digital input)

- Voltage level:
 - Low: -3 to 5 V
 - High: 12 to 30 V (as per IEC 61131-2)
- Input current typically: 3 mA with overload and reverse polarity protection
- Sampling frequency:
 - 4x4 Hz
 - 2x 20 kHz or 2x 4 Hz

Voltage input (analog input)

- Voltage: 0 to 10 V, 0 to 5 V, ±10 V, inaccuracy ±0.1 % of measuring range, input impedance >400 kΩ
- Voltage: 0 to 100 mV, 0 to 1 V, ±1 V, ±100 mV, inaccuracy ±0.1 % of measuring range, input impedance >1 MΩ
- Temperature drift: 0.01 % / K (0.0056 % / °F)

Resistance thermometer Pt100 as per ITS 90

- Measuring range: -200 to 800 °C (-328 to 1472 °F)
- Accuracy: 4-wire connection 0.03 % of full scale value
- Type of connection: 3-wire or 4-wire system

- Measuring current: 500 μ A
- Resolution: 16 bit
- Temperature drift: 0.01 % / K (0.0056 % / °F)

Resistance thermometer Pt500 as per ITS 90

- Measuring range: -200 to 250 °C (-328 to 482 °F)
- Accuracy: 4-wire connection 0.1 % of full scale value
- Type of connection: 3-wire or 4-wire system
- Measuring current: 500 μ A
- Resolution: 16 bit
- Temperature drift: 0.01 % / K (0.0056 % / °F)

Resistance thermometer Pt1000 as per ITS 90

- Measuring range: -200 to 250 °C (-328 to 482 °F)
- Accuracy: 4-wire connection 0.08 % of full scale value
- Type of connection: 3-wire or 4-wire system
- Measuring current: 500 μ A
- Resolution: 16 bit
- Temperature drift: 0.01 % / K (0.0056 % / °F)

Thermocouples (TC)

- J (Fe-CuNi), IEC 584
 - Measuring range: -210 to 999.9 °C (-346 to 1832 °F)
 - Accuracy: \pm (0.15 % of measuring range +0.5 K) from -100 °C
 \pm (0.15 % of measuring range +0.9 °F) from -148 °F
- K (NiCr-Ni), IEC 584
 - Measuring range: -200 to 1372 °C (-328 to 2502 °F)
 - Accuracy: \pm (0.15 % of measuring range +0.5 K) from -130 °C
 \pm (0.15 % of measuring range +0.9 °F) from -202 °F
- T (Cu-CuNi), IEC 584
 - Measuring range: -270 to 400 °C (-454 to 752 °F)
 - Accuracy: \pm (0.15 % of measuring range +0.5 K) from -200 °C
 \pm (0.15 % of measuring range +0.9 °F) from -382 °F
- N (NiCrSi-NiSi), IEC 584
 - Measuring range: -270 to 1300 °C (-454 to 1386 °F)
 - Accuracy: \pm (0.15 % of measuring range +0.5 K) from -100 °C
 \pm (0.15 % of measuring range +0.9 °F) from -148 °F
- B (Pt30Rh-Pt6Rh), IEC 584
 - Measuring range: 0 to 1820 °C (32 to 3308 °F)
 - Accuracy: \pm (0.15 % of measuring range +1.5 K) from 600 °C
 \pm (0.15 % of measuring range +2.7 °F) from 1112 °F
- D (W3Re/W25Re), ASTM E 998
 - Measuring range: 0 to 2315 °C (32 to 4199 °F)
 - Accuracy: \pm (0.15 % of measuring range +1.5 K) from 500 °C
 \pm (0.15 % of measuring range +2.7 °F) from 932 °F
- C (W5Re/W26Re), ASTM E 998
 - Measuring range: 0 to 2315 °C (32 to 4199 °F)
 - Accuracy: \pm (0.15 % of measuring range +1.5 K) from 500 °C
 \pm (0.15 % of measuring range +2.7 °F) from 932 °F
- L (Fe-CuNi), DIN 43710, GOST
 - Measuring range: -200 to 900 °C (-328 to 1652 °F)
 - Accuracy: \pm (0.15 % of measuring range +0.5 K) from -100 °C
 \pm (0.15 % of measuring range +0.9 °F) from -148 °F

- U (Cu-CuNi), DIN 43710
 - Measuring range: -200 to 600 °C (-328 to 1112 °F)
 - Accuracy: \pm (0.15 % of measuring range +0.5 K) from -100 °C
 \pm (0.15 % of measuring range +0.9 °F) from -148 °F
- S (Pt10Rh-Pt), IEC 584
 - Measuring range: 0 to 1768 °C (32 to 3214 °F)
 - Accuracy: \pm (0.15 % of measuring range +3.5 K) for 0 to 100 °C
 \pm (0.15 % of measuring range +1.5 K) from 100 to 1768 °C
 \pm (0.15 % of measuring range +6.3 °F) for 0 to 212 °F
 \pm (0.15 % of measuring range +2.7 °F) for 212 to 2314 °F
- R (Pt13Rh-Pt), IEC 584
 - Measuring range: -50 to 1768 °C (-58 to 3214 °F)
 - Accuracy: \pm (0.15 % of measuring range +3.5 K) for 0 to 100 °C
 \pm (0.15 % of measuring range +1.5 K) from 100 to 1768 °C
 \pm (0.15 % of measuring range +6.3 °F) for 0 to 212 °F
 \pm (0.15 % of measuring range +2.7 °F) for 212 to 2314 °F

Galvanic isolation

The inputs between the individual extension cards and the basic unit are galvanically isolated (\rightarrow 12).



With digital inputs, all terminal blocks are galvanically isolated from one another.

Output of Density Computer FML621

Output signal

Current, pulse, transmitter power supply (MUS) and switching output

Galvanic isolation

- The signal inputs and outputs are galvanically isolated from the supply voltage.
Testing voltage: 2.3 kV
- All signal inputs and outputs are galvanically isolated from one another.
Testing voltage: 500 V



The specified insulation voltage is the AC testing voltage U_{eff} , which is applied between the connections. Basis for assessment: IEC 61010-1, protection class II, overvoltage category II.

Current output, pulse output

Current output

- 0 to 20 mA or 4 to 20 mA +10 % overrange, reversible
- Max. loop current: 22 mA- short-circuit current
- Max. load: 750 Ω at 20 mA
- Accuracy: 0.1 % of full scale value
- Temperature drift: 0.1 % /10 K (0.056 % / 10 °F) ambient temperature
- Output ripple: <10 mV at 500 Ω for frequencies <50 kHz
- Resolution: 13 bit
- Error signals: 3.6 mA or 21 mA limit value in accordance NAMUR NE 43 - adjustable

Pulse output

- Basic unit:
 - Frequency range: up to 12.5 kHz
 - Voltage level: 0 to 1 V low, 12 to 28 V high
 - Min. load: 1 k Ω
 - Pulse width: 0.04 to 1000 ms
- Extension cards - digital passive, open collector:
 - Frequency range: up to 12.5 kHz
 - I_{max} = 200 mA
 - U_{max} = 24 V \pm 15 %
 - $U_{\text{low/max}}$ = 1.3 V at 200 mA
 - Pulse width: 0.04 to 1000 ms

Number of outputs

- 2x 0 to 20 mA or 4 to 20 mA / pulse - in basic unit
- Ethernet option: No current output present in the basic unit
- Max. number:
 - 8x 0 to 20 mA or 4 to 20 mA / pulse - depends on the number of extension cards
 - 6 x digital passive - depends on the number of extension cards

Signal sources

All existing multifunctional inputs and results of mathematic calculations can be freely assigned to the outputs.

Switch output

Function

Limit relay switches in the operating modes: Minimum or maximum safety, gradient, alarm, frequency or pulse, device error.

Switching behavior

Binary, switches when the limit value is reached - potential-free NO contact.

Switching capacity

Max. 250 V_{AC} 3 A / 30 V_{DC} 3 A



Do not combine line voltage and protective extra low voltage for extension card relays.

Switching frequency

Maximum 5 Hz

Threshold

User-programmable

Hysteresis

0 to 99 %

Sig. Source

All available inputs and calculated variables can be allocated freely to the switching outputs.

Number of switching cycles

> 100,000

Scan rate

500 ms

Number

- 1 relay - in the basic unit
- Max. number: 19 relays - depends on the number and type of extension cards

Transmitter power supply and external power supply

Transmitter power supply, terminals 81/82 or 81/83 - optional power extension cards 181/182 or 181/183

- Max. output voltage: 24 V_{DC} ±15 %
- Impedance: <345 Ω
- Max. loop current: 22 mA (at U_{out} >16 V)

FML621 technical data:

- HART® communication is not impaired
- Number: 3 MUS in the basic unit
- Max. number: 10 - depends on the number and type of extension cards

Additional power supply terminals 91/92, e.g. external display:

- Supply voltage: 24 V_{DC} ±5 %
- Max. current: 80 mA, short-circuit proof
- Number: 1
- Source resistance: <10 Ω

Power supply of Liquiphant Density

NOTICE


Operation with other switching units is not permitted.

Destruction of electronic components.

- ▶ Do not install the FEL60D electronic insert in devices that were originally used as point level switches.

Terminal assignment

The output signal of the density sensor is based on pulse technology. With the aid of this signal, the fork frequency is continuously forwarded to the Density Computer FML621.

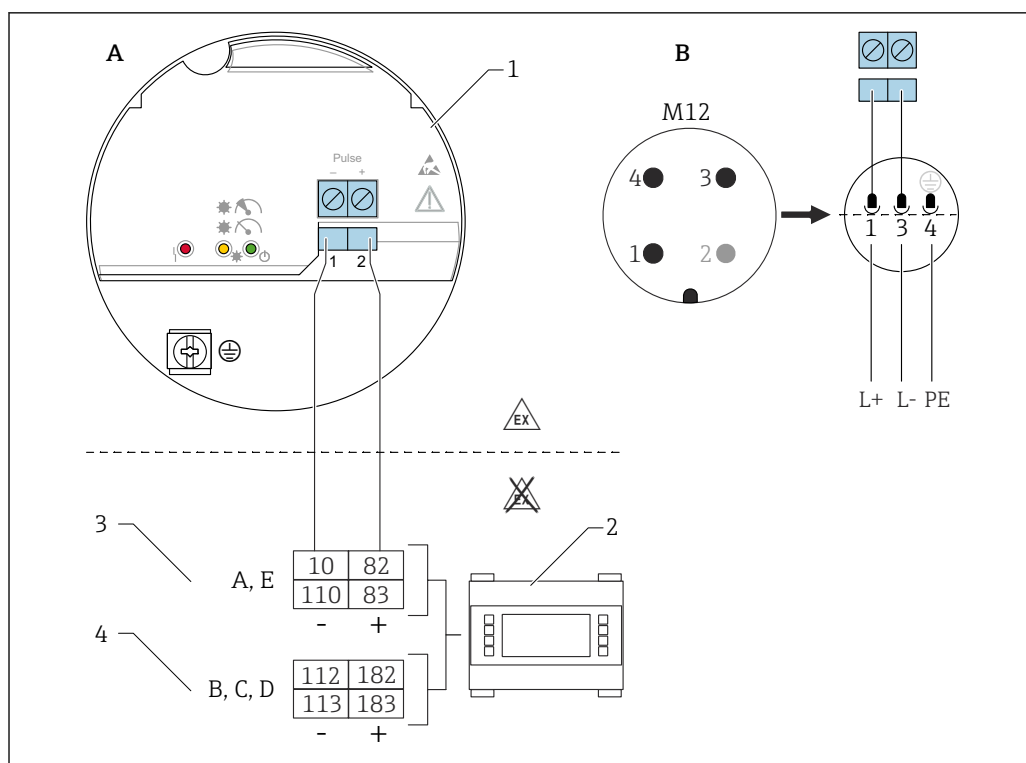

A0036059

3 Connection diagram: Connecting the FEL60D electronic insert to the Density Computer FML621

- A Connection wiring with terminals
 B Connection wiring with M12 plug in housing according to EN61131-2 standard
 1 Electronic insert FEL60D
 2 Density Computer FML621
 3 Slots A, E with extension cards (already included in the basic unit)
 4 Slots B, C, D with extension cards (optional)

Supply voltage $U = 24 V_{DC} \pm 15 \%$, only suitable for connecting to the Density Computer FML621

Power consumption $P < 160 \text{ mW}$

Current consumption $I < 10 \text{ mA}$

Overvoltage protection Overvoltage category II

Pulse signal in case of alarm Output signal in case of power failure and damaged sensor: 0 Hz.

Adjustment

There are 3 different types of adjustment:

- **Standard adjustment (order configuration):**
Two fork parameters are determined at the factory to describe the sensor characteristics and are provided in the calibration report with the product. These parameters must be transmitted to the Density Computer FML621.
- **Special adjustment (select in the Product Configurator):**
Three fork parameters are determined at the factory to describe the sensor characteristics and are provided in the calibration report with the product. These parameters must be transmitted to the Density Computer FML621.
This type of adjustment achieves an even higher level of accuracy.
- **Field adjustment:**
With a field adjustment, the density determined by the user is transmitted to the FML621.


i All the necessary parameters of the Liquiphant Density are documented in the **adjustment report** and in the **sensor pass**.

The documents are included in the scope of delivery.

📖 Further information and the documentation currently available can be found on the Endress+Hauser website: www.endress.com → Downloads.

Power supply of Density Computer FML621


Density Computer terminal assignment

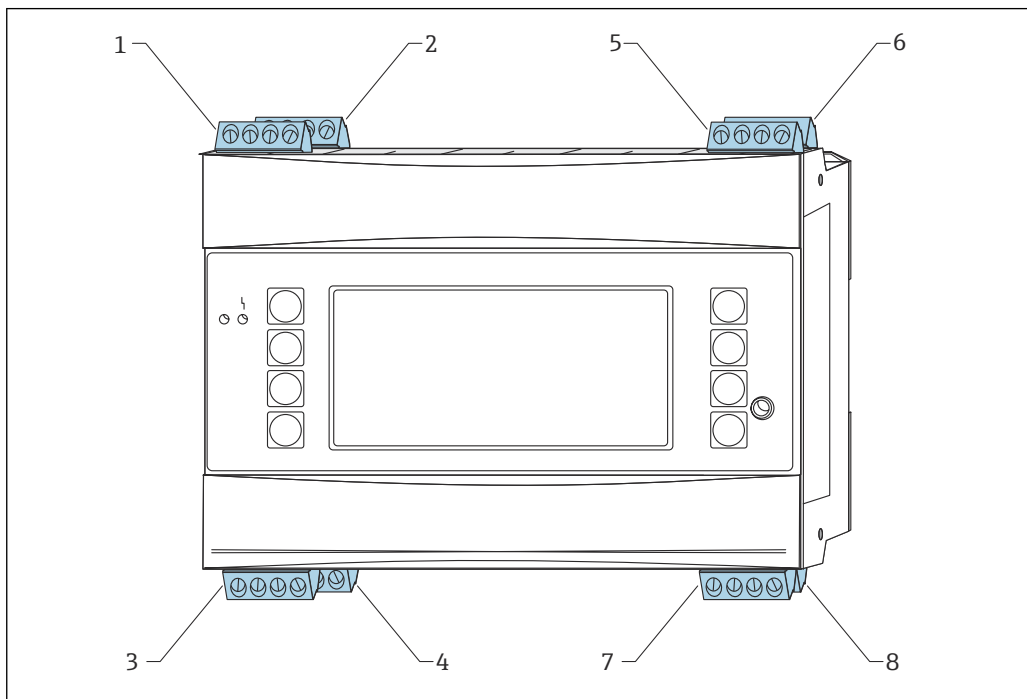

A0039654

4 Slot coding of basic unit

- 1 Slot A I - input
- 2 Slot A II - input
- 3 Slot A III - output
- 4 Slot A IV - output
- 5 Slot E I - input
- 6 Slot E II - input
- 7 Slot E III - output
- 8 Slot E IV - output

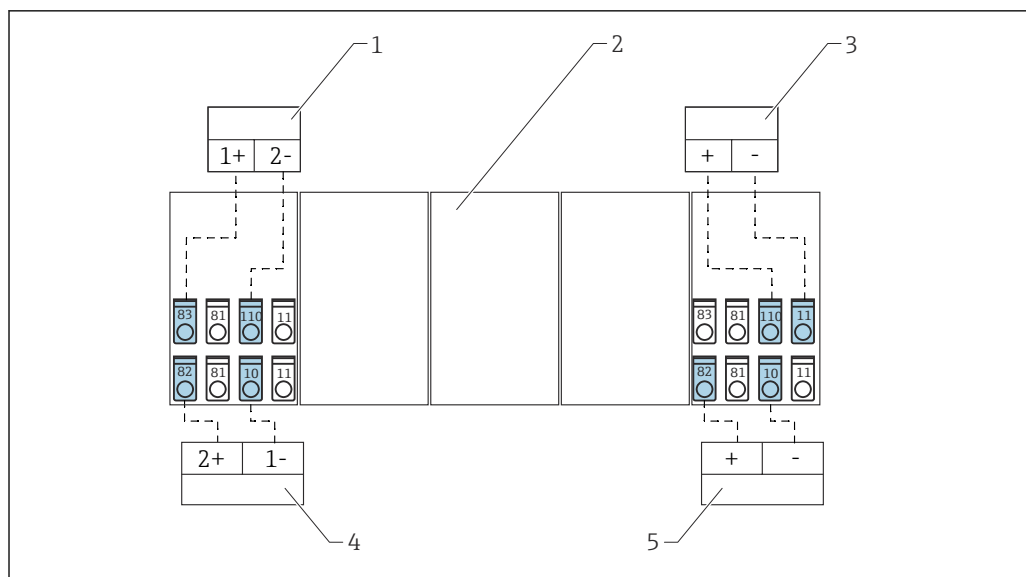


A0039655

5 Overview of connections - inputs

- 1 Passive sensor, e.g. pressure measurement
- 2 Slot for additional extension card
- 3 Active sensor
- 4 Passive sensor, e.g. density measurement
- 5 Passive sensor, e.g. temperature transmitter passive

i Active sensor: passing on temperature information from a PLC can be taken as an example for connecting an active sensor.

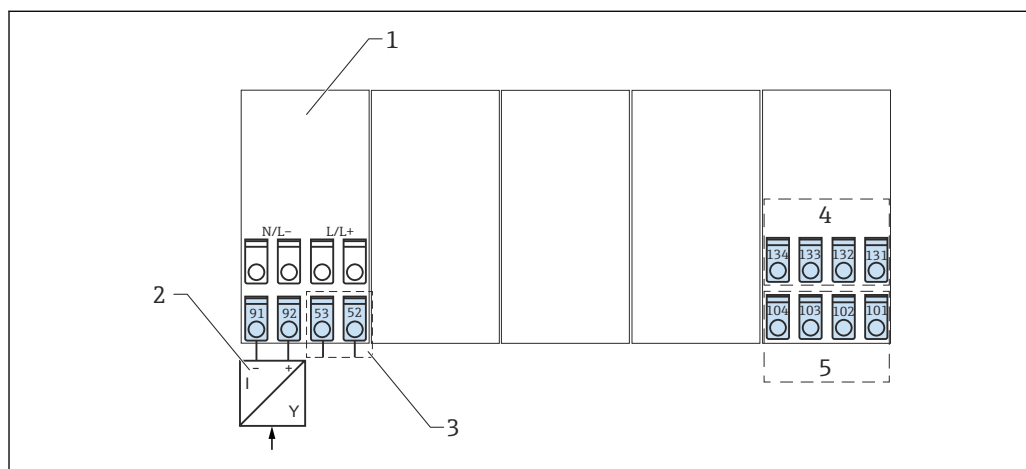

A0039656

6 Connection overview - outputs

- 1 Extension card
- 2 Power supply for sensors
- 3 Relay contact
- 4 Pulse and current outputs - active
- 5 Bus interfaces

i With the Ethernet option, there is no current output or pulse output available at slot E.

Slot A I

Input: current or PFM or pulse input 1

- Terminal 10: (+)0 to 20 mA or 4 to 20 mA, PFM, pulse input 1
- Terminal 11: ground for 0 to 20 mA or 4 to 20 mA, PFM, pulse input
- Terminal 81: ground, sensor power supply 1
- Terminal 82: 24 V sensor power supply 1

Slot A II

Input: current or PFM or pulse input 2

- Terminal 110: (+) 0 to 20 mA or 4 to 20 mA, PFM, pulse input 2
- Terminal 11: ground for 0 to 20 mA or 4 to 20 mA, PFM, pulse input
- Terminal 81: ground, sensor power supply 2
- Terminal 83: 24 V sensor power supply 2

Slot A III

Output: relay or additional sensor power supply

- Terminal 52: common relay (COM)
- Terminal 53: NO contact relay (NO)
- Terminal 91: ground, sensor power supply
- Terminal 93: +24 V sensor power supply

Slot A IV

Output: power supply

- Terminal L/L+: **L** for AC, **L+** for DC
- Terminal N/L-: **N** for AC, **L-** for DC

Slot E I

Input: current or PFM or pulse input 1

- Terminal 10: (+) 0 to 20 mA or 4 to 20 mA, PFM, pulse input 3
- Terminal 11: ground for 0 to 20 mA or 4 to 20 mA, PFM, pulse input
- Terminal 81: ground, sensor power supply 3
- Terminal 82: 24 V sensor power supply 3

Slot E II

Input: current or PFM or pulse input 2

- Terminal 110: (+) 0 to 20 mA or 4 to 20 mA, PFM, pulse input 4
- Terminal 11: ground for 0 to 20 mA or 4 to 20 mA, PFM, pulse input
- Terminal 81: ground, sensor power supply 4
- Terminal 83: 24 V sensor power supply 4

Slot E III

Output: RS485

- Terminal 101: (-) RxTx 1
- Terminal 102: (+) RxTx 1

Slot E III

Output: RS485 (optional)

- Terminal 103: (-) RxTx 2
- Terminal 104: (+) RxTx 2

Slot E IV

Output: current/pulse output 1


- Terminal 131: (-) 0/4 to 20 mA/pulse output 1
- Terminal 132: (+) 0/4 to 20 mA/pulse output 1

Slot E IV

 Ethernet, if the Ethernet option has been ordered.

Output: current/pulse output 2

- Terminal 133: (-) 0/4 to 20 mA/pulse output 2
- Terminal 134: (+) 0/4 to 20 mA/pulse output 2

 The inputs in the same slot are not galvanically isolated. There is a separation voltage of 500 V between the inputs and outputs in different slots. Terminals with the same second digit are jumpered internally, e.g. the terminals 11 and 81.

Supply voltage

- Low voltage power supply unit: 90 to 230 V_{AC} 50 to 60 Hz
- Extra-low voltage power supply unit: 20 to 36 V_{DC} or 20 to 28 V_{AC} 50 to 60 Hz

Power consumption

8 to 38 VA - depending on version and wiring.

Power supply connection

NOTICE

Destruction of electronic components.

- Check whether the supply voltage matches the voltage indicated on the nameplate of the device.

⚠ DANGER

Impermissible supply voltage

There is a high risk of physical injury and damage to the electronic components.


- For the device version with a supply voltage of 90 to 250 V, a switch must be installed in an easily accessible location. This switch is identified as a barrier in the power circuit of the device.


NOTICE

Insufficient protection of the device's power supply circuit.

Destruction of electronic components.

- Protect the power circuit with a 10-A fuse if the device is supplied with 90 to 250 V.

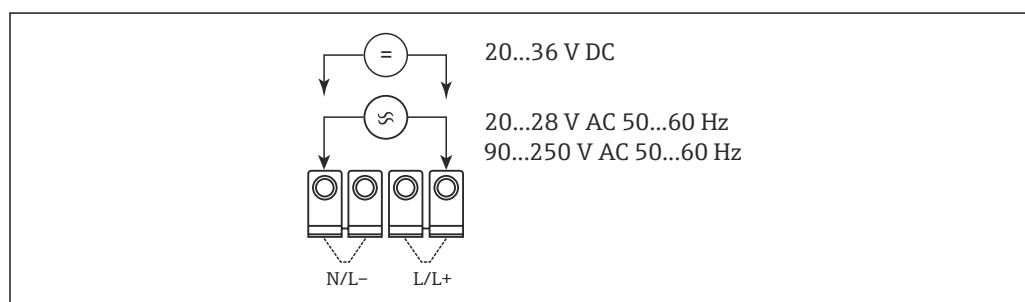

 7 Power supply connection

Interface connection data

RS232

The RS232 interface is connected via an interface cable and a jack socket on the front of the housing.


- Connection: jack socket 3.5 mm (0.14 in), front
- Transmission protocol: ReadWin® 2000
- Transmission rate: max. 57 600 baud

RS485

- Connection: plug-in terminals 101 and 102
- Transmission protocol:
 - Serial: ReadWin® 2000
 - Parallel: open standard
- Transmission rate: max. 57 600 baud

PROFIBUS®, PROFINET®

Optional connection of the Density Computer FML621 to PROFIBUS® or PROFINET® via the serial RS485 interface with the external HMS AnyBus protocol converter module for PROFIBUS® or PROFINET®


Suitable protocol converter available as an accessory,  see the "Accessories" section.

Optional: additional RS485 interface

- Connection: plug-in terminals 103 and 104
- Transmission protocol and transmission rate as standard interface RS485

Optional: Ethernet interface

- Ethernet interface: 10/100 BaseT
- Connection type: RJ45
- Connection via shielded cable
- IP address output via Setup menu in device
- Connection to devices via an interface is only possible in office environments
- Safety distances: office equipment standard IEC 60950-1 must be taken into consideration
- Connection to a PC is possible via a "crossover" cable

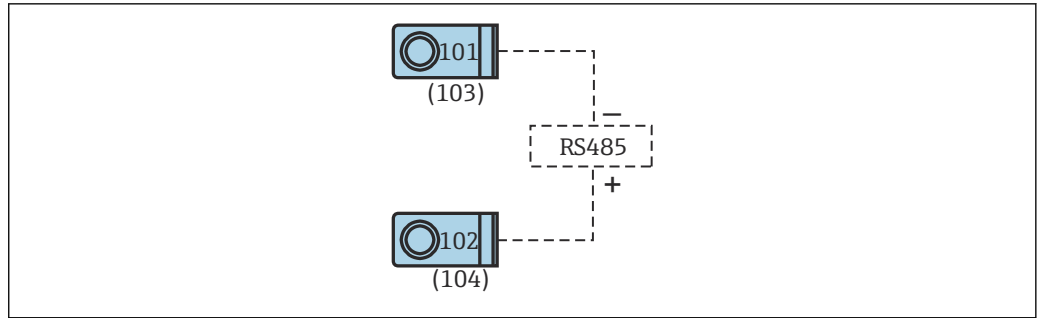

A0039688

8 Interface connection


Slots, extension cards

WARNING

The device is connected to the mains and is live.

Possibility of physical injury and destruction of electronic components.

- Ensure the device is in a de-energized state.
- Do not install or wire the device when it is connected to the mains voltage.

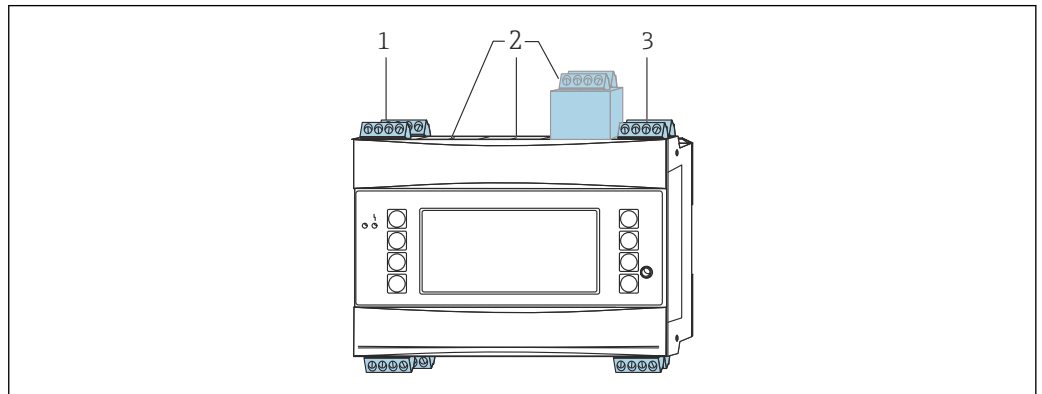

A0039653

9 Slots and extension cards in the Density Computer

- 1 Slot A, extension card already installed
- 2 Slots B, C, D can be extended with extension cards
- 3 Slot E, extension card already installed



The extension cards installed in slots A and E are an integral part of the basic unit.

Slots B, C and D can be extended with additional extension cards.

Slots - specification

- Slot A:
 - Input: 2x density sensors, 0 to 20 mA or 4 to 20 mA
 - Output: 2x 0 to 20 mA or 4 to 20 mA
- Slots B, C, D:
 - Input: max. 10 analog inputs or 18 digital inputs
 - Output: max. 8 analog outputs or 6 digital outputs or 19 SPST relays
- Slot E:
 - Input: 2x density sensors, 0 to 20 mA or 4 to 20 mA
 - Output: SPST relay

Endress+Hauser-specific devices




In the basic version of the Density Computer FML621, slots A and E are already fitted with extension cards.

Additionally, slots B, C and D can be fitted with extension cards.



The maximum cable length is 1 000 m (3 280.8 ft). The cable must be shielded to comply with EMC requirements. The maximum permitted power supply per core is 25 Ω.

Density sensor with a pulse output

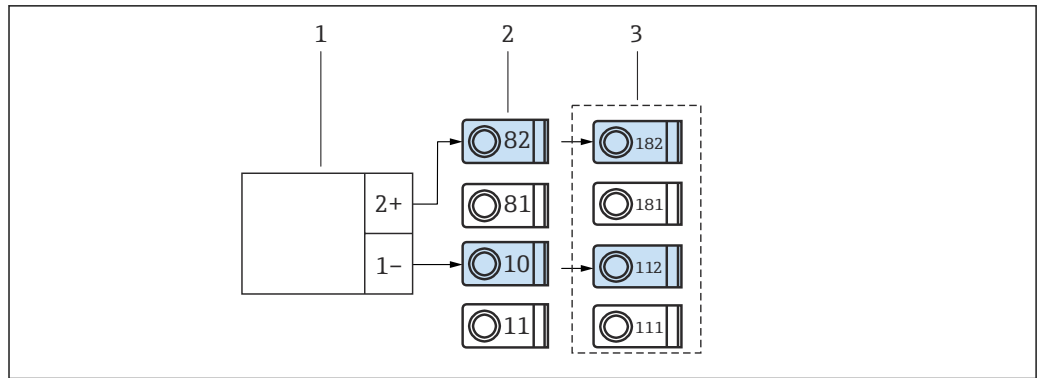


A0039671

10 Connecting the density sensor with pulse output

- 1 Density sensor
- 2 Slot A I
- 3 Additional slot B I

Temperature sensor via temperature head transmitter

i PT100, PT500 and PT1000 sensors can only be connected via an optional extension card (in slot B, C or D).

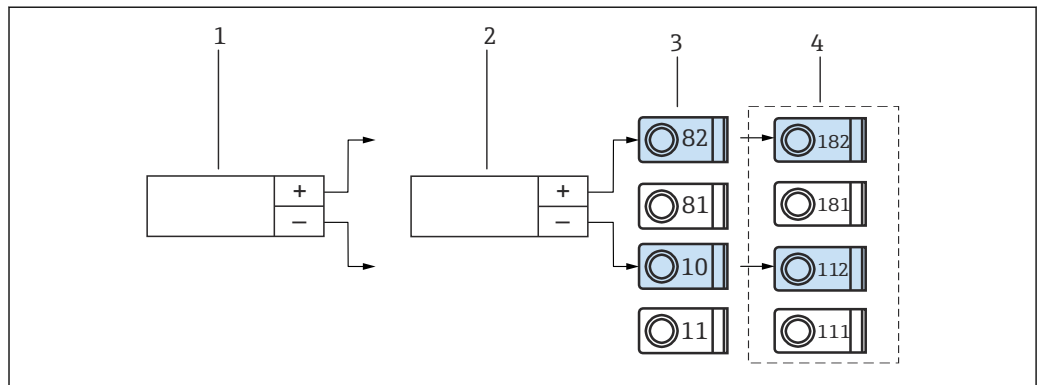


A0039673

11 Connecting the temperature sensor via the temperature head transmitter

- 1 Temperature transmitter 1
- 2 Temperature transmitter 2
- 3 Slot A I
- 4 Slot B I (optional extension card)

Pressure sensor with passive current output

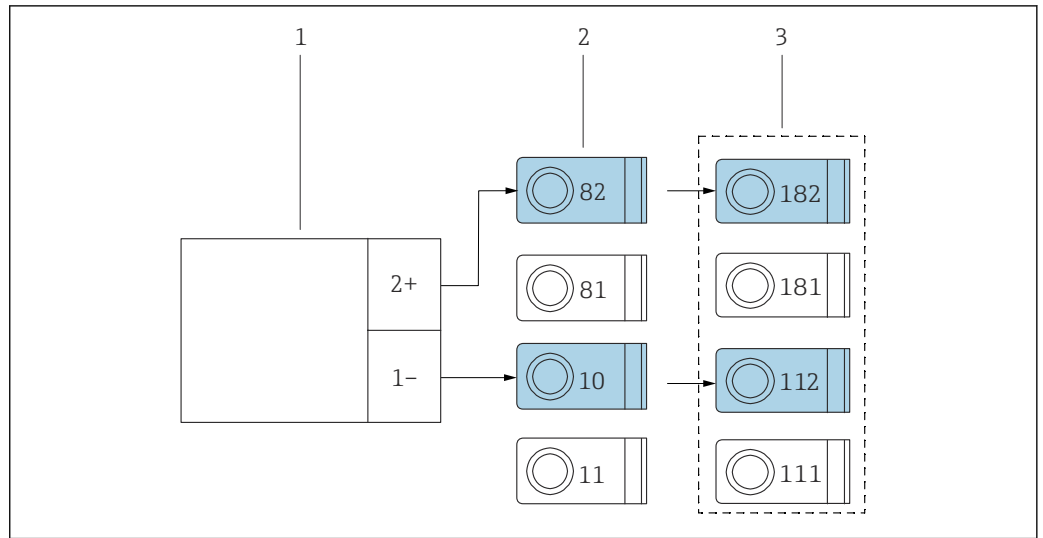


12 Connecting the pressure sensor with passive current output

- 1 Pressure transmitter
- 2 Slot A I
- 3 Slot B I (optional extension card)

Connection of outputs

The device has two galvanically isolated outputs or an Ethernet connection, which can be configured as an analog output or active pulse output. In addition, an output for connecting a relay and the option of transmitter power supply are available for each device. The number of outputs increases with the number of additionally installed extension cards (→ 22).

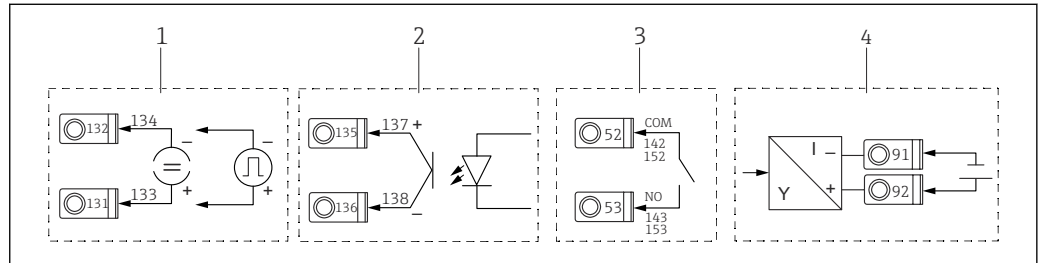

13 Connection of outputs


- 1 Active pulse and current outputs
- 2 Passive pulse output with open collector
- 3 Relay output (NO), e.g. slot A III
- 4 transmitter power supply (MUS) output

Ethernet option

Ethernet connection

An IEEE 802.3-compatible connection on a shielded RJ45 connector on the underside of the device is available as a network connection. This can be used to connect the device to devices in the network environment with a hub or switch. For safety distances, the office equipment standard EN 60950 must be taken into account. The arrangement corresponds to a standard MDI interface (AT&T258), which means that a shielded 1:1 cable with a maximum length of 100 m (328 ft) can be used. The Ethernet interface is designed as a 10 and 100-BASE-T. Direct connection to a PC is possible with a crossover cable. Half-duplex and full-duplex data transmission is supported.

i If the Density Computer FML621 has an Ethernet interface, no analog outputs are available on the basic unit via slot E!

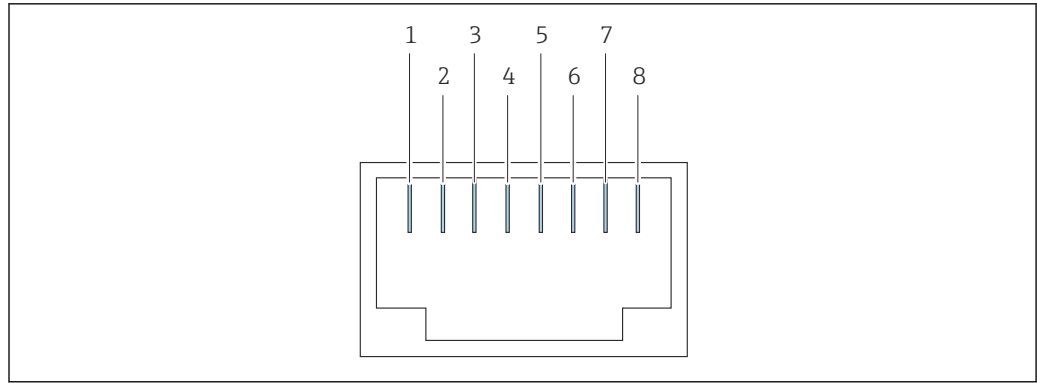

A0039690

14 RJ45 jack


- 1 Tx+
- 2 Tx-
- 3 Rx+
- 4 Not connected
- 5 Not connected
- 6 Rx-
- 7 Not connected
- 8 Not connected

LED indicators

Two LEDs below the plug-in connector indicate the status of the Ethernet interface:

- Yellow LED - connection signal
LED is lit when the device is connected to a network.
- Green LED - Tx/Rx
 - LED flashes when the device is sending or receiving data.
 - LED is continuously lit when the device is not sending or receiving data.

Extension cards (optional)

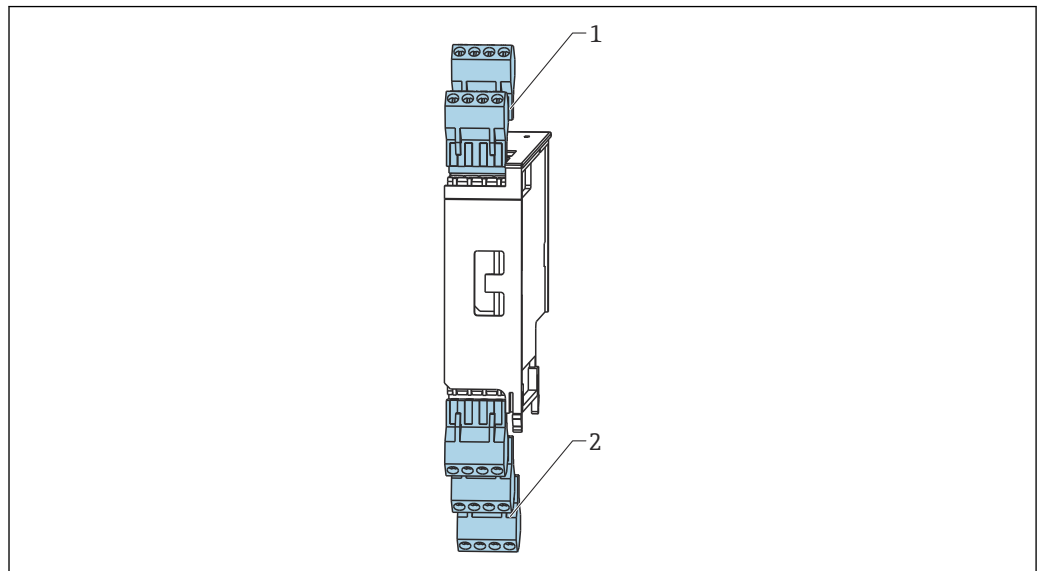

A0039691

15 Extension card with terminals (slots B, C and D)

- 1 Input: slots I, II
- 2 Output: slot III, IV, V

Terminal assignment, "Universal (FML621A-UA)" extension card with intrinsically safe inputs (FML621A-UB)

Slots B I, C I, D I

Input: current or PFM or pulse input 1

- Terminal 182: 24 V sensor power supply 1
- Terminal 112: (+) 0 to 20 mA or 4 to 20 mA, PFM, pulse input 1
- Terminal 111: ground for 0 to 20 mA or 4 to 20 mA, PFM, pulse input
- Terminal 181: sensor power supply ground 1

Slots B II, C II, D II

Input: current or PFM or pulse input 2

- Terminal 183: 24 V sensor power supply 2
- Terminal 181: sensor power supply ground 2
- Terminal 113: (+) 0 to 20 mA or 4 to 20 mA, PFM, pulse input 2
- Terminal 111: ground for 0 to 20 mA or 4 to 20 mA, PFM, pulse input

Slots B III, C III, D III

- Output: relay 1
 - Terminal 142: common relay (COM)
 - Terminal 143: NO contact relay (NO)
- Output: relay 2
 - Terminal 152: common relay (COM)
 - Terminal 153: NO contact relay (NO)

Slots B IV, C IV, D IV

Output: Current or pulse output - active

- Terminal 131: + 0 to 20 mA or 4 to 20 mA pulse output 1
- Terminal 132: - 0 to 20 mA or 4 to 20 mA pulse output 1
- Terminal 133: + 0 to 20 mA or 4 to 20 mA pulse output 2
- Terminal 134: - 0 to 20 mA or 4 to 20 mA pulse output 2

Slots B V, C V, D V


Output: Current or pulse output - passive


- Terminal 135: + pulse output 3 - open collector
- Terminal 136: - pulse output 3
- Terminal 137: + pulse output 4 - open collector
- Terminal 138: - pulse output 4


Terminal assignment, "Temperature (FML621A-TA)" extension card with intrinsically safe inputs (FML621A-TB)

Temperature sensors

Connection for Pt100, Pt500 and Pt1000.

 Terminals 116 and 117 must be bridged when connecting 3-wire sensors.

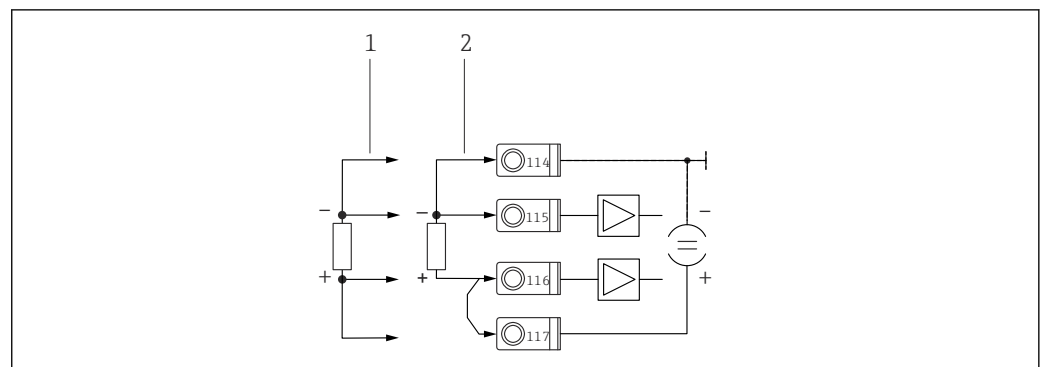

 16 Temperature sensor connection, optional temperature extension card e.g. in slot B (slot B I)

- 1 4-wire input
- 2 3-wire input

Slots B I, C I, D I

Input: RTD input 1

- Terminal 117: + RTD power supply 1
- Terminal 116: + RTD sensor 1
- Terminal 115: - RTD sensor 1
- Terminal 114: - RTD power supply 1

Slots B II, C II, D II

Input: RTD input 2

- Terminal 121: + RTD power supply 1
- Terminal 120: + RTD sensor 1
- Terminal 119: - RTD sensor 1
- Terminal 118: - RTD power supply 1

Slots B III, C III, D III

- Output: Relay 1
 - Terminal 142: Common relay 1 (COM)
 - Terminal 143: NO contact relay 1 (NO)
- Output: Relay 2
 - Terminal 152: Common relay 2 (COM)
 - Terminal 153: NO contact relay 21 (NO)

Slots B IV, C IV, D IV

- Output: Current or pulse output 1 - active
 - Terminal 131: + 0 to 20 mA or 4 to 20 mA
 - Terminal 132: - 0 to 20 mA or 4 to 20 mA
- Output: Current or pulse output 2 - active
 - Terminal 133: + 0 to 20 mA or 4 to 20 mA
 - Terminal 134: - 0 to 20 mA or 4 to 20 mA


Slots B V, C V, D V

- Output: Passive pulse output
 - Terminal 135: + pulse output 3 - open collector
 - Terminal 136: - pulse output 3
- Output: Passive pulse output
 - Terminal 137: + pulse output 4 - open collector
 - Terminal 138: - pulse output 4

Terminal assignment, "Digital card (FML621A-DA)" extension card; with intrinsically safe inputs (FML621A-DB)



The digital card has six intrinsically safe inputs. Terminals E1 and E4 can be defined as pulse inputs.

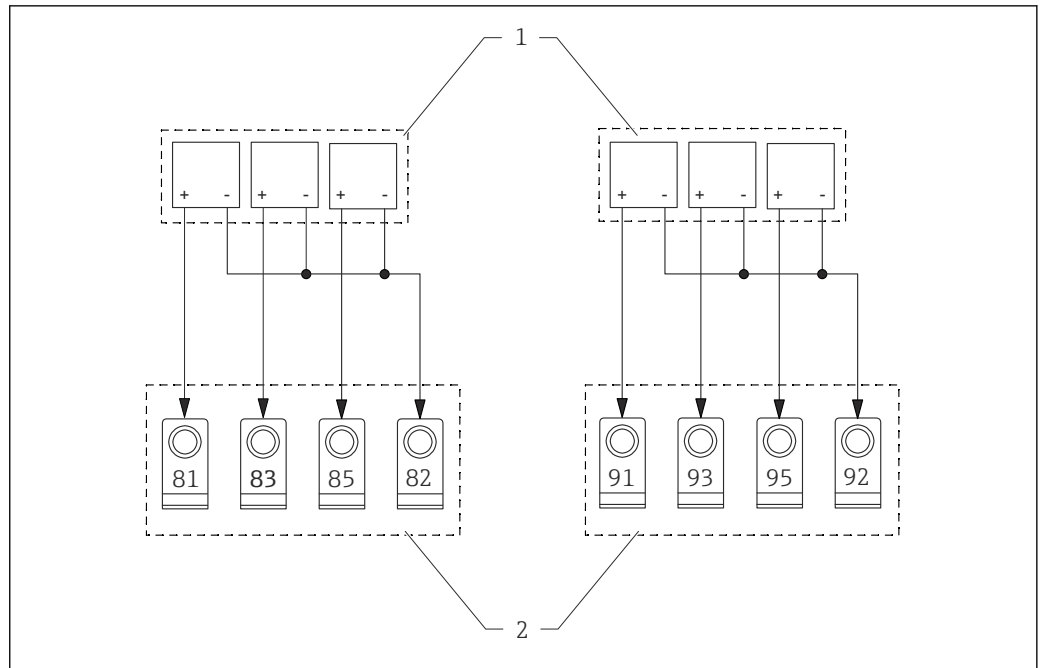

A0039694

17 Connecting the digital card

- 1 Digital input device
2 Terminal

i The current, PFM, pulse or RTD inputs in the same slot are not galvanically isolated. There is a separation voltage of 500 V between the aforementioned inputs and outputs in different slots.

Terminals with identical second digits are bridged internally.

Slots B I, C I, D I

Digital inputs E1 to 3

- Terminal 81: E1 20 kHz or 4 Hz as pulse input
- Terminal 83: E2 4 Hz
- Terminal 85: E3 4 Hz
- Terminal 82: Signal ground E1 to 3

Slots B II, C II, D II

Digital inputs E4 to 6

- Terminal 91: E4 20 kHz or 4 Hz as pulse input
- Terminal 93: E5 4 Hz
- Terminal 95: E6 4 Hz
- Terminal 92: Signal ground E4 to 6

Slots B III, C III, D III


- Output: Relay 1
 - Terminal 142: Common relay 1 (COM)
 - Terminal 143: NO contact relay 1 (NO)
- Output: Relay 2
 - Terminal 152: Common relay 2 (COM)
 - Terminal 153: NO contact relay 2 (NO)

Slots B IV, C IV, D IV

- Output: Relay 3
 - Terminal 145: Common relay 3 (COM)
 - Terminal 146: NO contact relay 3 (NO)
- Output: Relay 4
 - Terminal 155: Common relay 4 (COM)
 - Terminal 156: NO contact relay 4 (NO)

Slots B V, C V, D V

- Output: Relay 5
 - Terminal 242: Common relay 5 (COM)
 - Terminal 243: NO contact relay 5 (NO)
- Output: Relay 6
 - Terminal 252: Common relay 6 (COM)
 - Terminal 253: NO contact relay 6 (NO)

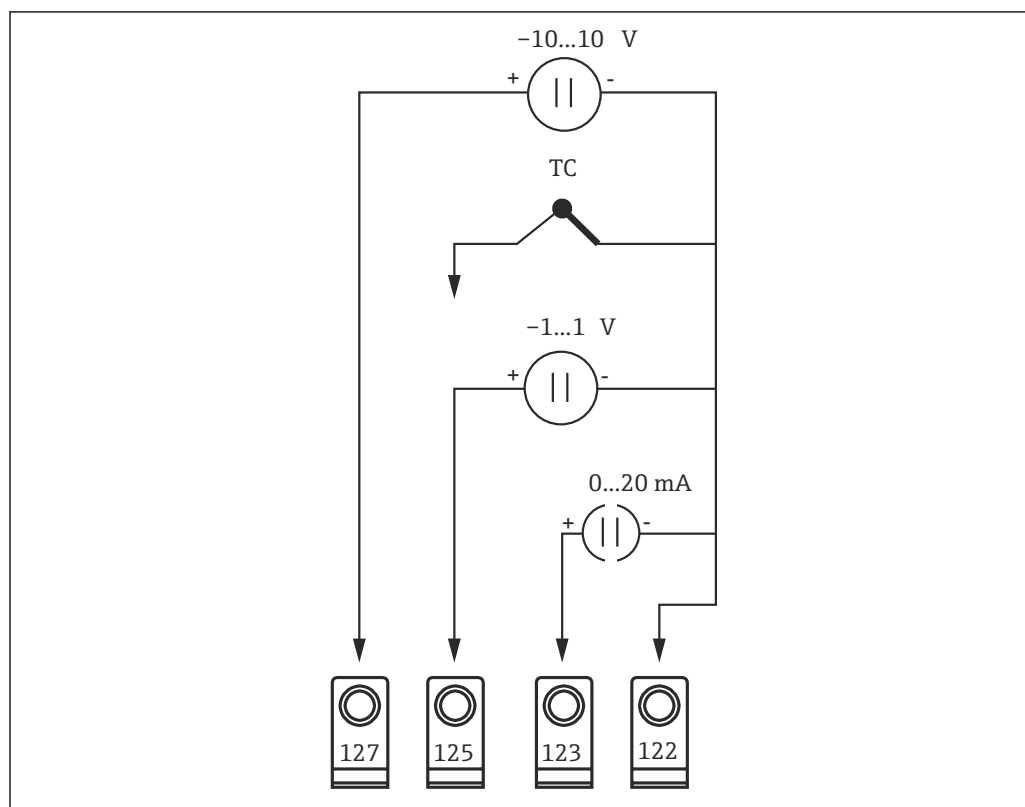Terminal assignment of extension card "U-I-TC card" with intrinsically safe inputs


A0039695

18 U-I-TC card



The card supports two input channels.

Channel 1 is supported by terminals 122, 123, 125 and 127.

Channel 2 is supported by terminals 222, 223, 225 and 227.

Slots B I, C I, D I
U-I-TC Input 1

- Terminal 127: -10 to +10 V input
- Terminal 125: -1 to +1 input, thermocouple
- Terminal 123: 0 to 20 mA input
- Terminal 122: input, signal ground

Slots B II, C II, D II
U-I-TC Input 2

- Terminal 227: -10 to +10 V input
- Terminal 225: -1 to +1 input, thermocouple
- Terminal 223: 0 to 20 mA input
- Terminal 222: input, signal ground

Slots B III, C III, D III

- Output: Relay 1
 - Terminal 142: Common relay 1 (COM)
 - Terminal 143: NO contact relay 1 (NO)
- Output: Relay 2
 - Terminal 152: Common relay 2 (COM)
 - Terminal 153: NO contact relay 2 (NO)

Slots B IV, C IV, D IV

- Output: Current or pulse output 1 - active
 - Terminal 131: + 0 to 20 mA or 4 to 20 mA pulse output 1
 - Terminal 132: - 0 to 20 mA or 4 to 20 mA pulse output 1
- Output: Current or pulse output 2 - active
 - Terminal 133: + 0 to 20 mA or 4 to 20 mA or pulse output 2
 - Terminal 134: - 0 to 20 mA or 4 to 20 mA pulse output 2

Slots B V, C V, D V

- Output: Passive pulse output
 - Terminal 135: + pulse output 3 - open collector
 - Terminal 136: - pulse output 3
- Output: Passive pulse output
 - Terminal 137: + pulse output 4 - open collector
 - Terminal 138: - pulse output 4

Connecting the remote display and operating unit

Description of functions

The remote display is an innovative addition to the powerful FML621 DIN rail device. The user has the opportunity to optimally install the arithmetic unit to suit the installation and mount the display and operating unit in a user-friendly way at an easily accessible location. The display can be connected to a DIN rail device both with and without an integrated display or operating unit. A 4-pin cable is supplied to connect the remote display with the basic unit. Other components are not necessary.

Please note the following:


- The remote display must be connected in order to use all of the functions of the operating unit.
- Operating the unit solely with ReadWin® 2000 is not permitted
- Only ever connect one display or operating unit to the Density Computer FML621 (DIN rail device)


Installation of the remote display or operating unit



- The mounting location of the display unit must be free from vibrations.
- The permitted ambient temperature during operation is -20 to +60 °C (-4 to +140 °F).
- The device must be protected against high temperatures or heat.

Installation of the display unit

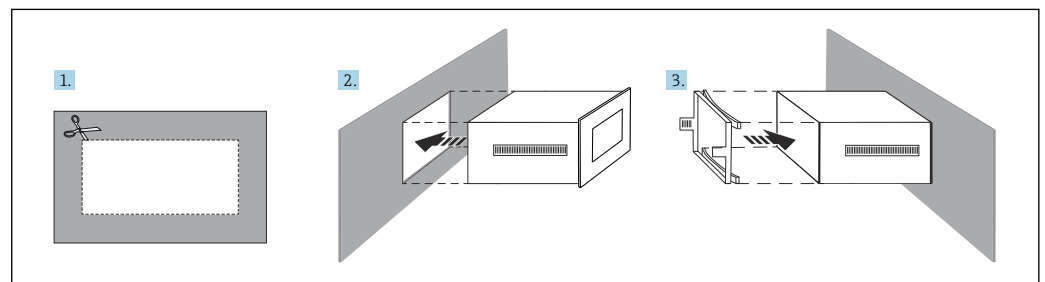


 19 Installation of the display unit

1. Cut out a mounting opening with the following dimensions: 138 mm (5.43 in) x 68 mm (2.68 in), installation depth 43 mm (1.69 in).
2. Push the device with the sealing ring through the hole from the front.
3. Slide the securing frame over the rear of the housing and press it against the cabinet until the retaining clips click into place.
 - The display unit is now installed.

Wiring

The remote display and operating unit is connected directly to the basic unit using the enclosed cable.

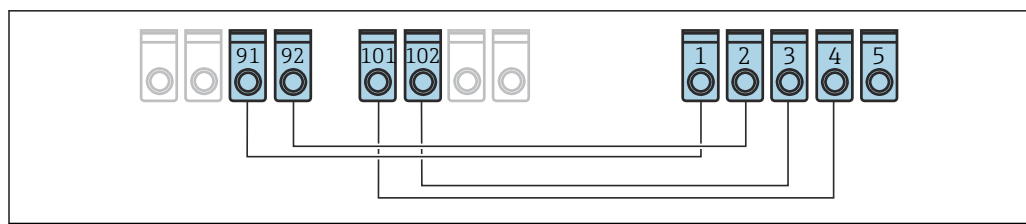

A0039699

20 Wire connections between remote display unit and basic unit.

- 1 Terminal GDN - remote display unit
- 2 Terminal 24 V_{DC} - remote display unit
- 3 Terminal + Rx Tx - remote display unit
- 4 Terminal - Rx Tx - remote display unit
- 5 Terminal PE - remote display unit
- 91 Terminal GND - slot A III - basic unit
- 92 Terminal 24 V_{DC} - slot A III - basic unit
- 101 Terminal - Rx Tx - slot E III - basic unit
- 102 Terminal + Rx Tx - slot E III - basic unit

Performance characteristics

Reference operating conditions

Normal operating conditions for special calibration and Liquiphant Density

- Medium: water H₂O
- Fluid temperature: 0 to 80 °C (32 to 176 °F), motionless liquid
- Ambient temperature: 24 °C (75 °F) ±5 °C (±9 °F)
- Moisture: max. 90 %
- Warm-up time: >30 min

Reference operating conditions of Density Computer FML621

- Power supply: 207 to 250 V_{AC} ±10 %, 50 Hz, ±0.5 Hz
- Warm-up time: >30 min
- Ambient temperature: 25 °C (77 °F), ±5 °C (±9 °F)
- Humidity: 39 % ±10 % rF.

Performance characteristics



The accuracy described here refers to the entire density measuring line.

General measuring conditions for accuracy data

- Measuring range: 0.3 to 2 g/cm³ (0.3 to 2 SGU)
- Observe the distance between the tuning fork and the surface of the medium (> 50 mm (1.97 in))
 see the "Orientation" section
- Measured error, temperature sensor: < 1 K
- Maximum viscosity: 350 mPa·s (3.5 P)
- Maximum flow velocity: 2 m/s (6.56 ft/s)
 - Laminar flow rate, bubble-free
 - Structural measures, e.g. a bypass or pipe enlargement to reduce flow, must be put in place for higher flow velocities
- Process temperature: 0 to +80 °C (+32 to +176 °F) - validity of accuracy data
- Power supply as per FML621 specification
- Data as per DIN EN 61298-2
- Process pressure: -1 to +25 bar (-14.5 to +362.5 psi)

Maximum measured error

1 g/cm³ = 1 SGU (Specific Gravity Unit)


- Standard adjustment: ±0.02 g/cm³ (±1.2 % of span 1.7 g/cm³, under general measuring conditions)
- Special adjustment: ±0.005 g/cm³ (±0.3 % of span 1.7 g/cm³, under normal operating conditions)
- Field adjustment: ±0.002 g/cm³ (at operating point)

Non-repeatability - reproducibility

1 g/cm³ = 1 SGU (Specific Gravity Unit)

- Standard adjustment: ±0.002 g/cm³ (under general measuring conditions)
- Special adjustment: ±0.0007 g/cm³ (under normal operating conditions)
- Field adjustment: ±0.002 g/cm³ (at operating point)

Factors influencing accuracy data

-  Clean the sensor (CIP/SIP) if process temperatures of up to 140 °C (284 °F) persist over a long period.
- All information relating to accuracy when determining the viscosity of liquids is based on Newtonian fluids.
- A density measurement can be performed in the following liquids: gels, viscoelastic gels, non-Newtonian elastic fluids, pseudoelastic and plastic-viscous fluids.
- Long-term drift typically: ±0.02 kg/m³ (0.001 lb/ft³) per day
- Temperature coefficient typically: ±0.2 kg/m³ (±0.01 lb/ft³) per 10 K
- Fluid velocity in pipes: >2 m/s (6.56 ft/s)
- Buildup on fork
- Air bubbles in the case of vacuum applications
- Incomplete coverage of the fork
- In the event of changes in pressure >6 bar (87 psi), a pressure measurement is necessary for compensation.
- In the event of changes in temperature >1 K, a temperature measurement is necessary for compensation.
- Mechanical stress, such as deformation of the tuning fork, can impair accuracy and must be avoided.
- Devices exposed to mechanical stress must be replaced.

Cyclic field calibration can take place depending on the accuracy required.

Mounting


Installation instructions for Liquiphant Density



The following information is complemented by additional documentation on the Liquiphant (available on the Endress+Hauser website: www.endress.com → Downloads)

Orientation

The mounting location must be selected such that the tuning fork and the membrane are always immersed in the medium.

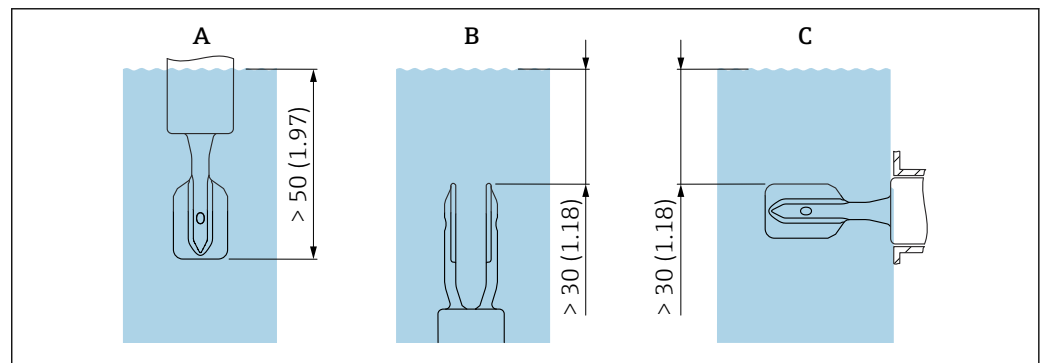

 21 Engineering unit mm (in)

- A Installation from above
- B Installation from below
- C Installation from the side

A0039685


Inlet and outlet runs

Inlet run

Install the sensor as far as possible from fittings such as valves, T-sections, elbows, flange elbows, etc.

To comply with the accuracy specification, the inlet run must meet the following requirements:

Inlet run: $\geq 5 \times \text{DN}$ (nominal diameter) - min. 750 mm (29.5 in)

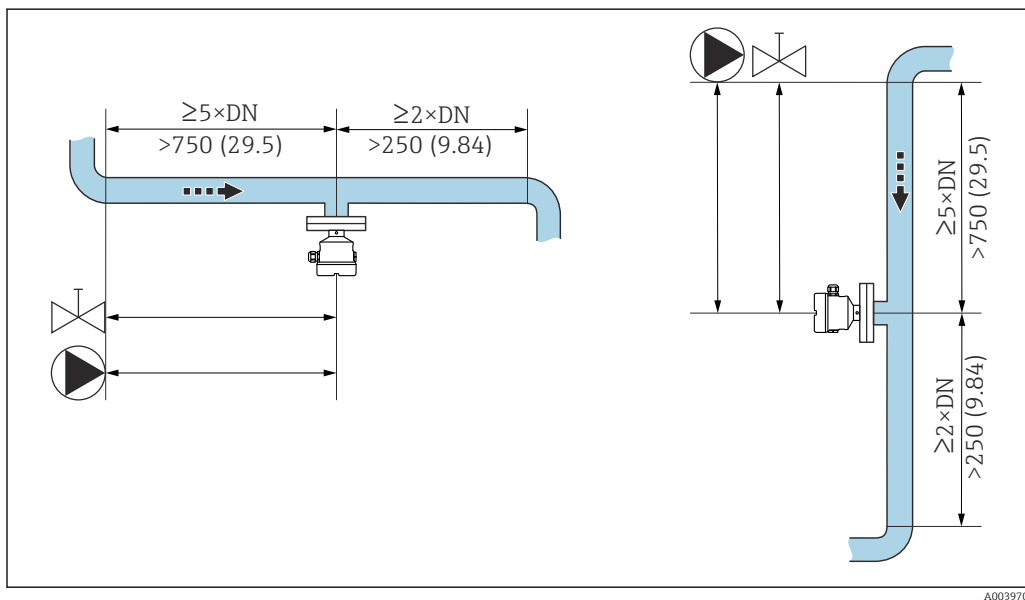


22 Installing the inlet run. Unit of measurement mm (in)

Outlet run

To comply with the accuracy specification, the outlet run must meet the following requirements:

Outlet run: $\geq 2 \times \text{DN}$ (nominal diameter) - min. 250 mm (9.84 in)

The pressure and temperature sensor must be installed on the outlet side of the flow direction after the Liquiphant density sensor. When installing pressure and temperature measuring points downstream of the device, make sure the distance between the measuring point and the device is sufficient.

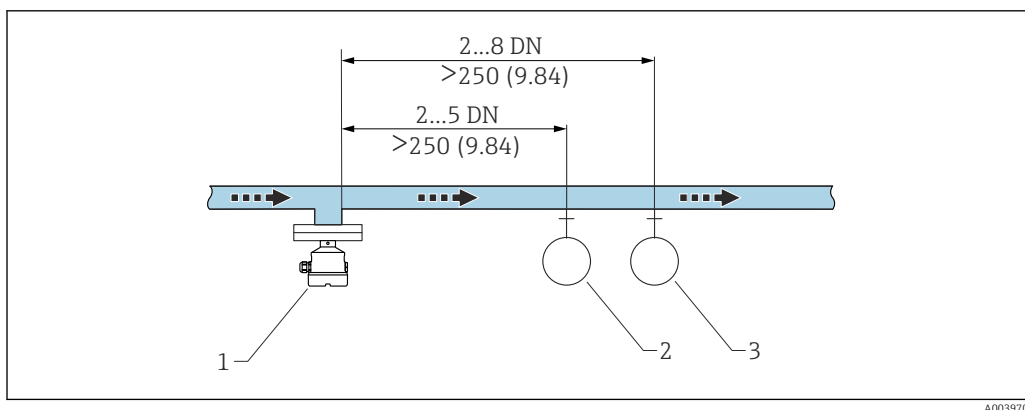

23 Installing the outlet run. Unit of measurement mm (in)


- 1 Liquiphant density sensor
- 2 Pressure measuring point
- 3 Temperature measuring point

Mounting location and correction factor

The Liquiphant can be installed in vessels, tanks or pipes.

Correction factor "r"


The tuning fork of the Liquiphant Density needs free space to vibrate. The medium must flow freely around the tuning fork. The measurement result is affected if the distance between the tuning fork and the wall of the tank or pipe is very short. The measured error can be compensated for by entering a correction factor "r".


	h	r
 A0039687	12 mm (0.47 in)	1.0026
	14 mm (0.55 in)	1.0016
	16 mm (0.63 in)	1.0011
	18 mm (0.71 in)	1.0008
	20 mm (0.79 in)	1.0006
	22 mm (0.87 in)	1.0005
	24 mm (0.94 in)	1.0004
	26 mm (1.02 in)	1.0004
	28 mm (1.10 in)	1.0004
	30 mm (1.18 in)	1.0003
	32 mm (1.26 in)	1.0003
	34 mm (1.34 in)	1.0002
	36 mm (1.42 in)	1.0001
	38 mm (1.50 in)	1.0001
	40 mm (1.57 in)	1.0000


 Vortexes and eddies can falsify the measurement result due to the incorrect orientation of the tuning fork:

The tuning fork must be aligned in the flow direction in the event of internal fixtures in pipes or tanks with a stirrer.

- A marking on the process connection indicates the position of the tuning fork.
Threaded connection = dot on the hexagon head; flange = 2 lines on the flange.
- The flow velocity of the medium must not exceed 2 m/s (6.56 ft/s) during measurement

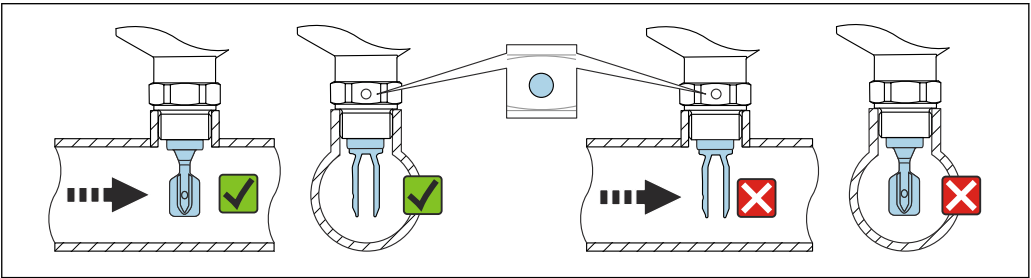


 24 Installation in pipes (take fork position and marking into consideration)

	D	r
 A0039707	<44 mm (1.73 in)	-
	44 mm (1.73 in)	1.0225
	46 mm (1.81 in)	1.0167
	48 mm (1.89 in)	1.0125
	50 mm (1.97 in)	1.0096
	52 mm (2.05 in)	1.0075

	D	r
	54 mm (2.13 in)	1.0061
	56 mm (2.20 in)	1.0051
	58 mm (2.28 in)	1.0044
	60 mm (2.36 in)	1.0039
	62 mm (2.44 in)	1.0035
	64 mm (2.52 in)	1.0032
	66 mm (2.60 in)	1.0028
	68 mm (2.68 in)	1.0025
	70 mm (2.76 in)	1.0022
	72 mm (2.83 in)	1.0020
	74 mm (2.91 in)	1.0017
	76 mm (2.99 in)	1.0015
	78 mm (3.07 in)	1.0012
	80 mm (3.15 in)	1.0009
	82 mm (3.23 in)	1.0007
	84 mm (3.31 in)	1.0005
	86 mm (3.39 in)	1.0004
	88 mm (3.46 in)	1.0003
	90 mm (3.54 in)	1.0002
	92 mm (3.62 in)	1.0002
	94 mm (3.70 in)	1.0001
	96 mm (3.78 in)	1.0001
	98 mm (3.86 in)	1.0001
	100 mm (3.94 in)	1.0001
	>100 mm (3.94 in)	1.0000

i Pipe nominal diameters with internal dimensions <44 mm (1.73 in) are not permitted!

In pipes with high flow rates of 2 to 5 m/s (6.56 to 16.4 ft/s) or in tanks with turbulence on the surface of the medium, structural measures must be taken to reduce turbulence at the sensor. For this purpose, the Liquiphant Density can be installed in a bypass or in a pipe with a larger diameter.

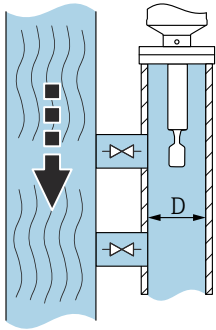	D	r
 <p>A0039689</p>	<44 mm (1.73 in)	-
	44 mm (1.73 in)	1.0191
	46 mm (1.81 in)	1.0162
	48 mm (1.89 in)	1.0137
	50 mm (1.97 in)	1.0116
	52 mm (2.05 in)	1.0098
	54 mm (2.13 in)	1.0083
	56 mm (2.20 in)	1.0070
	58 mm (2.28 in)	1.0059
	60 mm (2.36 in)	1.0050
	62 mm (2.44 in)	1.0042

	D	r
	64 mm (2.52 in)	1.0035
	66 mm (2.60 in)	1.0030
	68 mm (2.68 in)	1.0025
	70 mm (2.76 in)	1.0021
	72 mm (2.83 in)	1.0017
	74 mm (2.91 in)	1.0014
	76 mm (2.99 in)	1.0012
	78 mm (3.07 in)	1.0010
	80 mm (3.15 in)	1.0008
	82 mm (3.23 in)	1.0006
	84 mm (3.31 in)	1.0005
	86 mm (3.39 in)	1.0004
	88 mm (3.46 in)	1.0003
	90 mm (3.54 in)	1.0003
	92 mm (3.62 in)	1.0002
	94 mm (3.70 in)	1.0002
	96 mm (3.78 in)	1.0001
	98 mm (3.86 in)	1.0001
	100 mm (3.94 in)	1.0001
	>100 mm (3.94 in)	1.0000

Density Computer FML621

Mounting location

Mount the device in a cabinet on a DIN rail as per IEC 60715.

Orientation

No restrictions.

Environment

Liquiphant Density

Ambient temperature range

–40 to 70 °C (–40 to 158 °F)

The minimum permitted ambient temperature of the plastic housing is limited to –20 °C (–4 °F); 'indoor use' applies for North America.

Outdoor operation in strong sunlight:

- Mount the device in a shaded location
- Avoid direct sunlight, particularly in warmer climatic regions
- Use a weather protection cover, can be ordered as an accessory



Further information on using the device in hazardous areas (ATEX) and on documentation that is currently available can be found on the Endress+Hauser website: www.endress.com → Downloads.

Storage temperature

–40 to +80 °C (–40 to +176 °F)

Operating altitude

As per IEC 61010-1 Ed.3:

- Up to 2 000 m (6 600 ft) above sea level
- Can be extended to 3 000 m (9 800 ft) above sea level if overvoltage protection is used

Climate class

As per IEC 60068-2-38 test Z/AD

Degree of protection

In accordance with DIN EN 60529, NEMA 250

IP66/IP68 NEMA 4X/6P

Types of housing:

- Single compartment; plastic
- Single compartment; aluminum, coated; Ex d/XP
- Single compartment; 316L, cast; Ex d/XP
- Dual compartment L-shaped, aluminum, coated; Ex d/XP



If the "M12 plug" option is selected as the electrical connection, **IP66/67 NEMA TYPE 4X** applies for all housing types.

Pollution degree

Pollution degree 2

Density Computer FML621

Ambient temperature range

CAUTION

Extension cards generate additional heat.

Destruction of electronic components.

- Install additional ventilation with a minimum air current of 0.5 m/s (1.64 ft/s).

Temperature range: -20 to 50 °C (-4 to 122 °F).

Storage temperature

-30 to 70 °C (-22 to 158 °F)

Climate class

As per IEC 60654-1 Class B2/EN 1434 Class "C" - no condensation permitted.

Electrical safety

As per IEC 61010-1: operating environment at altitudes of < 2 000 m (6 560 ft) above sea level.

Degree of protection

- Basic unit: IP20
- Remote operating and display unit: front IP65

Electromagnetic compatibility



Interference emission

IEC 61326 Class A


Interference immunity

- Power failure: 20 ms, no effect
- Starting current limitation: $I_{\max}/I_n < 50\%$ ($T_{50\%} \leq 50$ ms)
- Electromagnetic fields: 10 V/m (3.048 V/ft) as per IEC 61000-4-3
- Conducted HF: 0.15 to 80 Hz, 10 V as per IEC 61000-4-3
- Electrostatic discharge: 6 kV contact, indirect as per IEC 61000-4-2
 - Burst pulses - power supply: 2 kV as per IEC 61000-4-4
 - Burst pulses - signal: 1 kV/2 kV as per IEC 61000-4-4
 - Voltage peak - AC power supply: 1 kV/2 kV as per IEC 61000-4-5
 - Voltage peak - DC power supply: 1 kV/2 kV as per IEC 61000-4-5
 - Voltage peak - signal: 0.5 kV/1 kV as per IEC 61000-4-5


Process: Liquiphant Density

Process temperature range	0 to 80 °C (32 to 176 °F)
Thermal shock	≤ 120 K/s
Process pressure range	<p>–1 to +25 bar (–14.5 to +362.5 psi)</p> <p>⚠ WARNING</p> <p>The maximum pressure for the device depends on the lowest-rated element, with regard to pressure, of the selected component. This means that it is necessary to pay attention to the process connection as well as the sensor.</p> <ul style="list-style-type: none"> ▶ For pressure specifications, see the "Mechanical construction" section. ▶ Only operate the device within the specified limits! ▶ The Pressure Equipment Directive (2014/68/EU) uses the abbreviation "PS". The abbreviation "PS" corresponds to the MWP (maximum working pressure) of the device. <p>Refer to the following standards for the permitted pressure values of the flanges at higher temperatures:</p> <ul style="list-style-type: none"> ■ pR EN 1092-1: With regard to its stability-temperature property, the material 1.4435 is identical to 1.4404, which is classed as 13E0 in EN 1092-1 Tab. 18. The chemical composition of the two materials can be identical. ■ ASME B 16.5 ■ JIS B 2220 <p>The lowest value from the derating curves of the device and of the selected flange applies in each case.</p> <p> Canadian CRN approval: more details about the maximum pressure values are available in the download area of the product page under: www.endress.com → Downloads.</p>
Pressure tightness	<p>Up to vacuum</p> <p> In vacuum evaporation plants, select the 0.4 g/cm³ density setting.</p>
Solids contents	Ø ≤ 5 mm (0.2 in)

Mechanical construction: Liquiphant Density

-  For the dimensions, see the Product Configurator: www.endress.com
- Enter the product in the search field and select the result
- In the menu bar, select "Configuration" → Extended selection
 - Fully select the basic features
 - In the menu bar, select "CAD"
 - Select the preferred view

Design, dimensions	<p>Device height</p> <p>The device height is calculated from the following components:</p> <ul style="list-style-type: none"> ■ Housing including cover ■ Temperature spacer and/or pressure-tight feedthrough (second line of defense), optional ■ Pipe extension, short pipe or compact version ■ Process connection (flange, thread) <p>The individual heights of the components can be found in the following sections:</p> <ul style="list-style-type: none"> ■ Determine device height and add individual heights ■ Take the installation clearance into consideration (space that is needed to install the device)
--------------------	--

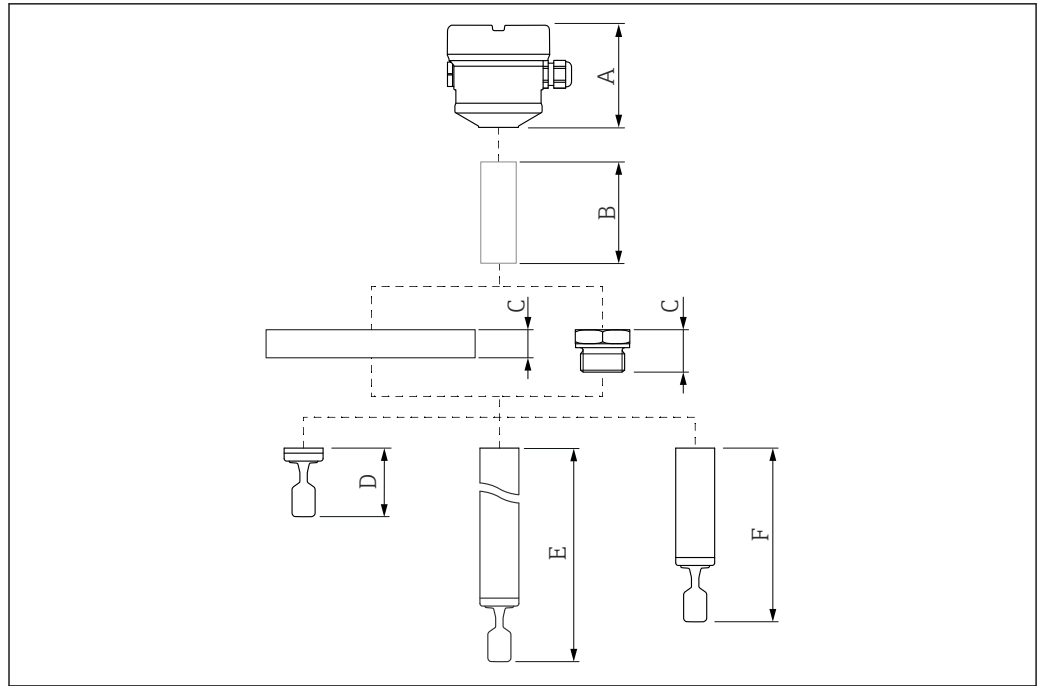

A0036841

25 Components to determine the device height


- A Housing with electronic insert FEL60D and cover
- B Temperature spacer, pressure-tight feedthrough (second line of defense), optional
- C Process connection (flange, thread)
- D Compact probe version with tuning fork
- E Pipe extension probe with tuning fork
- F Short tube version of probe with tuning fork

Dimensions

Housing and cover


All housings can be aligned. In the case of metal housings, the housing alignment can also be fixed with the locking screw.

Single compartment housing; material

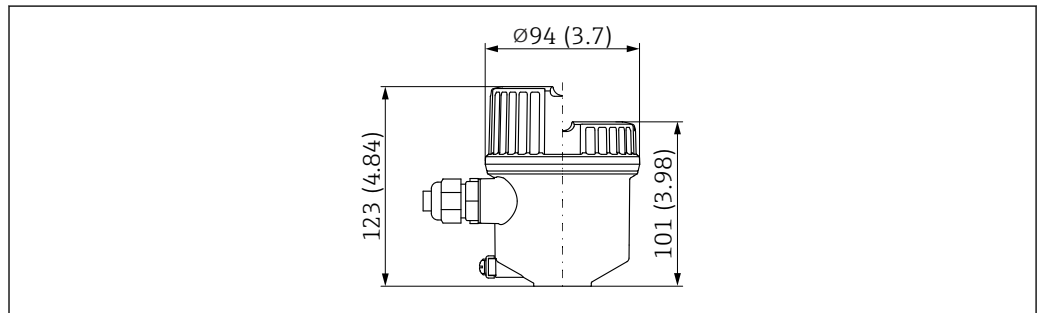


A0035911

26 Single compartment; plastic housing. Unit of measurement mm (in)

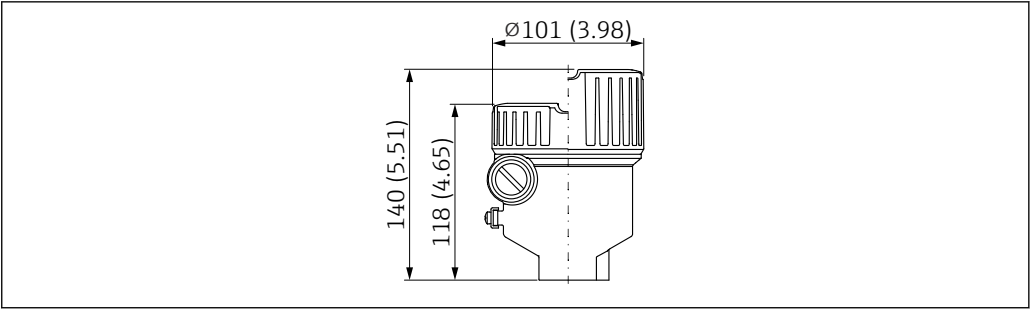

A0039401


27 Single compartment; aluminum, coated; with Ex d/XP approval. Unit of measurement mm (in)

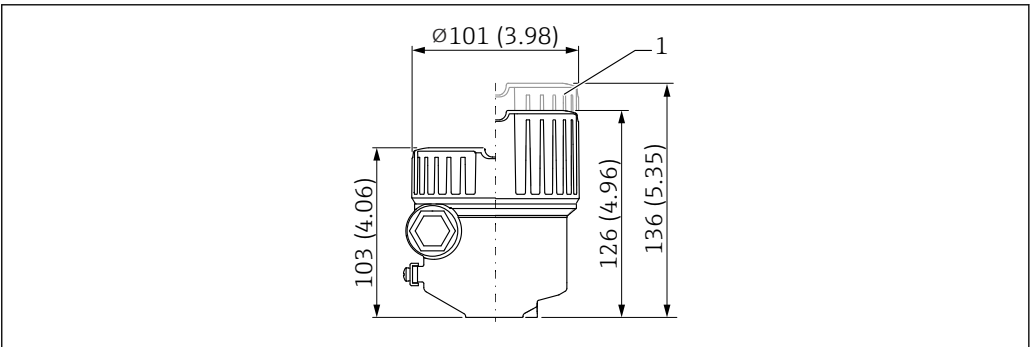

A0039402

28 Single compartment; aluminum, coated. Unit of measurement mm (in)


1 Cover for Ex ec approval

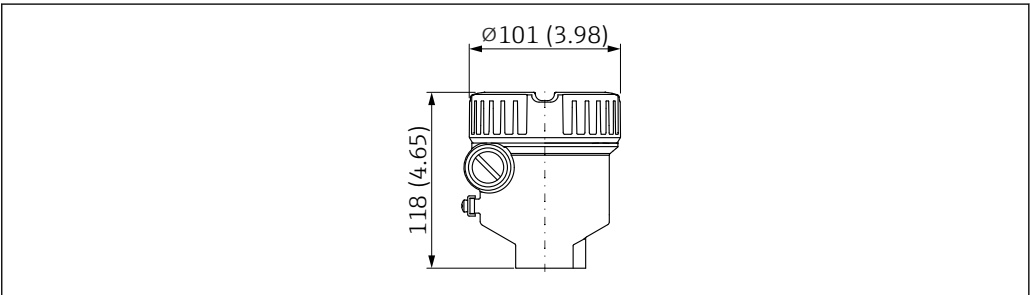

A0035590

29 Single compartment; 316L, cast; also with Ex d/XP approval. Unit of measurement mm (in)

Dual compartment, L-shaped housing; material

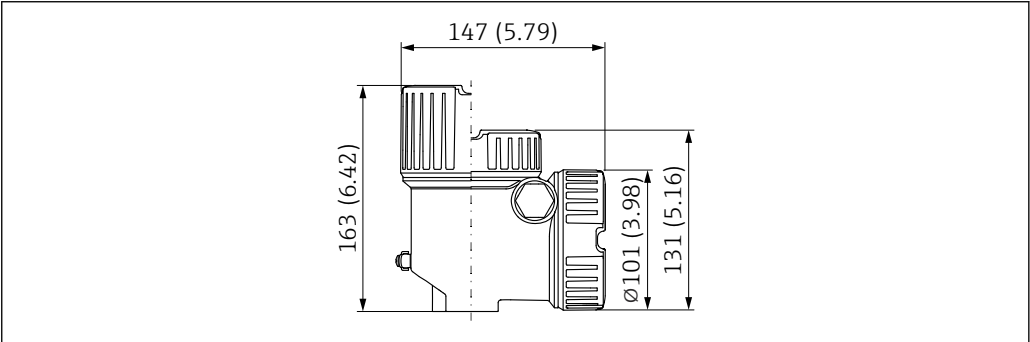

A0035591

30 Dual compartment; L-shaped; aluminum, coated; also with Ex d/XP approval. Unit of measurement mm (in)

Ground terminal

- Ground terminal inside the housing, max. conductor cross-section 2.5 mm² (14 AWG)
- Ground terminal outside on the housing, max. conductor cross-section 4 mm² (12 AWG)

Cable glands

Cable diameter:

- Plastic: Ø5 to 10 mm (0.2 to 0.38 in)
- Nickel-plated brass: Ø7 to 10.5 mm (0.28 to 0.41 in)
- Stainless steel: Ø7 to 12 mm (0.28 to 0.47 in)




The scope of delivery comprises:

- 1 cable gland installed
- 1 cable gland sealed with dummy plug

Exceptions: with Ex d/XP, only threaded entries are permitted.

Temperature spacer, pressure-tight feedthrough (optional)

Enables sealed insulation of the vessel and a normal ambient temperature for the housing

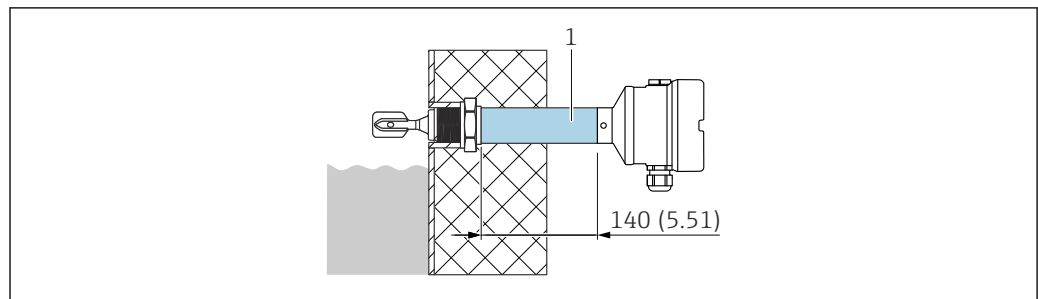

A0036845

Unit of measurement mm (in)

1 Temperature spacer and/or pressure-tight feedthrough


Product Configurator, feature "Sensor design", optional:

- Temperature spacer
- Pressure-tight feedthrough (second line of defense)
 - If the sensor is damaged, protects the housing from vessel pressures up to 100 bar (1450 psi).
 - The "Pressure-tight feedthrough" version can only be selected in combination with the "Temperature spacer" version

Probe design

Compact

- Material: 316L or Alloy C
- Sensor length L: depends on process connection
See section on process connections: thread G, ASME B1.20.3 MNPT, EN10226 R, Tri-Clamp

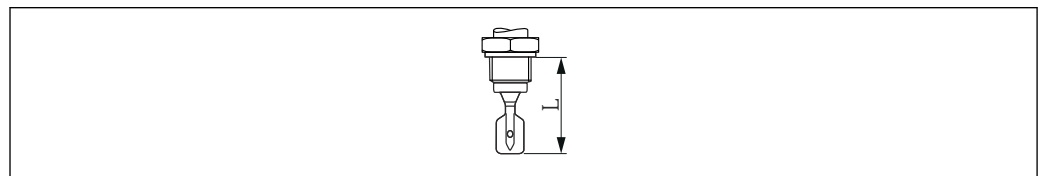

A0042435


31 Probe design: compact, sensor length L

Short pipe

- Material: 316L, sensor length L: depends on process connection
- Material: Alloy C, sensor length L: depends on process connection
 - Flange = 115 mm (4.53 in)
 - Thread G 3/4 = 115 mm (4.53 in)
 - Thread G 1 = 118 mm (4.65 in)
 - Thread NPT, R = 99 mm (3.9 in)
 - Tri-Clamp = 115 mm (4.53 in)

Pipe extension

- Material: 316L, sensor length L: 117 to 6 000 mm (4.7 to 236 in)
- Material: Alloy C, sensor lengths L: 148 to 3 000 mm (5.9 to 118 in)
- Length tolerances L: < 1 m (3.3 ft) = -5 mm (-0.2 in), 1 to 3 m (3.3 to 9.8 ft) = -10 mm (-0.39 in)

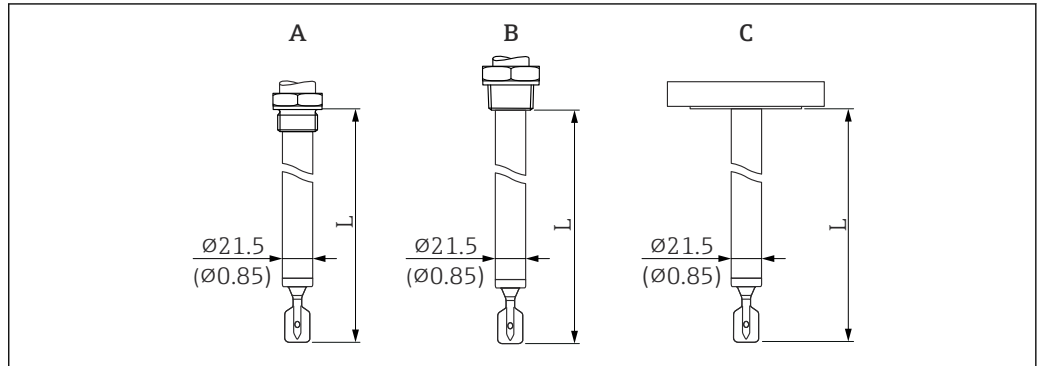


A0036860

32 Probe designs: pipe extension, short pipe, sensor length L. Unit of measurement mm (in)

- A G 3/4, G 1
 B NPT 3/4, NPT 1, R 3/4, R 1
 C Flange, Tri-Clamp

Tuning fork

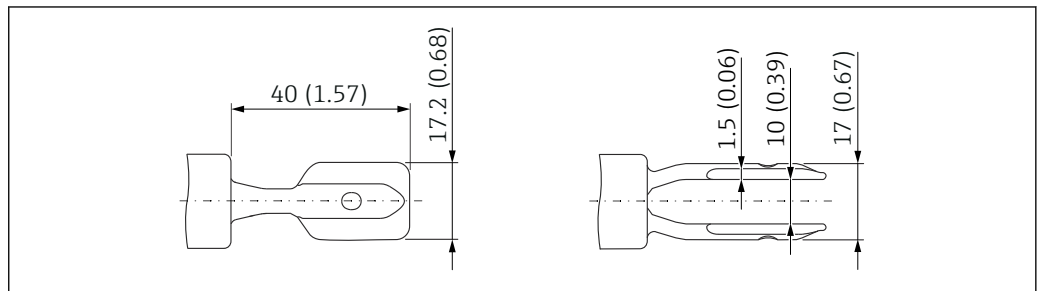


A0038269

33 Tuning fork. Unit of measurement mm (in)

Process connections

Height of process connection

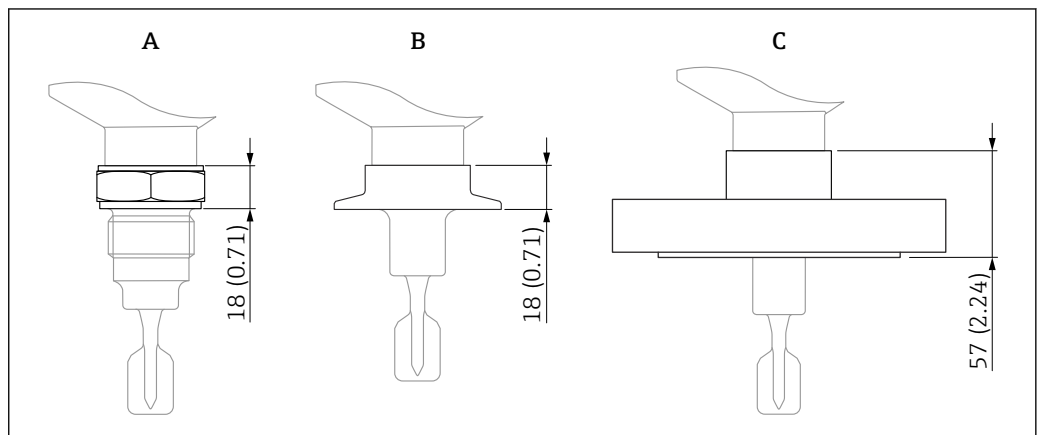

A0046284


Unit of measurement mm (in)


- A Process connection with threaded connection
 B Process connection with Clamp
 C Process connection with flange

Thread ISO228 G for installing in weld-in adapter


G ¾, G 1 suitable for installing in weld-in adapter

- Material: 316L
- Pressure rating, temperature: ≤ 40 bar (580 psi), ≤ 100 °C (212 °F)
- Pressure rating, temperature: ≤ 25 bar (363 psi), ≤ 150 °C (302 °F)
- Weight: 0.2 kg (0.44 lb)
- Accessory: weld-in adapter


 The weld-in adapter is not included in the scope of delivery.

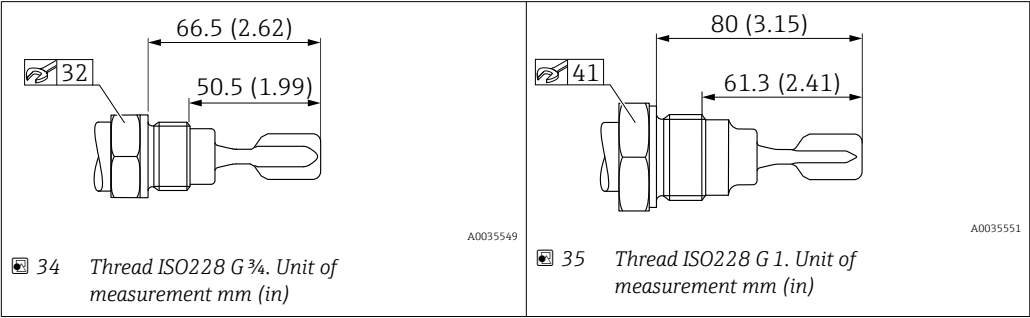


Thread ISO228 G with flat seal

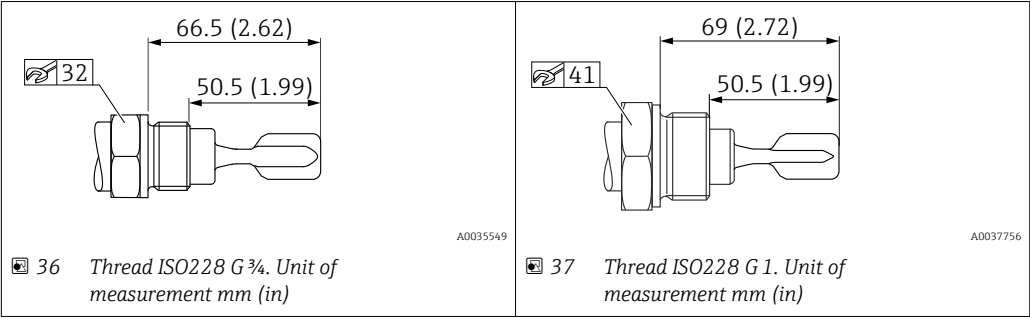

Thread ASME B1.20.3, MNPT

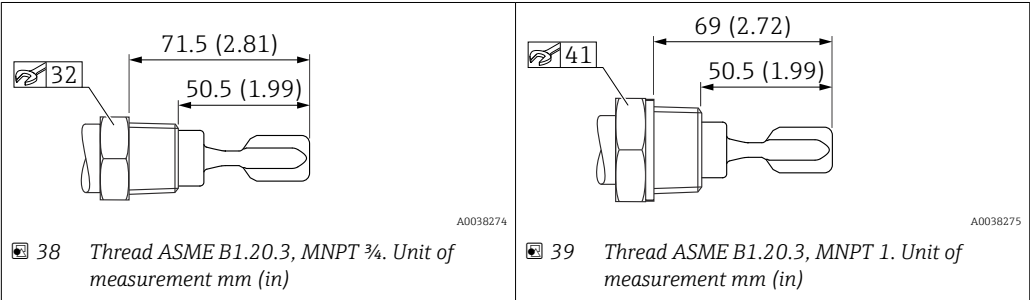

Thread EN10226, R

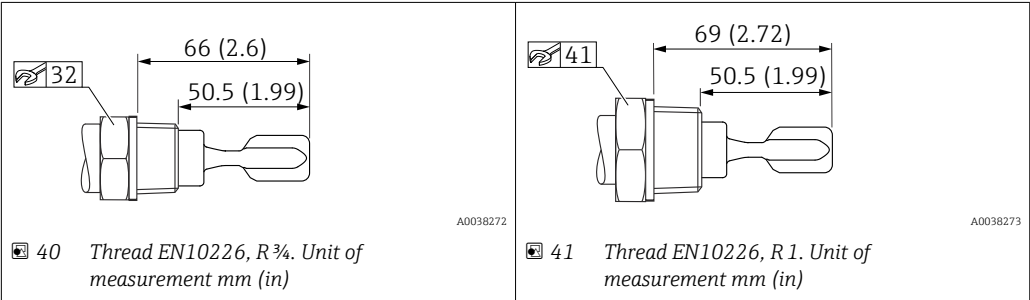


Tri-Clamp


ISO2852 DN25-38 (1 to 1 ½"), DIN32676 DN25-40

- Material: 316L
- Pressure rating: ≤ 25 bar (363 psi)
- Temperature: ≤ 150 °C (302 °F)
- Weight: 0.22 kg (0.49 lb)

ISO2852 DN40-51 (2"), DIN32676 DN50

- Material: 316L
- Pressure rating: ≤ 25 bar (363 psi)
- Temperature: ≤ 150 °C (302 °F)
- Weight: 0.3 kg (0.66 lb)


 The maximum temperature and the maximum pressure are dependent on the clamping ring and the seal used. The lowest value applies in each case.

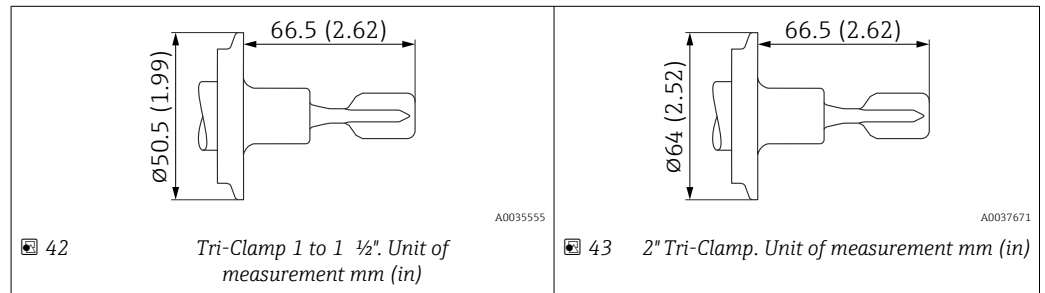

Flanges

AlloyC22-plated flanges are available for higher chemical resistance.

The flange carrier material is made of 316L and is welded to an AlloyC22 disk.

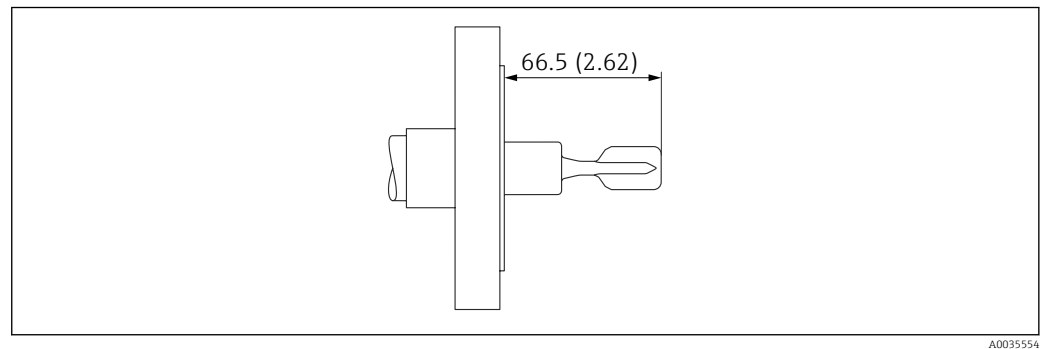

ASME B16.5 flanges, RF

Pressure rating	Type	Material	Weight
Cl.150	NPS 1"	316/316L	1.0 kg (2.21 lb)
Cl.150	NPS 1-¼"	316/316L	1.2 kg (2.65 lb)
Cl.150	NPS 2"	316/316L	2.4 kg (5.29 lb)
Cl.150	NPS 2"	AlloyC22>316/316L	2.4 kg (5.29 lb)
Cl.150	NPS 1-½"	316/316L	1.5 kg (3.31 lb)
Cl.150	NPS 3"	316/316L	4.9 kg (10.8 lb)
Cl.150	NPS 4"	316/316L	7.0 kg (15.44 lb)
Cl.300	NPS 1-¼"	316/316L	2.0 kg (4.41 lb)
Cl.300	NPS 1-½"	316/316L	2.7 kg (5.95 lb)
Cl.300	NPS 2"	316/316L	3.2 kg (7.06 lb)

Pressure rating	Type	Material	Weight
Cl.300	NPS 3"	316/316L	6.8 kg (14.99 lb)
Cl.300	NPS 3"	AlloyC22>316/316L	6.8 kg (14.99 lb)
Cl.300	NPS 4"	316/316L	11.5 kg (25.6 lb)
Cl.600	NPS 2"	316/316L	4.2 kg (9.26 lb)
Cl.600	NPS 3"	316/316L	6.8 kg (14.99 lb)

ASME B16.5 flanges, FF

Pressure rating	Type	Material	Weight
Cl.150	NPS 1"	316/316L	1.0 kg (2.21 lb)
Cl.150	NPS 2"	316/316L	2.4 kg (5.29 lb)
Cl.300	NPS 1-½"	316/316L	2.7 kg (5.95 lb)
Cl.300	NPS 2"	316/316L	3.2 kg (7.06 lb)

ASME B16.5 flanges, RTJ

Pressure rating	Type	Material	Weight
Cl.300	NPS 2"	316/316L	3.2 kg (7.06 lb)
Cl.300	NPS 4"	316/316L	11.5 kg (25.6 lb)
Cl.600	NPS 2"	316/316L	4.2 kg (9.26 lb)
Cl.600	NPS 3"	316/316L	6.2 kg (13.67 lb)

EN flanges EN 1092-1, A

Pressure rating	Type	Material	Weight
PN6	DN32	316L (1.4404)	1.2 kg (2.65 lb)
PN6	DN40	316L (1.4404)	1.4 kg (3.09 lb)
PN6	DN50	316L (1.4404)	1.6 kg (3.53 lb)
PN10/16	DN80	316L (1.4404)	4.8 kg (10.58 lb)
PN10/16	DN100	316L (1.4404)	5.6 kg (12.35 lb)
PN25/40	DN25	316L (1.4404)	1.3 kg (2.87 lb)
PN25/40	DN32	316L (1.4404)	2.0 kg (4.41 lb)
PN25/40	DN40	316L (1.4404)	2.4 kg (5.29 lb)
PN25/40	DN50	316L (1.4404)	3.2 kg (7.06 lb)
PN25/40	DN65	316L (1.4404)	4.3 kg (9.48 lb)
PN25/40	DN80	316L (1.4404)	5.9 kg (13.01 lb)
PN25/40	DN100	316L (1.4404)	7.5 kg (16.54 lb)
PN40	DN50	316L (1.4404)	3.2 kg (7.06 lb)
PN100	DN50	316L (1.4404)	5.5 kg (12.13 lb)

EN flanges EN 1092-1, B1

Pressure rating	Type	Material	Weight
PN6	DN32	316L (1.4404)	1.2 kg (2.65 lb)
PN6	DN50	316L (1.4404)	1.6 kg (3.53 lb)
PN6	DN50	AlloyC22>316L	1.6 kg (3.53 lb)
PN10/16	DN100	316L (1.4404)	5.6 kg (12.35 lb)
PN10/16	DN100	AlloyC22>316L	5.6 kg (12.35 lb)
PN25/40	DN25	316L (1.4404)	1.4 kg (3.09 lb)
PN25/40	DN25	AlloyC22>316L	1.4 kg (3.09 lb)
PN25/40	DN50	316L (1.4404)	3.2 kg (7.06 lb)
PN25/40	DN50	AlloyC22>316L	3.2 kg (7.06 lb)
PN25/40	DN80	316L (1.4404)	5.9 kg (13.01 lb)
PN25/40	DN80	AlloyC22>316L	5.2 kg (11.47 lb)
PN100	DN50	316L (1.4404)	5.5 kg (12.13 lb)

EN flanges EN 1092-1, C

Type	Material	Pressure rating	Weight
DN32	316L (1.4404)	PN6	1.2 kg (2.65 lb)
DN50	316L (1.4404)	PN25/40	3.2 kg (7.06 lb)

EN flanges EN 1092-1, D

Type	Material	Pressure rating	Weight
DN32	316L (1.4404)	PN6	1.2 kg (2.65 lb)
DN50	316L (1.4404)	PN25/40	3.2 kg (7.06 lb)

EN flanges EN 1092-1, E

Type	Material	Pressure rating	Weight
DN32	316L (1.4404)	PN6	1.2 kg (2.65 lb)
DN50	316L (1.4404)	PN25/40	3.2 kg (7.06 lb)

JIS flanges B2220

Pressure rating	Type	Material	Weight
10K	10K 25A	316L (1.4404)	1.3 kg (2.87 lb)
10K	10K 40A	316L (1.4404)	1.5 kg (3.31 lb)
10K	10K 50A	316L (1.4404)	1.7 kg (3.75 lb)
10K	10K 50A	AlloyC22>316L	1.7 kg (3.75 lb)
10K	10K 80A	316L (1.4404)	2.2 kg (4.85 lb)
10K	10K 100A	316L (1.4404)	2.8 kg (6.17 lb)

Process connection, sealing surface

- Thread ISO228, G
- Thread ASME, MNPT
- Thread EN10226, R
- Tri-Clamp ISO2852
- Flange ASME B16.5, RF (Raised Face)
- Flange ASME B16.5, FF (Flat Face)
- Flange ASME B16.5, RTJ (Ring Type Joint)
- Flange EN1092-1, Form A
- Flange EN1092-1, Form B1
- Flange EN1092-1, Form C
- Flange EN1092-1, Form D
- Flange EN1092-1, Form E
- Flange JIS B2220, RF (Raised Face)

Weight

Basic weight: 1.35 kg (2.98 lb)

The basic weight comprises:

- Sensor (compact), sensor with pipe extension
- Electronic insert
- Housing: single compartment, plastic with cover
- Thread, G ¾"

Housing

- Single compartment, aluminum, coated: 0.8 kg (1.76 lb)
- 316L cast: 2.1 kg (4.63 lb)
- Dual compartment L-shaped; aluminum coated: 1.22 kg (2.69 lb)

Temperature spacer

0.6 kg (1.32 lb)

Pressure-tight feedthrough

0.7 kg (1.54 lb)

Pipe extension

- 1 000 mm: 0.9 kg (1.98 lb)
- 100 in: 2.3 kg (5.07 lb)

Process connection

See "Process connections" section

Weather protection cover, plastic

0.2 kg (0.44 lb)

Weather protection cover, metal

0.93 kg (2.05 lb)

Materials

Materials in contact with process

Process connection and pipe extension


316L (1.4404 or 1.4435)

Tuning fork

316L (1.4435)

Optional Alloy C22 (2.4602)

Flanges

- Flanges,  mechanical construction
- Flange plating: Alloy C22 (2.4602)

Seals

Flat seal for process connection G ¾ or G 1: fiber-reinforced elastomer seal, asbestos-free according to DIN 7603



Scope of delivery with flat seal according to DIN7603

- Metric thread G ¾, G 1 standard
- Metric thread G ¾, G 1 for installation in weld-in adapter



Scope of delivery without seal

- Tri-Clamp
- Flanges
- R and NPT thread

Materials not in contact with process

Plastic housing

- Housing: PBT/PC
- Blind cover: PBT/PC
- Transparent cover: PA12
- Cover with viewing window: PBT/PC and PC
- Cover seal: EPDM
- Potential equalization: 316L
- Seal under potential equalization: EPDM
- Plug: PBT-GF30-FR
- M20 cable gland: PA
- Seal on plug and cable gland: EPDM
- Threaded adapter as replacement for cable glands: PA66-GF30
- Nameplate: plastic foil
- TAG plate: plastic foil, metal or provided by the customer

Aluminum housing, coated

- Housing: aluminum EN AC 44300
- Dummy cover: aluminum EN AC 44300
- Cover with sight glass: aluminum EN AC 44300, PC Lexan 943A synthetic glass
Cover with polycarbonate sight glass optionally available.
- Cover seal materials: HNBR
- Cover seal materials: FVMQ (only for low temperature version)
- Nameplate: plastic foil
- TAG plate: plastic foil, stainless steel or provided by customer
- M20 cable glands: select material (stainless steel, nickel-plated brass, polyamide)

Stainless steel housing, cast

- Housing: stainless steel AISI 316L (1.4409)
- Cover: AISI 316L (1.4409)
- Cover sealing materials: FVMQ (in low temperature version only)
- Cover sealing materials: HNBR
- Nameplate: stainless steel 316L
- TAG plate: plastic foil, stainless steel or provided by the customer
- Cable glands M20: select material (stainless steel, nickel-plated brass, polyamide)

Process connections

- Process connection: 316L (1.4404), optional 2.4602 (AlloyC22)
- Flanges:
 - According to EN/DIN: 316L (1.4404)
 - According to ASME: 316/316L
 - According to JIS : 316L (1.4404)
- Flange plating: AlloyC22 (2.4602)
- Flat seal for G ¾ or G 1 process connection: elastomer fiber, asbestos-free


Surface roughness

The surface roughness of the surface in contact with the process is Ra <3.2 µm (126 µin).

Mechanical construction: Density Computer FML621

Terminal Pluggable screw terminals - power supply terminal is coded. The terminal range - 1.5 mm² (16 AWG) solid, 1 mm² (18 AWG) flexible with ferrules - applies to all connections.

Dimensions

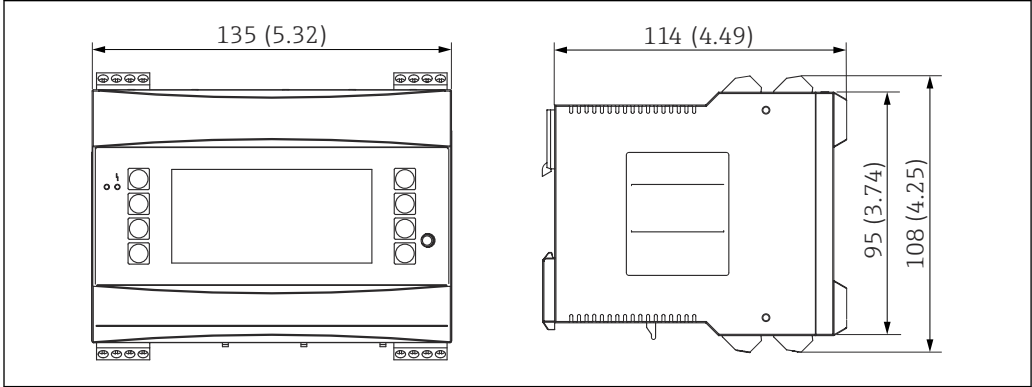


The drawing shows two views of the device. The front view on the left has a width of 135 (5.32) mm. The side view on the right has a depth of 114 (4.49) mm, a height of 95 (3.74) mm, and a total height including the base of 108 (4.25) mm. The device is designed for DIN rail mounting.

45 Housing for DIN rail as per IEC 60715. Unit of measurement mm (in)

A0039709

Slots with extension cards

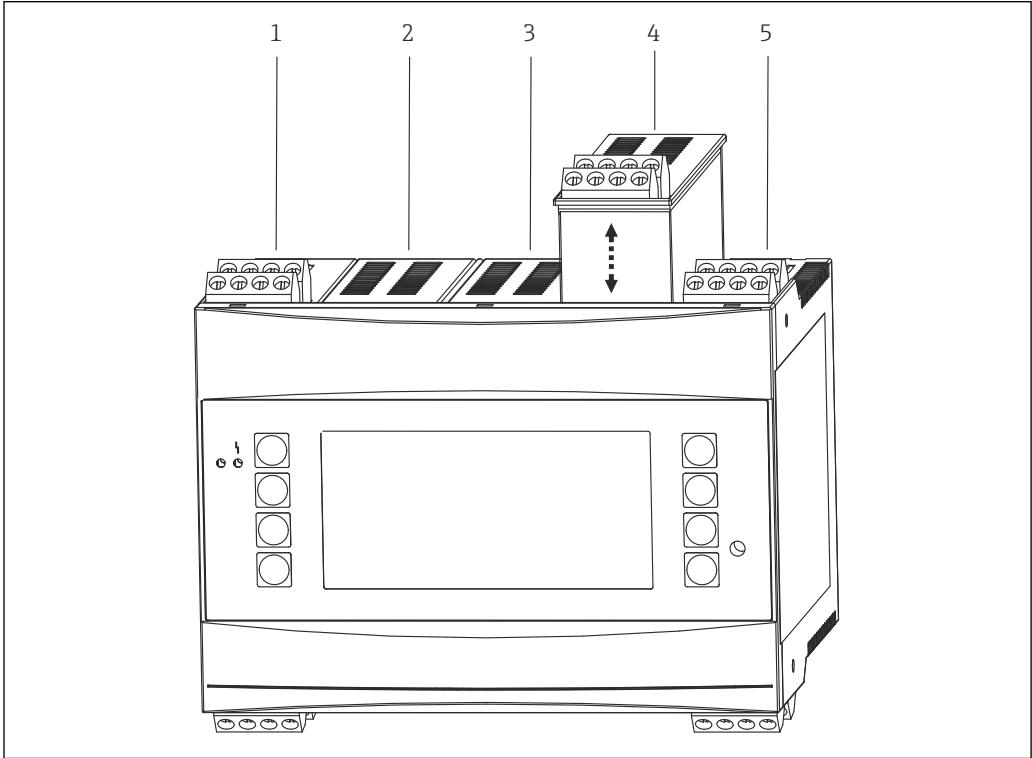

The drawing shows the device with five extension cards installed in slots 1 through 5. Slot 1 is on the left, slot 2 is in the middle, slot 3 is on the right, slot 4 is on the top right, and slot 5 is on the bottom right. The cards are labeled 1 through 5.

46 Device with additional extension cards

1 Slot A, extension card (already included in basic unit)
2 Slot B, extension card (optional or available as accessory)
3 Slot C, extension card (optional or available as accessory)
4 Slot D, extension card (optional or available as accessory)
5 Slot E, extension card (already included in basic unit)

A0039710

Weight **Basic unit:**
500 g (17.6 oz) Weight with all additional extension cards.
Remote operating unit:
300 g (10.6 oz).

Materials **Housing:**
Polycarbonate plastic, UL 94V0

Operability: Density Computer FML621



- An operating and display unit can also be used for commissioning the Density Computer FML621.
- The operating and display unit can also be used for multiple devices.
- An operating and display unit is absolutely essential for field adjustment.

Display elements

Display


160x80 dot-matrix LCD with blue backlight. In the event of an error, the color of the backlight changes to red. It is possible to configure the background color.

LED status indicator

- Operation: 1 x green 2 mm (0.08 in)
- Fault signal: 1 x red 2 mm (0.08 in)


Operating and display unit - optional or as an accessory

- In addition, a display and operating unit with the following dimensions can be connected to the device in the panel-mounted housing:
 - B: 144 mm (5.67 in)
 - H: 72 mm (2.83 in)
 - D: 43 mm (1.69 in)
- Connection to the integrated RS484 interface is performed using the connection cable (length = 3 m (9.84 ft)), which is included in the accessory kit.
- It is possible to operate the operating and display unit in parallel with a device-internal display in the FML621.

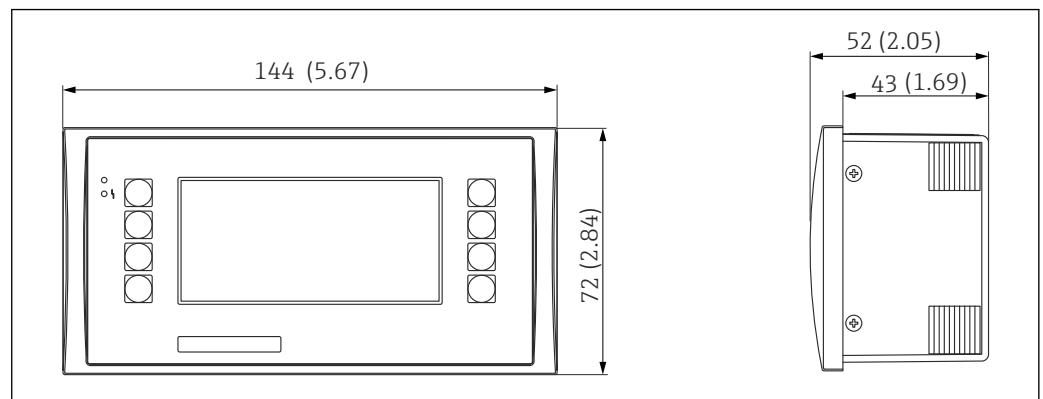

A0039711

47 Operating and display unit for panel mounting. Unit of measurement mm (in)

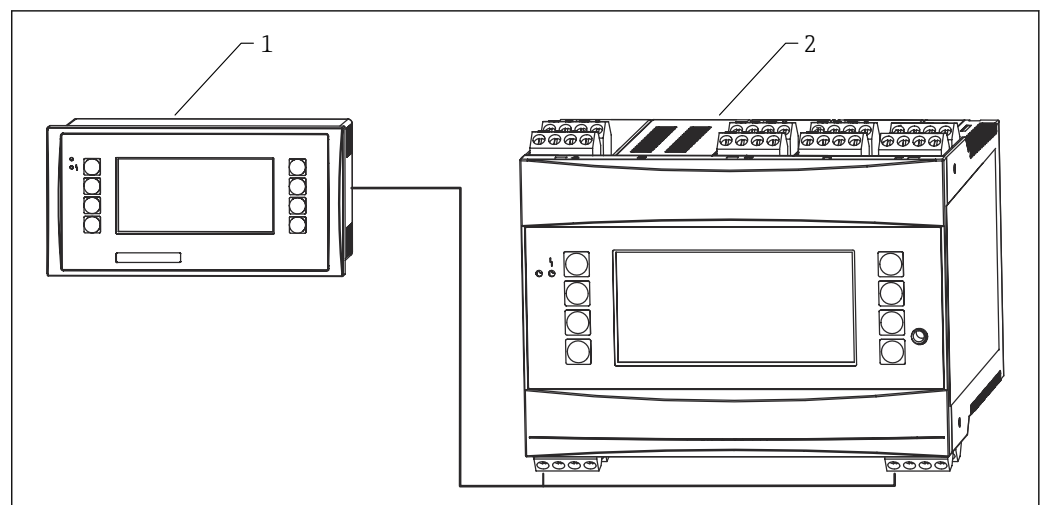

A0039717

48 Operating and display unit in panel-mounted housing

- 1 Operating or display unit
- 2 Basic unit

Operating elements	Eight soft keys at the front are used to interact with the display. The functions of the keys are shown on the display.
Remote operation	<ul style="list-style-type: none"> ■ RS232 interface via mini jack plug socket 3.5 mm (0.14 in), configuration using a PC and ReadWin® 2000 PC software ■ RS485 interface
Real-time clock	<ul style="list-style-type: none"> ■ Deviation: 30 min per year ■ Power reserve: 14 days

Certificates and approvals

CE mark	<p>The measuring system meets the legal requirements of the applicable EU Directives. These are listed in the corresponding EU Declaration of Conformity along with the standards applied.</p> <p>Endress+Hauser confirms that the device has been successfully tested by applying the CE mark.</p>
Ex approval	<p>For available Ex approvals, see Product Configurator.</p> <p>All explosion protection data are listed in a separate document, which is available on request.</p>
Other standards and guidelines	<p>IEC 60529 Degrees of protection provided by enclosures (IP code)</p> <p>IEC 61010 Safety requirements for electrical equipment for measurement, control and laboratory use</p> <p>EN 61326 series EMC product family standard for electrical equipment for measurement, control and laboratory use</p> <p>NAMUR User association of automation technology in process industries</p>

Ordering information

Detailed ordering information is available from your nearest sales organization www.addresses.endress.com or in the Product Configurator at www.endress.com:

1. Select the product using the filters and search field.
2. Open the product page.
3. Select **Configuration**.



Product Configurator - the tool for individual product configuration

- Up-to-the-minute configuration data
- Depending on the device: Direct input of measuring point-specific information such as measuring range or operating language
- Automatic verification of exclusion criteria
- Automatic creation of the order code and its breakdown in PDF or Excel output format
- Ability to order directly in the Endress+Hauser Online Shop

TAG	<p>Measuring point (TAG)</p> <p>The device can be ordered with a tag name.</p> <p>Location of tag name</p> <p>Select in the additional specification:</p> <ul style="list-style-type: none"> ■ Stainless steel wired-on tag plate ■ Plastic foil ■ Plate provided ■ RFID TAG
------------	--

- RFID TAG + stainless steel wired-on tag plate
- RFID TAG + plastic foil
- RFID TAG + plate provided

Definition of tag name

Specify in the additional specification:
3 lines with a maximum of 18 characters per line
The specified tag name appears on the selected plate and/or on the RFID TAG.

Test reports, declarations and inspection certificates

All test reports, declarations and inspection certificates are provided electronically in the *Device Viewer*:
Enter the serial number from the nameplate (www.endress.com/deviceviewer)



Product documentation on paper

Test reports, declarations and inspection certificates in hard copy can optionally be ordered with feature 570 "Service", Version I7 "Product documentation on paper". The documents are then provided with the device upon delivery.


Accessories for Liquiphant Density

Device Viewer

All the spare parts for the device, along with the order code, are listed in the *Device Viewer* (www.endress.com/deviceviewer).

Weather protection cover for dual compartment housing, aluminum


- Material: stainless steel 316L
- Order number: 71438303

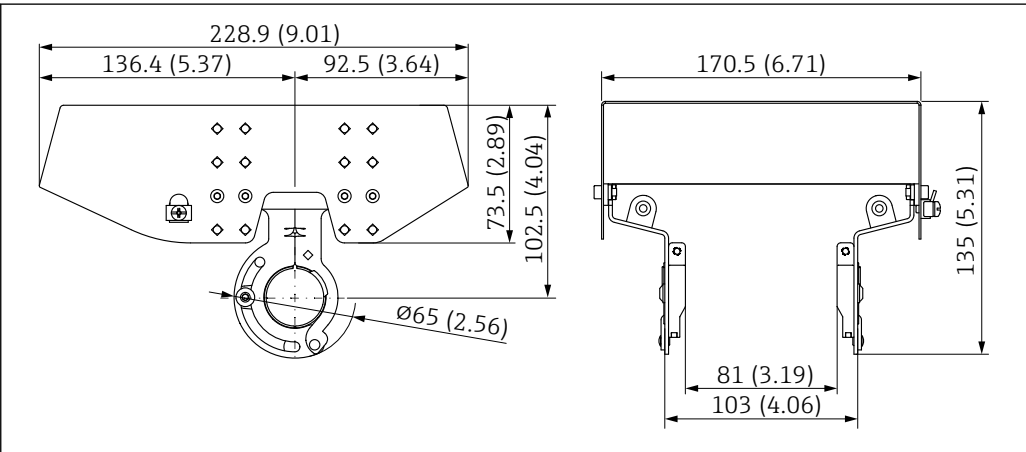

49 Weather protection cover for dual compartment housing, aluminum. Unit of measurement mm (in)

Weather protection cover for single compartment housing, aluminum or 316L, cast

- Material: plastic
- Order number: 71438291

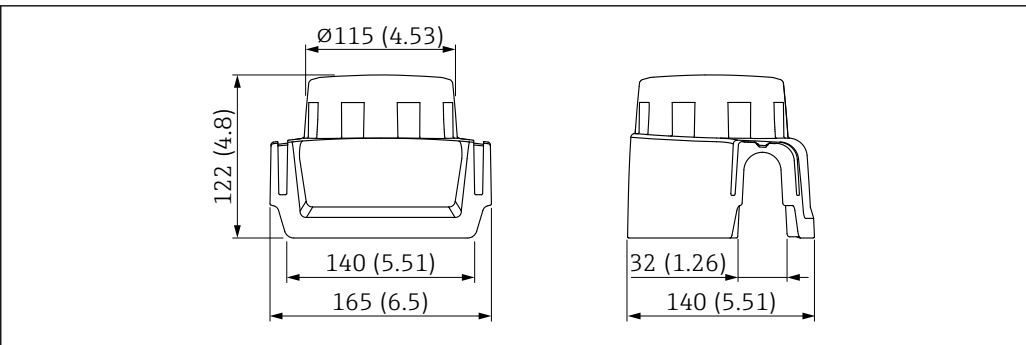

50 Weather protection cover for single compartment housing made of aluminum or 316L, cast. Unit of measurement mm (in)

M12 socket

i The M12 sockets listed are suitable for use in the temperature range
–25 to +70 °C (–13 to +158 °F).

M12 socket IP69

- Terminated at one end
- Angled
- 5 m (16 ft) PVC cable (orange)
- Slotted nut 316L (1.4435)
- Body: PVC
- Order number: 52024216


M12 socket IP67

- Angled
- 5 m (16 ft) PVC cable (gray)
- Slotted nut Cu Sn/Ni
- Body: PUR
- Order number: 52010285

Sliding sleeves for unpressurized operation

i Not suitable for use in explosive atmospheres.

For installation from above and immersion in the liquid for density measurement.

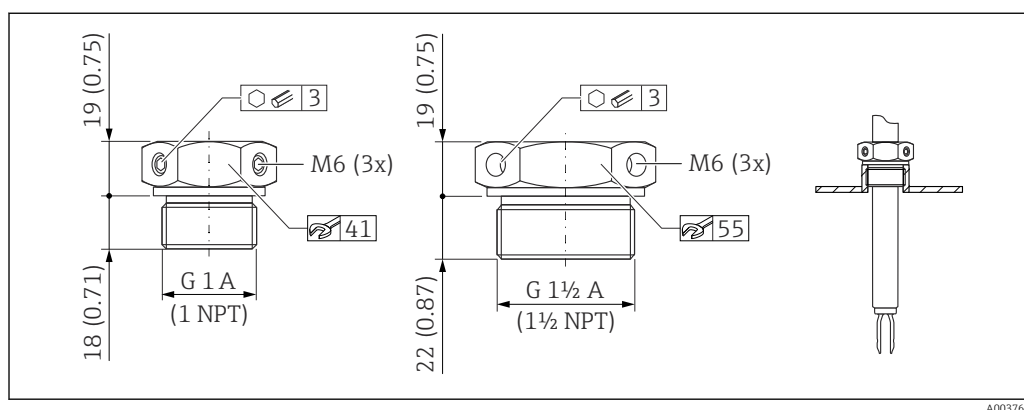

51 Sliding sleeves for unpressurized operation $p_e = 0$ bar (0 psi). Unit of measurement mm (in)

G 1, DIN ISO 228/1

- Material: 1.4435 (AISI 316L)
- Weight: 0.21 kg (0.46 lb)
- Order number: 52003978
- Order number: 52011888, approval: with inspection certificate EN 10204 - 3.1 material

NPT 1, ASME B 1.20.1

- Material: 1.4435 (AISI 316L)
- Weight: 0.21 kg (0.46 lb)
- Order number: 52003979
- Order number: 52011889, approval: with inspection certificate EN 10204 - 3.1 material

G 1 1/2, DIN ISO 228/1


- Material: 1.4435 (AISI 316L)
- Weight: 0.54 kg (1.19 lb)
- Order number: 52003980
- Order number: 52011890, approval: with inspection certificate EN 10204 - 3.1 material

NPT 1 1/2, ASME B 1.20.1

- Material: 1.4435 (AISI 316L)
- Weight: 0.54 kg (1.19 lb)
- Order number: 52003981
- Order number: 52011891, approval: with inspection certificate EN 10204 - 3.1 material

High pressure sliding sleeves

- For installation from above and immersion in the liquid for density measurement
- Suitable for max. process pressure 100 bar (1 450 psi)
- For use in hazardous areas
- Seal package made of graphite
- For G 1, G 1½: seal is included in the delivery

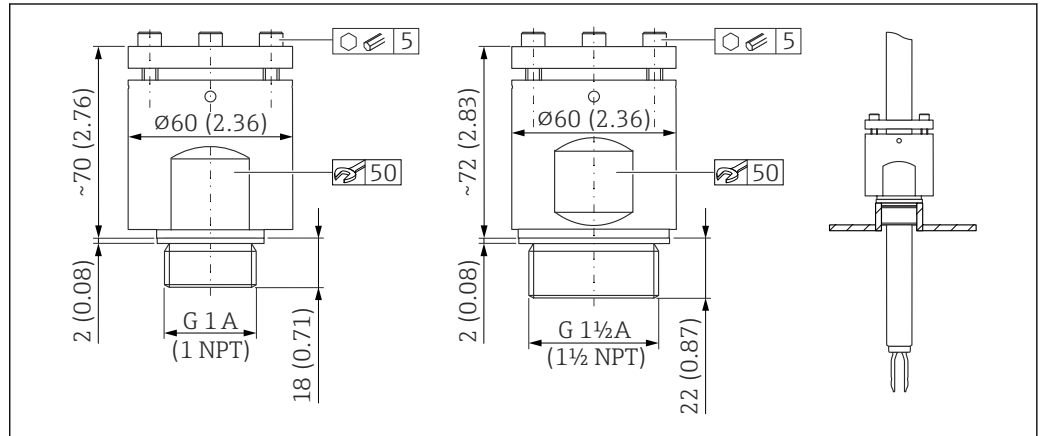

52 High pressure sliding sleeves. Unit of measurement mm (in)

G 1, DIN ISO 228/1

- Material: 1.4435 (AISI 316L)
- Weight: 1.13 kg (2.49 lb)
- Order number: 52003663
- Order number: 52011880, approval: with inspection certificate EN 10204 - 3.1 material

G 1, DIN ISO 228/1

- Material: AlloyC22
- Weight: 1.13 kg (2.49 lb)
- Approval: with inspection certificate EN 10204 - 3.1 material
- Order number: 71118691

NPT 1, ASME B 1.20.1

- Material: 1.4435 (AISI 316L)
- Weight: 1.13 kg (2.49 lb)
- Order number: 52003667
- Order number: 52011881, approval: with inspection certificate EN 10204 - 3.1 material

NPT 1, ASME B 1.20.1

- Material: AlloyC22
- Weight: 1.13 kg (2.49 lb)
- Approval: with inspection certificate EN 10204 - 3.1 material
- Order number: 71118694

G 1½, DIN ISO 228/1

- Material: 1.4435 (AISI 316L)
- Weight: 1.32 kg (2.91 lb)
- Order number: 52003665
- Order number: 52011882, approval: with inspection certificate EN 10204 - 3.1 material

G 1½, DIN ISO 228/1

- Material: AlloyC22
- Weight: 1.32 kg (2.91 lb)
- Approval: with inspection certificate EN 10204 - 3.1 material

NPT 1½, ASME B 1.20.1

- Material: 1.4435 (AISI 316L)
- Weight: 1.32 kg (2.91 lb)
- Order number: 52003669
- Order number: 52011883, approval: with inspection certificate EN 10204 - 3.1 material

NPT 1½, ASME B 1.20.1

- Material: AlloyC22
- Weight: 1.32 kg (2.91 lb)
- Approval: with inspection certificate EN 10204 - 3.1 material
- Order number: 71118695

Accessories for Density Computer FML621

Device Viewer

All the spare parts for the device, along with the order code, are listed in the *Device Viewer* (www.endress.com/deviceviewer).

General

RXU10-A1

Cable set for Density Computer FML621 for connecting to a PC or modem

FML621A-AA

Remote display for panel mounting:

- B: 144 mm (5.67 in)
- H: 72 mm (2.83 in)
- T: 43 mm (1.69 in)

RMS621A-P1

PROFIBUS interface

51004148

Adhesive label, printed, max. 2 x 16 characters

51002393

Metal sign for TAG number

51010487

Sign, paper, TAG 3 x 16 characters

Extension cards

The device can be extended with a maximum of three universal or digital or current or Pt100 cards.

FML621A-DA

Digital

- 6 x digital input
- 6 x relay output
- Kit with terminals and fixing frame

FML621A-DB

Digital, ATEX-approved

- 6 x digital input
- 6 x relay output
- Kit with terminals

FML621A-CA

2x U, I, TC

- 2x 0 to 20 mA or 4 to 20 mA per pulse
- 2x digital
- 2x SPST relay

FML621A-CB

Multifunction, 2x U, I, TC ATEX

- 2x 0 to 20 mA or 4 to 20 mA per pulse
- 2x digital
- 2x SPST relay

FML621A-TA

Temperature (Pt100/Pt500/Pt1000)

Complete, including terminals and securing frame

FML621A-TB

Temperature, ATEX-approved (Pt100/PT500/PT1000)

Complete, including terminals

FML621A-UA

Universal - PFM or pulse or analog or transmitter power supply

Complete, including terminals and securing frame

FML621A-UB

Universal ATEX-approved - PFM or pulse or analog or transmitter power supply
Complete, including terminals

PROFINET® Interface

Order code RMS621A-P2

Supplementary documentation



The certificates, approvals and other documentation currently available can be accessed as follows:

Endress+Hauser website: www.endress.com → Downloads.

Standard documentation

Document type: Operating Instructions (BA)

Installation and initial commissioning – contains all the functions in the operating menu that are needed for a normal measuring task. Functions beyond this scope are not included.

Document type: Brief Operating Instructions (KA)

Quick guide to the first measured value – includes all essential information from incoming acceptance to electrical connection.

Document type: Safety Instructions, certificates

Depending on the approval, Safety Instructions are also supplied with the device, e.g. XA. This documentation is an integral part of the Operating Instructions.

The nameplate indicates the Safety Instructions (XA) that are relevant to the device.

**Supplementary device-
dependent documentation**

Special Documentation

- SD02398F: Sliding sleeve for Liquiphant (Installation Instructions)
- SD01622P: Weld-in adapter (Installation Instructions)
- TI00426F: Adapter and flanges (overview)



www.addresses.endress.com
