

Safety Instructions

Liquiphant FTL64

ATEX, IECEx: Ex db ia IIC T6 Ga/Gb
Ex db ia IIC T6 Gb



Liquiphant FTL64

Table of contents

Associated documentation	4
Supplementary documentation	4
Certificates and declarations	4
Certificate holder	5
Other standards	5
Extended order code	5
Safety instructions: General	9
Safety instructions: Special conditions	9
Safety instructions: Installation	11
Safety instructions: Zone 0	12
Safety instructions: Zone separation Zone 0, Zone 1	13
Explosion protection with heat insulation	13
Temperature tables	13
Connection data	18

Associated documentation

All documentation is available on the Internet:
www.endress.com/Deviceviewer
(enter the serial number from the nameplate).



If not yet available, a translation into EU languages can be ordered.

To commission the device, please observe the Operating Instructions pertaining to the device:

BA02037F

Supplementary documentation

Explosion protection brochure: CP00021Z

The explosion protection brochure is available on the Internet:
www.endress.com/Downloads

Certificates and declarations**EU Declaration of Conformity**

Declaration Number:
EC00721

The EU Declaration of Conformity is available on the Internet:
www.endress.com/Downloads

EU type-examination certificate

Certificate number:
KIWA 19ATEX0017X

List of applied standards: See EU Declaration of Conformity.

IEC Declaration of Conformity

Certificate number:
IECEX KIWA 19.0010X

Affixing the certificate number certifies conformity with the following standards (depending on the device version):

- IEC 60079-0 : 2017
- IEC 60079-1 : 2014
- IEC 60079-11 : 2011
- IEC 60079-26 : 2021

Certificate holder	Endress+Hauser SE+Co. KG Hauptstraße 1 79689 Maulburg, Germany Address of the manufacturing plant: See nameplate.
Other standards	Among other things, the following standards shall be observed in their current version for proper installation: <ul style="list-style-type: none"> ■ IEC/EN 60079-14: "Explosive atmospheres - Part 14: Electrical installations design, selection and erection" ■ EN 1127-1: "Explosive atmospheres - Explosion prevention and protection - Part 1: Basic concepts and methodology"
Extended order code	The extended order code is indicated on the nameplate, which is affixed to the device in such a way that it is clearly visible. Additional information about the nameplate is provided in the associated Operating Instructions.

Structure of the extended order code

FTL64	-	*****	+	A*B*C*D*E*F*G*..
<i>(Device type)</i>		<i>(Basic specifications)</i>		<i>(Optional specifications)</i>

* = Placeholder

At this position, an option (number or letter) selected from the specification is displayed instead of the placeholders.

Basic specifications

The features that are absolutely essential for the device (mandatory features) are specified in the basic specifications. The number of positions depends on the number of features available. The selected option of a feature can consist of several positions.

Optional specifications

The optional specifications describe additional features for the device (optional features). The number of positions depends on the number of features available. The features have a 2-digit structure to aid identification (e.g. JA). The first digit (ID) stands for the feature group and consists of a number or a letter (e.g. J = Test, Certificate). The second digit constitutes the value that stands for the feature within the group (e.g. A = 3.1 material (wetted parts), inspection certificate).

More detailed information about the device is provided in the following tables. These tables describe the individual positions and IDs in the extended order code which are relevant to hazardous locations.

Extended order code: Liquiphant



The following specifications reproduce an extract from the product structure and are used to assign:

- This documentation to the device (using the extended order code on the nameplate).
- The device options cited in the document.

Device type



FTL64

Basic specifications

Position 1, 2 (Approval)		
Selected option		Description
FTL64	BB ¹⁾	ATEX II 1/2 G Ex db ia IIC T6...T1 Ga/Gb ATEX II 2 G Ex db ia IIC T6...T1 Gb IECEX Ex db ia IIC T6...T1 Ga/Gb IECEX Ex db ia IIC T6...T1 Gb

- 1) In connection with Position 3, 4 = A8 and Optional specification, ID Nx, Ox = NG:
The temperature classes change to T4...T1

Position 3, 4 (Output)		
Selected option		Description
FTL64	A7	FEL67, 2-wire PFM + test button
	A8	FEL68, 2-wire NAMUR + test button
	GA	FEL60D, density/concentration



Position 6 (Housing, Material)		
Selected option		Description
FTL64	A	Single compartment; plastic
	B	Single compartment; Alu, coated
	C	Single compartment; 316L, cast
	M	Dual compartment L-shape; Alu, coated
<p> Shown in the temperature tables exemplary as follows:</p> 		

Position 7 (Electrical Connection)		
Selected option		Description
FTL64	A	Gland M20, plastic, IP66/68 NEMA Type 4X/6P
	B ¹⁾	Gland M20, brass nickel plated, IP66/68 NEMA Type 4X/6P
	C ²⁾	Gland M20, 316L, IP66/68 NEMA Type 4X/6P
	F	Thread M20, IP66/68 NEMA Type 4X/6P
	G	Thread G1/2, IP66/68 NEMA Type 4X/6P
	H ³⁾	Thread NPT1/2, IP66/68 NEMA Type 4X/6P
	I ⁴⁾	Thread NPT3/4, IP66/68 NEMA Type 4X/6P
	M ⁴⁾	Plug M12, IP66/67 NEMA Type 4X
	Y	Special version: Thread NPT1/2, IP66/68 NEMA Type 4X/6P

- 1) Only in connection with Position 6 = B, M
- 2) Only in connection with Position 6 = B, C
- 3) Only in connection with Position 6 = A
- 4) Only in connection with Position 6 = B, C, M

Position 8 (Application)		
Selected option		Description
FTL64	D	Process max 280°C/536°F, max 100bar
	E	Process max 230°C/446°F, max 100bar
	R	Process max 230°C/446°F, max 40bar (PFA)
	9	Special version: Process max 300°C/572°F, max 100bar

Position 9 (Surface Refinement)		
Selected option		Description
FTL64	A	Standard Ra<3,2um/126uin
	R	Coating PFA (conductive)
	Y	Coating ECTFE, PFA (Edlon, RubyRed), Enamel

Position 10 (Type of Probe)		
Selected option		Description
FTL64	1	Compact version
	2	Extension tube
 Shown in the temperature tables exemplary as follows:		

Optional specifications

ID Jx, Kx (Test, Certificate, Declaration)		
Selected option		Description
FTL64	JL ¹⁾	Ambient temperature -50°C/-58°F
	JN ¹⁾	Ambient temperature -52°C/-62°F

- 1) Only in connection with Position 6 = B, C, M, Position 7 = B, C, F, G, I, Y

ID Nx, Ox (Accessory Mounted)		
Selected option		Description
FTL64	NF ¹⁾	Bluetooth VU121, Labeling: VA13-02
	NG ²⁾	Prepared for Heartbeat Verification + Monitoring + Bluetooth VU121, Labeling: VA13-01

- 1) Only in connection with Position 3, 4 = A7, Position 6 = A, B, M
 2) Only in connection with Position 3, 4 = A8, Position 6 = A, B, M

ID Px, Rx (Accessory Enclosed)		
Selected option		Description
FTL64	PA ¹⁾	Weather protection cover, 316L
	PB ²⁾	Weather protection cover, plastic
	R6 ³⁾	Test magnet


- 1) Only in connection with Position 6 = M
 2) Only in connection with Position 6 = B, C
 3) Only in connection with Position 3, 4 = A8

Safety instructions: General

- The device is intended to be used in explosive atmospheres as defined in the scope of IEC 60079-0 or equivalent national standards. If no potentially explosive atmospheres are present or if additional protective measures have been taken: The device may be operated according to the manufacturer's specifications.
- Devices suitable for zone separation (marked Ga/Gb or Da/Db) are always suitable for installation in the less critical zone (Gb or Db). Due to space limitations the corresponding marking maybe not indicated on the nameplate.
- Staff must meet the following conditions for mounting, electrical installation, commissioning and maintenance of the device:
 - Be suitably qualified for their role and the tasks they perform
 - Be trained in explosion protection
 - Be familiar with national regulations
- Install the device according to the manufacturer's instructions and national regulations.
- Do not operate the device outside the specified electrical, thermal and mechanical parameters.
- Only use the device in media to which the wetted materials have sufficient durability.
- Avoid electrostatic charging:
 - Of plastic surfaces (e.g. enclosure, sensor element, special varnishing, attached additional plates, ..)
 - Of isolated capacities (e.g. isolated metallic plates)
- Refer to the temperature tables for the relationship between the permitted ambient temperature for the sensor and/or transmitter, depending on the range of application and the temperature class.
- Alterations to the device can affect the explosion protection and must be carried out by staff authorized to perform such work by Endress+Hauser.

Safety instructions: Special conditions

Permitted ambient temperature range at the electronics enclosure:
 $-40\text{ °C} \leq T_a \leq +70\text{ °C}$

- Limitations of the maximum ambient temperature at the electronics enclosure may be required dependent on device configuration, process temperatures and temperature classification.
- Details of limitations: →  13, "Temperature tables".
- To avoid electrostatic charging: Do not rub surfaces with a dry cloth.
- In the event of additional or alternative special varnishing on the enclosure or other metal parts or for adhesive plates:
 - Observe the danger of electrostatic charging and discharge.
 - Do not install in the vicinity of processes (≤ 0.5 m) generating strong electrostatic charges.

Basic specification, Position 6 = A

Avoid electrostatic charging of the enclosure (e.g. friction, cleaning, maintenance, strong medium flow).

Basic specification, Position 6 = B, M

Avoid sparks caused by impact and friction.

Optional specification, ID Px, Rx = PA

Connect the weather protection cover to the local potential equalization.

Optional specification, ID Px, Rx = PB

Avoid electrostatic charging of the weather protection cover (e.g. friction, cleaning, maintenance, strong medium flow).

Optional specification, ID Px, Rx = R6

Suitable for use in explosion hazardous areas.

Device group IIC/IIB

Basic specification, Position 9 = R, Y (Enamel)

Due to the surface resistance $1 \text{ G}\Omega$ ($|R|$ PFA-conductive) or the enamel (glass) surface, these coatings are suitable without restrictions.

Basic specification, Position 9 = Y (ECTFE, PFA (Edlon, RubyRed))


- Probes can be used in gases of Group IIC if avoiding electrostatic charging (e.g. through friction, cleaning, maintenance, strong medium flow). These probes are marked by the warning sign "Avoid Electrostatic Charge".
- If electrostatic charging cannot be avoided: Probe can be used in gases of Group IIB.

Type of protection Ex db

The high-temperature part of the device (fork/pipe/process connection/temperature spacer) is designed in type of protection Ex db and has an Ex ia connection to the electronics insert.

The installation on the terminals of the device must always be carried out in type of protection Ex i.

Safety instructions: Installation

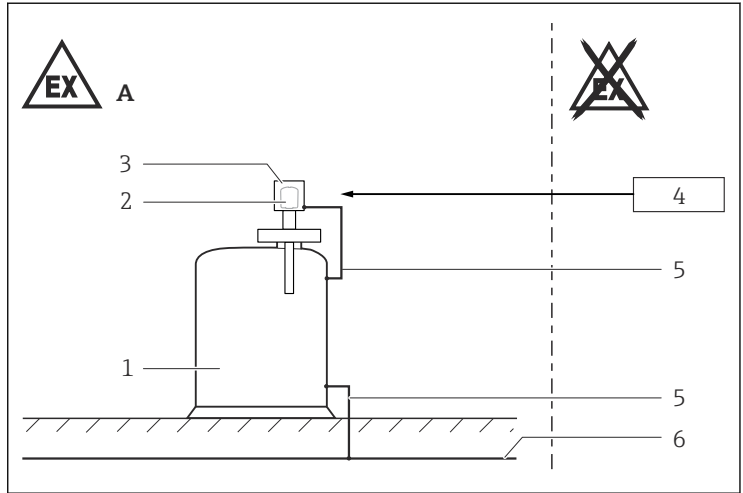

A0025536

1

A Zone 1

1 Tank; Zone 0, Zone 1

2 Electronic insert

3 Enclosure

4 Basic specification, Position 3, 4 = A7, A8:
Associated intrinsically safe power supply units
Basic specification, Position 3, 4 = GA:

Only associated intrinsically safe power supply unit FML621 from
Endress+Hauser

5 Potential equalization line

6 Local potential equalization

- When the device is connected to certified intrinsically safe circuits of Category Ex ib for Equipment Groups IIC and IIB, the type of protection changes to Ex ib IIC and Ex ib IIB.
- Continuous service temperature of the connecting cable: $\geq T_a + 20 \text{ K}$.
- Observe the pertinent guidelines when interconnecting intrinsically safe circuits.
- Observe the maximum process conditions according to the manufacturer's Operating Instructions.
- At high medium temperatures, note flange pressure load capacity as a factor of temperature.

- Install the device to exclude any mechanical damage or friction during the application. Pay particular attention to flow conditions and tank fittings.
- Support extension tube of the device if a dynamic load is expected.
- The device can be equipped with the Bluetooth® module: refer to the Operating Instructions and specifications in the "Bluetooth® module" chapter.

Accessory high pressure sliding sleeve

The high pressure sliding sleeve can be used for a continuous setting of the switch point and is suited for zone separation if mounted properly (see Operating Instructions).

Intrinsic safety

- The device is only suitable for connection to certified, intrinsically safe equipment with explosion protection Ex ia / Ex ib.
- The intrinsically safe input power circuit of the device is isolated from ground. The dielectric strength is at least $500 V_{\text{rms}}$.

Potential equalization

Integrate the device into the local potential equalization.

Optional specification, ID Px, Rx = PA

Connect the weather protection cover to the local potential equalization.

Bluetooth® module

Basic specification, Position 3, 4 = A7

If the device is equipped with the Bluetooth® module, no battery is required or allowed.

Basic specification, Position 3, 4 = A8

- If the device is equipped with the Bluetooth® module, a battery is required.
- Removal or replacement of the battery is only permitted in non-hazardous areas.
- Observe the information in the Safety Instructions (XA) included with the Bluetooth® module.

Safety instructions: Zone 0

When using under non-atmospheric pressures and non-atmospheric temperatures: The sensor part of the device approved for Zone 0 does not cause any ignition hazards.


Safety instructions:
Zone separation
Zone 0, Zone 1

The zone separation wall of the device is made of stainless steel or high corrosion-resistant alloy of thickness ≥ 1 mm.

Explosion protection with heat insulation

Basic specification, Position 8 = D, E, R, 9

- While observing the "temperature derating", the device is suitable for process temperatures up to 300 °C.
- When operating, ensure that you rule out contact between hot component surfaces and potentially explosive atmospheres beyond the limits of the corresponding temperature class. Suitable measures: e.g. thermal insulation at container and/or pipes.
- The temperature of 85 °C specified at the reference point may not be exceeded.
- To protect the electronics, observe the specified ambient temperature at the electronics enclosure.

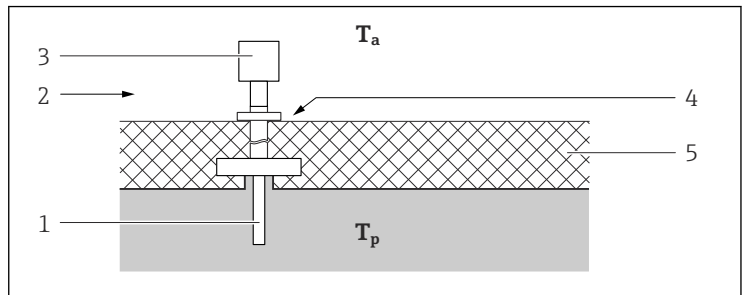

A0025541



- 2
- T_a Ambient temperature
 T_p Process temperature
 1 Sensor
 2 Temperature class, e.g. T6
 3 Enclosure
 4 Reference point: max. +85 °C
 5 E.g. thermal insulation

Temperature tables



Optional specification, ID Jx, Kx = JL

Lower limit of the ambient temperature for explosion protection changes to -50 °C.

Optional specification, ID Jx, Kx = JN

Lower limit of the ambient temperature for explosion protection changes to -52 °C.

General notes

- i** *Optional specification, ID Px, Rx = PB*
 When using the weather protection cover: Reduce the values T_a of P1, P2, P3 by 16 K.

Description notes


- i** Unless otherwise indicated, the positions always refer to the basic specification.

1st column: Position 8 = A, B, ...

2nd column: Temperature classes T6 (85 °C) to T1 (450 °C)


Column P1 to P5: Position (temperature value) on the axes of the derating

- T_a : Ambient temperature in °C
- T_p : Process temperature in °C

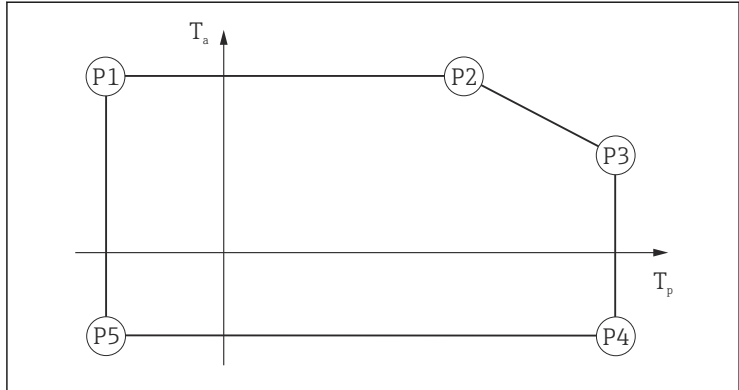

A0033052

Zone 0, Zone 1

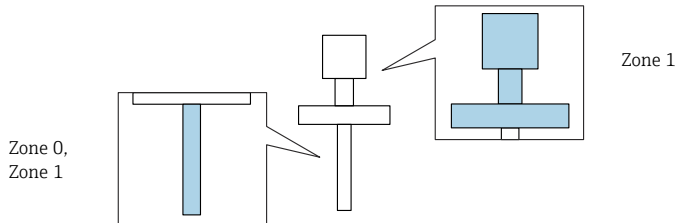

Position 3, 4 = A7

E, R		P1		P2		P3		P4		P5	
		T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a
	T6 ¹⁾	-60	70 65 ²⁾	77	70 65 ²⁾	80	70	80	-40 -50 ³⁾ -52 ⁴⁾	-60	-40 -50 ³⁾ -52 ⁴⁾
	T5 ¹⁾	-60	70 65 ²⁾	95	70 65 ²⁾	95	70	95		-60	
	T4	-60	70 65 ²⁾	130	70 65 ²⁾	130	70	130		-60	
	T3	-60	70 65 ²⁾	195	70 65 ²⁾	195	70	195		-60	
	T2...T1	-60	70 65 ²⁾	206	70 65 ²⁾	230	68	230		-60	

- 1) In connection with Position 3, 4 = A8 and Optional specification, ID Nx, Ox = NG: The temperature classes change to T4...T1
- 2) Only in connection with Position 3, 4 = A8 and Optional specification, ID Nx, Ox = NG
- 3) Only in connection with Optional specification, ID Jx, Kx = JL
- 4) Only in connection with Optional specification, ID Jx, Kx = JN

D, 9		P1		P2		P3		P4		P5	
		T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a
	T6 ¹⁾	-60	70 65 ²⁾	80	70 65 ²⁾	80	70	80	-40 -50 ³⁾ -52 ⁴⁾	-60	-40 -50 ³⁾ -52 ⁴⁾
	T5 ¹⁾	-60	70 65 ²⁾	95	70 65 ²⁾	95	70	95		-60	
	T4	-60	70 65 ²⁾	130	70 65 ²⁾	130	70	130		-60	
	T3	-60	70 65 ²⁾	195	70 65 ²⁾	195	70	195		-60	
	T2	-60	70 65 ²⁾	270	70 65 ²⁾	280 290 ⁵⁾	68	280 290 ⁵⁾		-60	
	T1	-60	70 65 ²⁾	270	70 65 ²⁾	280 300 ⁵⁾	68	280 300 ⁵⁾	-60		

- 1) In connection with Position 3, 4 = A8 and Optional specification, ID Nx, Ox = NG: The temperature classes change to T4...T1
- 2) Only in connection with Position 3, 4 = A8 and Optional specification, ID Nx, Ox = NG
- 3) Only in connection with Optional specification, ID Jx, Kx = JL
- 4) Only in connection with Optional specification, ID Jx, Kx = JN
- 5) Only in connection with Position 8 = 9

Position 3, 4 = A8

E, R		P1		P2		P3		P4		P5	
		T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a
	T6 ¹⁾	-60	70 65 ²⁾	80	70 65 ²⁾	80	70	80	-40 -50 ³⁾ -52 ⁴⁾	-60	-40 -50 ³⁾ -52 ⁴⁾
	T5 ¹⁾	-60	70 65 ²⁾	95	70 65 ²⁾	95	70	95		-60	
	T4	-60	70 65 ²⁾	130	70 65 ²⁾	130	70	130		-60	
	T3	-60	70 65 ²⁾	195	70 65 ²⁾	195	70	195		-60	
	T2...T1	-60	70 65 ²⁾	230	70 65 ²⁾	230	68	230		-60	

- 1) In connection with Position 3, 4 = A8 and Optional specification, ID Nx, Ox = NG: The temperature classes change to T4...T1
- 2) Only in connection with Position 3, 4 = A8 and Optional specification, ID Nx, Ox = NG
- 3) Only in connection with Optional specification, ID Jx, Kx = JL
- 4) Only in connection with Optional specification, ID Jx, Kx = JN

D, 9		P1		P2		P3		P4		P5	
		T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a
	T6 ¹⁾	-60	70 65 ²⁾	80	70 65 ²⁾	80	70	80	-40 -50 ³⁾ -52 ⁴⁾	-60	-40 -50 ³⁾ -52 ⁴⁾
	T5 ¹⁾	-60	70 65 ²⁾	95	70 65 ²⁾	95	70	95		-60	
	T4	-60	70 65 ²⁾	130	70 65 ²⁾	130	70	130		-60	
	T3	-60	70 65 ²⁾	195	70 65 ²⁾	195	70	195		-60	
	T2	-60	70 65 ²⁾	280	70 65 ²⁾	280 290 ⁵⁾	70	280 290 ⁵⁾		-60	
	T1	-60	70 65 ²⁾	280	70 65 ²⁾	280 300 ⁵⁾	70	280 300 ⁵⁾	-60		

- 1) In connection with Position 3, 4 = A8 and Optional specification, ID Nx, Ox = NG: The temperature classes change to T4...T1
- 2) Only in connection with Position 3, 4 = A8 and Optional specification, ID Nx, Ox = NG
- 3) Only in connection with Optional specification, ID Jx, Kx = JL
- 4) Only in connection with Optional specification, ID Jx, Kx = JN
- 5) Only in connection with Position 8 = 9

Position 3, 4 = GA

E, R		P1		P2		P3		P4		P5	
		T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a
	T6 ¹⁾	-60	62	63	62	80	60	80	-40 -50 ²⁾ -52 ³⁾	-60	-40
	T5 ¹⁾	-60	70 65 ⁴⁾	95	70 65 ⁴⁾	95	70	95		-60	-50 ²⁾ -52 ³⁾
	T4	-60	70 65 ⁴⁾	130	70 65 ⁴⁾	130	70	130		-60	
	T3	-60	70 65 ⁴⁾	195	70 65 ⁴⁾	195	70	195		-60	
	T2...T1	-60	70 65 ⁴⁾	201	70 65 ⁴⁾	230	68	230		-60	

- 1) In connection with Position 3, 4 = A8 and Optional specification, ID Nx, Ox = NG: The temperature classes change to T4...T1
- 2) Only in connection with Optional specification, ID Jx, Kx = JL
- 3) Only in connection with Optional specification, ID Jx, Kx = JN
- 4) Only in connection with Position 3, 4 = A8 and Optional specification, ID Nx, Ox = NG

D, 9		P1		P2		P3		P4		P5	
		T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a	T _p	T _a
	T6 ¹⁾	-60	62	64	62	80	61	80	-40 -50 ²⁾ -52 ³⁾	-60	-40
	T5 ¹⁾	-60	70 65 ⁴⁾	95	70 65 ⁴⁾	95	70	95		-60	-50 ²⁾ -52 ³⁾
	T4	-60	70 65 ⁴⁾	130	70 65 ⁴⁾	130	70	130		-60	
	T3	-60	70 65 ⁴⁾	195	70 65 ⁴⁾	195	70	195		-60	
	T2	-60	70 65 ⁴⁾	261	70 65 ⁴⁾	280 290 ⁵⁾	68	280 290 ⁵⁾		-60	
	T1	-60	70 65 ⁴⁾	261	70 65 ⁴⁾	280 300 ⁵⁾	68	280 300 ⁵⁾		-60	

- 1) In connection with Position 3, 4 = A8 and Optional specification, ID Nx, Ox = NG: The temperature classes change to T4...T1
- 2) Only in connection with Optional specification, ID Jx, Kx = JL
- 3) Only in connection with Optional specification, ID Jx, Kx = JN
- 4) Only in connection with Position 3, 4 = A8 and Optional specification, ID Nx, Ox = NG
- 5) Only in connection with Position 8 = 9

Connection data

Optional specification, ID Nx, Ox = NF, NG

When using the Bluetooth® module: No changes to the connection values.

Associated intrinsically safe power supply unit with max. electrical specifications below the characteristic values of the electronic inserts

<i>Basic specification, Position 3, 4</i>	Power supply circuit
A7	$U_i = 14.6 \text{ V}$ $I_i = 100 \text{ mA}$ $P_i = 633 \text{ mW}$ $L_i = 0$ $C_i = 3 \text{ nF}$
A8	$U_i = 16 \text{ V}$ $I_i = 52 \text{ mA}$ $P_i = 170 \text{ mW}$ $L_i = 0$ $C_i = 30 \text{ nF}$

Only associated intrinsically safe power supply unit FML621 from Endress+Hauser

<i>Basic specification, Position 3, 4</i>	Power supply circuit
GA	$U_i = 27.6 \text{ V}$ $I_i = 93 \text{ mA}$ $P_i = 640 \text{ mW}$ $L_i = 3 \text{ }\mu\text{H}$ $C_i = 3 \text{ nF}$



71561283

www.addresses.endress.com
