

Special Documentation

Proline Promass 300

PROFIBUS PA

Petroleum application package



Table of contents

1	About this document	4
1.1	Document function	4
1.2	Content and scope	4
1.3	Symbols used	4
1.4	Documentation	5
1.5	Registered trademarks	5
2	Product features and availability	6
2.1	Product features	6
2.2	Availability	6
3	API referenced correction	8
3.1	General principles	8
3.2	System integration	9
3.3	Commissioning	9
3.4	Additional measured variables	14
4	Net oil & water cut	17
4.1	General principles	17
4.2	System integration	18
4.3	Commissioning	18
4.4	Additional measured variables	23
5	Weighting of flow-related factors ..	26
5.1	"Weighted averages" submenu	26
6	Workflow	27

1 About this document

1.1 Document function

This manual is Special Documentation; it does not replace the Operating Instructions pertaining to the device. It serves as a reference for using the Petroleum software integrated in the measuring device.

1.2 Content and scope





This documentation contains a description of the additional parameters and technical data that are provided with the **Petroleum** application package.

It provides detailed information on:









- Application-specific parameters
- Advanced technical specifications



1.3 Symbols used

1.3.1 Safety symbols

Symbol	Meaning
	DANGER! This symbol alerts you to a dangerous situation. Failure to avoid this situation will result in serious or fatal injury.
	WARNING! This symbol alerts you to a dangerous situation. Failure to avoid this situation can result in serious or fatal injury.
	CAUTION! This symbol alerts you to a dangerous situation. Failure to avoid this situation can result in minor or medium injury.
	NOTE! This symbol contains information on procedures and other facts which do not result in personal injury.

1.3.2 Symbols for certain types of information


Symbol	Meaning
	Tip Indicates additional information.
	Reference to documentation
	Reference to page
	Reference to graphic
	Notice or individual step to be observed
	Series of steps
	Result of a step
	Operation via local display

Symbol	Meaning
	Operation via operating tool
	Write-protected parameter


1.3.3 Symbols in graphics

Symbol	Meaning
1, 2, 3 ...	Item numbers
A, B, C, ...	Views
A-A, B-B, C-C, ...	Sections

1.4 Documentation

 For an overview of the scope of the associated Technical Documentation, refer to the following:

- *W@M Device Viewer* (www.endress.com/deviceviewer): Enter the serial number from nameplate
- *Endress+Hauser Operations App*: Enter the serial number from the nameplate or scan the 2D matrix code (QR code) on the nameplate

 This Special Documentation is available:

- On the CD-ROM supplied with the device (depending on the device version ordered)
- In the Download Area of the Endress+Hauser Internet site: www.endress.com → Downloads

This documentation is an integral part of the following Operating Instructions:

Measuring device	Documentation code
Promass E 300	BA01506D
Promass F 300	BA01507D
Promass O 300	BA01510D
Promass Q 300	BA01512D
Promass X 300	BA01514D

1.5 Registered trademarks

PROFIBUS®

Registered trademark of the PROFIBUS User Organization, Karlsruhe, Germany

2 Product features and availability

2.1 Product features

The "**Petroleum**" application package provides specific algorithms together with device variables and external inputs for calculating additional parameters, options and measured variables, which are then available to the user.

The following three functions are available with the application package:

- **API referenced correction**

Corrections for the corrected volume and reference density, calculated and based on the API MPMS, Chapter 11 Section 1 "Temperature and Pressure Volume Correction Factors for Generalized Crude Oils, Refined Products, and Lubricating Oils", and Chapter 11 Section 2 Part 4 "Temperature Correction for the Volume of NGL and LPG Tables 23E, 24E, 53E, 95E [sic], and 60E" . → 📖 8

- **Net oil & water cut**

Determines the net oil and water content based on the density values of the measuring device or on the oil/water contents measured by an external measuring device. Performed in accordance with API MPMS, Chapter 20 Section 1 "Allocation Measurement". All the corrections to the volume and density are performed in accordance with API MPMS, Chapter 11 Section 1 "Temperature and Pressure Volume Correction Factors for Generalized Crude Oils, Refined Products, and Lubricating Oils", and Chapter 11 Section 2 Part 4 "Temperature Correction for the Volume of NGL and LPG Tables 23E, 24E, 53E, 95E [sic], and 60E" → 📖 17

- **Weighting of flow-related variables**

Re-settable flow weighted averages for both density and temperature based on API MPMS Chapter 12 Section 2 Part 2 - "Measurement Tickets" → 📖 26

2.2 Availability

The **Petroleum** application package can be ordered directly with the device.

It is available subsequently via an activation code. Detailed information on the order code in question is available from your local Endress+Hauser sales center or on the product page of the Endress+Hauser website: www.endress.com.

The availability of the **Petroleum** application package with the **EJ** option can be checked as follows:

- Order code with breakdown of the device features on the delivery note
- In the W@M Device Viewer (www.endress.com/deviceviewer)
Enter the serial number from the nameplate and check in the device information whether the option **EJ** "Petroleum" appears under the order code for "Application packages".
- In the operating menu:
The software options currently enabled are displayed in the **Software option overview** parameter.
Expert → System → Administration

2.2.1 Order code for

If ordering directly with the device or subsequently as a retrofit kit:
Order code for "Application packages", option **EJ** "Petroleum"

2.2.2 Activation

A retrofit kit is supplied if the application package is ordered subsequently.

This kit includes a tag plate with device data and an activation code.



For details, see Installation Instructions EA001164D

2.2.3 Access

The application package is compatible with all the system integration options. Interfaces with digital communication are required to access the data saved in the device. The speed of data transmission depends on the type of communication interface used.

3 API referenced correction

3.1 General principles

With the API referenced correction function in the "Petroleum" application package, the measuring device can calculate the corrected volume flow and standard density in compliance with the guidelines set down in the API MPMS, Chapter 11 Section 1 "Temperature and Pressure Volume Correction Factors for Generalized Crude Oils, Refined Products, and Lubricating Oils" and Chapter 11 Section 2 Part 4 "Temperature Correction for the Volume of NGL and LPG Tables 23E, 24E, 53E, 95E [sic], and 60E".

Promass measuring devices measure both the mass flow and the density of a fluid under controlled conditions. Using these measured values, the volume flow can be calculated by dividing the mass flow by the density.

When the fluid temperature changes, the density and volume also change. Therefore it is necessary to correct the volume flow back to standard conditions. Here, the temperature and pressure are corrected back to target values.

The fluid temperature must be known to be able to correct to standard or reference conditions. Given that all Promass measuring devices measure the temperature, this value can be used for the correction process. However, API MPMS Chapter 5 Section 6 explicitly advises against such an approach; it is also not the standard practice in many custody transfer applications and other applications. Therefore, an external source can provide a temperature to the measuring device in order to calculate the correction value. All users must understand the application and the requirements before they use the internal measured value and must know whether this is acceptable.

In order to correct volumes and densities from observed to standard or reference conditions based on the effect of pressure on the liquid (CPL) the meter must know the fluid pressure. As there is no internal pressure measurement, if a user wants to correct this effect the pressure must be either fixed statically in the meter or provided as an input from an external source.

Key parameters must be configured before the "Petroleum" application package is fully operational. In addition to configuring the pressure and temperature sources, it is necessary to select the API commodity group based on the process fluid as well as the API table number for which the reference or standard conditions should apply.

The options available in the **API commodity group** parameter and in the **API table selection** parameter are described in the following section.

API commodity group parameter with the API commodity group and the associated process fluid:

- A - crude oil
- B - refined products
- C - special applications
- D - lubricating oils
- E - NGL/LPG

The following must be considered when selecting the option in the **API commodity group** parameter:

- The calculation and correction of the corrected volume and standard density depend on the process fluid selected.
- If the **C - special applications** option is selected, the thermal expansion coefficient of the fluid must be specified.
- The calculations and corrections programmed into the device do not apply for the following media:
 - LNG
 - Ethylene
 - Butadiene
 - Cyclohexane
 - Aromas
 - Asphalts
 - Road tars



Options available in the "API table selection" parameter



API table selection	Unit	Standard conditions
API table 5/6	API°	60°F & 0 psi(g)
API table 23/24	SGU	60°F & 0 psi(g)
API table 53/54	kg/m ³	15°C & 0 kPa(g)
API table 59/60	kg/m ³	20°C & 0 kPa(g)

3.2 System integration

Additional measured variables are available with the **Petroleum** application package and the **API referenced correction** option selected in the **Petroleum mode** parameter.

- Reference density alternative
- GSV flow
- GSV flow alternative
- NSV flow
- NSV flow alternative
- S&W volume flow




 Overview of the extended range of measured variables available with the **Petroleum** application package: →  14

 For detailed information on system integration, see the Operating Instructions for the device →  5

3.3 Commissioning

3.3.1 Configuring the measuring device

Configuration of the measuring device if the **API referenced correction** option is selected



1. Start with the **Petroleum** submenu →  9
2. Configure the outputs →  14
3. Read out the measured values →  14


Navigation


"Advanced setup" submenu → Petroleum

▶ Petroleum	
Petroleum mode (4187)	→ 11
API commodity group (4151)	→ 11
API table selection (4152)	→ 11
Thermal expansion coefficient (4153)	→ 12
Alternative pressure value (4155)	→ 12
Alternative temperature value (4154)	→ 12
Pressure compensation (6130)	→ 12
Pressure value (6059)	→ 12
External pressure (6209)	→ 12
Temperature correction source (6184)	→ 13
External temperature (6080)	→ 13
Shrinkage factor (4167)	→ 13
S&W input mode (4189)	→ 13
S&W (4156)	→ 13
S&W correction value (4194)	→ 14
Meter factor (4198)	→ 14

Parameter overview with brief description

Parameter	Prerequisite	Description	Selection / User entry / User interface	Factory setting
Petroleum mode	–	Select petroleum mode. If the API referenced correction option is selected, the Corrected volume flow parameter and the Reference density unit parameter are calculated in accordance with the guidelines in the API MPMS, Chapter 11 Section 1 "Temperature and Pressure Volume Correction Factors for Generalized Crude Oils, Refined Products, and Lubricating Oils", and Chapter 11 Section 2 Part 4 "Temperature Correction for the Volume of NGL and LPG Tables 23E, 24E, 53E, 95E [sic], and 60E".	<ul style="list-style-type: none"> ■ Off ■ API referenced correction 	Off
API commodity group	–	Select API commodity group of the measured medium.  For additional information, see the API MPMS, Chapter 11 Section 1 "Temperature and Pressure Volume Correction Factors for Generalized Crude Oils, Refined Products, and Lubricating Oils", and Chapter 11 Section 2 Part 4 "Temperature Correction for the Volume of NGL and LPG Tables 23E, 24E, 53E, 95E [sic], and 60E".	<ul style="list-style-type: none"> ■ A - crude oil ■ B - refined products* ■ C - special applications ■ D - lubricating oils* ■ E - NGL / LPG* 	A - crude oil
API table selection	–	Select reference density by API table. Use this function to select the API table according to the desired values for the reference temperature and pressure.  For additional information, see the API MPMS, Chapter 11 Section 1 "Temperature and Pressure Volume Correction Factors for Generalized Crude Oils, Refined Products, and Lubricating Oils", and Chapter 11 Section 2 Part 4 "Temperature Correction for the Volume of NGL and LPG Tables 23E, 24E, 53E, 95E [sic], and 60E".	<ul style="list-style-type: none"> ■ API table 5/6* ■ API table 23/24 ■ API table 53/54 ■ API table 59/60 	API table 53/54

Parameter	Prerequisite	Description	Selection / User entry / User interface	Factory setting
Thermal expansion coefficient	The C - special applications option is selected in the API commodity group parameter	Enter the thermal expansion coefficient of the measured medium.	$414 \cdot 10^{-6}$ to $1674 \cdot 10^{-6}$ 1/K	$414 \cdot 10^{-6}$ 1/K
Alternative pressure value	The API referenced correction option is selected in the Petroleum mode parameter.	Enter an alternative user-defined pressure value. The volume and density are corrected with this value. The value specified is an alternative value to the reference pressure in the table selected in the API table selection parameter.	1.01325 to 104.434 60935 bar	1.01325 bar
Alternative temperature value	The API referenced correction option is selected in the Petroleum mode parameter.	Enter an alternative user-defined temperature value. The volume and density are corrected with this value. The value specified is an alternative value to the reference temperature in the table selected in the API table selection parameter.	-46 to 93 °C	29.5 °C
Pressure compensation	–	Select pressure compensation type. If the effect of pressure on the volume and density of the fluid is to be corrected, the type of pressure compensation can be selected here.  Pressure compensation can be deactivated if it is not needed for the application. If pressure compensation is deactivated, the measuring device continues to correct the effect of temperature on the volume and density.	<ul style="list-style-type: none"> ■ Off ■ Fixed value ■ External value ■ Current input 1 * ■ Current input 2 * ■ Current input 3 * 	Off
Pressure value	The Fixed value option or the Current input 1...n option is selected in the Pressure compensation parameter.	Enter process pressure to be used for pressure correction. The value entered corrects the effect of pressure on the volume and density of the fluid. The pressure is 0 bar(g) = 1.01325 bar under standard conditions.	Positive floating-point number	0 bar
External pressure	The Fixed value option or the Current input 1...n option is selected in the Pressure compensation parameter.	Shows the external process pressure value.	Positive floating-point number	0 bar

Parameter	Prerequisite	Description	Selection / User entry / User interface	Factory setting
Temperature correction source	–	<p>Select source for temperature correction.</p> <p>The effect of temperature on the volume and density of the fluid must be kept to a minimum.</p> <p> The setting requires detailed knowledge of the functioning of the device and application. It is not advisable to use the internal temperature value for correction purposes. According to the API MPMS, Chapter 5 Section 6 or other standards, and according to custody transfer guidelines, the use of the internal temperature value is not recommended. The value of a typical downstream external temperature measuring device should be used.</p>	<ul style="list-style-type: none"> ■ Internal measured value ■ External value ■ Current input 1 * 	Internal measured value
External temperature	The External value option or the Current input 1...n option is selected in the Temperature mode parameter.	Shows the external process temperature.	–273.15 to 99999 °C	Country-specific: <ul style="list-style-type: none"> ■ 0 °C ■ +32 °F
Shrinkage factor	–	<p>Enter shrinkage factor.</p> <p>The volume flow can decrease as a result of outgassing between the separation point and the storage tank. A reduction in the volume flow is taken into account by entering a shrinkage factor.</p>	Positive floating-point number	1.0
S&W input mode	The API referenced correction option is selected in the Petroleum mode parameter.	<p>Select input mode for sediment and water.</p> <p>If the calculated volume flow should be reduced owing to the presence of sediment and water in the fluid, this can be done using a fixed value, a value from an external source or by entering a current value.</p>	<ul style="list-style-type: none"> ■ Off ■ Fixed value ■ External value ■ Current input 1 * ■ Current input 2 * ■ Current input 3 * 	Off
S&W	The Fixed value option is selected in the S&W input mode parameter.	<p>Enter a value for sediment and water in percent.</p> <p>Use this function to enter a percentage to factor in a reduction in the volume flow due to the presence of sediment and water in the fluid.</p>	0 to 100 %	0 %

Parameter	Prerequisite	Description	Selection / User entry / User interface	Factory setting
S&W correction value	The External value option or the Current input 1...n option is selected in the S&W input mode parameter.	Shows the correction value for sediment and water.	Positive floating-point number	0 %
Meter factor	The Net oil & water cut option is selected in the Petroleum mode parameter parameter.	Displays the current calibration factor for correcting the volume flow. The correction is required due to inaccuracies in the measuring device.	Signed floating-point number	1.0

* Visibility depends on order options or device settings

3.3.2 Configuration of the outputs

Additional measured variables are available for the outputs, the local display and the totalizer if the **API referenced correction** option is selected:

- Reference density
- Reference density alternative
- GSV flow
- GSV flow alternative
- NSV flow
- NSV flow alternative
- S&W volume flow

3.4 Additional measured variables

Additional measured variables are available with the **Petroleum** application package if the **API referenced corrections** option has been selected in the **Petroleum mode** parameter.

Navigation

"Diagnostics" menu → Measured values → Measured variables

► Process variables	
CTL (4191)	→ 15
CPL (4192)	→ 15
CTPL (4193)	→ 15
S&W volume flow (4161)	→ 15
S&W correction value (4194)	→ 15
Reference density alternative (4168)	→ 15
GSV flow (4157)	→ 16
GSV flow alternative (4158)	→ 16
NSV flow (4159)	→ 16

NSV flow alternative (4160)	→ 16
CTL alternative (4174)	→ 16
CPL alternative (4197)	→ 16
CTPL alternative (4173)	→ 16

Parameter overview with brief description

Parameter	Prerequisite	Description	User interface	Factory setting
CTL	The API referenced correction option is selected in the Petroleum mode parameter parameter.	Displays the correction factor which represents the effect of temperature on the fluid. This is used to convert the measured volume flow and the measured density to values at reference temperature.	Positive floating-point number	1
CPL	The API referenced correction option is selected in the Petroleum mode parameter parameter.	Displays the correction factor which represents the effect of pressure on the fluid. This is used to convert the measured volume flow and the measured density to values at reference pressure.	Positive floating-point number	1
CTPL	The API referenced correction option is selected in the Petroleum mode parameter parameter.	Displays the combined correction factor which represents the effect of temperature and pressure on the fluid. This is used to convert the measured volume flow and the measured density to values at reference temperature and reference pressure.	Positive floating-point number	1
S&W volume flow	The API referenced correction option is selected in the Petroleum mode parameter parameter.	Displays the S&W volume flow which is calculated from the measured total volume flow minus the net volume flow. <i>Dependency</i> The unit is taken from the Volume flow unit parameter.	Signed floating-point number	1 l/h
S&W correction value	The External value option or the Current input 1...n option is selected in the S&W input mode parameter.	Shows the correction value for sediment and water.	Positive floating-point number	0 %
Reference density alternative	The API referenced correction option is selected in the Petroleum mode parameter parameter.	Displays the fluid density at the alternative reference temperature. <i>Dependency</i> The unit is taken from the Reference density unit parameter.	Signed floating-point number	1 kg/NI

Parameter	Prerequisite	Description	User interface	Factory setting
GSV flow	The API referenced correction option is selected in the Petroleum mode parameter parameter.	Displays the measured total volume flow, corrected to the reference temperature and reference pressure. <i>Dependency</i> The unit is taken from the Corrected volume flow unit parameter.	Signed floating-point number	0 NI/h
GSV flow alternative	The API referenced correction option is selected in the Petroleum mode parameter parameter.	Displays the measured total volume flow, corrected to the alternative reference temperature and the alternative reference pressure. <i>Dependency</i> The unit is taken from the Corrected volume flow unit parameter.	Signed floating-point number	0 NI/h
NSV flow	The API referenced correction option is selected in the Petroleum mode parameter parameter.	Displays the net volume flow which is calculated from the measured total volume flow minus the value for sediment & water and minus the shrinkage. <i>Dependency</i> The unit is taken from the Corrected volume flow unit parameter.	Signed floating-point number	0 NI/h
NSV flow alternative	The API referenced correction option is selected in the Petroleum mode parameter parameter.	Displays the net volume flow which is calculated from the measured alternative total volume minus the value for sediment & water and minus the shrinkage. <i>Dependency</i> The unit is taken from the Corrected volume flow unit parameter.	Signed floating-point number	0 NI/h
CTL alternative	The API referenced correction option is selected in the Petroleum mode parameter parameter.	Displays the correction factor which represents the effect of temperature on the fluid. This is used to convert the measured volume flow and the measured density to values at the alternative reference temperature.	Positive floating-point number	1
CPL alternative	The API referenced correction option is selected in the Petroleum mode parameter parameter.	Displays the correction factor which represents the effect of pressure on the fluid. This is used to convert the measured volume flow and the measured density to values at the alternative reference pressure.	Positive floating-point number	1
CTPL alternative	The API referenced correction option is selected in the Petroleum mode parameter parameter.	Displays the combined correction factor which represents the effect of temperature and pressure on the fluid. This is used to convert the measured volume flow and the measured density to values at the alternative reference temperature and the alternative reference pressure.	Positive floating-point number	1


4 Net oil & water cut

4.1 General principles

The **Net oil & water cut** option is used to calculate the percentage of the water in the emulsion flow in proportion to the total volume. In this way, it is possible to display and totalize the volume flow for the oil part of the process only. The net oil volume refers directly to the oil volume minus the water volume. The calculation is performed in accordance with API standards MPMS, Chapter 20 Section 1 – Allocation Measurement.

If a fluid contains both water and oil, the measuring device measures the density of the overall mixture of water and oil. If the share of water in the mixture changes, the density of the overall mixture also changes.

If the density values of the pure oil and pure water are known, the density of the mixture is in the range between these two density values.

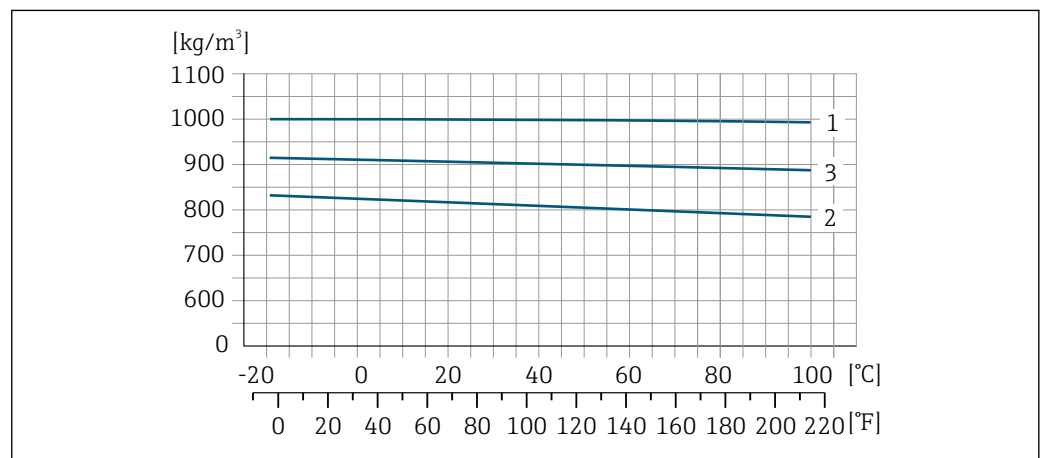

A0034911

1 Example of an oil/water mixture: density as a function of the temperature

- 1 Density curve of pure water
- 2 Density curve of pure oil
- 3 Density curve of oil/water mixture

If this is the case, the share of the two components can be calculated using the following formula. This is also known as the density-based determination of the water cut.

$$W_c = \frac{\rho_e - \rho_o}{\rho_w - \rho_o}$$

A0034909

2 Density-based determination of the water cut

- ρ_e Emulsion density (density of the fluid) measured by the measuring device
- ρ_o Density of the pure oil
- ρ_w Density of the pure water
- W_c Water cut (content of water in an oil/water mixture)


To use this function, the density values of pure oil and pure water at a known temperature and pressure (oil only) must be known. The density values of pure oil and water for the temperature and pressure of the fluid are first calculated with the **Net oil & water cut** option. These values and the measured density of the fluid are then used to determine the water content of the mixture with using the formula above.

These values are usually taken from a sample of oil and water:

- Density of the oil sample
- Temperature of the oil sample
- Pressure of the oil sample
- Density of the water sample
- Temperature of the water sample

In addition to configuring the pressure and temperature sources, it is necessary to select the API commodity group based on the process fluid as well as the API table number for which the reference or standard conditions should apply.

If the percentage water content is known, the volume of the oil and the volume of the water can be totalized separately.

As soon as the net oil volume and the net water volume have been determined, they can be corrected back to the corrected volume using the properties of water and the API MPMS, Chapter 11 Section 1 "Temperature and Pressure Volume Correction Factors for Generalized Crude Oils, Refined Products, and Lubricating Oils", as already described under the **API referenced correction** option (→  8).

Reading in the water content from an external measuring device



The **Net oil & water cut** option allows the user to read in the water content from an external measuring device.



- The percentage water content measured externally can be communicated directly to the measuring device by analog means or via fieldbus.
- The volume flow and corrected volume flow for water and oil are calculated with the external water content value.
- The density and temperature values of the samples also need to be specified with this method in order to calculate the standard variables.

4.2 System integration

Additional measured variables are available with the **Petroleum** application package and the **Net oil & water cut** option selected in the **Petroleum mode** parameter.

- Water cut
- Oil density
- Water density
- Oil mass flow
- Water mass flow
- Oil volume flow
- Water volume flow
- Oil corrected volume flow
- Water corrected volume flow

 Overview of the extended range of measured variables available with the **Petroleum** application package: →  23



 For detailed information on system integration, see the Operating Instructions for the device →  5

4.3 Commissioning

4.3.1 Configuring the measuring device



















Configuration of the measuring device if the **Net oil & water cut** option is selected.



1. Start with the **Petroleum** submenu →  18

- 2. The density, temperature and pressure values of an oil and water sample are always needed to determine the standard density and corrected volume flow of the water content. Start entering the data with the **Oil density unit** parameter and the parameters that follow.
- 3. Configure the outputs →  22
- 4. Read out the measured values →  23



Navigation



"Advanced setup" submenu → Petroleum

▶ Petroleum	
Petroleum mode (4187)	→  20
Water cut mode (4190)	→  20
API commodity group (4151)	→  20
API table selection (4152)	→  20
Thermal expansion coefficient (4153)	→  21
Pressure compensation (6130)	→  21
Pressure value (6059)	→  21
External pressure (6209)	→  21
Temperature correction source (6184)	→  21
External temperature (6080)	→  22
Shrinkage factor (4167)	→  22
Oil density unit (0615)	→  22
Oil density sample (4162)	→  22
Oil temperature sample (4163)	→  22
Oil pressure sample (4166)	→  22
Water density unit (0616)	→  22
Water reference density unit (0617)	→  22
Water density sample (4164)	→  22

Water temperature sample (4165)	→  22
Meter factor (4198)	→  22

Parameter overview with brief description

Parameter	Prerequisite	Description	Selection / User entry / User interface	Factory setting
Petroleum mode	–	Select petroleum mode. If the Net oil & water cut option is selected, the water in the emulsion flow is calculated in proportion to the total volume to determine the net oil content.	<ul style="list-style-type: none"> ▪ Off ▪ Net oil & water cut 	Off
Water cut mode	The Net oil & water cut option is selected in the Petroleum mode parameter parameter.	Select water cut mode.	<ul style="list-style-type: none"> ▪ Calculated value ▪ External value ▪ Current input 1 * ▪ Current input 2 * ▪ Current input 3 * 	Calculated value
API commodity group	–	Select API commodity group of the measured medium.  For additional information, see the API MPMS, Chapter 11 Section 1 "Temperature and Pressure Volume Correction Factors for Generalized Crude Oils, Refined Products, and Lubricating Oils", and Chapter 11 Section 2 Part 4 "Temperature Correction for the Volume of NGL and LPG Tables 23E, 24E, 53E, 95E [sic], and 60E".	<ul style="list-style-type: none"> ▪ A - crude oil ▪ C - special applications ▪ E - NGL / LPG * 	A - crude oil
API table selection	–	Select reference density by API table. Use this function to select the API table according to the desired values for the reference temperature and pressure.  For additional information, see the API MPMS, Chapter 11 Section 1 "Temperature and Pressure Volume Correction Factors for Generalized Crude Oils, Refined Products, and Lubricating Oils", and Chapter 11 Section 2 Part 4 "Temperature Correction for the Volume of NGL and LPG Tables 23E, 24E, 53E, 95E [sic], and 60E".	<ul style="list-style-type: none"> ▪ API table 5/6 * ▪ API table 23/24 ▪ API table 53/54 ▪ API table 59/60 	API table 53/54

Parameter	Prerequisite	Description	Selection / User entry / User interface	Factory setting
Thermal expansion coefficient	The C - special applications option is selected in the API commodity group parameter	Enter the thermal expansion coefficient of the measured medium.	$414 \cdot 10^{-6}$ to $1674 \cdot 10^{-6}$ 1/K	$414 \cdot 10^{-6}$ 1/K
Pressure compensation	–	<p>Select pressure compensation type.</p> <p>If the effect of pressure on the volume and density of the fluid is to be corrected, the type of pressure compensation can be selected here.</p> <p> Pressure compensation can be deactivated if it is not needed for the application. If pressure compensation is deactivated, the measuring device continues to correct the effect of temperature on the volume and density.</p>	<ul style="list-style-type: none"> ■ Off ■ Fixed value ■ External value ■ Current input 1 * ■ Current input 2 * ■ Current input 3 * 	Off
Pressure value	The Fixed value option or the Current input 1...n option is selected in the Pressure compensation parameter.	<p>Enter process pressure to be used for pressure correction.</p> <p>The value entered corrects the effect of pressure on the volume and density of the fluid. The pressure is 0 bar(g) = 1.01325 bar under standard conditions.</p>	Positive floating-point number	0 bar
External pressure	The Fixed value option or the Current input 1...n option is selected in the Pressure compensation parameter.	Shows the external process pressure value.	Positive floating-point number	0 bar
Temperature correction source	–	<p>Select source for temperature correction.</p> <p>The effect of temperature on the volume and density of the fluid must be kept to a minimum.</p> <p> The setting requires detailed knowledge of the functioning of the device and application. It is not advisable to use the internal temperature value for correction purposes. According to the API MPMS, Chapter 5 Section 6 or other standards, and according to custody transfer guidelines, the use of the internal temperature value is not recommended. The value of a typical downstream external temperature measuring device should be used.</p>	<ul style="list-style-type: none"> ■ Internal measured value ■ External value ■ Current input 1 * 	Internal measured value

Parameter	Prerequisite	Description	Selection / User entry / User interface	Factory setting
External temperature	The External value option or the Current input 1...n option is selected in the Temperature mode parameter.	Shows the external process temperature.	-273.15 to 99 999 °C	Country-specific: ■ 0 °C ■ +32 °F
Shrinkage factor	-	Enter shrinkage factor. The volume flow can decrease as a result of outgassing between the separation point and the storage tank. A reduction in the volume flow is taken into account by entering a shrinkage factor.	Positive floating-point number	1.0
Oil density unit	The Net oil & water cut option is selected in the Petroleum mode parameter.	Select unit for the density of oil.	Unit choose list	kg/m ³
Oil density sample	The Net oil & water cut option is selected in the Petroleum mode parameter.	Enter the value for the density of the oil sample.	470 to 1210 kg/m ³	850 kg/m ³
Oil temperature sample	The Net oil & water cut option is selected in the Petroleum mode parameter.	Enter the value for the temperature of the oil sample.	- 273.15 to 99 726.84 99 °C	15 °C
Oil pressure sample	The Net oil & water cut option is selected in the Petroleum mode parameter.	Enter the value for the pressure of the oil sample.	Positive floating-point number	1.01325 bar
Water density unit	The Net oil & water cut option is selected in the Petroleum mode parameter.	Select unit for the density of the water.	Unit choose list	kg/m ³
Water reference density unit	The Net oil & water cut option is selected in the Petroleum mode parameter.	Select unit for reference density of the water.	Unit choose list	kg/Nm ³
Water density sample	The Net oil & water cut option is selected in the Petroleum mode parameter.	Enter the value for the density of the water sample.	900 to 1200 kg/m ³	999.2 kg/m ³
Water temperature sample	The Net oil & water cut option is selected in the Petroleum mode parameter.	Enter the value for the temperature of the water sample.	- 273.15 to 99 726.84 99 °C	15 °C
Meter factor	The Net oil & water cut option is selected in the Petroleum mode parameter.	Displays the current calibration factor for correcting the volume flow. The correction is required due to inaccuracies in the measuring device.	Signed floating-point number	1.0

* Visibility depends on order options or device settings

4.3.2 Configuration of the outputs

Additional measured variables are available for the outputs, the local display and the totalizer if the **Net oil & water cut** option is selected:

- Water cut
- Oil density
- Water density
- Oil mass flow
- Water mass flow
- Oil volume flow
- Water volume flow
- Oil corrected volume flow
- Water corrected volume flow

4.4 Additional measured variables

Additional measured variables are available with the **Petroleum** application package if the **Net oil & water cut** option has been selected in the **Petroleum mode** parameter.

Navigation

"Diagnostics" menu → Measured values → Measured variables

► Process variables	
Oil CTL (4175)	→ 23
Oil CPL (4177)	→ 23
Oil CTPL (4176)	→ 24
Water CTL (4172)	→ 24
Oil density (4169)	→ 24
Water density (4170)	→ 24
Water cut (4171)	→ 24
Oil volume flow (4178)	→ 24
Oil corrected volume flow (4179)	→ 24
Oil mass flow (4180)	→ 24
Water volume flow (4181)	→ 25
Water corrected volume flow (4182)	→ 25
Water mass flow (4183)	→ 25

Parameter overview with brief description

Parameter	Prerequisite	Description	User interface	Factory setting
Oil CTL	The Net oil & water cut option is selected in the Petroleum mode parameter parameter.	Displays the correction factor which represents the effect of temperature on the oil. This is used to convert the measured oil volume flow and the measured oil density to values at reference temperature.	Positive floating-point number	1
Oil CPL	The Net oil & water cut option is selected in the Petroleum mode parameter parameter.	Displays the correction factor which represents the effect of pressure on the oil. This is used to convert the measured oil volume flow and the measured oil density to values at reference pressure.	Positive floating-point number	1

Parameter	Prerequisite	Description	User interface	Factory setting
Oil CTPL	The Net oil & water cut option is selected in the Petroleum mode parameter parameter.	Displays the combined correction factor which represents the effect of temperature and pressure on the oil. This is used to convert the measured oil volume flow and the measured oil density to values at reference temperature and reference pressure.	Positive floating-point number	1
Water CTL	The Net oil & water cut option is selected in the Petroleum mode parameter parameter.	Displays the correction factor which represents the effect of temperature on the water. This is used to convert the measured water volume flow and the measured water density to values at reference temperature.	Positive floating-point number	1
Oil density	The Net oil & water cut option is selected in the Petroleum mode parameter parameter.	Displays the density of the oil currently measured.	Signed floating-point number	1 kg/m ³
Water density	The Net oil & water cut option is selected in the Petroleum mode parameter parameter.	Displays the density of the water currently measured.	Signed floating-point number	1 kg/m ³
Water cut	The Net oil & water cut option is selected in the Petroleum mode parameter parameter.	Displays the percentage water volume flow in relation to the total volume flow of the fluid.	0 to 100 %	0 %
Oil volume flow	The Net oil & water cut option is selected in the Petroleum mode parameter parameter.	Displays the currently calculated volume flow of the oil. Dependency: <ul style="list-style-type: none"> ▪ Based on the value displayed in the Water cut parameter ▪ The unit is taken from the Volume flow unit parameter. 	Signed floating-point number	0 l/h
Oil corrected volume flow	The Net oil & water cut option is selected in the Petroleum mode parameter parameter.	Displays the currently calculated volume flow of the oil, calculated to values at reference temperature and reference pressure. Dependency: <ul style="list-style-type: none"> ▪ Based on the value displayed in the Water cut parameter ▪ The unit is taken from the Corrected volume flow unit parameter. 	Signed floating-point number	0 NI/h
Oil mass flow	The Net oil & water cut option is selected in the Petroleum mode parameter parameter.	Displays the currently calculated mass flow of the oil. Dependency: <ul style="list-style-type: none"> ▪ Based on the value displayed in the Water cut parameter ▪ The unit is taken from the Mass flow unit parameter. 	Signed floating-point number	0 kg/h

Parameter	Prerequisite	Description	User interface	Factory setting
Water volume flow	The Net oil & water cut option is selected in the Petroleum mode parameter parameter.	Displays the currently calculated volume flow of the water. Dependency: <ul style="list-style-type: none"> ▪ Based on the value displayed in the Water cut parameter ▪ The unit is taken from the Volume flow unit parameter. 	Signed floating-point number	0 l/h
Water corrected volume flow	The Net oil & water cut option is selected in the Petroleum mode parameter parameter.	Displays the currently calculated volume flow of the water, calculated to values at reference temperature and reference pressure. Dependency: <ul style="list-style-type: none"> ▪ Based on the value displayed in the Water cut parameter ▪ The unit is taken from the Corrected volume flow unit parameter. 	Signed floating-point number	0 NI/h
Water mass flow	The Net oil & water cut option is selected in the Petroleum mode parameter parameter.	Displays the currently calculated mass flow of the water. Dependency: <ul style="list-style-type: none"> ▪ Based on the value displayed in the Water cut parameter ▪ The unit is taken from the Mass flow unit parameter. 	Signed floating-point number	0 kg/h

5 Weighting of flow-related factors

Certain applications in the oil and gas industry may require an average density or temperature to be provided for a batch.


An average value for the density and an average value for the temperature have been provided for this purpose. These values are volume-weighted and can be reset. Both values can be reset at the start of a batch and then read at the end of the batch. They are calculated as described in the API MPMS, Chapter 12, Section 2, Part 2 – Calculation of Petroleum Quantities.

5.1 "Weighted averages" submenu

The temperature and density averages can be read and reset in the **Weighted averages** submenu.

Navigation

"Operation" menu → Weighted averages

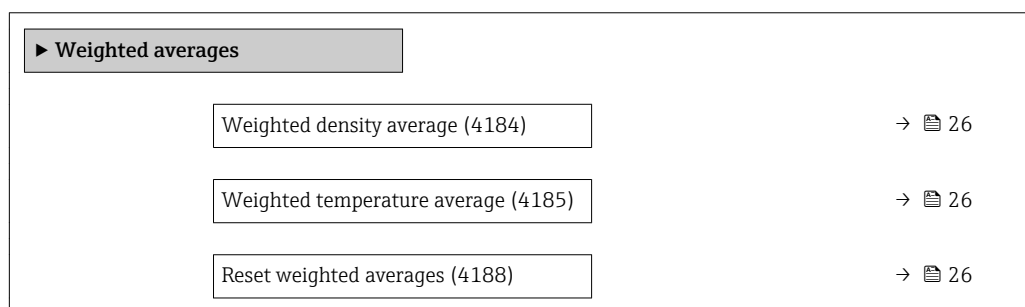


Parameter overview with brief description

Parameter	Description	User interface / Selection	Factory setting
Weighted density average	Displays the weighted average for the density since the last time the density averages were reset. Dependency: The unit is taken from the Density unit parameter.	Signed floating-point number	1 kg/l
Weighted temperature average	Displays the weighted average for the temperature since the last time the temperature averages were reset. Dependency: The unit is taken from the Temperature unit parameter.	Signed floating-point number	0 °C
Reset weighted averages	Use this function to reset the weighted averages for pressure and temperature.	<ul style="list-style-type: none"> ■ Totalize ■ Reset + totalize 	Totalize

6 Workflow

The workflow below provides a schematic representation of the configuration procedure in the **Petroleum** application package if the **"API referenced correction"** option or **"Net oil & water cut"** option is selected.

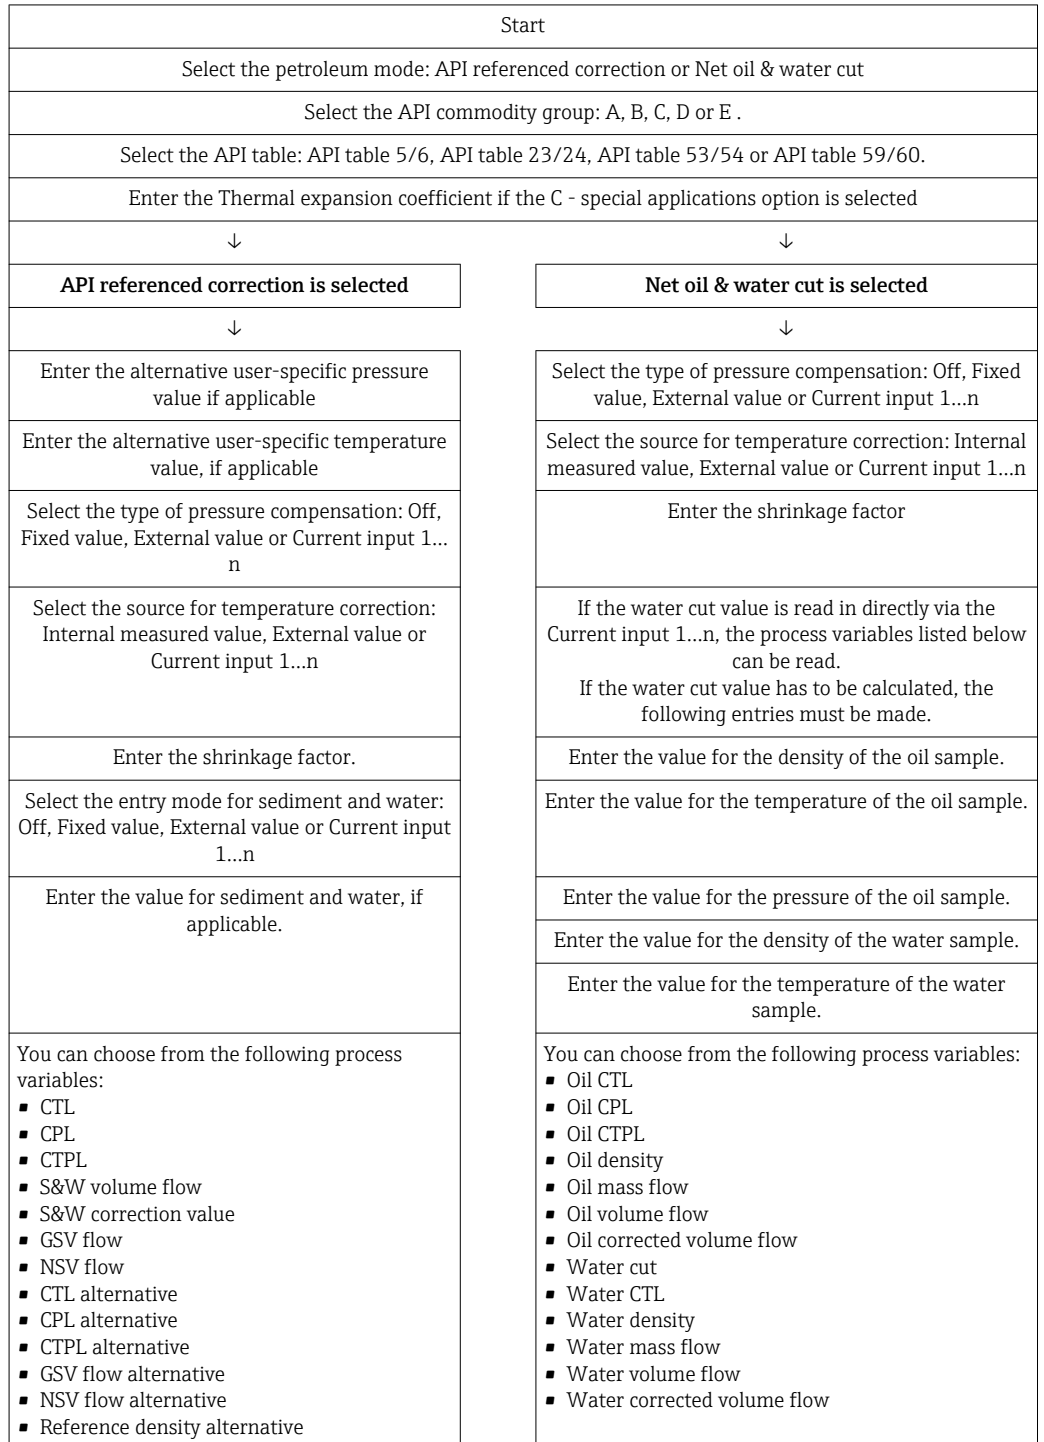

www.addresses.endress.com
