# Safety Instructions Proline Prosonic Flow 300

UKEX: II3G







## **Proline Prosonic Flow 300**

#### Table of contents

Associated documentation	4
Manufacturer's certificates	4
Manufacturer address	4
Extended order code	4
Safety instructions: General	7
Safety instructions: Installation	8
Temperature tables	9
Connection values: Signal circuits 1	2

# Associated documentation

All documentation is available:

- On the CD-ROM supplied (not included in the delivery for all device versions).
- Available for all device versions via:
  - Internet: www.endress.com/deviceviewer
  - Smart phone/tablet: Endress+Hauser Operations App
- In the Download Area of the Endress+Hauser web site: www.endress.com → Download.

This document is an integral part of the following Operating Instructions:

Measuring device	Documentation code		
	HART	Modbus RS485	
Prosonic Flow G 300	BA01834D	BA01835D	

#### Additional documentation

Contents	Document type	Documentation code
Remote display and operating module	Special documentation	SD01763D
DKX001	Safety Instructions	XA02581D
	II3G Ex nA or II3G Ex ec	
Explosion Protection	Brochure	CP00021Z/11

Please note the documentation associated with the device.

# Manufacturer's certificates

### **UK Declaration of Conformity**

Documentation code: UK\_00110

# Manufacturer address


Endress+Hauser Flowtec AG

Kägenstrasse 7 4153 Reinach BL Switzerland

# Extended order code

The extended order code is indicated on the nameplate, which is affixed to the device in such a way that it is clearly visible. Additional information about the nameplate is provided in the associated Operating Instructions.

#### Structure of the extended order code



#### Device type

The device and the device design is defined in the "Device type" section (Product root).

#### Basic specifications

The features that are absolutely essential for the device (mandatory features) are specified in the basic specifications. The number of positions depends on the number of features available. The selected option of a feature can consist of several positions.

#### Optional specifications

The optional specifications describe additional features for the device (optional features). The number of positions depends on the number of features available. The features have a 2-digit structure to aid identification (e.g. JA). The first digit (ID) stands for the feature group and consists of a number or a letter (e.g. J = Test, Certificate). The second digit constitutes the value that stands for the feature within the group (e.g. A = 3.1 material (wetted parts), inspection certificate).

More detailed information about the device is provided in the following tables. These tables describe the individual positions and IDs in the extended order code which are relevant to hazardous locations.

#### Device type

Position	Order code for	Option selected	Description
1	Instrument family	9	Ultrasonic transit time flowmeter
2	Sensor	G	Sensor type
3	Transmitter	3	Transmitter type: 4-wire, compact version
4	Generation index	В	Platform generation
5, 6	Nominal diameter	DN 25300	Nominal diameter of sensor

### **Basic specifications**

Position 1, 2	Position 4, 5	Type of protection			
Order code for "Approval" Option selected	Order code for "Output, input 1" Option selected	Transmitter	Sensor		
US	BA, MA	Ex ec nC ic IIC T5T1 Gc	Ex ic IIC T5T1 Gc		

Position	Order code for	Option selected	Description
4, 5	Output, input 1	BA	4-20mA HART
		MA	Modbus RS485
6	Output, input 2	A	W/o
		В	4-20mA
		D	Configurable I/O initial setting off
		Е	Pulse/frequency/switch output
		F	Pulse output, phase-shifted
		Н	Relay
		I	4-20mA input
		J	Status input
7	Output, input 3	A	W/o
		В	4-20mA
		D	Configurable I/O initial setting off
		Е	Pulse/frequency/switch output
		F	Pulse output, phase-shifted
		Н	Relay
		I	4-20mA input
		J	Status input
8	Display; Operation	A	W/o; via communication
		F	4-line, illuminated; touch control
		G	4-line, illuminated; touch control + WLAN
		M	W/o; prepared for remote display DKX001
		0	4-line, illuminated; touch control
9	Housing	A	Alu, coated
		L	Cast, stainless
17, 18	Device Model	A2	2

#### Optional specifications

ID	ID Order code for Option selected		Description
Jx	Test, certificate	JP	Ambient temperature, measuring device −50 °C
Px	Enclosed accessories	P8	Wireless antenna, wide area (external WLAN antenna) 1)

1) The external WLAN antenna is available with the order code for "Accessory Enclosed", option P8.

#### Safety instructions: General

- Staff must meet the following conditions for mounting, electrical installation, commissioning and maintenance of the device:
  - Be suitably qualified for their role and the tasks they perform
  - Be trained in explosion protection
  - Be familiar with national regulations or guidelines (e.g. EN 60079-14)
- Install the device according to the manufacturer's instructions and national regulations.
- Do not operate the device outside the specified electrical, thermal and mechanical parameters.
- Only use the device in media to which the wetted materials have sufficient durability.
- Refer to the temperature tables for the relationship between the permitted ambient temperature for the sensor and/or transmitter, depending on the range of application, and the temperature classes.
- Modifications to the device can affect the explosion protection and must be carried out by staff authorized to perform such work by Endress+Hauser.
- Observe all the technical data of the device (see nameplate).

#### Safety instructions: Installation

■ Continuous service temperature of the connecting cable: -40 to +80 °C (-50 to +60 °C for optional specifications, ID Jx (Test, Certificate) = JP); in accordance with the range of service temperature taking into account additional influences of the process conditions ( $T_{a,min}$  and  $T_{a,max} + 20$  K).

- Only use certified cable entries suitable for the application. Observe selection criteria as per EN 60079-14.
- When the measuring device is connected, attention must be paid to explosion protection at the transmitter.
- Turning the transmitter housing
  - Loosen both hexagon socket screws until the transmitter housing can be turned.
  - Turn transmitter housing to desired position (mechanically limited); if necessary turn 270° in other direction.
  - Tighten both hexagon socket screws with a maximum of 7 Nm.
- In potentially explosive atmospheres:
  - Do not disconnect the electrical connection of the power supply circuit when energized.
  - Do not open the connection compartment cover when energized.

#### Ex ec type of protection

- In potentially explosive atmospheres: Do not disconnect the electrical connection of the power supply circuit when energized.
- Seal unused entry glands with approved sealing plugs that correspond to the type of protection.
- Only use certified cable entries or sealing plugs.
- Equipment in type of protection Ex ec, shall be installed using a transient protection not exceeding 140% of the peak rated voltage value at the power supply terminals and IO terminals.

#### Optional external WLAN antenna

- Connect the antenna bushing H337 to the transmitter housing and tighten by hand.
- Use only external antennas supplied by Endress+Hauser.
- Connect antenna or antenna cable with plug-in connector type N (MIL-STD-348) to antenna bushing H337.

### Intrinsic safety

Observe the guidelines for interconnecting intrinsically safe circuits (e.g. EN 60079-14, Proof of Intrinsic Safety).



- When using the remote display and operating module DKX001 the internal display and operating module must be removed.
- When using the separate approved, remote display and operating module DKX001, only use the following variants:
   Basic specification of the remote display and operating module DKX001, order code "Approval", option US

#### Potential equalization

- Integrate the device into the local potential equalization .
- If the ground connection has been established via the pipe as specified, it is also possible to integrate the sensor into the potential equalization system via the pipe.
- The antenna bushing H337 of the external antenna must be integrated into the local potential equalization system. This is the case if the sensor is connected in accordance with the regulations via the coupling.

# Temperature tables

#### Ambient temperature

Minimum ambient temperature

- $T_a = -40 \, ^{\circ}\text{C}$
- Optional specification, ID Jx (Test, Certificate) = JP
   T<sub>a</sub> = -50 °C depending on the selected device variant (see nameplate)

Maximum ambient temperature

 $T_{\text{a}} = +60\,^{\circ}\text{C}$  depending on the medium temperature and temperature class

#### Medium temperature

Minimum medium temperature

$$T_{\rm m} = -50~{\rm ^{\circ}C}$$

Maximum medium temperature

 $T_{\rm m}$  for T5...T1 depending on the maximum ambient temperature  $T_{\rm a}$ 

# Maximum medium temperature with or without thermal insulation according to Endress+Hauser specifications

With integrated pressure measuring cell

DN	T <sub>a</sub>						
	[°C]	T6 [85 °C]	T5 [100 ℃]	T4 [135 ℃]	T3 [200 ℃]	T2 [300 ℃]	T1 [450 ℃]
25300	55	-	40	90	90	90	90
	60	-	-	90	90	90	90


### Without integrated pressure measuring cell

DN	T <sub>a</sub> [°C]	T <sub>m</sub> [°C]					
	[ [ [	T6 [85 ℃]	T5 [100 ℃]	T4 [135 ℃]	T3 [200°C]	T2 [300 °C]	T1 [450°C]
25300	50	-	85	120	150	150	150
	55	-	-	120	150	150	150
	60	-	ı	120 <sup>1)</sup>	150 <sup>1)</sup>	150 <sup>1)</sup>	150 <sup>1)</sup>

1) For horizontal installation: Install the transmitter below the sensor.

### With thermal insulation without Endress+Hauser specifications

The specified reference temperature  $T_{ref}$  and the maximum medium temperature  $T_{m,\,max}$  for each temperature class must not be exceeded  $\rightarrow \; \stackrel{\text{\tiny def}}{=} \; 9.$ 

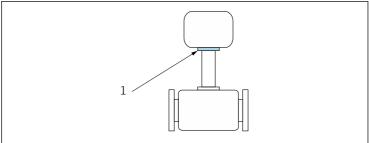

A0039269

- 1 Position of reference point for temperature measurement
- 1 Reference point  $(T_{ref})$

#### Reference temperature $T_{ref}$

T6	T5	T4	T3	T2	T1
[85 ℃]	[100°C]	[135 ℃]	[200°C]	[300°C]	[450 ℃]
-	62	72	73	73	

# Connection values: Signal circuits

The following tables contain specifications which are dependent on the transmitter type and its input and output assignment. Compare the following specifications with those on the nameplate of the transmitter.

#### Terminal assignment

*Transmitter:* supply voltage, input/outputs


#### HART

Supply voltage		Input/output 1		Input/output 2		Input/output 3	
1 (+)	2 (-)	26 (+)	27 (-)	24 (+)	25 (-)	22 (+)	23 (-)
		Device-s	Device-specific terminal assignment: adhesive label in terminal cover.				

#### Modbus RS485

Supply voltage		Input/o	utput 1	Input/output 2		Input/output 3	
1 (+)	2 (-)	26 (B)	27 (A)	24 (+)	25 (-)	22 (+)	23 (-)
		Device-specific terminal assignment: adhesive label in terminal cover.					

#### Remote display and operating module DKX001

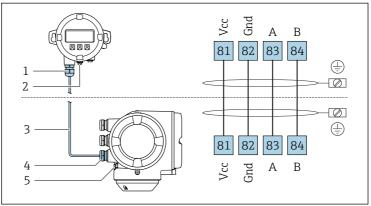

A0027518

- 1 Remote display and operating module DKX001
- *2 Protective earth (PE)*
- 3 Connecting cable
- 4 Measuring device
- 5 Protective earth (PE)

### Safety-related values

Order code "Output; input 1"	Output type	Safety-related values "Output; input 1"	
		26 (+)	27 (-)
Option <b>BA</b>	Current output 4 to 20 mA HART	$U_{N} = 30 V_{DC}$ $U_{M} = 250 V_{AC}$	
Option <b>MA</b>	Modbus RS485	$U_{N} = 30 V_{DC}$ $U_{M} = 250 V_{AC}$	

Order code	Output type	Safety-related values			
"Output; input 2"; "Output; input 3"		Output; input 2		Output; input 3	
		24 (+)	25 (-)	22 (+)	23 (-)
Option <b>B</b>	Current output 4 to 20 mA	$U_{N} = 30 V_{DC}$ $U_{M} = 250 V_{AC}$			
Option <b>D</b>	User-configurable input/output	$U_{\rm N} = 30 \ V_{\rm DC}$ $U_{\rm M} = 250 \ V_{\rm AC}$			
Option <b>E</b>	Pulse/frequency/ switch output	$U_{N} = 30 V_{DC}$ $U_{M} = 250 V_{AC}$			
Option <b>F</b>	Double pulse output	$U_N = 30 V_{DC}$ $U_M = 250 V_{AC}$			
Option <b>H</b>	Relay output	Relay output $ \begin{array}{c} U_{N}=30~V_{DC} \\ I_{N}=100~mA_{DC}/500~mA_{AC} \\ U_{M}=250~V_{AC} \end{array} $			
Option <b>I</b>	Current input 4 to 20 mA	$U_N = 30 V_{DC}$ $U_M = 250 V_{AC}$			
Option <b>J</b>	Status input	$U_{N} = 30 V_{DC}$ $U_{M} = 250 V_{AC}$			

## Remote display DKX001

Basic specification, position 1, 2 Approval	Terminal assignment	Basic specification, position 8 Display; Operation Option O
Option <b>US</b>	81, 82, 83, 84	$U_n = 3.3 \text{ V}$
Option <b>63</b>	01, 02, 03, 04	I <sub>n</sub> = 150 mA





www.addresses.endress.com