

# Safety Instructions

## RN22, RN42

[Ex ia Ga] IIC  
[Ex ia Da] IIIC  
Ex ec IIC Gc





# RN22, RN42

## Table of contents

Associated documentation .....	4
Supplementary documentation .....	4
Manufacturer´s certificates .....	4
Manufacturer address .....	4
Safety instructions: Intrinsic safety .....	5
Safety instructions: Installation in Zone 2 (EPL Gc) .....	6
Safety instructions: Specific conditions of use .....	6

**Associated documentation**

This document is an integral part of the following Operating Instructions:

- Operating instructions: BA02004K
- Brief operating instructions: KA01449K
- Technical information: TI01515K

**Supplementary documentation**

Explosion protection brochure: CP00021Z

The Explosion-protection brochure is available:

- In the download area of the Endress+Hauser website:  
[www.endress.com](http://www.endress.com) -> Downloads -> Brochures and Catalogs -> Text Search: CP00021Z
- On the CD for devices with CD-based documentation

**Manufacturer's certificates****NEPSI certificate**

Certificate number: GYJ22.1942U, GYJ22.1806X

Affixing the certificate number certifies conformity with the following standards (depending on the device version)

- GB/T 3836.1-2021
- GB/T 3836.3-2021
- GB/T 3836.4-2021

**CCC certificate**

Certificate number: 2023322316005023




Please refer to NEPSI/CCC certificates for conditions of safe use.

**Manufacturer address**

Endress+Hauser Wetzler GmbH + Co. KG  
Obere Wank 1  
87484 Nesselwang, Germany

## Safety instructions:

### Intrinsic safety

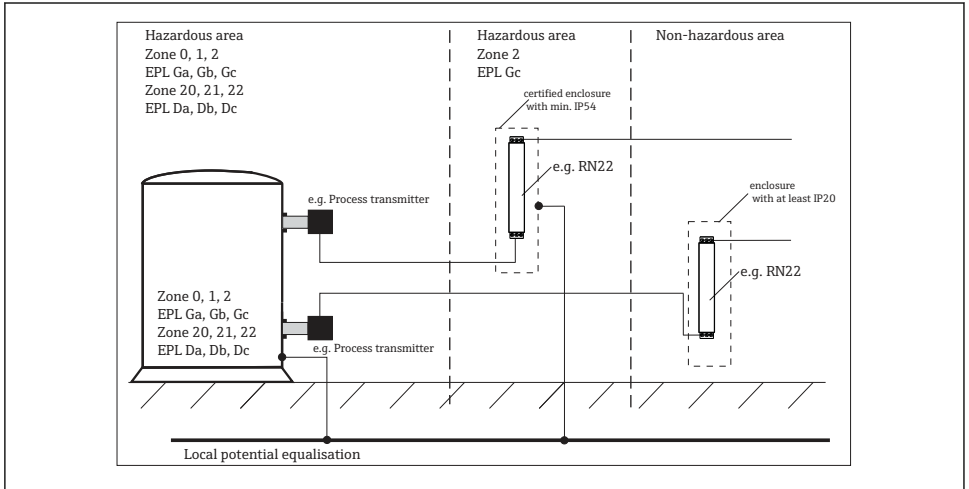

A0046146

- Comply with the installation and safety instructions in the Operating Instructions.
- Install the device according to the manufacturer's instructions and any other valid standards and regulations (e.g. EN/IEC 60079-14).
- The unit is an associated electrical apparatus and can only be installed outside the hazardous area.
- The unit must be installed in such way that a minimum ingress protection of IP 20 is achieved.
- When installing the unit care must be taken that there must be a spacing of at least 50 mm (zone radius) to the intrinsically safe terminals
- Screw tight the unused terminals for keeping the required distances between intrinsically safe circuits/terminals.

**Safety instructions:**  
**Installation in Zone 2 (EPL Gc)**

These instructions concern the required enclosure, accessories and supply cables in final application.

- Comply with the installation and safety instructions in the Operating Instructions.
- Install the component according to the manufacturer's instructions and any other valid standards and regulations (e.g. IEC/EN 60079-14).
- Seal the cable entries tight with certified cable glands which have at least type of protection Ex ec suitable for Group IIC (degree of protection IP54).

**Safety instructions:**  
**Specific conditions of use**

- If several devices are installed side by side, it is important to ensure that the maximum side wall temperature of the individual device of 80 °C (176 °F) is not exceeded. If this cannot be guaranteed, mount the devices at a distance from one another or ensure sufficient cooling.
- When install the unit in EPL Gc a certified enclosure shall be used providing a degree of protection of at least IP54 and compliance with the enclosure requirements to IEC/EN 60079-0.
- In an explosive atmosphere, do not open the certified enclosure when voltage is supplied (ensure that at least IP 54 is maintained during operation).
- For full certification as an electrical equipment for use in EPL Gc the tests according to IEC 60079-0:2017 section 5.2 and 5.3 have to be carried out. Based on the test results a temperature class shall be assigned.

Type of protection
Ex ia Ga  IIC
Ex ia Da  IIIC
Ex ec IIC Gc

Ambient temperature: -40 to +60 °C

Type	Electrical data	
RN22, RN42	Supply RN22: terminals 1.1 (+), 1.2 (-)	U = 24V DC (-20%/+25%) Um = 250 V
	Supply RN42: terminals 1.1 (L/+), 1.2 (N/-)	U = 24 to 230 V AC/DC (-20 %/+10 %) 50/60Hz Um = 250 V

Type	Electrical data		
	Output circuit: terminal 3.1 (+), 3.2 (-) terminal 2.1 (+), 2.2 (-)	U = 30V DC I = 0/4 - 20 mA Um = 30 V	
	Input circuit: Connection 2-wire (active) RN22: terminal 4.1 (+), 4.2 (-) terminal 6.1 (+), 6.2 (-) RN42: terminal 4.1 (+), 4.2 (-)	Uo ≤ 27.3V DC Io ≤ 87.6 mA Po = 597 mW Ci = negligibly small Li = negligibly small	
	Maximum connection values Single values:	Ex ia IIC Ex ia IIB Ex ia IIA	Lo = 5.2 mH Lo = 20.8 mH Lo = 44.8 mH Co = 88 nF Co = 683 nF Co = 2280 nF
	Combined values Lo/Co:	Ex ia IIC	1.3 mH/0.05 µF; 1 mH/0.052 µF; 0.5 mH/0.065 µF
		Ex ia IIB	26 mH/0.39 µF; 2 mH/0.44 µF; 1 mH/0.53 µF; 0.5 mH/0.64 µF; 0.2 mH/0.683 µF
		Ex ia IIA	49 mH/1.3 µF; 20 mH/1.6 µF; 1 mH/1.8 µF; 0.5 mH/2.2 µF; 0.2 mH/2.28 µF
	Connection 4-wire (passive) RN22: terminal 4.2 (+), 5.1 (-) terminal 6.2 (+), 5.2 (-) RN42: terminal 4.2 (+), 4.3 (-)	Uo ≤ 27.3V DC Io ≤ 10 mA Po = 68 mW Ci = negligibly small Li = negligibly small	
	Maximum connection values Combined values Lo/Co:	Ex ia IIC	100 mH/0.065 µF; 2 mH/0.072 µF; 1 mH/0.081 µF; 0.5 mH/0.088 µF
		Ex ia IIB	100 mH/0.48 µF; 2 mH/0.52 µF; 1 mH/0.59 µF; 0.5 mH/0.683 µF
		Ex ia IIA	100 mH/1.7 µF; 1 mH/1.9 µF; 0.5 mH/2.28 µF
	Connection 4-wire (passive) RN22: terminal 4.2 (+), 5.1 (-) terminal 6.2 (+), 5.2 (-) RN42: terminal 4.2 (+), 4.3 (-)	Ui ≤ 30 V DC Io not applicable when keeping Ui Po not applicable when keeping Ui Ci = negligibly small Li = negligibly small	



71588962

[www.addresses.endress.com](http://www.addresses.endress.com)

---