Brief Operating Instructions **Gammapilot FMG50 HART**

Radiometric measuring technology





These Brief Operating Instructions are not a substitute for the Operating Instructions pertaining to the device.


Detailed information is provided in the Operating Instructions and other documentation.

Available for all device versions via:

- Internet: www.endress.com/deviceviewer
- Smartphone/tablet: Endress+Hauser Operations app



Associated documentation 1

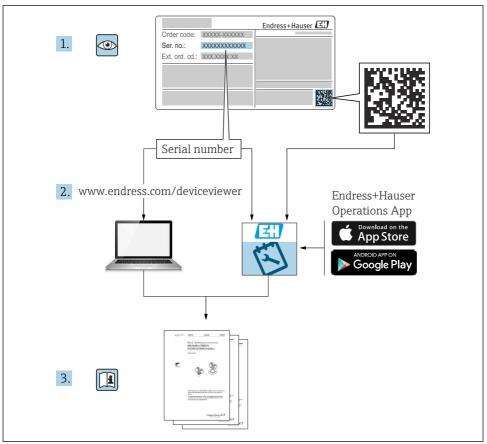

A0023555

2 About this document

2.1 Symbols used

Safety symbols 2.1.1

A CAUTION

This symbol alerts you to a dangerous situation. Failure to avoid this situation can result in minor or medium injury.

⚠ DANGER

This symbol alerts you to a dangerous situation. Failure to avoid this situation will result in serious or fatal injury.

NOTICE

This symbol contains information on procedures and other facts which do not result in personal injury.

▲ WARNING

This symbol alerts you to a dangerous situation. Failure to avoid this situation can result in serious or fatal injury.

2.1.2 Symbols for certain types of information and graphics



Warns against radioactive substances or ionizing radiation



Permitted

Procedures, processes or actions that are permitted



Forbidden

Procedures, processes or actions that are forbidden



Tip

Indicates additional information



Reference to documentation



Notice or individual step to be observed

1., 2., 3.

Series of steps



Result of a step

1, 2, 3, ...

Item numbers

A, B, C, ... Views

(a)

Visual inspection

2.2 Documentation

The following document types are available in the Downloads area of the Endress+Hauser website (www.endress.com/downloads):



- For an overview of the scope of the associated Technical Documentation, refer to the following:
- Device Viewer (www.endress.com/deviceviewer): Enter serial number from nameplate.
- Endress+Hauser Operations app: Enter serial number from nameplate or scan matrix code on nameplate.

2.2.1 Technical Information (TI)

Planning aid

The document contains all the technical data on the device and provides an overview of the accessories and other products that can be ordered for the device.

2.2.2 Operating Instructions (BA)

Your reference quide

These Operating Instructions contain all the information that is required in various phases of the life cycle of the device: from product identification, incoming acceptance and storage, to mounting, connection, operation and commissioning through to troubleshooting, maintenance and disposal.

2.2.3 Safety Instructions (XA)

Depending on the approval, the following Safety Instructions (XA) are supplied with the device. They are an integral part of the Operating Instructions.



The nameplate indicates the Safety Instructions (XA) that are relevant to the device.

2.2.4 Functional Safety Manual (FY)

Depending on the SIL approval, the Functional Safety Manual (FY) is an integral part of the Operating Instructions and applies in addition to the Operating Instructions, Technical Information and ATEX Safety Instructions.



The different requirements that apply for the protective function are described in the Functional Safety Manual (FY).

2.3 Registered trademarks

HART®

Registered trademark of the FieldComm Group, Austin, Texas, USA

Apple[®]

Apple, the Apple logo, iPhone, and iPod touch are trademarks of Apple Inc., registered in the U.S. and other countries. App Store is a service mark of Apple Inc.

Android®

Android, Google Play and the Google Play logo are trademarks of Google Inc.

Bluetooth®

The *Bluetooth*® word mark and logos are registered trademarks owned by the Bluetooth SIG, Inc. and any use of such marks by Endress+Hauser is under license. Other trademarks and trade names are those of their respective owners.

3 Basic safety instructions

3.1 Requirements for personnel

The personnel for installation, commissioning, diagnostics and maintenance must fulfill the following requirements:

- Trained, qualified specialists must have a relevant qualification for this specific function and task
- Are authorized by the plant owner/operator
- Are familiar with federal/national regulations
- Before beginning work, the specialist staff must have read and understood the instructions in the Operating Instructions and supplementary documentation as well as in the certificates (depending on the application)
- Following instructions and basic conditions

The operating personnel must fulfill the following requirements:

- Being instructed and authorized according to the requirements of the task by the facility's owner-operator
- Following the instructions in these Operating Instructions

3.2 Intended use

The Gammapilot FMG50 is a compact transmitter for non-contact level, point level, density and concentration measurement. The detector is up to 3 m (9.84 ft) in length. The Gammapilot FMG50 is certified according to IEC 61508 for safety-related operation up to SIL 2/3.

3.3 Hazardous area

If the measuring system is used in hazardous areas, the corresponding national standards and regulations must be observed. The device is accompanied by separate "Ex documentation", which is an integral part of these Operating Instructions. The installation specifications, connection values and safety instructions listed in this supplementary documentation must be observed.

- Technical personnel must be qualified and trained for the hazardous area.
- Comply with the metrological and safety-related requirements for the measuring point.

A WARNING

► Observe the safety instructions associated with the device. These instructions depend on the certificate ordered


3.4 Radiation protection

The Gammapilot FMG50 is used in conjunction with a radioactive source, fitted in a source container. The Gammapilot FMG50 does not emit any radioactive radiation. Observe the following instructions when handling radioactive sources:

3.4.1 Basic radiation protection guidelines

WARNING

► When working with radioactive sources, avoid any unnecessary exposure to radiation. All unavoidable radiation exposure must be kept to a minimum. Three basic concepts apply to achieve this:

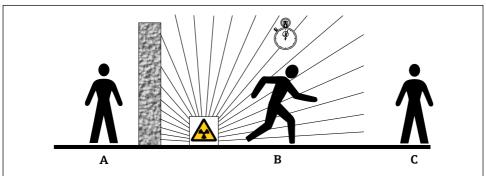

A0016373

- A Shielding
- B Time
- C Distance

A CAUTION

► When working with source containers, all the instructions for mounting and usage outlined in the following documents must be observed:



Source container documentation

- **■** FOG60:
 - TI00445F
- FQG61, FQG62:
 - TI00435F
- FOG63:
 - TI00446F
- FQG66:
 - TI01171F
 - BA01327F

Shielding

Ensure the best possible shielding between the radiation source and yourself and all other person. Effective shielding is provided by source containers (FQG60, FQG61/FQG62,FQG63, FQG66) and all high-density materials (lead, iron, concrete etc.).

Time

Remain as short as possible in the area exposed to radiation.

Distance

Keep as far away from the radiation source as possible. The radiation intensity decreases in proportion to the square of the distance from the radiation source.

3.5 Workplace safety

When working on and with the device:

- ▶ Wear the required personal protective equipment as per national regulations.
- ► Switch off the supply voltage before connecting the device.

3.6 Operational safety

Risk of injury!

- ▶ Operate the device only if it is in proper technical condition, free from errors and faults.
- ► The operator is responsible for ensuring trouble-free operation of the device.

3.7 Product safety

This measuring device is designed in accordance with good engineering practice to meet state-of-the-art safety requirements, has been tested, and left the factory in a condition in which it is safe to operate. It meets general safety standards and legal requirements.

The manufacturer confirms successful testing of the device by affixing to it the CE mark, the UKCA mark, the C-Tick mark and the EAC mark.

3.8 Supplementary safety instructions

A CAUTION

Devices with version NaI(TI) contain more than 0.1% sodium iodide and are recorded in the CAS No. 7681-82-5 safety data sheet.

► The sodium iodide is generally not accessible and fully encapsulated. Ensure full compliance with the safety instructions in the CAS No.7681-82-5 safety data sheet if the encapsulation of the sodium iodide within the device is damaged.

4 Incoming acceptance and product identification

4.1 Incoming acceptance

Check the following during incoming acceptance:

- Are the order codes on the delivery note and the product sticker identical?
- Are the goods undamaged?
- Does the data on the nameplate match the order specifications on the delivery note?
- If required (see nameplate), are the Safety Instructions (XA) provided?
- If any one of these conditions is not met, contact your Endress+Hauser Sales Center.

4.1.1 Product identification

The following options are available for identification of the device:

- Nameplate specifications
- Extended order code with breakdown of the device features on the delivery note
- ► Enter serial number from nameplates in *W@M Device Viewer* (www.endress.com/deviceviewer)
 - ► All of the information on the measuring device and on the scope of the technical documentation pertaining to the device is displayed.
- ► Enter the serial number from the nameplate into the *Endress+Hauser Operations App* or scan the 2-D matrix code on the nameplate.
 - All of the information on the measuring device and on the scope of the technical documentation pertaining to the device is displayed.

4.1.2 Manufacturer address

Endress+Hauser SE+Co. KG Hauptstraße 1 79689 Maulburg, Germany

Place of manufacture: See nameplate.

4.2 Transport, storage and disposal

4.2.1 Storage conditions

Pack the device so that is protected against impact for storage and transport. The original packaging offers the best protection for this. The permitted storage temperature is:

NaI (Tl) crystal

 $-40 \text{ to } +80 \,^{\circ}\text{C} \, (-40 \text{ to } +176 \,^{\circ}\text{F})$

PVT scintillator (standard)

 $-40 \text{ to } +60 \,^{\circ}\text{C} \, (-40 \text{ to } +140 \,^{\circ}\text{F})$

PVT scintillator (high-temperature version)

-20 to +80 °C (−4 to +176 °F)



As the device contains a battery, it is recommended to store the device at room temperature in a location that does not receive direct sunlight

4.2.2 Transporting to the measuring point

A CAUTION

Risk of injury

► Follow the safety instructions and transport conditions for devices weighing more than 18 kg (39.69 lb).

4.2.3 Disposal



If required by the Directive 2012/19/EU on waste electrical and electronic equipment (WEEE), our products are marked with the depicted symbol in order to minimize the disposal of WEEE as unsorted municipal waste. Such products may not be disposed of as unsorted municipal waste and can be returned to Endress+Hauser for disposal at conditions stipulated in our General Terms and Conditions or as individually agreed.

Battery disposal

- The end user is legally obliged to return used batteries.
- The end user can return old batteries or electronic assemblies containing these batteries free of charge to Endress+Hauser.



In accordance with German law regulating the use of batteries (BattG §28 Para 1 Number 3), this symbol is used to denote electronic assemblies that must not be disposed of as household waste

5 Mounting

A WARNING

▶ The four screws connecting the detector pipe to the terminal head may not be opened.



0038007

5.1 Mounting requirements

5.1.1 General information

- The angle of emission of the source container must be exactly aligned to the measuring range of the Gammapilot FMG50. Observe the measuring range marks of the device.
- The source container and the Gammapilot FMG50 should be mounted as close to the vessel as possible. Any access to the beam must be blocked to ensure that it is not possible to reach into this area.
- The Gammapilot FMG50 should be protected against direct sunlight or process heat in order to increase its service life.
 - Feature 620, option PA: "Weather protection cover 316L"
 - Feature 620, option PV: "Heat shield 1200-3000 mm, PVT"
 - Feature 620, option PW: "Heat shield NaI, 200-800 mm, PVT"
- Terminals can optionally be ordered with the device
- The mounting device must be installed in such a way as to withstand the weight of the Gammapilot FMG50 under all anticipated operating conditions (e.g. vibrations).
- More information with regard to the safety-related use of the Gammapilot FMG50 can be found in the Functional Safety Manual.

In addition to the dimensions and weights, the mounting requirements for level measurement and point level measurement are described in the following section.


Mounting requirements for

- Density measurement
- Interface measurement
- Density profile measurement (DPS)
- Concentration measurement
- Concentration measurement with radiating media
- Flow measurements

are described in the Operating Instructions.

5.1.2 Dimensions, weights

Gammapilot FMG50

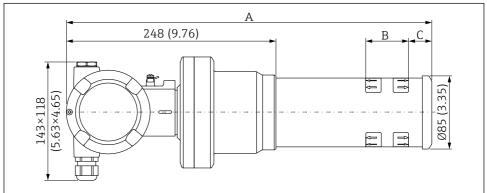

A0037984

Version NaI (Tl) 2":

- Total length A: 430 mm (16.93 in)
- Total weight: 11.60 kg (25.57 lb)
- Measuring range length B: 51 mm (2 in)
- Distance C: 24 mm (0.94 in)

■ Version NaI (Tl) 4":

- Total length A: 480 mm (18.90 in)
- Total weight: 12.19 kg (26.87 lb)
- Measuring range length B: 102 mm (4 in)
- Distance C: 24 mm (0.94 in)

■ Version NaI (Tl) 8":

- Total length A: 590 mm (23.23 in)
- Total weight: 13.00 kg (28.63 lb)
- Measuring range length B: 204 mm (8 in)
- Distance C: 30 mm (1.18 in)

■ Version PVT 200:

- Total length A: 590 mm (23.23 in)
- Total weight: 12.10 kg (26.68 lb)
- Measuring range length B: 200 mm (8 in)
- Distance C: 41 mm (1.61 in)

■ Version PVT 400:

- Total length A: 790 mm (31.10 in)
- Total weight: 13.26 kg (29.23 lb)
- Measuring range length B: 400 mm (16 in)
- Distance C: 41 mm (1.61 in)

Version PVT 800 :

- Total length A: 1190 mm (46.85 in)
- Total weight: 15.54 kg (34.26 lb)
- Measuring range length B: 800 mm (32 in)
- Distance C: 41 mm (1.61 in)

■ Version PVT 1200:

- Total length A: 1590 mm (62.60 in)
- Total weight: 17.94 kg (39.55 lb)
- Measuring range length B: 1200 mm (47 in)
- Distance C: 41 mm (1.61 in)

Version PVT 1600 :

- Total length A: 1990 mm (78.35 in)
- Total weight: 20.14 kg (44.40 lb)
- Measuring range length B: 1600 mm (63 in)
- Distance C: 41 mm (1.61 in)

■ Version PVT 2000:

- Total length A: 2 390 mm (94.09 in)
- Total weight: 22.44 kg (49.47 lb)
- Measuring range length B: 2 000 mm (79 in)
- Distance C: 41 mm (1.61 in)

■ Version PVT 2400:

- Total length A: 2790 mm (109.84 in)
- Total weight: 24.74 kg (54.54 lb)
- Measuring range length B: 2 400 mm (94 in)
- Distance C: 41 mm (1.61 in)

Version PVT 3000 :


- Total length A: 3390 mm (133.46 in)
- Total weight: 28.14 kg (62.04 lb)
- Measuring range length B: 3 000 mm (118 in)
- Distance C: 41 mm (1.61 in)
- The weight data refer to the stainless steel housing versions. The aluminum housing versions are 2.5 kg (5.51 lb) lighter.
- The additional weight for small parts is: 1 kg (2.20 lb)
- If using a collimator, pay attention to the documentation SD02822F.

5.1.3 Mounting requirements for level measurements

Conditions

- The Gammapilot FMG50 is mounted vertically for level measurements.
- To facilitate installation and commissioning, the Gammapilot FMG50 can be configured and ordered with an additional support (order feature 620, option Q4: "Retaining bracket").

Examples

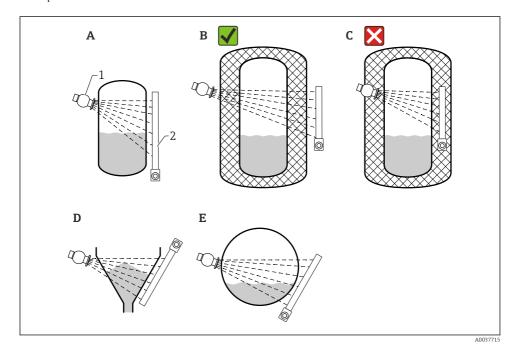


- A Vertical cylinder; the Gammapilot FMG50 is mounted vertically with the detector head pointing either downwards or upwards, the gamma radiation is aligned to the measuring range.
- B Correct: Gammapilot FMG50 mounted outside the tank insulation
- C Incorrect: Gammapilot FMG50 mounted inside the tank insulation
- D Conical tank outlet
- E Horizontal cylinder
- 1 Source container
- 2 Gammapilot FMG50

5.1.4 Mounting requirements for point level measurement

Conditions

For point level detection, the Gammapilot FMG50 is generally mounted horizontally at the height of the desired level limit.

Measuring system arrangement

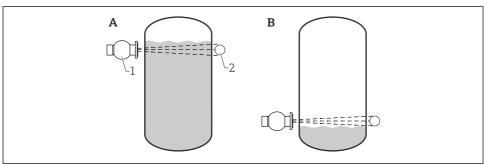

A0018075

- A Maximum point level detection
- B Minimum point level detection
- 1 Source container
- 2 Gammapilot FMG50

6 Electrical connection

6.1 Connecting requirements


A WARNING

Note the following before connecting:

- ▶ If the device is used in hazardous areas, make sure to comply with national standards and the specifications in the Safety Instructions (XAs). The specified cable gland must be used.
- ► The supply voltage must match the specifications on the nameplate.
- $\,\blacktriangleright\,$ Switch off the supply voltage before connecting the device.
- ► Connect the potential matching line to the external ground terminal of the transmitter before connecting the device.
- ► Connect the protective ground to the protective ground terminal.
- ► The cables must be adequately insulated, with due consideration given to the supply voltage and the overvoltage category.
- ► The connecting cables must offer adequate temperature stability, with due consideration given to the ambient temperature.

6.1.1 4 to 20 mA HART connection

Connection of the device with HART communication, power source and 4 to 20 mA display

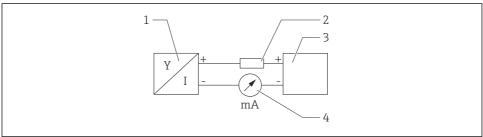

4002000

■ 1 Block diagram of HART connection

- 1 Device with HART communication
- 2 HART resistor
- 3 Power supply
- 4 Multimeter or ammeter

Power supply

■ Non-Ex: supply voltage: 16 to 35 VDC

■ Ex i: supply voltage: 16 to 30 VDC

The HART communication resistor of 250 Ω in the signal line is always necessary in the case of a low-impedance power supply.

The voltage drop to be taken into account is:

Max. 6 V for 250 O communication resistor.

6.1.2 Rated cross-section

Protective ground or grounding of the cable shield: rated cross-section $> 1 \text{ mm}^2$ (17 AWG) Rated cross-section of 0.5 mm² (AWG20) to 2.5 mm² (AWG13)

6.2 Connecting the device


A WARNING

- Please refer to the separate documentation on applications in hazardous areas for the safety instructions
- For optimum electromagnetic compatibility, the potential matching line should be as short as possible and at least 2.5 mm^2 (14 AWG) in cross-section.
- Connecting cables should be routed away from the housing from below to prevent moisture from penetrating the connection compartment. Otherwise, a drip loop should be provided or a weather protection cover should be used.
- Please follow the enclosed installation instructions if a G1/2 entry is used.
- Housing thread
 The thread of the electronics and connection compartment is co
 - The thread of the electronics and connection compartment is coated with lubricant varnish.

X Avoid additional lubrication.

6.2.1 Direct connection






A0038024

1 Ground terminal for connecting the potential matching line

Connect the potential matching line to the ground terminal.






A0038877

1 Connection compartment

Release the cover lock to the connection compartment.

3. Unscrew the cover.






A0038156

- 1 Cable entry
- 2 Dummy plug

Guide the cables into the cable glands or cable entries.

5.

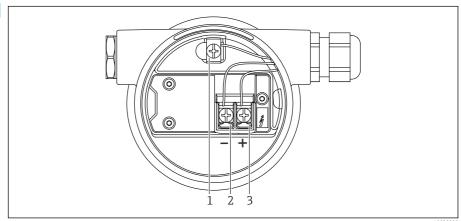

A0038895

- 2 Connection terminals and ground terminal in the connection compartment
- 1 Internal ground terminal (to ground the cable shield)
- 2 Negative terminal
- 3 Positive terminal


Connect the cable.

- 6. Tighten the cable glands or cable entries so that they are leak-tight.
- 7. Screw the cover securely back onto the connection compartment.
- 8. Tighten the cover lock.

6.2.2 Connection with fieldbus connector

In the case of device versions with a fieldbus connector, the housing does not have to be opened to establish the connection.

Pin assignment for connector M12-A



A0011175

Pin 1: Signal +


Pin 2: Not used

Pin 3: Signal -

Pin 4: Ground

Material: CuZn, gold-plated contacts of the plug-in jack and plug

6.2.3 Connection with a Harting plug Han7D

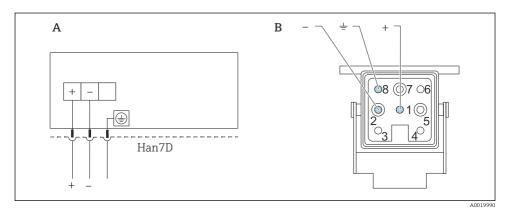

- A Electrical connection for devices with Harting plug Han7D
- B View of the connection on the device


Material: CuZn, gold-plated contacts of the plug-in jack and plug

6.3 Connecting an operating unit



For descriptions on the individual operating units, see the Operating Instructions. $\label{eq:continuous}$

A wide range of operating units is available for operating the device via the HART protocol. Connection of these units is illustrated in the diagram below.

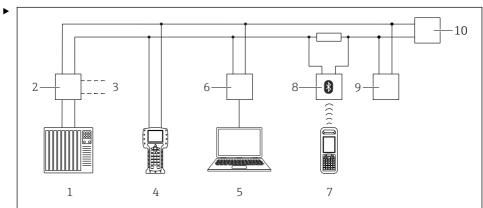

A0030185

- 3 Options for remote operation via HART protocol
- 1 *PLC* (programmable logic controller)
- 2 Transmitter power supply unit, e.g. RN221N (with communication resistor)
- 3 Connection for Commubox FXA191, FXA195 and Field Communicator 375, 475
- 4 Field Communicator 475
- 5 Computer with operating tool (e.g. DeviceCare/FieldCare, AMS Device Manager, SIMATIC PDM)
- 6 Commubox FXA191 (RS232) or FXA195 (USB)
- 7 Field Xpert SFX350/SFX370
- 8 VIATOR Bluetooth modem with connecting cable
- 9 RIA15
- 10 Device (FMG50)

Connect one or more operating units to the device.

7 Commissioning

7.1 Post-installation and post-connection check

Perform the post-installation check and the post-connection check for the FMG50 prior to commissioning the measuring point.


You can reset the device to the factory setting in the event of an error.

7.1.1 Resetting to the default configuration

A CAUTION

- ► A reset may negatively impact the measurement. As a rule, a basic setup must be performed again after a reset. All calibration data are deleted after a reset. A complete recalibration is needed to put the measurement back into operation.
- 1. Connect the device with FieldCare or DeviceCare.

- 2. Open the device in FieldCare or DeviceCare.
 - The dashboard (homepage) of the device is displayed: Click "System → Device management"

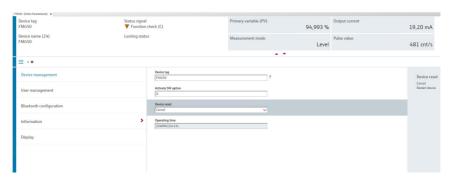

3. Reset the device in the "Device reset" parameter

The following types of reset can be selected:

Restart device

A soft reset is performed here. The device software performs all the diagnostics that would also be performed by a hard reset by switching the device on/off.

Reset to factory default

It is always advisable to reset the customer parameters if you want to use a device with an unknown history, or if the operating mode is changed. When a reset is performed, all customer parameters are reset to the factory default values

Optional: reset to customer settings

If the device was ordered with a customized configuration, a reset restores these customer settings configured at the factory.

A reset can also be performed on site via the operating keys (see the "Commissioning via onsite operation" section).


7.2 Commissioning using the wizard

A wizard is provided in FieldCare or DeviceCare $^{1)}$ that guides the user through the initial commissioning process.

1. Connect the device with FieldCare or DeviceCare.

FieldCare and DeviceCare are available for download at www.software-products.endress.com. To download the software, it is necessary to register in the Endress+Hauser software portal.

- 2. Open the device in FieldCare or DeviceCare.

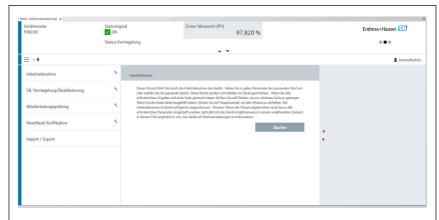

Δ0039359

- 4 Screenshot: Commissioning Wizard
- 3. Click "Commissioning" to launch the Wizard.
- 4. Enter the appropriate value in each parameter or select the appropriate option. These values are written directly to the device.
- 5. Click "Next" to go to the next page.
- 6. Once all the pages have been completed, click "Finish" to close the Wizard.
- If you cancel the Wizard before all the necessary parameters have been entered, the device may be in an undefined state. In such situations, it is advisable to reset the device to the factory default settings.

7.3 Operation

7.3.1 Operation via FieldCare/DeviceCare

FieldCare/DeviceCare is an Endress+Hauser asset management tool based on FDT technology. With FieldCare/DeviceCare you can configure all Endress+Hauser devices as well as devices from other manufacturers that support the FDT standard. Hardware and software requirements can be found on the Internet:

www.de.endress.com -> Search: FieldCare -> FieldCare -> Technical data

FieldCare supports the following functions:

- Configuration of transmitters in online mode
- Loading and saving of device data (upload/download)
- Documentation of the measuring point

Connection options:

- HART via Commubox FXA195 and the USB port on a computer
- Commubox FXA291 via the service interface

7.3.2 Operation via SmartBlue app

Requirements

Device requirements

Commissioning via SmartBlue is only possible if the device has a Bluetooth module.

SmartBlue system requirements


SmartBlue is available as a download from the Google Play Store for Android devices and from the iTunes Store for iOS devices.

- Devices with iOS:
 - iPhone 4S or higher from iOS9.0; iPad2 or higher from iOS9.0; iPod Touch 5th generation or higher from iOS9.0
- Devices with Android: From Android 4.4 KitKat and Bluetooth® 4.0

Initial password

The serial number of the device is used as the initial password when establishing the connection for the first time. The serial number can be found on the nameplate.

SmartBlue app

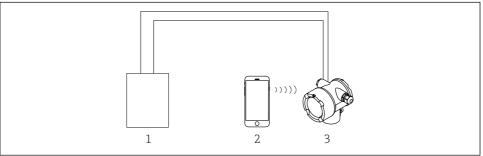

A0038833

- 5 Operation via SmartBlue (app)
- 1 Transmitter power supply unit
- 2 Smartphone / tablet with SmartBlue (app)
- 3 Transmitter with Bluetooth module
- 1. Scan the QR code or enter "SmartBlue" in the search field of the App Store.



A0039186

■ 6 Download link

2.2.

- 2. Start SmartBlue.
- 3. Select device from livelist displayed.
- 4. Enter the login data:
 - User name: admin
 Password: serial number of the device or ID number of the Bluetooth display
 An available Bluetooth connection is indicated by a flashing Bluetooth symbol.
- 5. Tap the icons for more information.

For commissioning, see the "Commissioning Wizard" section


- Change the password after logging in for the first time!
- Bluetooth is not available in all markets.

 Please pay attention to the radio approvals listed in document SD02402F or contact the Endress+Hauser sales organization.

7.3.3 Operation via local display

Operation via keys is only active if a display is not attached

The device can also be operated on site using the keys. If operation is locked using the DIP switches on site, parameter entry via communication is not possible.

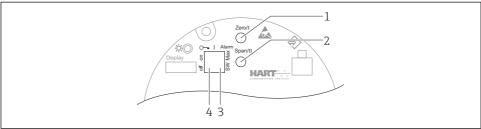

A0039395

- 1 Operating key for empty calibration (function I)
- 2 Operating key for full calibration (function II)
- 3 DIP switch for alarm current (SW-defined/Min. alarm)
- 4 DIP switch for locking and unlocking the device
- **Empty calibration:** Press and hold the operating key for empty calibration (I) > 3 s
- **Full calibration:** Press and hold the operating key for full calibration (II) > 3 s
- Background calibration: Simultaneously press and hold the operating key for empty calibration (I) and operating key for full calibration (II) > 3 s
- Reset to factory defaults: Simultaneously press and hold the operating key for empty calibration (I) and full calibration (II) > 12 s. The LED starts flashing. When the flashing stops, the device is reset to the factory default settings.

Level basic calibration

Calibration time per calibration: 5 min!

- Reset
 - ► Press both keys > 12 s
- 2. Start background calibration
 - ▶ Press both keys > 3 s
 The green LED is lit for one second and starts flashing at an interval of 2 s
- 3. Start empty calibration
 - Press the "Zero / 1" key > 3 s
 The green LED is lit for one second and starts flashing at an interval of 2 s
 Wait 5 min until the green LED stops flashing
- 4. Start full calibration
 - → Press the "Span / 2" key > 3 s

 The green LED is lit for one second and starts flashing at an interval of 2 s

 Wait 5 min until the green LED stops flashing

A reset deletes all calibrations!

Status and power LED


A green LED that signals the status and button activation feedback is provided on the electronic insert.

Behavior of the LED

- The LED flashes once briefly when the device is started
- When a key is pressed, the LED flashes to confirm the key activation
- When a reset is performed, the LED flashes as long as both keys are pressed and the reset is not yet active (countdown). The LED stops flashing once the reset is active.
- The LED flashes while calibration is being performed via onsite operation

7.3.4 Operation via the service interface

DeviceCare/FieldCare via service interface (CDI)

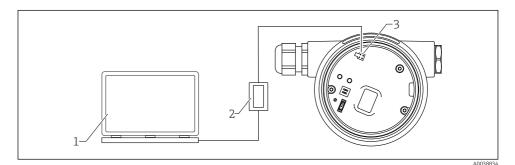

■ 7 DeviceCare/FieldCare via service interface (CDI)

- 1 Computer with DeviceCare/FieldCare operating tool
- 2 Commubox FXA291
- 3 Service interface (CDI) of the device (= Endress+Hauser Common Data Interface)

7.3.5 Operation via WirelessHART

SWA70 WirelessHART adapter with the Commubox FXA195 and the "FieldCare/DeviceCare" operating program

7.3.6 Overview of the operating menu

A complete overview of the operating menu is provided in the "Description of Device Parameters" documentation.



GP01141F





www.addresses.endress.com