


# Operating Instructions

## Picomag IO-Link

Electromagnetic flowmeter



- Make sure the document is stored in a safe place such that it is always available when working on or with the device.
- To avoid danger to individuals or the facility, read the "Basic safety instructions" section carefully, as well as all other safety instructions in the document that are specific to working procedures.
- The manufacturer reserves the right to modify technical data without prior notice. Your Endress+Hauser Sales Center will supply you with current information and updates to these instructions.

# Table of contents

<b>1</b>	<b>About this document</b> . . . . .	<b>5</b>	<b>7</b>	<b>Operation options</b> . . . . .	<b>20</b>
1.1	Document function . . . . .	5	7.1	Access to the operating menu via the SmartBlue app . . . . .	20
1.2	Symbols used . . . . .	5	<b>8</b>	<b>System integration</b> . . . . .	<b>21</b>
1.2.1	Safety symbols . . . . .	5	8.1	Overview of device description files . . . . .	21
1.2.2	Electrical symbols . . . . .	5	8.2	Device master file . . . . .	21
1.2.3	Communication-specific symbols . . . . .	5	<b>9</b>	<b>Commissioning</b> . . . . .	<b>22</b>
1.2.4	Symbols for certain types of information . . . . .	6	9.1	Switching ON the measuring device . . . . .	22
1.2.5	Symbols in graphics . . . . .	6	9.2	Overview of the operating menu . . . . .	22
1.3	Documentation . . . . .	6	9.3	Configuring the measuring device . . . . .	22
1.4	Registered trademarks . . . . .	6	9.3.1	Identification . . . . .	22
<b>2</b>	<b>Basic safety instructions</b> . . . . .	<b>8</b>	9.3.2	Configuring system units . . . . .	22
2.1	Requirements for the personnel . . . . .	8	9.3.3	Setting the installation direction and measurement . . . . .	23
2.2	Intended use . . . . .	8	9.3.4	Configuring the IO modules . . . . .	24
2.3	Workplace safety . . . . .	8	9.3.5	Totalizer . . . . .	29
2.4	Operational safety . . . . .	9	9.3.6	Configuring the display . . . . .	30
2.5	Product safety . . . . .	9	9.3.7	Data management . . . . .	31
2.6	IT security . . . . .	9	9.3.8	Security . . . . .	31
2.7	Device-specific IT security . . . . .	9	9.4	Diagnostics . . . . .	32
2.7.1	Access via Bluetooth® wireless technology . . . . .	9	9.5	System . . . . .	32
2.7.2	Protecting access via a password . . . . .	9	<b>10</b>	<b>Operation</b> . . . . .	<b>33</b>
2.7.3	Access via the SmartBlue app . . . . .	10	10.1	Offline quick view of configuration . . . . .	33
<b>3</b>	<b>Incoming acceptance and product identification</b> . . . . .	<b>11</b>	<b>11</b>	<b>Diagnostics and troubleshooting</b> . . . . .	<b>35</b>
3.1	Incoming acceptance . . . . .	11	11.1	General troubleshooting . . . . .	35
3.2	Product identification . . . . .	11	11.2	Diagnostic information on local display . . . . .	36
3.2.1	Symbols on measuring device . . . . .	12	11.2.1	Diagnostic message . . . . .	36
<b>4</b>	<b>Storage and transport</b> . . . . .	<b>13</b>	11.3	Overview of diagnostic events . . . . .	37
4.1	Storage conditions . . . . .	13	11.4	Device information . . . . .	37
4.2	Transporting the product . . . . .	13	11.5	Firmware history . . . . .	38
4.3	Packaging disposal . . . . .	13	<b>12</b>	<b>Accessories</b> . . . . .	<b>39</b>
<b>5</b>	<b>Mounting</b> . . . . .	<b>14</b>	<b>13</b>	<b>Technical data</b> . . . . .	<b>41</b>
5.1	Mounting requirements . . . . .	14	13.1	Input . . . . .	41
5.1.1	Mounting position . . . . .	14	13.2	Output . . . . .	41
5.2	Mounting the measuring device . . . . .	14	13.3	Power supply . . . . .	41
<b>6</b>	<b>Electrical connection</b> . . . . .	<b>16</b>	13.4	Performance characteristics . . . . .	41
6.1	Electrical safety . . . . .	16	13.5	Installation . . . . .	42
6.2	Connecting requirements . . . . .	16	13.6	Environment . . . . .	42
6.2.1	Requirements for connection cable . . . . .	16	13.7	Process . . . . .	42
6.2.2	Pin assignment, device plug . . . . .	16	13.8	Mechanical construction . . . . .	43
6.3	Connecting the device . . . . .	19	13.9	Operability . . . . .	45
6.4	Post-connection check . . . . .	19	13.10	Certificates and approvals . . . . .	46

---

<b>14</b>	<b>Appendix</b> .....	<b>47</b>
14.1	Radio approvals .....	47
14.1.1	Argentina .....	47
14.1.2	Brazil .....	47
14.1.3	Europe .....	47
14.1.4	India .....	47
14.1.5	Indonesia .....	48
14.1.6	Canada and United States .....	48
14.1.7	Mexico .....	48
14.1.8	Republic of Korea .....	49
14.1.9	Singapore .....	49
14.1.10	Taiwan .....	49
14.1.11	Thailand .....	49
14.1.12	United Arab Emirates .....	50
14.1.13	Other countries .....	50
14.2	IO-Link process data .....	51
14.2.1	Data structure .....	51
14.2.2	Diagnostic information .....	51
14.3	IO-Link ISDU parameter list .....	52
	<b>Index</b> .....	<b>59</b>

# 1 About this document

## 1.1 Document function

These Operating Instructions contain all the information that is required in various phases of the life cycle of the device: from product identification, incoming acceptance and storage, to mounting, connection, operation and commissioning through to troubleshooting, maintenance and disposal.

## 1.2 Symbols used

### 1.2.1 Safety symbols

#### DANGER

This symbol alerts you to a dangerous situation. Failure to avoid this situation will result in serious or fatal injury.

#### WARNING

This symbol alerts you to a dangerous situation. Failure to avoid this situation can result in serious or fatal injury.



#### CAUTION

This symbol alerts you to a dangerous situation. Failure to avoid this situation can result in minor or medium injury.



#### NOTICE

This symbol contains information on procedures and other facts which do not result in personal injury.











### 1.2.2 Electrical symbols

Symbol	Meaning
	Direct current
	<b>Ground connection</b> A grounded terminal which, as far as the operator is concerned, is grounded via a grounding system.

### 1.2.3 Communication-specific symbols

Symbol	Meaning
	<b>Bluetooth®</b> Wireless data transmission between devices over a short distance.
 IO-Link®	<b>IO-Link</b> Communications system for connecting intelligent sensors and actuators to an automation system. In the IEC 61131-9 standard, IO-Link is standardized under the name "Single-drop digital communication interface for small sensors and actuators (SDCI)".


### 1.2.4 Symbols for certain types of information

Symbol	Meaning
	<b>Permitted</b> Procedures, processes or actions that are permitted.
	<b>Preferred</b> Procedures, processes or actions that are preferred.
	<b>Forbidden</b> Procedures, processes or actions that are forbidden.
	<b>Tip</b> Indicates additional information.
	Reference to documentation
	Reference to page
	Reference to graphic
	Notice or individual step to be observed
	Series of steps
	Result of a step

### 1.2.5 Symbols in graphics

Symbol	Meaning
1, 2, 3, ...	Item numbers
A, B, C, ...	Views

## 1.3 Documentation

 For an overview of the scope of the associated Technical Documentation, refer to the following:

- The *W@M Device Viewer*: Enter the serial number of the measuring device ([www.endress.com/deviceviewer](http://www.endress.com/deviceviewer))
- The *Endress+Hauser Operations App*: Enter the serial number of the measuring device or scan the 2-D matrix code on the measuring device.

## 1.4 Registered trademarks

### IO-Link®

Is a registered trademark. It may only be used in conjunction with products and services by members of the IO-Link Community or by non-members who hold an appropriate license. For more specific guidelines on use, refer to the IO-Link Community rules on:

[www.io.link.com](http://www.io.link.com).

### Bluetooth® wireless technology



The Bluetooth® word mark and logos are registered trademarks owned by the Bluetooth SIG, Inc. and any use of such marks by Endress+Hauser is under license.

### Apple®

Apple, the Apple logo, iPhone, and iPod touch are trademarks of Apple Inc., registered in the U.S. and other countries. App Store is a service mark of Apple Inc.

**Android®**

Android, Google Play and the Google Play logo are trademarks of Google Inc.

## 2 Basic safety instructions

### 2.1 Requirements for the personnel

The personnel for installation, commissioning, diagnostics and maintenance must fulfill the following requirements:

- ▶ Trained, qualified specialists must have a relevant qualification for this specific function and task.
- ▶ Are authorized by the plant owner/operator.
- ▶ Are familiar with federal/national regulations.
- ▶ Before starting work, read and understand the instructions in the manual and supplementary documentation as well as the certificates (depending on the application).
- ▶ Follow instructions and comply with basic conditions.

The operating personnel must fulfill the following requirements:

- ▶ Are instructed and authorized according to the requirements of the task by the facility's owner-operator.
- ▶ Follow the instructions in this manual.

### 2.2 Intended use

#### Application and media

The measuring device described in this manual is intended only for the flow measurement of liquids with a minimum conductivity of 10  $\mu\text{S}/\text{cm}$ .

To ensure that the measuring device remains in proper condition for the operation time:

- ▶ Use the measuring device only for media to which the process-wetted materials have an adequate level of resistance.
- ▶ Not suitable for use in ambient atmospheres with contamination by harmful gases, e.g. hydrogen sulfide, sulfur dioxide, nitrogen oxides or chlorine gas.

#### Incorrect use

Non-designated use can compromise safety. The manufacturer is not liable for damage caused by improper or non-designated use.

#### WARNING

#### **Danger of breakage due to corrosive or abrasive fluids and ambient conditions!**

- ▶ Verify the compatibility of the process fluid with the sensor material.
- ▶ Ensure the resistance of all fluid-wetted materials in the process.
- ▶ Keep within the specified pressure and temperature range.

#### Residual risks

#### CAUTION

**Risk of hot or cold burns! The use of media and electronics with high or low temperatures can produce hot or cold surfaces on the device.**

- ▶ Mount suitable touch protection.

### 2.3 Workplace safety

When working on and with the device:

- ▶ Wear the required personal protective equipment as per national regulations.



## 2.4 Operational safety

Risk of injury!

- ▶ Operate the device in proper technical condition and fail-safe condition only.
- ▶ The operator is responsible for interference-free operation of the device.

## 2.5 Product safety

This measuring device is designed in accordance with good engineering practice to meet state-of-the-art safety requirements, has been tested, and left the factory in a condition in which it is safe to operate.

It meets general safety standards and legal requirements. It also complies with the EU directives listed in the device-specific EU Declaration of Conformity. The manufacturer confirms this by affixing the CE mark to the device..

## 2.6 IT security

The manufacturer warranty is valid only if the product is installed and used as described in the Operating Instructions. The product is equipped with security mechanisms to protect it against any inadvertent changes to the settings.

IT security measures, which provide additional protection for the product and associated data transfer, must be implemented by the operators themselves in line with their security standards.

## 2.7 Device-specific IT security

### 2.7.1 Access via Bluetooth® wireless technology

**Secure signal transmission via Bluetooth® wireless technology uses an encryption method tested by the Fraunhofer Institute.**

- The device is not visible via *Bluetooth*® wireless technology without the SmartBlue App.
- Only one point-to-point connection is established between the device and a smartphone or tablet.
- The *Bluetooth*® wireless technology interface can be disabled via SmartBlue.

### 2.7.2 Protecting access via a password

Different passwords are available to protect access to the device via the Bluetooth® interface or write access to the device parameters:

- Bluetooth key  
The password protects a connection between an operating device (e.g. smartphone, tablet) and the device via the Bluetooth® interface.
- User-specific access code  
Protect write access to the device parameters via the SmartBlue app.

#### General notes on the use of passwords

- The access code and Bluetooth key supplied with the device should be changed during commissioning.
- Follow the general rules for generating a secure password when defining and managing the access code or Bluetooth key.
- The user is responsible for the management and careful handling of the access code and Bluetooth key.

### 2.7.3 Access via the SmartBlue app


Two access levels (user roles) are defined for the device: the **Operator** user role and the **Maintenance** user role. The **Maintenance** user role is the default setting.

If a user-specific access code is not defined (in the **Set access code** parameter), the default setting **0000** continues to apply and the **Maintenance** user role is automatically enabled. The device's configuration data are not write-protected and can be edited at all times.


If a user-specific access code has been defined (in the **Set access code** parameter), all the parameters are write-protected and the device is accessed with the **Operator** user role. The previously defined access code must first be entered again before the **Maintenance** user role is enabled and all the parameters can be write-accessed.

### 3 Incoming acceptance and product identification


#### 3.1 Incoming acceptance




Are the order codes on the delivery note (1) and the product sticker (2) identical?

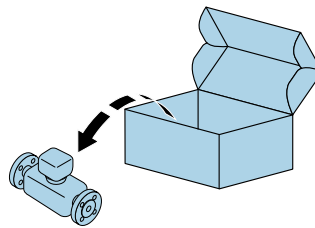

Are the goods undamaged?

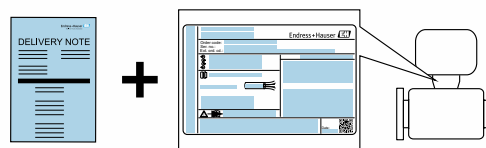

Do the data on the nameplate match the ordering information on the delivery note?

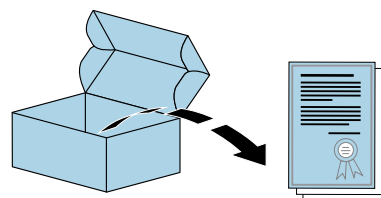

Is the accompanying safety data sheet present?





- If one of the conditions is not satisfied, contact your Endress+Hauser Sales Center.
- The Technical Documentation is available via the Internet or via the *Endress+Hauser Operations App*, see the "Product identification" section .

#### 3.2 Product identification

The following options are available for identification of the measuring device:

- The device label
- Order code with breakdown of the device features on the delivery note
- Enter the serial number on the device label in *W@M Device Viewer* ([www.endress.com/deviceviewer](http://www.endress.com/deviceviewer)): all the information about the measuring device is displayed.
- Enter the serial number on the device label into the *Endress+Hauser Operations App* or scan the 2-D matrix code (QR code) on the measuring device with the *Endress+Hauser Operations App*: all the information about the measuring device is displayed.

### 3.2.1 Symbols on measuring device

Symbol	Meaning
	<b>WARNING!</b> This symbol alerts you to a dangerous situation. Failure to avoid this situation can result in serious or fatal injury. To determine the nature of the potential hazard and the measures required to avoid it, consult the documentation accompanying the measuring device.
	<b>Reference to documentation</b> Refers to the corresponding device documentation.

## 4 Storage and transport

### 4.1 Storage conditions


Observe the following notes for storage:

- ▶ Store in the original packaging to ensure protection from shock.
- ▶ Store in a dry place.
- ▶ Do not store outdoors.

Storage temperature →  42

### 4.2 Transporting the product

Transport the device to the measuring point in the original packaging.

 Do not remove protective covers or caps installed on process connections. They prevent mechanical damage to the sealing surfaces and contamination in the measuring tube.

### 4.3 Packaging disposal


All packaging materials are environmentally friendly and 100% recyclable: Carton in accordance with European Packaging Directive 94/62EC; recyclability is confirmed by the affixed RESY symbol.

## 5 Mounting

### 5.1 Mounting requirements

#### 5.1.1 Mounting position

##### Mounting location

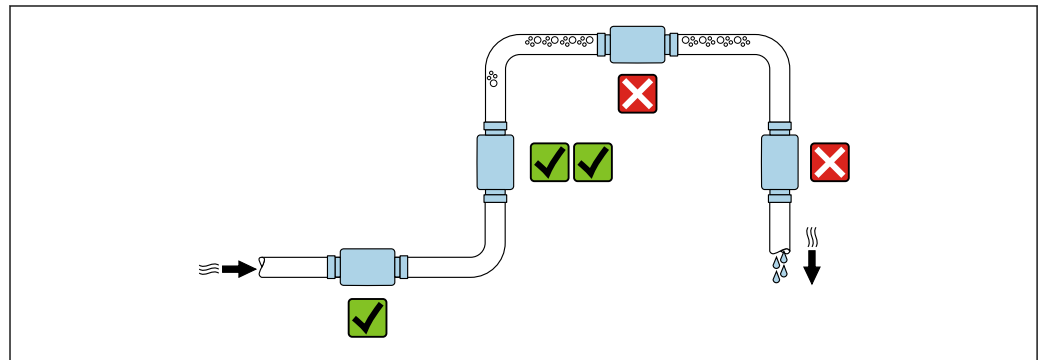

A0046065

Preferably install the sensor in an ascending pipe.

##### Inlet and outlet runs

No inlet and outlet runs need to be considered.

**i** The installation dimensions provide information on the dimensions and installed lengths of the device → 43

**i** The arrow points in the preferred direction of flow. Measurement in the other direction is also possible. → 23

### 5.2 Mounting the measuring device


**i** Install the measuring device without any mechanical tension so that pipe forces are not transferred to the measuring device.

#### **WARNING**

##### **Burn hazard!**

If medium temperatures or ambient temperatures exceed 50 °C, areas of the housing can heat to over 65 °C.


- ▶ Safeguard the housing so that it cannot be touched accidentally.

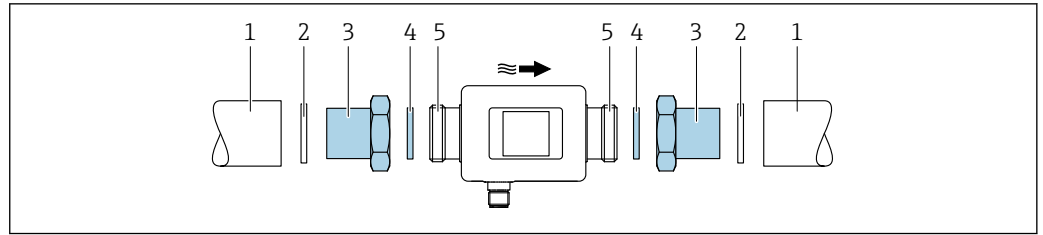

A0039002

**1** Measuring device with male thread

- 1 Pipe with female thread
- 2 Seal (not supplied)
- 3 Adapter: available adapters → 39
- 4 Seal (included in delivery)
- 5 Measuring device connection, male thread

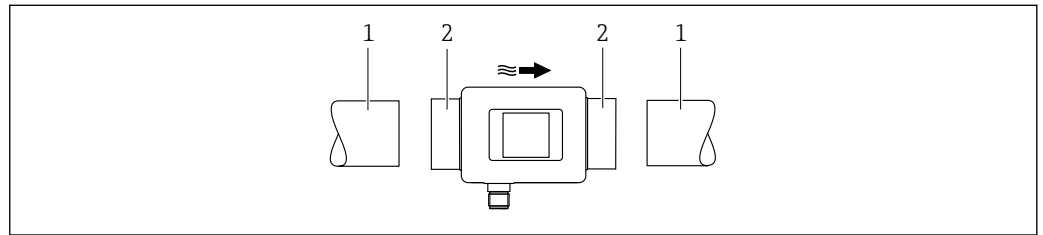

A0046929

**2** Measuring device with female thread

- 1 Pipe with conical male thread
- 2 Measuring device connection, female thread

**i** No seals are included in the delivery for devices with a female thread. Suitable commercially available seal material can be used.


## 6 Electrical connection

### 6.1 Electrical safety

In accordance with applicable national regulations.


### 6.2 Connecting requirements

#### 6.2.1 Requirements for connection cable

National regulations and standards apply. The cable can be ordered as an optional accessory →  39.

<b>Connection cable</b>	M12 × 1 A-coded
<b>Conductor cross-section</b>	At least 0.12 mm <sup>2</sup> (AWG26)
<b>Degree of protection</b>	IP65/67, pollution degree 3
<b>Temperature specification</b>	At least 20 °C (68 °F) higher than the maximum ambient temperature in the application

#### 6.2.2 Pin assignment, device plug

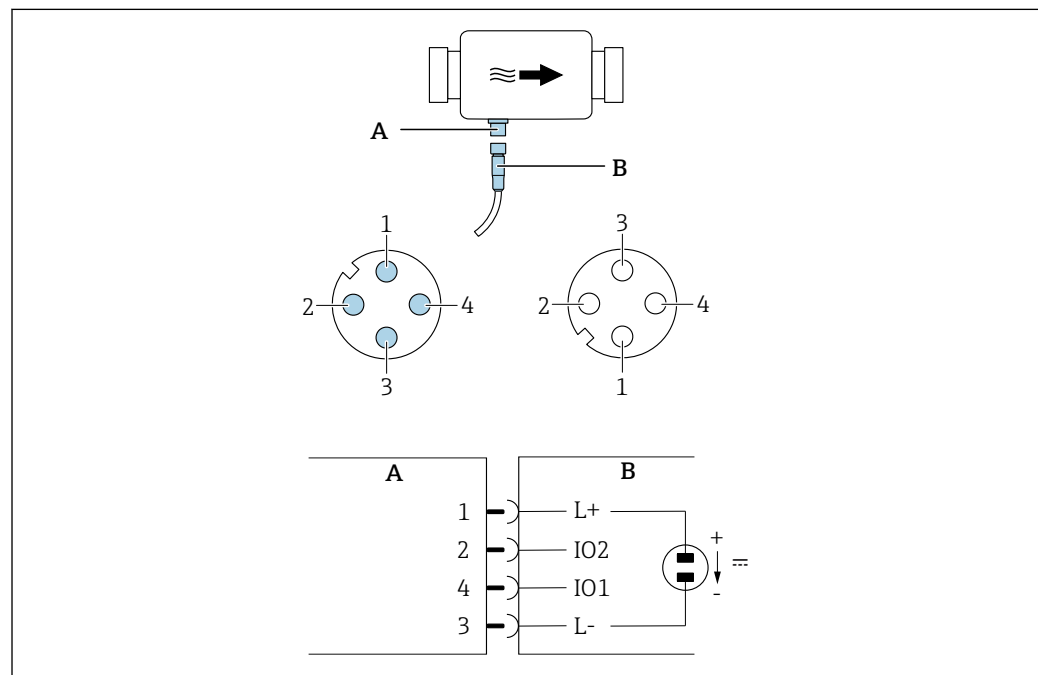

A0033004

A Plug (measuring instrument)

B Socket (customer side)

1 - 4 Pin assignment

#### Pin assignment

Pin	Assignment	Color	Description
1	L+	Brown	Supply voltage + (18 to 30 V <sub>DC</sub> /max. 3 W)
2	I/O 2	White	Input/output 2, can be configured independently of I/O 1



Pin	Assignment	Color	Description
3	L-	Blue	Supply voltage -
4	I/O 1	Black	Input/output 1, can be configured independently of I/O 2

### Switch output configuration version


The switching behavior of I/O 1 and I/O 2 can be configured independently of one another.

PNP <sup>1)</sup>	NPN <sup>2)</sup>
<p style="text-align: right; font-size: small;">A0033005</p> <p>A Plug (measuring instrument)                  B Socket (customer side)                  L+ Supply voltage +                  L- Supply voltage -</p>	<p style="text-align: right; font-size: small;">A0033006</p> <p>A Plug (measuring instrument)                  B Socket (customer side)                  L+ Supply voltage +                  L- Supply voltage -</p>
<p>The load is switched to high side L+. The maximum load current is 250 mA. The output is protected against short-circuiting and reverse polarity.</p>	<p>The load is switched to low side L-. The maximum load current is 250 mA. The output is protected against short-circuiting and reverse polarity.</p>

- 1) Positive Negative Positive (high side switch)
- 2) Negative Positive Negative (low side switch)

### Pulse output configuration version

Option only available for output 1 → 25

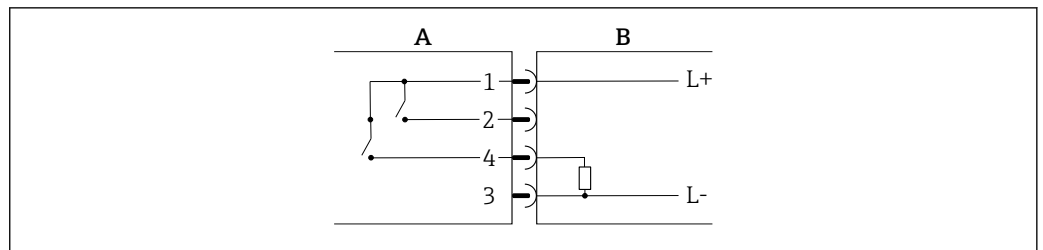


3 Pulse output with PNP switching behavior

A Plug (measuring instrument)  
 B Socket (customer side)  
 L+ Supply voltage +  
 L- Supply voltage -

The load is switched to high side L+. The maximum load current is 250 mA. The output is protected against short-circuiting and reverse polarity.

### Current output configuration version

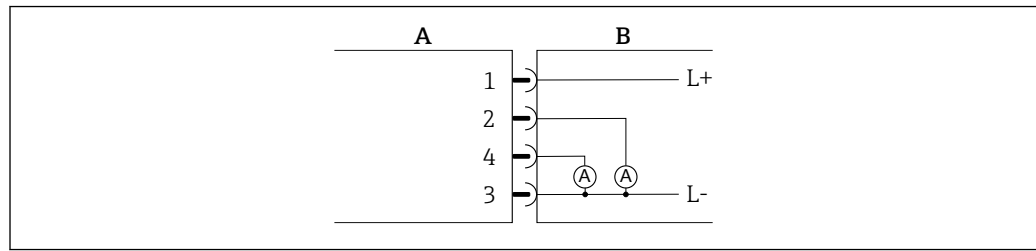

A0046581

4 Current output, active, 4 to 20 mA

A Plug (measuring device)


B Socket (customer side)

L+ Supply voltage +

L- Supply voltage -

The current flows from the output to L-. The maximum load may not exceed 500  $\Omega$ . A bigger load distorts the output signal.

### Voltage output configuration version

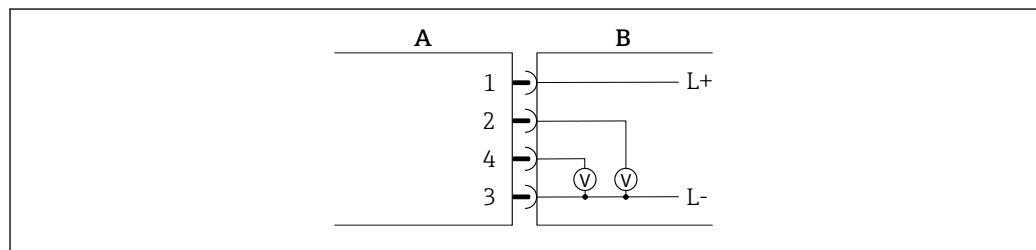

A0046582

5 Voltage output, active, 2 to 10 V

A Plug (measuring device)

B Socket (customer side)


L+ Supply voltage +

L- Supply voltage -

The voltage from the output applies to L-. The load must be at least 600  $\Omega$ . The output is protected against short-circuiting and reverse polarity.

### Digital input configuration version

- 15 V (switch-on threshold)
- 5 V (switch-off threshold)

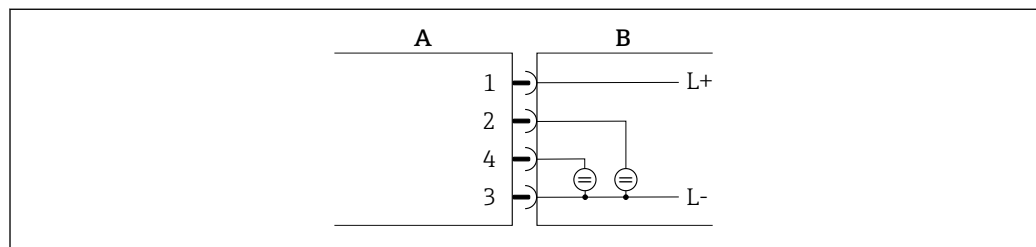

A0033008

6 Digital input

A Plug (measuring device)

B Socket (customer side)

L+ Supply voltage +

L- Supply voltage -

Internal resistance: 7.5 kΩ

**IO-Link configuration version**

**i** Option only available for output 1 in the **Output 1** → 24 submenu

The measuring instrument has an IO-Link communication interface with a baud rate of 38400 and with a second IO function on pin 2. This requires an IO-Link compatible module (IO-Link master) for operation. The IO-Link communication interface allows direct access to the process and diagnostics data.


**6.3 Connecting the device**

**NOTICE**

**The measuring device may only be installed by properly trained technicians.**

- ▶ Comply with national and international regulations regarding the installation of electrotechnical systems.
- ▶ Power supply according to EN 50178, SELV, PELV or Class 2.

1. De-energize the system.
2. Insert the device plug and tighten with the union nut to 0.6 Nm or hand-tight. The device plug should not be rotated, but can be rotated once by a maximum of 180° to the left or right if necessary.

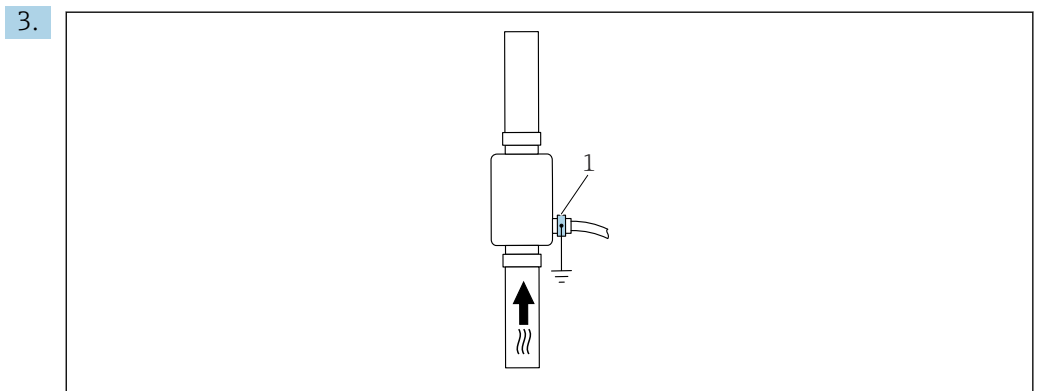

A0046190

1 Ground terminal

In the case of non-grounded pipes:  
The device must be grounded using the ground terminal accessory.

**6.4 Post-connection check**

Are the device and cable undamaged (visual inspection)?	<input type="checkbox"/>
Are the mounted cables strain-relieved?	<input type="checkbox"/>
Is the connector connected correctly?	<input type="checkbox"/>
Does the supply voltage match the specifications on the transmitter nameplate?	<input type="checkbox"/>
Is the pin assignment of the connector correct?	<input type="checkbox"/>
Is the potential equalization established correctly?	<input type="checkbox"/>

## 7 Operation options

### 7.1 Access to the operating menu via the SmartBlue app


The device can be operated and configured via the SmartBlue app. In this case, the connection is established via the Bluetooth® wireless technology interface.

#### Supported functions

- Device selection in Live List and access to the device (login)
- Configuration of the device
- Access to measured values, device status and diagnostic information

The SmartBlue app is available to download free of charge for Android devices (Google Playstore) and iOS devices (iTunes Apple Store): *Endress+Hauser SmartBlue*

Directly to the app with the QR code:

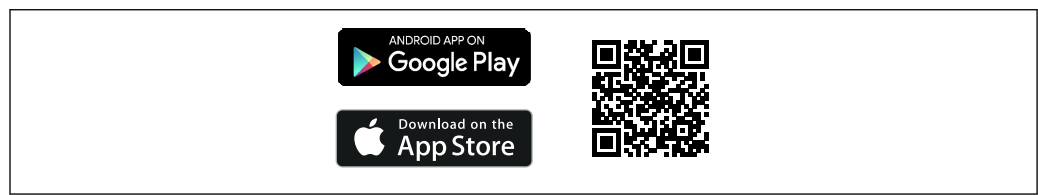

A0039202

#### System requirements


- Devices with iOS:  
From iOS 11
- Devices with Android:  
Android 6.0 KitKat or higher


Downloading the SmartBlue app:

1. Install and start the SmartBlue app.
  - ↳ A Live List shows all the devices available.  
The list displays the devices with the configured tag name. The default setting for the tag name is **EH\_DMA\_XYZZ** (XYZZ = the last 7 digits of the device serial number).
2. For Android devices, activate GPS positioning (not necessary for devices with IOS)
3. Select the device from the Live List.
  - ↳ The Login dialog box opens.

Logging in:

4. Enter the user name: **admin**
5. Enter the initial password: serial number of the device.
  - ↳ When you log in for the first time, a message is displayed advising you to change the password.
6. Confirm your entry.
  - ↳ The main menu opens.
7. Optional: Change Bluetooth® password: Menu: Guidance → Security → Change Bluetooth password

 Forgotten your password: contact Endress+Hauser Service.


 Navigate through the various items of information about the device: swipe the screen to the side.

## 8 System integration

The measuring device has an IO-Link communication interface. The IO-Link interface allows direct access to process and diagnostics data and enables the user to configure the measuring device on the fly.

Properties:

- IO-Link Specification: Version 1.1
- IO-Link Smart Sensor Profile 2nd Edition
- SIO mode: yes
- Speed: COM2 (38.4 kBaud)
- Minimum cycle time: 10 ms
- Process data width: 120 bit
- IO-Link data storage: yes
- Block configuration: no
- Device operational: The measuring device is operational 4 seconds after the supply voltage is applied

 More information on IO-Link is available at [www.io-link.com](http://www.io-link.com)

 Overview of the entire IO-Link ISDU parameter list →  52

### 8.1 Overview of device description files


*Current version data for the device*

Firmware version	01.01.zz	Information on the firmware version can be found: <ul style="list-style-type: none"> <li>▪ On the title page of the Operating instructions</li> <li>▪ On the device label</li> <li>▪ In the <b>Firmware version</b> parameter in the System menu</li> </ul>
Release date of firmware version	05.2019	---
Profile version	<ul style="list-style-type: none"> <li>▪ 1.1</li> <li>▪ Smart Sensor Profile</li> </ul>	---

### 8.2 Device master file

In order to integrate field devices into a digital communication system, the IO-Link system needs a description of the device parameters, such as output data, input data, data format, data volume and supported transfer rate.

These data are available in the device master file (IODD<sup>1)</sup>), provided to the IO-Link master when the communication system is commissioned.

-  The IODD can be downloaded as follows:
- Endress+Hauser: [www.endress.com](http://www.endress.com)
  - IODDfinder: <http://ioddfinder.io-link.com>

1) IO Device Description

## 9 Commissioning

### 9.1 Switching ON the measuring device

Once the supply voltage has been switched on, the measuring device adopts the normal mode after a maximum of 4 s. During the start-up phase, the outputs are in the same state as the measuring device in the switched-off state.

### 9.2 Overview of the operating menu

*Overview of the operating menu*

<b>Guidance</b>	
	<ul style="list-style-type: none"> <li>▶ Identification → 22</li> <li>▶ System units → 22</li> <li>▶ Sensor → 23</li> <li>▶ Output 1 → 24</li> <li>▶ Output 2 → 24</li> <li>▶ Totalizer → 29</li> <li>▶ Display → 30</li> <li>▶ Data management → 31</li> <li>▶ Security → 31</li> </ul>
<b>Diagnostics</b>	→ 32
<b>System</b>	
	<ul style="list-style-type: none"> <li>▶ Data management → 32</li> <li>▶ Firmware → 32</li> </ul>

### 9.3 Configuring the measuring device

#### 9.3.1 Identification

The device tag and the user level can be changed in the **Identification** submenu.

##### Navigation

Menu: "Guidance" → Identification

#### 9.3.2 Configuring system units

In the **System units** submenu, you can configure the units of all measured values.

##### Navigation

Menu: "Guidance" → System units

Parameter overview with brief description

Parameter	Description	Selection	Factory setting
Volume flow unit	Select the unit for the volume flow.	<ul style="list-style-type: none"> <li>▪ l/s, m<sup>3</sup>/h, l/min, l/h</li> <li>▪ gal/min (us), fl. oz/min</li> </ul>	l/min
Volume unit	Select the unit for the volume.	<ul style="list-style-type: none"> <li>▪ ml, l, m<sup>3</sup></li> <li>▪ fl. oz (us), gal (us)</li> </ul>	ml
Temperature unit	Select the unit for the temperature.	<ul style="list-style-type: none"> <li>▪ °C</li> <li>▪ °F</li> </ul>	°C
Totalizer unit	Select the unit for the totalizer.	<ul style="list-style-type: none"> <li>▪ ml, l, m<sup>3</sup></li> <li>▪ kl, Ml</li> <li>▪ fl. oz (us), gal (us)</li> <li>▪ kgal (us)</li> </ul>	m <sup>3</sup>
Conductivity unit	Select the unit for conductivity.	<ul style="list-style-type: none"> <li>▪ µS/cm</li> <li>▪ S/m</li> <li>▪ mS/cm</li> </ul>	µS/cm


### 9.3.3 Setting the installation direction and measurement

The **Sensor** submenu contains parameters for specific settings of the measuring device.

#### Navigation






Menu: "Guidance" → Sensor

Parameter overview with brief description

Parameter	Description	Selection/input	Factory setting
Installation direction	Select the installation direction.	<ul style="list-style-type: none"> <li>▪ Flow in arrow direction (forwards) Positive flow measurement in the direction of the arrow.</li> <li>▪ Flow against arrow direction (backwards) Positive flow measurement in the opposite direction of the arrow.</li> </ul>	Flow in arrow direction (forwards)
On value	Enter the on value for low flow cut off.	<p>Positive floating point number</p> <p> A flow measured value that is less than the value of the on value forces the display to zero. In the event of plant downtime, this prevents the totalizer from continuing to totalize even though there is no flow. The measured value flashes on the display when low flow cut off is active. Low flow cut off is deactivated again as soon as the flow measured value exceeds 1.5 times the on value.</p>	<p>Depends on the nominal diameter:</p> <p>DN 15 (½"): 0.05 l/min (0.013 gal/min)</p> <p>DN 20 (¾"): 0.1 l/min (0.026 gal/min)</p> <p>DN 25 (1"): 0.2 l/min (0.052 gal/min)</p> <p>DN 50 (2"): 1.5 l/min (0.4 gal/min)</p>
Damping	Enter the time constant for damping the flow measured value.	0 to 10 s	0 s

### 9.3.4 Configuring the IO modules

The measuring device has two signal inputs or signal outputs that can be configured independently of one another:

- Current output →  24
- Pulse output →  25
- Switch output →  26
- Voltage output →  27
- Digital input →  28

#### Navigation

Menu: "Guidance" → Output 1

Menu: "Guidance" → Output 2

#### Parameter overview with brief description

Parameter	Description	Selection	Factory setting
Output 1	Select the operating mode of output 1.	<ul style="list-style-type: none"> <li>■ Pulse output</li> <li>■ Current output</li> <li>■ Switch output</li> <li>■ Voltage output</li> <li>■ Digital input</li> <li>■ IO-Link</li> <li>■ Off</li> </ul>	IO-Link
Output 2	Select the operating mode of output 2.	<ul style="list-style-type: none"> <li>■ Current output</li> <li>■ Switch output</li> <li>■ Voltage output</li> <li>■ Digital input</li> <li>■ Off</li> </ul>	Off

#### Configuring the current output

The Current output submenu contains all the parameters that must be configured for the configuration of the current output.

The output is used to output process variables by analog means in the form of a 4-20 mA current.

#### Navigation

Menu: "Guidance" → Output 1 → Current output


Menu: "Guidance" → Output 2 → Current output

#### Parameter overview with brief description

Parameter	Description	Selection/input	Factory setting
Assign current output	Select process variable for current output.	<ul style="list-style-type: none"> <li>■ Off</li> <li>■ Volume flow</li> <li>■ Temperature</li> <li>■ Conductivity</li> </ul>	Volume flow
4 mA value	Enter 4 mA value.	Floating point number with sign	0 l/min
20 mA value	Enter 20 mA value.	Floating point number with sign	Depends on the nominal diameter: DN 15 (½"): 25 l/min (6.6 gal/min) DN 20 (¾"): 50 l/min (13.2 gal/min) DN 25 (1"): 100 l/min (26.4 gal/min) DN 50 (2"): 750 l/min (198.1 gal/min)




*Unidirectional flow measurement (Q), conductivity measurement (S)*

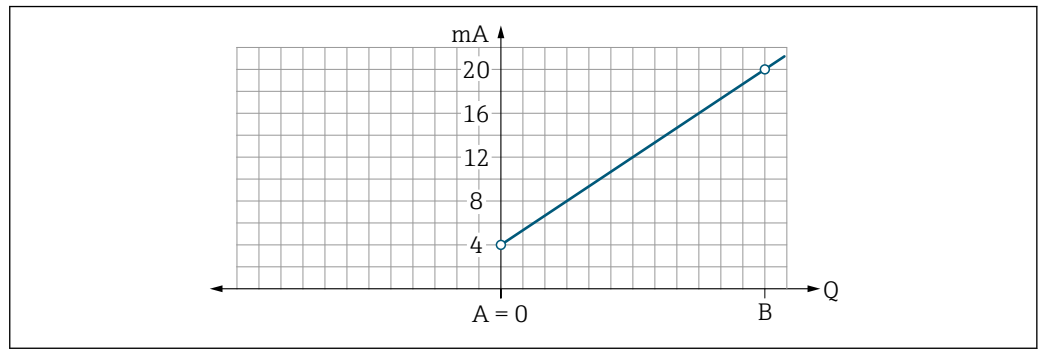

A Lower range value = 0  
 B Upper range value  
 Q Flow

- Current I is linearly interpolated between lower range value (A) and upper range value (B).
- The output range ends at 20.5 mA.

*Bidirectional flow measurement (Q), temperature measurement (T)*

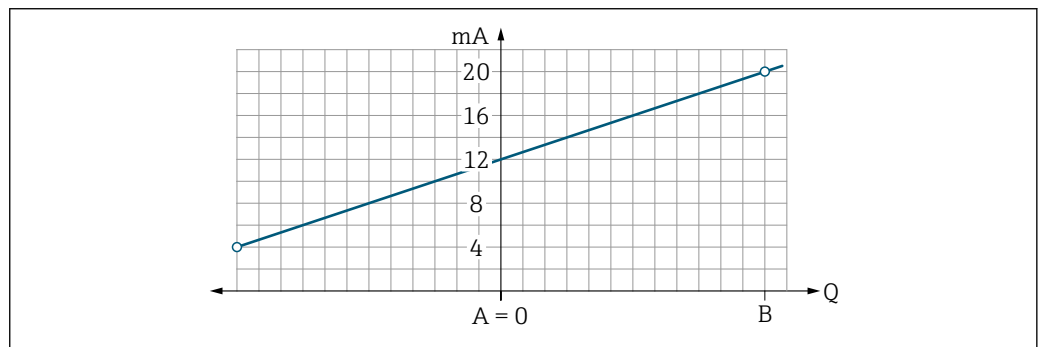

A Lower range value  
 B Upper range value  
 Q Flow

- Current I is linearly interpolated between lower range value (A) and upper range value (B).
- Rather than having a hard upper and lower limit, the output range ends at 20.5 mA at the top end and at 3.8 mA at the bottom end

**Configuring the pulse output**

The Pulse output submenu contains all the parameters that must be configured for the configuration of the pulse output.

**Navigation**

Menu: "Guidance" → Output 1

*Parameter overview with brief description*

Parameter	Description	User entry	Factory setting
Value per pulse	Enter the value for the pulse output.	Floating point number with sign	Depends on the nominal diameter: DN 15 (1/2"): 0.5 ml DN 20 (3/4"): 1.0 ml DN 25 (1"): 2.0 ml DN 50 (2"): 10.0 ml

The current pulse repetition frequency is calculated from the current flow and the configured pulse value:

Pulse repetition frequency = flow/pulse value

#### Example

- Flow: 24 l/min
- Pulse value: 0.001 l
- Pulse repetition frequency = 400 Pulse/s

The pulse output only outputs positive flow components in the set installation direction. Negative flow components are ignored and not balanced.

 Low flow cut off →  23 resets the pulse output.

#### Configuring the switch output

The Switch output submenu contains all the parameters that must be configured for the configuration of the switch output.


#### Navigation

Menu: "Guidance" → Output 1

Menu: "Guidance" → Output 2


#### Parameter overview with brief description

Parameter	Description	Selection/input	Factory setting
Polarity	Select the switching behavior.	<ul style="list-style-type: none"> <li>▪ NPN (low-side-switch) Switches load to low side to L-</li> <li>▪ PNP (high-side-switch) Switches load to high side to L+</li> </ul>	PNP (high-side-switch)
Switch output function		<ul style="list-style-type: none"> <li>▪ Off The switch output is permanently switched off (open, non-conductive).</li> <li>▪ On The switch output is permanently switched on (closed, conductive).</li> <li>▪ Diagnostic behavior The output switches off when an event with the status signal F occurs</li> <li>▪ Limit volume flow Indicates if a specified limit value has been reached for the process variable.</li> <li>▪ Limit temperature Indicates if a specified limit value has been reached for the process variable.</li> <li>▪ Limit conductivity Indicates if a specified limit value has been reached for the process variable.</li> <li>▪ Limit volume totalizer</li> <li>▪ Range volume flow</li> <li>▪ Range temperature</li> <li>▪ Range conductivity</li> <li>▪ Range volume totalizer</li> <li>▪ Empty pipe detection Output switches off if empty pipe detection is activated.</li> </ul>	Off
Switch-on value	Enter the measured value for the switch-on value.	Floating point number with sign	1 000 m <sup>3</sup> /h
Switch-off value	Enter the measured value for the switch-off value.	Floating point number with sign	1 000 m <sup>3</sup> /h

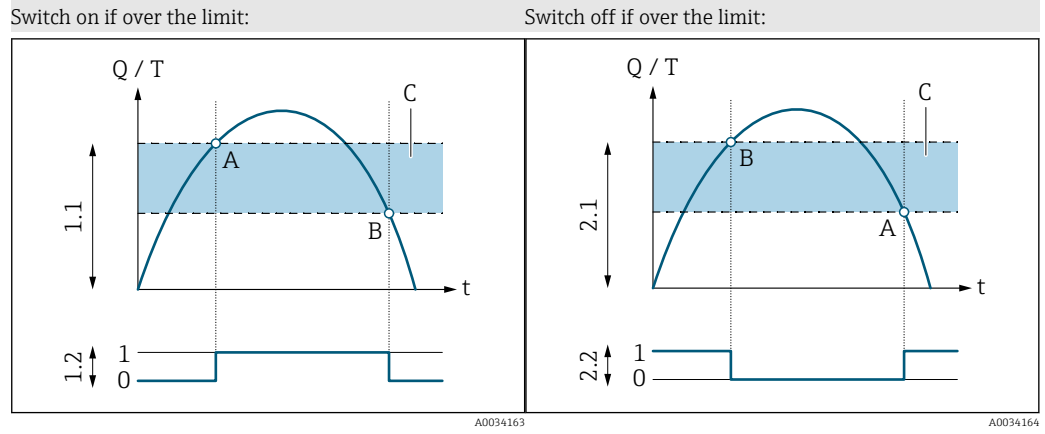

- 1.1 Input variables
- 1.2 Switch output
- A Switch-on point
- B Switch-off point
- C Hysteresis

- 2.1 Input variables
- 2.2 Switch output
- A Switch-on point
- B Switch-off point
- C Hysteresis

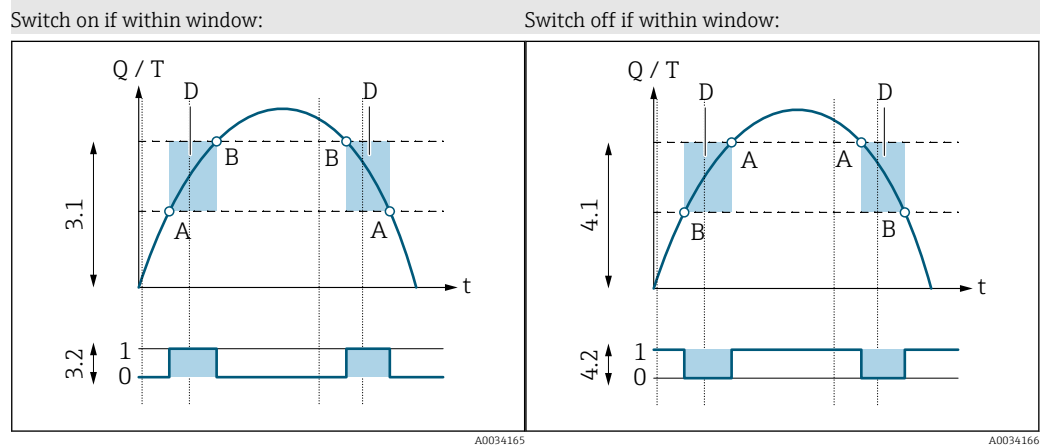

- 3.1 Input variables
- 3.2 Switch output
- A On-value (lower range limit)
- B Off-value (upper range limit)
- D Window

- 4.1 Input variables
- 4.2 Switch output
- A On-value (lower range limit)
- B Off-value (upper range limit)
- D Window

**Configuring the voltage output**

The Voltage output submenu contains all the parameters that must be configured for the configuration of the voltage output.


**Navigation**

Menu: "Guidance" → Output 1

Menu: "Guidance" → Output 2

*Parameter overview with brief description*


Parameter	Description	Selection/input	Factory setting
Assign voltage output	Select process variable for voltage output.	<ul style="list-style-type: none"> <li>■ Off</li> <li>■ Volume flow</li> <li>■ Temperature</li> <li>■ Conductivity</li> </ul>	Volume flow
2 V value	Enter the lower range value.	Floating point number with sign	0 l/min
10 V value	Enter the upper range value.	Floating point number with sign	Depends on the nominal diameter: DN 15 (½"): 25 l/min DN 20 (¾"): 50 l/min DN 25 (1"): 100 l/min DN 50 (2"): 750 l/min

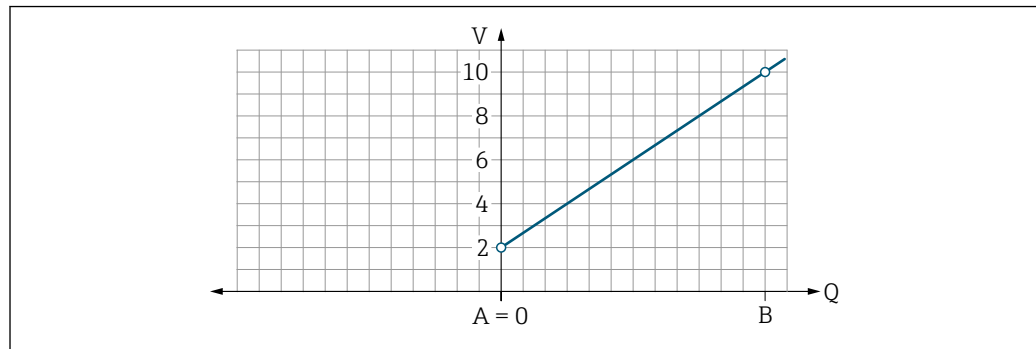*Unidirectional flow measurement (Q), conductivity measurement*

A0032995

A Lower range value = 0  
 B Upper range value  
 Q Flow

- Voltage U is linearly interpolated between lower range value (A) and upper range value (B).
- The output range ends at 10.25 V.

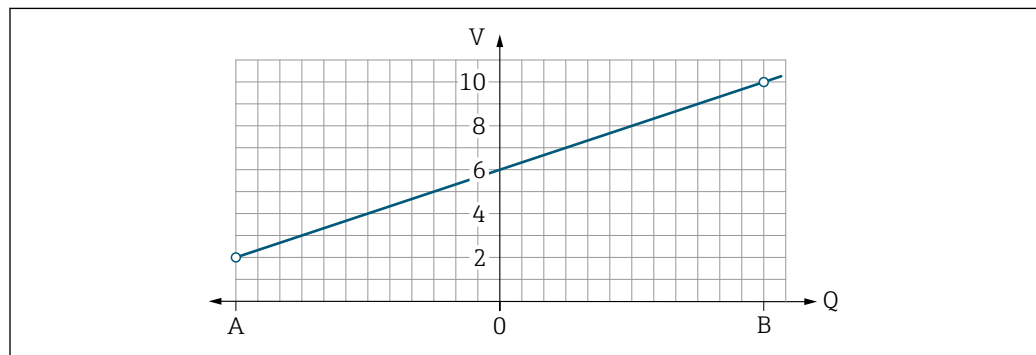*Bidirectional flow measurement (Q), temperature measurement (T)*

A0032996

A Lower range value  
 B Upper range value  
 Q Flow

- Voltage U is linearly interpolated between lower range value (A) and upper range value (B).
- Rather than having a hard upper and lower limit, the output range ends at 10.25 V at the top end and at 1.9 V at the bottom end

**Configuring the digital input**

The **Digital input** submenu contains all the parameters that must be configured for the configuration of the digital input.

The input is used to control an action with an external voltage signal. The minimum pulse duration is 100 ms.

**Navigation**

Menu: "Guidance" → Output 1

Menu: "Guidance" → Output 2

*Parameter overview with brief description*

Parameter	Description	Selection	Factory setting
Active level	Select the switching behavior for the digital input.	<ul style="list-style-type: none"> <li>▪ High Input reacts to high level/positive edge</li> <li>▪ Low Input reacts to low level/negative edge</li> </ul>	High
Assign status input	Select the function for the digital input.	<ul style="list-style-type: none"> <li>▪ Off</li> <li>▪ Reset totalizer Reset the totalizer (edge controlled) (positive/negative edge)</li> <li>▪ Flow override               <ul style="list-style-type: none"> <li>▪ Flow measured value = 0</li> <li>▪ No effect on temperature measurement (level controlled) (high/low level)</li> </ul> </li> </ul>	Reset totalizer

### 9.3.5 Totalizer

The totalizer can be reset with the **Reset totalizer** submenu.

#### Navigation

Menu: "Guidance" → Totalizer

*Parameter overview with brief description*

Parameter	Description	Display/options	Factory setting
Volume totalizer	Enter value.	Floating point number with sign	0 m <sup>3</sup>
Reset totalizer	Reset the totalizer.	<ul style="list-style-type: none"> <li>▪ Cancel The totalizer is not reset.</li> <li>▪ Reset + totalize The totalizer is reset.</li> </ul>	Cancel




### 9.3.6 Configuring the display


The **Display** submenu contains all the parameters that can be configured for the configuration of the onsite display.

#### Navigation

Menu: "Guidance" → Display

*Parameter overview with brief description*

Parameter	Description	Selection/input	Factory setting
Format display	Select how measured values are shown on the display.	Display value 1st line + display value 2nd line: <ul style="list-style-type: none"> <li>▪ Volume flow + temperature</li> <li>▪ Volume flow + totalizer</li> <li>▪ Temperature + totalizer</li> <li>▪ Volume flow + conductivity</li> <li>▪ Totalizer + conductivity</li> <li>▪ Temperature + conductivity</li> </ul>	Volume flow + temperature
		4 display values: Volume flow + temperature + totalizer + conductivity	
		2 display values (multiplex): Volume flow +totalizer / temperature + conductivity	
Rotation display	Select local display rotation.	<ul style="list-style-type: none"> <li>▪ Auto (automatic)</li> <li>▪ The display rotates automatically depending on the installation position</li> </ul>	Auto
		<ul style="list-style-type: none"> <li>▪ 0°</li> <li>▪ Can be read in the horizontal installation position with flow from left to right</li> </ul>  <p style="text-align: right; font-size: small;">A0033013</p>	
		<ul style="list-style-type: none"> <li>▪ 90°</li> <li>▪ Can be read in the vertical installation position with flow from bottom to top</li> </ul>  <p style="text-align: right; font-size: small;">A0033014</p>	
		<ul style="list-style-type: none"> <li>▪ 180°</li> <li>▪ Can be read in the horizontal installation position with flow from right to left</li> </ul>  <p style="text-align: right; font-size: small;">A0033015</p>	

Parameter	Description	Selection/input	Factory setting
		<ul style="list-style-type: none"> <li>▪ 270°</li> <li>▪ Can be read in the vertical installation position with flow from top to bottom</li> </ul> 	
Backlight	Set the intensity of the backlighting.	0 to 100 %	50 %

### 9.3.7 Data management

#### Export configuration as report

The device configuration can be exported as a PDF report and saved in the mobile terminal or forwarded with this function.

#### Save configuration to file

The device configuration is saved in the app. The saved device configuration can be transferred to another measuring device using the System → "Load configuration from app" function.

#### Navigation

Menu: "Guidance" → Data management



### 9.3.8 Security

The **Security** submenu contains all the parameters needed to define the access code and configure the Bluetooth connection.

#### Navigation

Menu: "Guidance" → Security

*Parameter overview with brief description*

Parameter	Description	Entry/selection/display	Factory setting
Define access code	Define a user-specific access code to restrict write access to parameters.	4-digit string of numbers	0000
Bluetooth	Enable or disable the <i>Bluetooth</i> ® wireless technology interface.  If the interface is disabled, it can only be re-enabled by tapping the device.	<ul style="list-style-type: none"> <li>▪ Disable                             <ul style="list-style-type: none"> <li>▪ Disable the interface.</li> <li>▪ The connection to the measuring device is torn down.</li> </ul> </li> <li>▪ Enable</li> </ul>	Enable
Change Bluetooth password	Change Bluetooth password  Keep the password safe. If it is lost, Endress+Hauser cannot restore access to the device.	Character string comprising numbers, letters and special characters	Device serial number

#### Enable Bluetooth by tapping the device

1. Activate Bluetooth by tapping on the housing three times.
2. Establish a connection to the device via the SmartBlue app.



## 9.4 Diagnostics

The **Diagnostics** menu enables you to simulate, without a real flow situation, various process variables in the process and the device alarm mode and to verify downstream signal chains (switching of valves or closed-control loops).

### Navigation

"Diagnostics" menu

*Parameter overview with brief description*

Parameter	Description	Selection/input	Factory setting
Actual diagnostic	A diagnostic event has occurred.	Displays the current diagnostic event along with the diagnostic information.  If two or more messages occur simultaneously, the message with the highest priority is shown on the display.	Symbol for diagnostic behavior, diagnostic code and short message.
Simulation process variable	Activate the simulation of process variables.	<ul style="list-style-type: none"> <li>▪ Off Simulation is deactivated.</li> <li>▪ On Simulation is activated.</li> </ul>  Deactivate the simulation again once the test has been performed.	Off
Volume flow value	Enter the value for volume flow simulation.	Positive floating point number	-
Temperature value	Enter the value for temperature simulation.	Positive floating point number	-
Conductivity value	Enter the value for conductivity simulation	Positive floating point number	-


## 9.5 System

The **System** submenu contains all the parameters that can be used for the administration of the device.

### Navigation

Menu: "System"

*Parameter overview with brief description*


Parameter	Description	Entry/selection/display	Factory setting
Access status tooling	Displays the access status. No user entry/selection possible.	<ul style="list-style-type: none"> <li>▪ Operator</li> <li>▪ Maintenance</li> </ul>	Maintenance
Enter access code	Enter the defined access code. →  31 Restrict write access to parameters in order to protect the device configuration from unauthorized modification.	4-digit string of numbers	0000
Device reset	Reset the entire device configuration or some of the configuration to a defined state.	<ul style="list-style-type: none"> <li>▪ Cancel</li> <li>▪ To factory defaults</li> <li>▪ Restart device</li> </ul>	Cancel
Export configuration as report	The device configuration can be exported as a PDF report and saved in the mobile device or forwarded with this function.	-	-
Save configuration to file	The device configuration is saved in the app. The saved device configuration can be transferred to another measuring device using the System → "Load configuration from file" function.	-	-
Load Configuration from file	The saved device configuration can be uploaded to a new measuring device with this function.	-	-



# 10 Operation

## 10.1 Offline quick view of configuration

If you tap the top of the housing (e.g. on the arrow indicating the flow direction) with your fist or an object), the device displays an overview of the preset parameters.

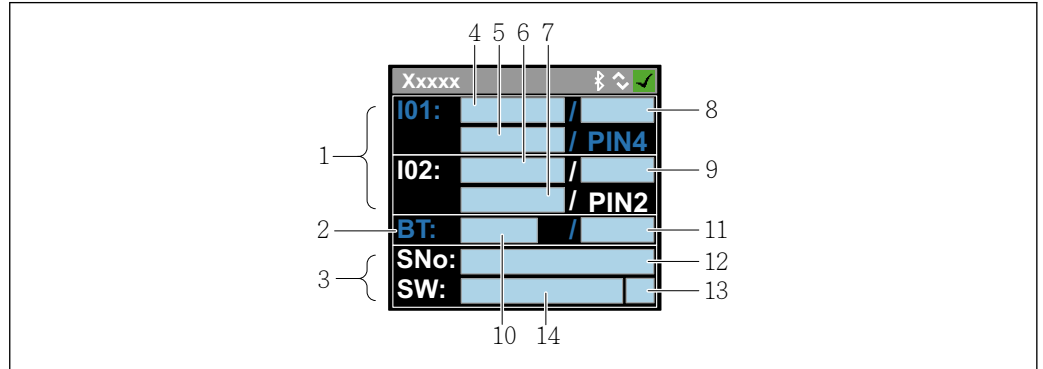



A0036432

7 Information in the status layout, overview of the preconfigured parameters

- 1 I/O area
- 2 Bluetooth area
- 3 Identification area
- 4 I/O type 1
- 5 I/O current value type 1
- 6 I/O type 2
- 7 I/O current value type 2
- 8 I/O assignment type 1
- 9 I/O assignment type 2
- 10 Bluetooth module status
- 11 Bluetooth connection status
- 12 Serial number
- 13 User role: Operator (O), Maintenance (M)
- 14 Software version

I/O area (in brackets: item number → 7, 33)

I/O type ( 4, 6)	I/O assignment (8, 9)	I/O current value (5, 7)
S-Out	<ul style="list-style-type: none"> <li>▪ Alrt</li> <li>▪ LimQ</li> <li>▪ LimT</li> <li>▪ LimV</li> <li>▪ Lims</li> <li>▪ WinQ</li> </ul>	<ul style="list-style-type: none"> <li>▪ WinT</li> <li>▪ WinV</li> <li>▪ Wins</li> <li>▪ EPD</li> <li>▪ Off</li> <li>▪ On</li> </ul>
I-Out	<ul style="list-style-type: none"> <li>▪ s</li> <li>▪ Q</li> <li>▪ T</li> </ul>	Off
U-Out	<ul style="list-style-type: none"> <li>▪ s</li> <li>▪ Q</li> <li>▪ T</li> </ul>	Off
S-In	<ul style="list-style-type: none"> <li>▪ RsT</li> <li>▪ OvrD</li> </ul>	Off
P-Out	Q	PNPOn      PNPOff
IO-L	PD	<ul style="list-style-type: none"> <li>▪ Dis.</li> <li>▪ Start</li> </ul>
Off	-	<ul style="list-style-type: none"> <li>▪ Preop.</li> <li>▪ Oper.</li> </ul>

Bluetooth area (in brackets: item number →  7,  33)

Bluetooth module status (10)	Bluetooth connection status (11)
On	Dis./Con.
Off	Dis.

# 11 Diagnostics and troubleshooting

## 11.1 General troubleshooting

### *For local display*

Error	Possible causes	Remedial action
Local display dark and no output signals	Supply voltage does not match the voltage specified on the nameplate.	Apply the correct supply voltage → 41.
	Supply voltage has incorrect polarity.	Correct the polarity.
	The connecting cables are not connected correctly.	Check the cable connection and correct if necessary.

### *For output signals*

Error	Possible causes	Remedial action
Device shows correct value on local display, but signal output is incorrect, though in the valid range.	Parametrization errors	Check parameterization and correct it.
Device measures incorrectly.	Configuration error or device is operated outside the application.	1. Check and correct parameter configuration. 2. Observe limit values specified in the "Technical Data".




### *For access*

Error	Possible causes	Remedial action
Measuring device not in smartphone or tablet live list	Bluetooth communication is disabled	1. Check whether the Bluetooth logo is visible on the local display or not. 2. Re-enable Bluetooth communication by tapping the device three times.
Device not responding via SmartBlue app	No Bluetooth connection	Enable Bluetooth function on smartphone or tablet.
	The device is already connected to another smartphone/tablet.	Check whether the device is already connected.
Login via SmartBlue app not possible	Device is being put into operation for the first time	Enter initial password (device serial number) and change.
Device cannot be operated via SmartBlue app	Incorrect password entered	Enter correct password.
	Password forgotten	Contact Endress+Hauser Service.
No write access to parameters	Current user role has limited access authorization	<ul style="list-style-type: none"> <li>▪ Check user role</li> <li>▪ Enter the correct customer-specific access code → 20</li> </ul>

## 11.2 Diagnostic information on local display




### 11.2.1 Diagnostic message

Faults detected by the self-monitoring system of the measuring device are displayed as a diagnostic message in alternation with the operational display.

Diagnostic message		
Alarm	Function check	Warning
 A0033011	 A0033010	 A0033009

If two or more diagnostic events are pending simultaneously, only the message of the diagnostic event with the highest priority is shown.

### Diagnostic behavior



Diagnostic message	Meaning
	<b>Alarm</b> <ul style="list-style-type: none"> <li>The measurement is interrupted.</li> <li>Signal outputs and totalizers assume the defined alarm condition.</li> <li>A diagnostic message is generated.</li> </ul>
	<b>Function check</b> Process measured values are simulated to test the outputs/wiring. <ul style="list-style-type: none"> <li>IO1/IO2 overload</li> <li>Flow override is active</li> </ul>
	<b>Warning</b> <ul style="list-style-type: none"> <li>Measurement is resumed.</li> <li>Measuring operation with limited accuracy</li> <li>The signal outputs and totalizers are not affected.</li> <li>A diagnostic message is generated.</li> </ul>

### Diagnostic behavior of outputs

Output	Diagnostic behavior
Switch output	<ul style="list-style-type: none"> <li>The output is switched off (fail-safe) if events with the status signal F occur</li> <li>No further response to events with other status signals</li> </ul>
Pulse output	<ul style="list-style-type: none"> <li>Pulse output stops if events with the status signal F occur</li> <li>No further response to events with other status signals</li> </ul>
Totalizer	<ul style="list-style-type: none"> <li>Totalizer stops if events with the status signal F occur</li> <li>No further response to events with other status signals</li> </ul>
Current output	<ul style="list-style-type: none"> <li>3.5 mA is output to signal events with the status signal F</li> <li>No further response to events with other status signals</li> </ul>
Voltage output	<ul style="list-style-type: none"> <li>1.75 V is output to signal events with the status signal F</li> <li>No further response to events with other status signals</li> </ul>
IO-Link	<ul style="list-style-type: none"> <li>All events reported to the Master</li> <li>Events read and processed further by the Master</li> </ul>

## 11.3 Overview of diagnostic events

Diagnostic event	Event text	Cause	Remedial measures	Status signal [ex-factory]
181	Coil. circ. fail.	Coil/frequency failure Coil current PWM outside tolerance range	Replace the measuring device.	F
180	Temp. circ. fail.	Temperature sensor open circuit/short-circuit	Replace the measuring device.	F
201	Device fail.	Internal hardware error	Replace the measuring device.	F
283	Memory fail.	CRC failure	Reset to factory settings.	F
446	I/O 1 overload	Overload at output 1	Increase load impedance.	C
447	I/O 2 overload	Overload at output 2	Increase load impedance.	C
485	Simulation act.	Measured value simulation active (via remote configuration)	–	C
453	Flow override	Flow override active (via auxiliary input)	–	C
441	I-Out 1 range	I-output 1 at range limit	Adjust parameter or process.	S
444	U-Out 1 range	U-output 1 at range limit	Adjust parameter or process.	S
443	P-Out 1 range	P-output 1 at range limit	Adjust parameter or process.	S
442	I-Out 2 range	I-output 2 at range limit	Adjust parameter or process.	S
445	U-Out 2 range	U-output 2 at range limit	Adjust parameter or process.	S
962	Empty pipe	Pipe is completely or partially empty	Adjust the process.	S
834	Temperat. range	Medium temperature outside the permitted range	Adjust the process.	S

 For more information on the diagnostics: see the "Diagnostics information" →  51

## 11.4 Device information

The **Device info** submenu contains all parameters that display different information for device identification.


### Navigation

Menu: "System" → Device info

*Parameter overview with brief description*

Parameter	Description	User interface
Device name	Displays the name of the measuring device.	Picomag
Device tag	Shows name of measuring point.	Max. 32 characters, such as letters, numbers or special characters (e.g. @, %, /).
Serial number	Displays the serial number of the measuring device.	Max. 11-digit character string comprising letters and numbers.

Parameter	Description	User interface
Firmware version	Displays the device firmware version installed.	Character string in the format xx.yy.zz
Extended order code	Displays the extended order code.	Character string composed of letters, numbers and certain punctuation marks (e.g. /).

-  The following information is shown on the display by tapping once on the housing:
- Status and values for output 1
  - Status and values for output 2
  - Bluetooth status (On/Off)
  - Serial number
  - Software version

## 11.5 Firmware history

Release date	Firmware version	Firmware changes	Documentation type	Documentation
09.2017	01.00.zz	Original firmware	Operating Instructions	BA01697D/06/EN/01.17 BA01697D/06/EN/02.17 BA01697D/06/EN/03.17
05.2019	01.01.zz	<ul style="list-style-type: none"> <li>▪ Conductivity measurement</li> <li>▪ Export configuration report</li> <li>▪ Save/load configuration</li> <li>▪ Bug fix</li> </ul>	Operating Instructions	BA01697D/06/EN/04.19 BA01697D/06/EN/05.20 BA01697D/06/EN/06.22

## 12 Accessories

Various accessories are available for the device, and can be ordered with the device or at a later stage from Endress+Hauser. An up-to-date overview of accessories is available from your local Endress+Hauser sales organization or on the product page of the Endress+Hauser website: [www.endress.com](http://www.endress.com).

*Adapter set (suitable for devices with male thread)*

Order number	Description
71355698	G $\frac{1}{2}$ " to G $\frac{3}{8}$ " male thread
71355699	G $\frac{1}{2}$ " to R $\frac{3}{8}$ " male thread
71355701	G $\frac{1}{2}$ " to G $\frac{1}{2}$ " female thread
71355702	G $\frac{1}{2}$ " to R $\frac{1}{2}$ " male thread
71355704	G $\frac{1}{2}$ " to $\frac{1}{2}$ " TriClamp
71355705	G $\frac{3}{4}$ " to R $\frac{3}{4}$ " male thread
71355707	G $\frac{3}{4}$ " to G $\frac{3}{4}$ " female thread
71355708	G $\frac{3}{4}$ " to R $\frac{3}{4}$ " TriClamp
71355709	G1" to R1" male thread
71355711	G1" to G1" female thread
71355712	G1" to 1" TriClamp
71355713	G2" to R1 $\frac{1}{2}$ " male thread
71355714	G2" to R2" male thread
71355717	G2" to G1 $\frac{1}{2}$ " male thread
71355718	G2" to G2" female thread
71355719	G2" to 2" TriClamp
71355720	G2" to 2" Victaulic
71399930	G2" to 54mm press fitting
71458012	Picomag adapter set G1/2"/R1/2" union nut
71458014	Picomag adapter set G3/4"/R1/2" union nut

*Cable set*

Order number	Description
71349260	2m/6.5ft, straight, 4x0.34, M12, PUR
71349261	5m/16.4ft, straight, 4x0.34, M12, PUR
71349262	10m/32.8ft, straight, 4x0.34, M12, PUR
71349263	2m/6.5ft, 90 degrees, 4x0.34, M12, PUR
71349264	5m/16.4ft, 90 degrees, 4x0.34, M12, PUR
71349265	10m/32.8ft, 90 degrees, 4x0.34, M12, PUR

*Seal set (suitable for devices with male thread)*

Order number	Description
71354741	DMA15 aramid fiber
71354742	DMA20 aramid fiber
71354745	DMA25 aramid fiber
71354746	DMA50 aramid fiber

*Ground terminal set*

Order number	Description
71345225	Ground terminal



## 13 Technical data

### 13.1 Input

Measured variables	<ul style="list-style-type: none"> <li>▪ Volume flow</li> <li>▪ Temperature</li> <li>▪ Conductivity</li> </ul>
Measuring range	DN 15 (½"): 0.05 to 35 l/min (0.013 to 9.2 gal/min)
Volume flow measurement	DN 20 (¾"): 0.1 to 75 l/min (0.026 to 19.8 gal/min)
	DN 25 (1"): 0.2 to 150 l/min (0.052 to 39.6 gal/min)
	DN 50 (2"): 1.5 to 750 l/min (0.4 to 198.1 gal/min)
Measuring range	-10 to +70 °C (+14 to +158 °F)
Medium temperature measurement	
Measuring range	DN 15 (½"): 20 to 30 000 µS/cm
Conductivity measurement	DN 20 (¾"): 20 to 30 000 µS/cm
	DN 25 (1"): 20 to 30 000 µS/cm
	DN 50 (2"): 20 to 10 000 µS/cm
Digital input	<ul style="list-style-type: none"> <li>▪ High or low active</li> <li>▪ Switch-on level 15 V</li> <li>▪ Switch-off level 5 V</li> <li>▪ Internal resistance 7.5 kOhm</li> </ul>

### 13.2 Output

Output	Max. load
Current output	500 Ω Load must not be greater
Voltage output	600 Ω Load must not be smaller
Pulse output	Max. pulse rate: 10 000 Pulse/s
Signal on alarm	<ul style="list-style-type: none"> <li>▪ Status signal (as per NAMUR Recommendation NE 107)</li> <li>▪ Plain text display with remedial action</li> </ul>
Switch output	<ul style="list-style-type: none"> <li>▪ Switching behavior: PNP or NPN</li> <li>▪ Max. load 250 mA</li> </ul>

### 13.3 Power supply

Supply voltage range	18 to 30 V <sub>DC</sub> (SELV, PELV, Class 2)
Power consumption	Maximum 3 W <ul style="list-style-type: none"> <li>▪ Without outputs IO1 and IO2: 120 mA</li> <li>▪ With outputs IO1 and IO2: 120 mA plus the effective load currents</li> </ul>

### 13.4 Performance characteristics

Volume flow measurement	
Reference operating conditions	Water, +15 to +45 °C, 2 to 6 bar
Maximum measured error	±0.8 % o.r. ±0.1 % o.f.s.
Repeatability	±0.2 % o.r.
Medium temperature measurement	
Maximum measured error	±2.5 °C
Repeatability	±0.5 °C
Conductivity measurement	
Repeatability	±5 %o.r. ±5 µS/cm

Maximum measured error, current output

Additional error	±20 µA <sup>1)</sup>
Repeatability	±10 µA
Response time T90	Typically 200 ms

1) At a device temperature of 25 °C.

Maximum measured error, voltage output

Additional error	±60 mV <sup>1)</sup>
Repeatability	±10 mV
Response time T90	Typically 200 ms

1) At a device temperature of 25 °C.

**i** The response time T90 is the time a measuring system needs to display 90% of the change of the measured value.

### 13.5 Installation

→ 14

### 13.6 Environment


Ambient temperature range	-10 to +60 °C (+14 to +140 °F)
Storage temperature	-25 to +85 °C (-13 to +185 °F)
Degree of protection	IP65/67, pollution degree 3
Humidity and moisture	Suitable for indoor environments with up to 100% rh (wet and damp locations)
Operating altitude	up to 2 000 m
Shock resistance	20 g (11 ms) in accordance with IEC/EN60068-2-27
Vibration resistance	Acceleration up to 5 g (10 to 2 000 Hz) in accordance with IEC/EN60068-2-6
Electromagnetic compatibility (EMC)	According to IEC/EN61326 and/or IEC/EN55011 (Class A)

### 13.7 Process

Medium temperature range	<ul style="list-style-type: none"> <li>▪ -10 to +70 °C (+14 to +158 °F)</li> <li>▪ Permissible short-term temperature: maximum one hour 85 °C (185 °F) every 4 hours.</li> <li>▪ Permissible short-term temperature with electronics switched off: maximum one hour 100 °C (212 °F) every 4 hours.</li> </ul>
Medium properties	Liquid, conductivity ≥ 10 µS/cm
Pressure	Max. 16 bar <sub>rel</sub>

**i** Avoid cavitation in the process.

#### Magnetism and static electricity

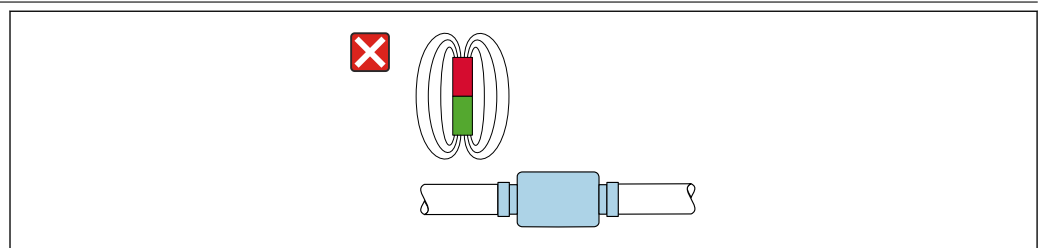


8 Avoid magnetic fields

A0046637

## 13.8 Mechanical construction

Measuring device with  
male thread

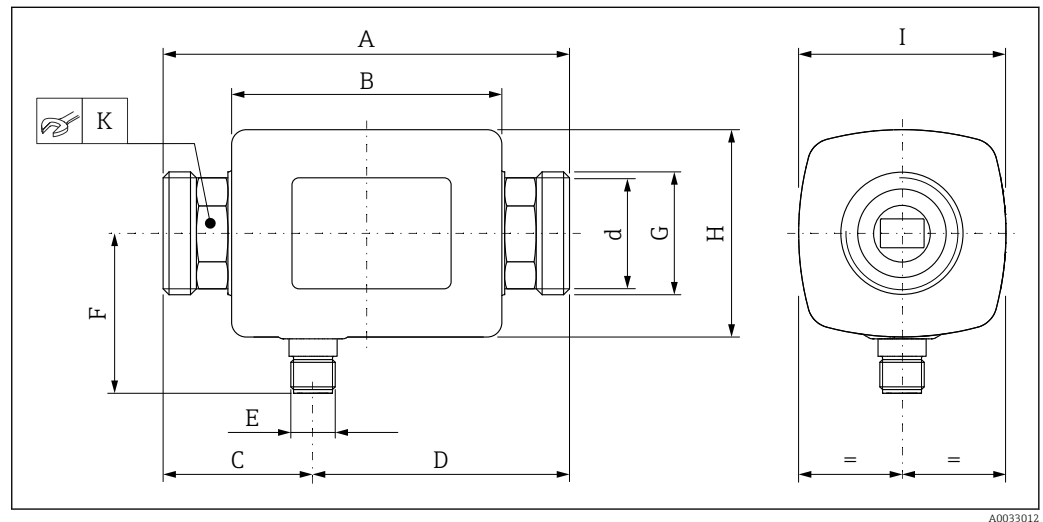

### Dimensions in SI units

DN	A [mm]	B [mm]	C [mm]	D [mm]	E	F [mm]	G	H [mm]	I [mm]	K [mm]	d [mm]
15	110	73	40.5	69.5	M12 × 1	43	G½"	56	56	SW 24	12
20	110	73	40.5	69.5	M12 × 1	43	G¾"	56	56	SW 27	15
25	110	73	40.5	69.5	M12 × 1	43	G1"	56	56	SW 27	15
50	200	113	80	120	M12 × 1	58	G2"	86	86	SW 52	43

### Dimensions in US units

DN	A [in]	B [in]	C [in]	D [in]	E	F [in]	G	H [in]	I [in]	K [in]	d [in]
15	4.33	2.87	1.59	2.74	M12 × 1	43	G½"	2.2	2.2	AF 1	0.42
20	4.33	2.87	1.59	2.74	M12 × 1	43	G¾"	2.2	2.2	AF 1½/16	0.59
25	4.33	2.87	1.59	2.74	M12 × 1	43	G1"	2.2	2.2	AF 1½/16	0.59
50	7.87	4.45	3.15	4.72	M12 × 1	58	G2"	3.39	3.39	AF 2½/16	1.69

### Weight in SI units

DN	[kg]
15	0.34
20	0.35
25	0.36
50	1.55

### Weight in US units


DN	Weight [lbs]
15	0.75
20	0.77
25	0.79
50	3.42

### Materials

Component	Material
Measuring tube	PEEK
Electrodes, temperature sensor	1.4435/316L
Process connection	1.4404/316L

Component	Material
Housing	1.4404/316L, 1.4409/CF3M
Seal	FKM or EPDM
Display window	Polycarbonate

Measuring device with female thread

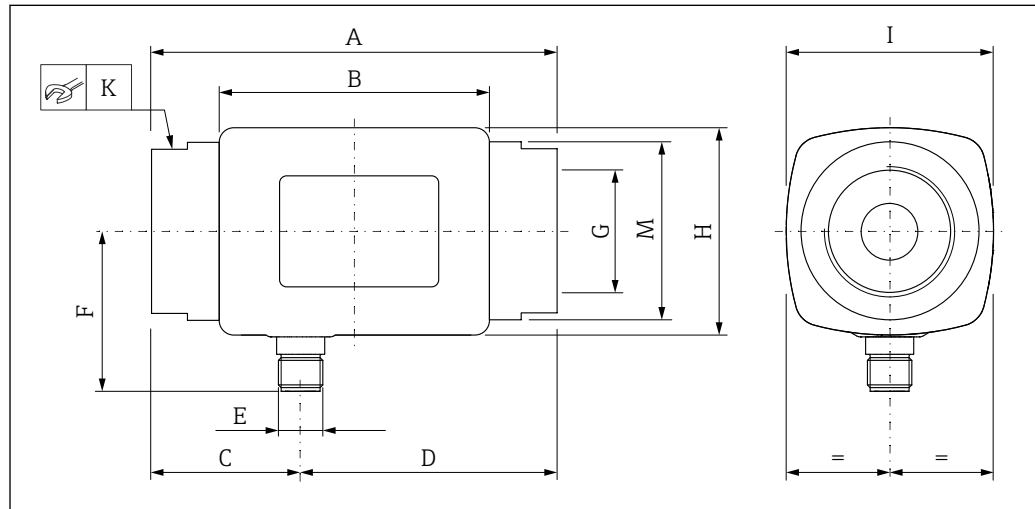

*Dimensions in SI units*

DN	A [mm]	B [mm]	C [mm]	D [mm]	E	F [mm]	G	H [mm]	I [mm]	K [mm]	ØM [mm]
15	110	73	40.5	69.5	M12 × 1	43	NPT½"	56	56	SW 27	29.5
20	110	73	40.5	69.5	M12 × 1	43	NPT¾"	56	56	SW 32	36
25	110	73	40.5	69.5	M12 × 1	43	NPT1"	56	56	SW 41	42
50	180	113	80	120	M12 × 1	58	NPT2"	86	86	SW 70	73.5

*Dimensions in US units*

DN	A [in]	B [in]	C [in]	D [in]	E	F [in]	G	H [in]	I [in]	K [in]	ØM [in]
15	4.33	2.87	1.59	2.74	M12 × 1	1.69	NPT½"	2.2	2.2	AF 1¼ <sub>16</sub>	1.16
20	4.33	2.87	1.59	2.74	M12 × 1	1.69	NPT¾"	2.2	2.2	AF 1¼	1.42
25	4.33	2.87	1.59	2.74	M12 × 1	1.69	NPT1"	2.2	2.2	AF 1⅞ <sub>16</sub>	1.65
50	7.09	4.45	2.76	4.33	M12 × 1	2.28	NPT2"	3.38	3.38	AF 2¾	2.89

*Weight in SI units*

DN	[kg]
15	0.34
20	0.35
25	0.36
50	1.55

*Weight in US units*

DN	Weight [lbs]
15	0.75
20	0.77
25	0.79
50	3.42


### Materials

Component	Material
Measuring tube	PEEK
Electrodes, temperature sensor	1.4435/316L
Process connection	1.4404/316L
Housing	1.4404/316L, 1.4409/CF3M
Seal	FKM or EPDM
Display window	Polycarbonate

## 13.9 Operability

### Local display

The device has an onsite display:

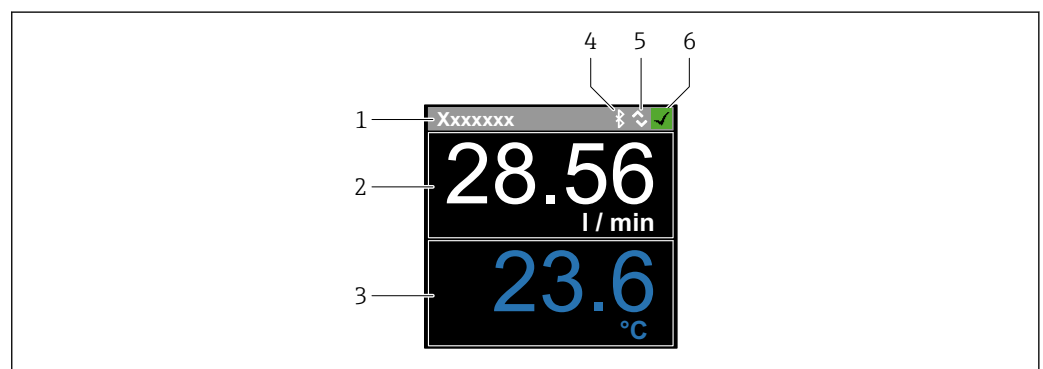

- 1 Tag name (configurable)
- 2 Measured variable 1 (configurable) with sign → 30
- 3 Measured variable 2 (configurable) with sign → 30
- 4 Active Bluetooth connection
- 5 Active I/O-Link connection
- 6 Device status

### Display element

3 measured variables can be displayed (volume flow, temperature, conductivity).

- i** Floating point numbers are saved in IEEE754 format and displayed with single precision format. The values are entered in the decimal system, however. As a result, extremely small, insignificant differences can arise between the value entered and the floating point number displayed, depending on the numerical values.

### Operation

- Via Bluetooth® wireless technology
- Via IO-Link

### Digital communication

Via IO-Link

### SmartBlue app

The device has a *Bluetooth*® wireless technology interface and can be operated and configured using the SmartBlue app.



- The range under reference conditions is 10 m (33 ft)
- Incorrect operation by unauthorized persons is prevented by means of encrypted communication and password encryption
- The *Bluetooth*® wireless technology interface can be disabled

## 13.10 Certificates and approvals

Current certificates and approvals for the product are available via the Product Configurator at [www.endress.com](http://www.endress.com).

1. Select the product using the filters and search field.
2. Open the product page.

The **Configuration** button opens the Product Configurator.

CE mark	<p>The device meets the legal requirements of the applicable EU Directives. These are listed in the corresponding EU Declaration of Conformity along with the standards applied.</p> <p>Endress+Hauser confirms successful testing of the device by affixing to it the CE mark.</p>
UKCA marking	<p>The device meets the legal requirements of the applicable UK regulations (Statutory Instruments). These are listed in the UKCA Declaration of Conformity along with the designated standards. By selecting the order option for UKCA marking, Endress+Hauser confirms a successful evaluation and testing of the device by affixing the UKCA mark.</p> <p>Contact address Endress+Hauser UK:          Endress+Hauser Ltd.          Floats Road          Manchester M23 9NF          United Kingdom  <a href="http://www.uk.endress.com">www.uk.endress.com</a></p>
Radio approval	<p>The measuring device has radio approval.</p> <p> For detailed information regarding radio approval, see the appendix →  47</p>
Pressure Equipment Directive	<p>Devices not bearing this marking (without PED or UKCA) are designed and manufactured according to sound engineering practice. They meet the requirements of</p> <p>a) Art. 4 Para. 3 of the Pressure Equipment Directive 2014/68/EU or          b) Part 1, Para. 8 of Statutory Instruments 2016 No. 1105.</p> <p>The scope of application is indicated</p> <p>a) in diagrams 6 to 9 in Annex II of the Pressure Equipment Directive 2014/68/EU or          b) Schedule 3, Para. 2 of Statutory Instruments 2016 No. 1105.</p>
cUL <sub>US</sub> listing	<p>The measuring device is UL-listed.</p>
Drinking water approval	<p>Availability, see Applicator: <a href="https://portal.endress.com/webapp/applicator">https://portal.endress.com/webapp/applicator</a></p>

## 14 Appendix

### 14.1 Radio approvals

#### 14.1.1 Argentina



CNC ID: C-22455

#### 14.1.2 Brazil

ADENDO AO MANUAL

Modelo: Picomag



A0037714

Para maiores informações, consulte o site da ANATEL: [www.gov.br/anatel/pt-br](http://www.gov.br/anatel/pt-br)

Este equipamento não tem direito à proteção contra interferência prejudicial e não pode causar interferência em sistemas devidamente autorizados.



#### 14.1.3 Europe

This device meets the requirements of the Telecommunications Directive RED 2014/53/EU.

#### 14.1.4 India

ETA Certificate No: ETA - 1707/18-RLO(NE)

### 14.1.5 Indonesia

<p>76485/SDPPI/2021 4962</p> 	 <p>Dilarang melakukan perubahan spesifikasi yang dapat menimbulkan gangguan fisik dan/atau elektromagnetik terhadap lingkungan sekitarnya.</p>
--	--


### 14.1.6 Canada and United States

#### English

This device complies with Part 15 of the FCC Rules and with Industry Canada licence-exempt RSS standard(s).

Operation is subject to the following two conditions:

- This device may not cause harmful interference, and
- This device must accept any interference received, including interference that may cause undesired operation.


 Changes or modifications made to this equipment not expressly approved by Endress+Hauser Flowtec AG may void the user's authorization to operate this equipment.

#### Français

Le présent appareil est conforme aux CNR d'industrie Canada applicables aux appareils radio exempts de licence.



L'exploitation est autorisée aux deux conditions suivantes :

- L'appareil ne doit pas produire de brouillage, et
- L'utilisateur de l'appareil doit accepter tout brouillage radioélectrique subi, même si le brouillage est susceptible d'en compromettre le fonctionnement.

 Les changements ou modifications apportés à cet appareil non expressément approuvés par Endress+Hauser Flowtec AG peuvent annuler l'autorisation de l'utilisateur d'opérer cet appareil.

### 14.1.7 Mexico

La operación de este equipo está sujeta dos condiciones: (1) es posible que este equipo o dispositivo no cause interferencia perjudicial y (2) este equipo o dispositivo debe aceptar cualquier interferencia, incluyendo la que pueda causar su operación no deseada.

  <p style="text-align: right; font-size: small;">A0034100</p>	<p>IFT No.: RCPENPI21-3683</p>
--	--------------------------------



### 14.1.8 Republic of Korea

#### KC 인증

적합성평가정보

R-C-EH7-Picomag

상호 : 한국엔드레스하우저 주식회사

기자재명칭(모델명): 특정소출력 무선기기(무선데이터통신시스템용무선기기)

/ Picomag

제조국 및 제조국가 : Endress+Hauser Flowtec AG / 프랑스

제조년월 : 제조년월로 표기

\*사용자안내문

이 기기는 업무용 환경에서 사용할 목적으로 적합성평가를 받은 기기로서 가정용 환경에서 사용하는 경우 전파간섭의 우려가 있습니다.

### 14.1.9 Singapore

Complies with IMDA Standards DA108204
---

### 14.1.10 Taiwan

#### 低功率電波輻射性電機管理辦法

第十二條	經型式認證合格之低功率射頻電機，非經許可，公司、商號或使用者均不得擅自變更頻率、加大功率或變更原設計之特性及功能。
第十四條	低功率射頻電機之使用不得影響飛航安全及干擾合法通信；經發現有干擾現象時，應改善至無干擾時方得繼續使用。前項合法通信，指依電信法規定作業之無線電通信。低功率射頻電機須忍受合法通信或工業、科學及醫療用電波輻射性電機設備之干擾。
產品名稱	Endress + Hauser
產品型號	Picomag
產地	瑞士
製造商	Endress + Hauser Flowtec AG

### 14.1.11 Thailand

เครื่องโทรคมนาคมและอุปกรณ์นี้ มีความสอดคล้องตามข้อกำหนดของ กสทช.

(This telecommunication equipment is in compliance with NBTC requirements.)



ผู้ใดมิไว้ในครอบครอง หรือ ใช้ซึ่งเครื่องวิทยุ  
คมนาคมหรือตั้งสถานีวิทยุคมนาคมนี้ ต้องได้รับ  
ใบอนุญาตจากเจ้าพนักงานผู้ออกใบอนุญาต  
หากฝ่าฝืน มาตรา 6 หรือมาตรา 11 มีความผิด  
ตามมาตรา 23 แห่งพระราชบัญญัติวิทยุคมนาคม  
พ.ศ. 2498 ต้องระวางโทษปรับไม่เกินหนึ่งแสนบาท  
หรือจำคุกไม่เกินห้าปี หรือทั้งปรับทั้งจำ



**nabp.** | โทรคมนาคม

กำกับดูแลเพื่อประชาชน

Call Center 1200 (Inswr)

A0041612

#### 14.1.12 United Arab Emirates

TRA Registered ER68711/19

#### 14.1.13 Other countries

Other national approvals are available on request.

## 14.2 IO-Link process data

### 14.2.1 Data structure

Bit number					119 ... 112	111 ... 104	103 ...96	95... 88	87... 80	79... 72	71... 64	63... 56	55... 48	47... 40	39... 32	31... 24	23... 16	15... 8	7...0
Data					Conductivity in $\mu\text{S}/\text{cm}$				Totalizer in l				Volume flow in l/s				Temperature in $\frac{1}{10}^{\circ}\text{C}$	Status	
Data type					32-bit floating point number with single precision (IEEE 754)				32-bit floating point number with single precision (IEEE 754)				32-bit floating point number with single precision (IEEE 754)				16-bit two's complement	8-bit	

Data structure of the status bits 7 to 0

Bit	Description
0	Switches once per sampling rate
1	Reserved
2	Current status S-Out 1
3	Current status S-Out 2
4	Reserved
5	Reserved
6	Reserved
7	Reserved

### 14.2.2 Diagnostic information

Diagnostic code		Display text	Coding (hex)	PDValid Validity	Priority
Status NE 107	Diagnostic number				
	-	SYSTEM OK	0x0000	1	1
F	181	COIL CIRC.FAIL.	0x5000	0	2
F	180	TEMP.CIRC.FAIL.	0x5000	0	3
F	201	DEVICE FAIL.	0x5000	0	4
F	283	MEMORY FAIL.	0x8C00	0	5
C	446	I/O 1 OVERLOAD	0x180C	1	6
C	447	I/O 2 OVERLOAD	0x180C	1	7
C	485	SIMULATION ACT.	0x8C01	1	8
C	453	FLOW OVERRIDE	0x180D	1	9
S	441	I-OUT 1 RANGE	0x180A	1	10
S	444	U-OUT 1 RANGE	0x1809	1	11
S	443	P-OUT 1 RANGE	0x180B	1	12
S	442	I-OUT 2 RANGE	0x180A	1	13
S	445	U-OUT 2 RANGE	0x1809	1	14
S	962	EMPTY PIPE	0x180E	1	15
S	834	TEMPERAT. RANGE	0x8C20	1	16

### 14.3 IO-Link ISDU parameter list

The individual parts of a parameter description are described in the following section:

Designation	ISDU (hex)	ISDU (dec)	Size (Byte)	Data type	Access	Value range	Factory setting	Range limits
<b>Identification</b>								
<b>Device Tag</b> First 10 characters displayed (starting from left)	0x0018	24	32 (max.)	string	r/w		EH_DMA_XXZZZ ZZ	
<b>Device Name</b>	0x0012	18	16 (max.)	string	r		Picomag	
<b>Device ID1</b>	0x0009	9	1	uint	r		0x01	
<b>Device ID2</b>	0x000A	10	1	uint	r		0x01	
<b>Device ID3</b>	0x000B	11	1	uint	r		0x01	
<b>Vendor Name</b>	0x0010	16	32 (max.)	string	r		Endress+Hauser	
<b>Vendor ID1</b>	0x0007	7	1	uint	r		0x00	
<b>Vendor ID2</b>	0x0008	8	1	uint	r		0x11	
<b>Device Serial No.</b> e.g. (YMXXXXZZ)	0x0015	21	11 (max.)	string	r		see nameplate	
<b>Firmware version</b> e.g. 01.00.00	0x0017	23	8 (max.)	string	r			
<b>Order Code</b> e.g. DMA15-AAAAA1	0x0102	258	18 (max.)	string	r		see nameplate	
<b>Device Type</b>	0x0100	256	2	uint	r		0x94FF	
<b>Diagnostics</b>								
<b>Actual Diagnostics</b> e.g. C485 (= SIMULATION ACT.)	0x0104	260	4	string	r			
<b>Last Diagnostics</b> e.g. S962 (= EMPTY PIPE)	0x0105	261	4	string	r			
<b>Simulation Proc. Var.</b>	0x015F	351	2	uint	r/w	enable=1 disable=0		
<b>Sim.Proc.Var.Value Volumeflow</b> Unit selection list from <b>Unit Volumeflow</b>	0x0166	358	4	float	r/w		0.0	-10 <sup>6</sup> 10 <sup>6</sup>
<b>Sim.Proc.Var.Value Temperature</b> Unit selection list from <b>Unit Temperature</b>	0x0168	360	4	float	r/w		0.0	-10 <sup>4</sup> 10 <sup>4</sup>
<b>Sim.Proc.Var.Value Conductivity</b> Unit selection list from <b>Unit Conductivity</b>	0x0167	359	4	float	r/w		0.0	0 10 <sup>6</sup>
<b>Measured Values</b>								
<b>Volumeflow</b> Current volume flow measured value	0x0161	353	4	float	r			
<b>Temperature</b> Current temperature measured value	0x0163	355	4	float	r			
<b>Conductivity</b> Current conductivity measured value	0x0164	356	4	float	r			
<b>Totalizer</b> Current totalizer measured value	0x0169	361	4	float	r/w		0.0	

Designation	ISDU (hex)	ISDU (dec)	Size (Byte)	Data type	Access	Value range	Factory setting	Range limits
<b>Totalizer Reset</b>	0x016A	362	2	uint	w	cancel=0 reset=1	cancel	
<b>System Units</b>								
<b>Unit Volumeflow</b>	0x0226	550	2	uint	r/w	l/s=0 l/h=5 fl. oz/min=4 m <sup>3</sup> /h=1 l/min=2 Usgpm=3	l/min	
<b>Unit Volume</b>	0x0227	551	2	uint	r/w	ml=0 USozf=1 l=2 m <sup>3</sup> =3 Usgal=4	ml	
<b>Unit Temperature</b>	0x0228	552	2	uint	r/w	°C=0 °F=1	°C	
<b>Unit Conductivity</b>	0x0229	553	2	uint	r/w	µS/cm=0 S/m=1 mS/cm=2	µS/cm=0	
<b>Unit Totalizer</b>	0x016B	363	2	uint	r/w	USozf=1 l=2 m <sup>3</sup> =3 Usgal=4 kl=5 MI=6 kUsg=7	m <sup>3</sup>	
<b>Sensor</b>								
<b>Install. Direction</b> In relation to direction of arrow on the device	0x015E	350	2	uint	r/w	forward=0 reverse=1	forward	
<b>Low Flow Cut Off</b> The flow rate below the selected value is zero Unit selection list from <b>Unit Volumeflow</b>	0x0160	352	4	float	r/w		0.4/0.75/1.2/5.0 l/min	0 10 <sup>6</sup>
<b>Damping</b> Volume flow damping via the PT1 element Unit: s	0x01A4	420	4	float	r/w		0 s	0 100

Designation	ISDU (hex)	ISDU (dec)	Size (Byte)	Data type	Access	Value range	Factory setting	Range limits
<b>Output 1</b>								
<b>Operating Mode</b> IO-Link is set if connected to a master	0x01F4	500	2	uint	r/w	P-Out=0 I-Out=1 S-In=2 S-Out=3 IO-Link=4 U-Out=5 off=6	IO-Link	
<b>Current output I-Out 1</b>								
<b>I - OUT Assign</b>	0x0258	600	2	uint	r/w	off=0 volume flow=1 temperature=2 conductivity=4	volume flow	
<b>Q-Start-Value</b> ASP <sup>1)</sup> for volume flow Unit selection list from <b>Unit Volumeflow</b>	0x0259	601	4	float	r/w		0 l/min	-9.9·10 <sup>9</sup> 9.9·10 <sup>9</sup>
<b>Q-End-Value</b> AEP <sup>2)</sup> for volume flow Unit selection list from <b>Unit Volumeflow</b>	0x025A	602	4	float	r/w		25/50/100/750 l/min	-9.9·10 <sup>9</sup> 9.9·10 <sup>9</sup>
<b>T-Start-Value</b> ASP <sup>1)</sup> for temperature Unit selection list from <b>Unit Temperature</b>	0x025F	607	4	float	r/w		-10 °C	-9.9·10 <sup>9</sup> 9.9·10 <sup>9</sup>
<b>T-End-Value</b> AEP <sup>2)</sup> for temperature Unit selection list from <b>Unit Temperature</b>	0x0260	608	4	float	r/w		+70 °C	-9.9·10 <sup>9</sup> 9.9·10 <sup>9</sup>
<b>s-Start-Value</b> ASP <sup>1)</sup> for conductivity Unit selection list from <b>Unit Conductivity</b>	0x025D	605	4	float	r/w		0	-9.9·10 <sup>9</sup> 9.9·10 <sup>9</sup>
<b>s-End-Value</b> AEP <sup>2)</sup> for conductivity Unit selection list from <b>Unit Conductivity</b>	0x025E	606	4	float	r/w		1000	-9.9·10 <sup>9</sup> 9.9·10 <sup>9</sup>

Designation	ISDU (hex)	ISDU (dec)	Size (Byte)	Data type	Access	Value range	Factory setting	Range limits
<b>Pulse output P-Out</b>								
<b>Pulse Value</b> Unit selection list from <b>Unit Volume</b>	0x03E8	1000	4	float	r/w		0.5/1.0/2.0/10.0 ml	10 <sup>-9</sup> 9.9·10 <sup>9</sup>
<b>Switch output S-Out 1</b>								
<b>Switch Polarity</b>	0x032B	811	2	uint	r/w	PNP=0 NPN=1	PNP	
<b>Switch Function</b>	0x0320	800	2	uint	r/w	alarm=0 off=1 on=2 lim.vol.flow=3, lim.temp.=4 lim.vol.=5 lims=11 win.vol.flow=6 win.temp.=7 win.vol.=8 wins=13 epd=9	alarm	
<b>Q-ON-Value</b> Unit selection list from <b>Unit Volumeflow</b>	0x0321	801	4	float	r/w		20/40/80/600 l/min	-9.9·10 <sup>9</sup> 9.9·10 <sup>9</sup>
<b>Q-OFF-Value</b> Unit selection list from <b>Unit Volumeflow</b>	0x0322	802	4	float	r/w		15/30/60/450 l/min	-9.9·10 <sup>9</sup> 9.9·10 <sup>9</sup>
<b>T-ON-Value</b> Unit selection list from <b>Unit Temperature</b>	0x0327	807	4	float	r/w		+ 60 °C	-9.9·10 <sup>9</sup> 9.9·10 <sup>9</sup>
<b>T-OFF-Value</b> Unit selection list from <b>Unit Temperature</b>	0x0328	808	4	float	r/w		+ 50 °C	-9.9·10 <sup>9</sup> 9.9·10 <sup>9</sup>
<b>V-ON-Value</b> Unit selection list from <b>Unit Totalizer</b>	0x0329	809	4	float	r/w		0.2/0.4/0.8/6.0 m <sup>3</sup>	-9.9·10 <sup>9</sup> 9.9·10 <sup>9</sup>
<b>V-OFF-Value</b> Unit selection list from <b>Unit Totalizer</b>	0x032A	810	4	float	r/w		0.15/0.3/0.6/4.5 m <sup>3</sup>	-9.9·10 <sup>9</sup> 9.9·10 <sup>9</sup>
<b>s-ON-Value</b> Unit selection list from <b>Unit Conductivity</b>	0x0325	805	4	float	r/w		500	-9.9·10 <sup>9</sup> 9.9·10 <sup>9</sup>
<b>s-OFF-Value</b> Unit selection list from <b>Unit Conductivity</b>	0x0326	806	4	float	r/w		200	-9.9·10 <sup>9</sup> 9.9·10 <sup>9</sup>
<b>Voltage output U-Out 1</b>								
<b>U - OUT Assign</b>	0x02BC	700	2	uint	r/w	off=0 volume flow=1 temperature=2 conductivity=4	volume flow	
<b>Q-Start-Value</b> ASP <sup>1)</sup> for volume flow Unit selection list from <b>Unit Volumeflow</b>	0x02BD	701	4	float	r/w		0 l/min	
<b>Q-End-Value</b> AEP <sup>2)</sup> for volume flow Unit selection list from <b>Unit Volumeflow</b>	0x02BE	702	4	float	r/w		25/50/100/750 l/min	

Designation	ISDU (hex)	ISDU (dec)	Size (Byte)	Data type	Access	Value range	Factory setting	Range limits
<b>T-Start-Value</b> ASP <sup>1)</sup> for temperature Unit selection list from <b>Unit Temperature</b>	0x02C3	707	4	float	r/w		-10 °C	
<b>T-End-Value</b> AEP <sup>2)</sup> for temperature Unit selection list from <b>Unit Temperature</b>	0x02C4	708	4	float	r/w		+70 °C	
<b>s-Start-Value</b> ASP <sup>1)</sup> for conductivity Unit selection list from <b>Unit Conductivity</b>	0x02C1	705	4	float	r/w		0 µS/cm	
<b>s-End-Value</b> AEP <sup>2)</sup> for conductivity Unit selection list from <b>Unit Conductivity</b>	0x02C2	706	4	float	r/w		1000 µS/cm	
<b>Digital input D-In 1</b>								
<b>D-IN Polarity</b>	0x0385	901	2	uint	r/w	low=0 high=1	high	
<b>D-IN Function</b>	0x0384	900	2	uint	r/w	off=0 res.tot.=1 zero ret.=2	res.tot.	
<b>IO-Link</b>								
<b>IO-LINK Vendor Name</b>	0x0010	16	32 (max.)	string	r		Endress+Hauser	
<b>IO-LINK Product Name</b>	0x0012	18	16 (max.)	string	r		Picomag	
<b>IO-LINK RevisionID</b>	0x0004	4	1	uint	r		0x11	
<b>Output 2</b>								
<b>Operating Mode</b>	0x01F5	501	2	uint	r/w	I-Out=1 S-In=2 S-Out=3 U-Out=5 off=6	off	
<b>Current output I-Out 2</b>								
<b>I - OUT Assign</b>	0x028A	650	2	uint	r/w	off=0 volume flow=1 temperature=2	temperature	
<b>Q-Start-Value</b> ASP <sup>1)</sup> for volume flow Unit selection list from <b>Unit Volumeflow</b>	0x028B	651	4	float	r/w		0 l/min	
<b>Q-End-Value</b> AEP <sup>2)</sup> for volume flow Unit selection list from <b>Unit Volumeflow</b>	0x028C	652	4	float	r/w		25/50/100/750 l/min	
<b>T-Start-Value</b> ASP <sup>1)</sup> for temperature Unit selection list from <b>Unit Temperature</b>	0x0291	657	4	float	r/w		-10 °C	
<b>T-End-Value</b> AEP <sup>2)</sup> for temperature Unit selection list from <b>Unit Temperature</b>	0x0292	658	4	float	r/w		+70 °C	
<b>s-Start-Value</b> ASP <sup>1)</sup> for conductivity Unit selection list from <b>Unit Conductivity</b>	0x028F	655	4	float	r/w		0	-9.9·10 <sup>9</sup> 9.9·10 <sup>9</sup>



Designation	ISDU (hex)	ISDU (dec)	Size (Byte)	Data type	Access	Value range	Factory setting	Range limits
<b>s-End-Value</b> AEP <sup>2)</sup> for conductivity Unit selection list from <b>Unit Conductivity</b>	0x0290	656	4	float	r/w		1000	-9.9·10 <sup>9</sup> 9.9·10 <sup>9</sup>
<b>Switch output S-Out 2</b>								
<b>Switch Polarity</b>	0x035D	861	2	uint	r/w	PNP=0 NPN=1	PNP	
<b>Switch Function</b>	0x0352	850	2	uint	r/w	alarm=0 off=1 on=2 lim.vol.flow=3 lim.temp.=4 lim.vol.=5, win.vol.flow=6 lims=11 win.temp.=7 win.vol.=8 wins=13 epd=9	alarm	
<b>Q-ON-Value</b> Unit selection list from <b>Unit Volumeflow</b>	0x0353	851	4	float	r/w		20/40/80/600 l/min	
<b>Q-OFF-Value</b> Unit selection list from <b>Unit Volumeflow</b>	0x0354	852	4	float	r/w		15/30/60/450 l/min	
<b>T-ON-Value</b> Unit selection list from <b>Unit Temperature</b>	0x0359	857	4	float	r/w		+ 60 °C	
<b>T-OFF-Value</b> Unit selection list from <b>Unit Temperature</b>	0x035A	858	4	float	r/w		+ 50 °C	
<b>V-ON-Value</b> Unit selection list from <b>Totalizer</b>	0x035B	859	4	float	r/w		0.2/0.4/0.8/6.0 m <sup>3</sup>	
<b>V-OFF-Value</b> Unit selection list from <b>Totalizer</b>	0x035C	860	4	float	r/w		0.15/0.3/0.6/4.5 m <sup>3</sup>	
<b>s-ON-Value</b> Unit selection list from <b>Conductivity</b>	0x0357	855	4	float	r/w		500	
<b>s-OFF-Value</b> Unit selection list from <b>Conductivity</b>	0x0358	856	4	float	r/w		200	
<b>Voltage output U-Out 2</b>								
<b>U - OUT Assign</b>	0x02EE	750	2	uint	r/w	off=0 volume flow=1 temperature=2	temperature	
<b>Q-Start-Value</b> ASP <sup>1)</sup> for volume flow Unit selection list from <b>Unit Volumeflow</b>	0x02EF	751	4	float	r/w		0 l/min	
<b>Q-End-Value</b> AEP <sup>2)</sup> for volume flow Unit selection list from <b>Unit Volumeflow</b>	0x02F0	752	4	float	r/w		25/50/100/750 l/min	
<b>T-Start-Value</b> ASP <sup>1)</sup> for temperature from <b>Unit Temperature</b>	0x02F5	757	4	float	r/w		-10 °C	

Designation	ISDU (hex)	ISDU (dec)	Size (Byte)	Data type	Access	Value range	Factory setting	Range limits
<b>T-End-Value</b> AEP <sup>2)</sup> for temperature from <b>Unit Temperature</b>	0x02F6	758	4	float	r/w		+70 °C	
<b>s-Start-Value</b> ASP <sup>1)</sup> for temperature from <b>Conductivity</b>	0x02F3	755	4	float	r/w		0 µS/cm	
<b>s-End-Value</b> AEP <sup>2)</sup> for temperature from <b>Conductivity</b>	0x02F4	756	4	float	r/w		1000 µS/cm	
<b>Digital input D-In 2</b>								
<b>D-IN Polarity</b>	0x0395	917	2	uint	r/w	low=0 high=1	high	
<b>D-IN Function</b>	0x0394	916	2	uint	r/w	off=0 res.tot.=1 zero ret.=2	res.tot.	
<b>Display</b>								
<b>Display Layout</b>	0x01C3	451	2	uint	r/w	QV=0 QT=1 Qs=3 VT=2, Vs=4 Ts=5 QVTs=6 QVTs_m=7	QT	
<b>Display Rotation</b>	0x01C4	452	2	uint	r/w	0 °=0 90 °=1 180 °=2 270 °=3 auto=4	Auto	
<b>Display Backlight</b>	0x01C2	450	2	uint	r/w	0 - 100	50	
<b>Bluetooth configuration</b>								
<b>Bluetooth Function</b>	0x041A	1050	2	uint	r/w	on=1 off=0	on	
<b>Bluetooth Tx Pwr Level</b>	0x041B	1051	2	uint	r	0 - 4		
<b>Bluetooth Conn. Status</b>	0x041C	1052	1	uint	r			
<b>Administration</b>								
<b>Set Access Code</b> Define the access code	0x0108	264	2	uint	w		0000	
<b>Access Code</b> Enter the access code	0x0107	263	2	uint	w			
<b>Reset Device</b>	0x010E	270	2	uint	w	cancel=0 restore fact.=1 restart=4	cancel	
<b>Product Specific Process Values</b>								
<b>Status IO 1</b>	0x0386	902	2	uint	r	low=0 high=1		
<b>Status IO 2</b>	0x0396	918	2	uint	r	low=0 high=1		

1) Analog Start Point

2) Analog End Point

# Index

## A

About this document . . . . .	5
Accessories . . . . .	39
Appendix . . . . .	47
Application	
Media . . . . .	8

## B

Basic safety instructions . . . . .	8
Bidirectional flow measurement (Q), temperature measurement (T) . . . . .	25, 28

## C

CE mark . . . . .	9, 46
Commissioning . . . . .	22
Configuring system units . . . . .	22
Configuring the current output . . . . .	24
Configuring the digital input . . . . .	28
Configuring the display . . . . .	30
Configuring the IO modules . . . . .	24
Configuring the measuring device . . . . .	22
Configuring the pulse output . . . . .	25
Configuring the voltage output . . . . .	27
Connecting requirements . . . . .	16
Connecting the device . . . . .	19
Current output configuration version . . . . .	18
Current version data for the device . . . . .	21

## D

Data management . . . . .	31
Declaration of Conformity . . . . .	9
Device information . . . . .	37
Device master file . . . . .	21
Diagnostic behavior . . . . .	36
Diagnostic information on local display . . . . .	36
Diagnostic message . . . . .	36
Diagnostics and troubleshooting . . . . .	35
Digital input configuration version . . . . .	18
Dimensions in SI units . . . . .	43, 44
Dimensions in US units . . . . .	43
Document function . . . . .	5
Documentation . . . . .	6
Drinking water approval . . . . .	46

## E

Electrical connection . . . . .	16
---------------------------------	----

## F

Field of application	
Residual risks . . . . .	8
Firmware history . . . . .	38

## I

Identification . . . . .	22
Identifying the measuring device . . . . .	11
Incoming acceptance . . . . .	11
Inlet and outlet runs . . . . .	14

## Inspection

Received goods . . . . .	11
Intended use . . . . .	8
IO-Link configuration version . . . . .	19

## M

Magnetism . . . . .	42
Materials . . . . .	43, 45
Mounting . . . . .	14
Mounting location . . . . .	14
Mounting position . . . . .	14
Mounting requirements . . . . .	14
Mounting the measuring device . . . . .	14

## O

Operation . . . . .	33
Operation options . . . . .	20
SmartBlue app . . . . .	20
Operational safety . . . . .	9
Overview of device description files . . . . .	21
Overview of diagnostic events . . . . .	37
Overview of the operating menu . . . . .	22

## P

Packaging disposal . . . . .	13
Pin assignment, device plug . . . . .	16
Post-connection check . . . . .	19
Pressure Equipment Directive . . . . .	46
Product safety . . . . .	9

## R

Radio approval . . . . .	46
Radio approvals . . . . .	47
Registered trademarks . . . . .	6
Requirements for connection cable . . . . .	16
Requirements for personnel . . . . .	8

## S

Security . . . . .	31
Setting the installation direction and measurement . . . . .	23
Static electricity . . . . .	42
Storage conditions . . . . .	13
Storage temperature . . . . .	13
Switch output configuration version . . . . .	17
Switch/pulse output configuration version . . . . .	17
Switching ON the measuring device . . . . .	22
Symbols used . . . . .	5
System integration . . . . .	21

## T

Technical data . . . . .	41
Certificates and approvals . . . . .	46
Environment . . . . .	42
Input . . . . .	41
Installation . . . . .	42
Mechanical construction . . . . .	43, 44
Operability . . . . .	45

---

Output . . . . .	41
Performance characteristics . . . . .	41
Power supply . . . . .	41
Process . . . . .	42
Temperature range	
Storage temperature . . . . .	13
Tools	
Transport . . . . .	13
Totalizer . . . . .	29
Transporting the measuring device . . . . .	13
Troubleshooting	
General . . . . .	35
<b>U</b>	
UKCA marking . . . . .	46
Unidirectional flow measurement (Q), conductivity measurement . . . . .	25, 28
Using the measuring device	
Borderline cases . . . . .	8
Incorrect use . . . . .	8
<b>V</b>	
Voltage output configuration version . . . . .	18
<b>W</b>	
W@M Device Viewer . . . . .	11
Weight	
Transport (notes) . . . . .	13
Weight in SI units . . . . .	43, 44
Weight in US units . . . . .	43, 44
Workplace safety . . . . .	8









71698531

[www.addresses.endress.com](http://www.addresses.endress.com)

---