


Operating Instructions

Topclean S CPC30



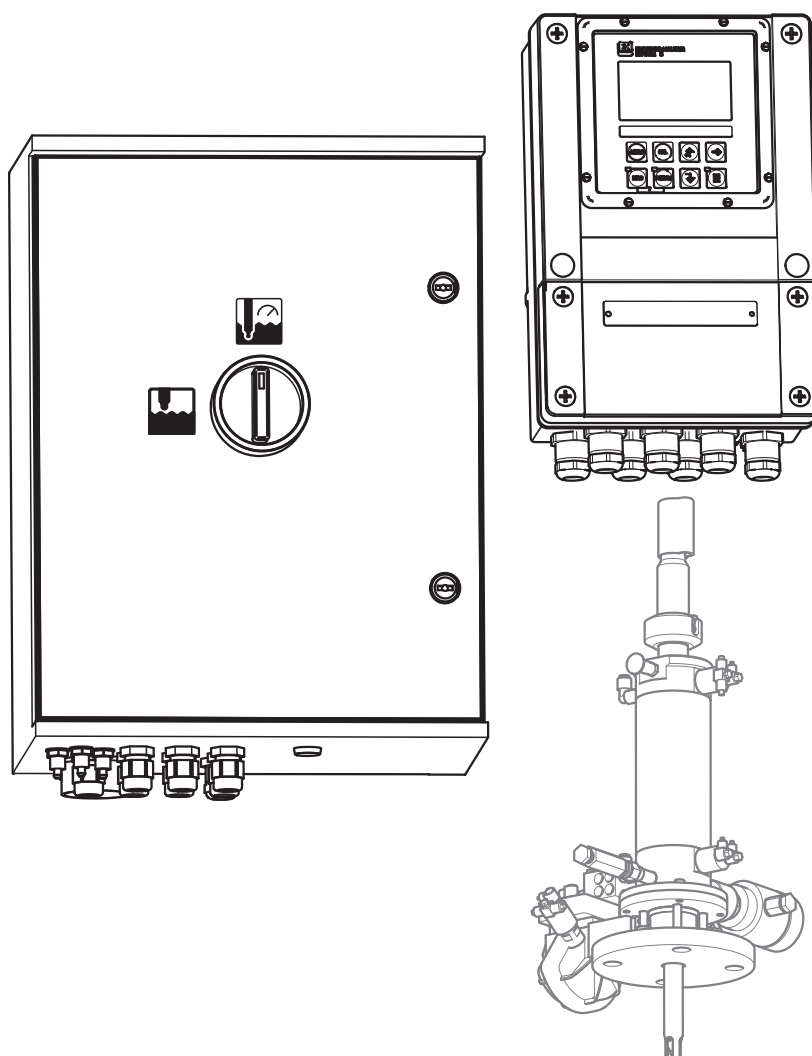

Automation of pH/ORP measurements



Document information

Warnings

The structure, signal words and safety colors of the signs comply with the specifications of ANSI Z535.6 ("Product safety information in product manuals, instructions and other collateral materials").

Safety message structure	Meaning
 DANGER Causes (/consequences) Possible consequences if ignored ► Corrective action	This symbol alerts you to a dangerous situation. Failure to avoid the situation will result in a fatal or serious injury.
 WARNING Causes (/consequences) Possible consequences if ignored ► Corrective action	This symbol alerts you to a dangerous situation. Failure to avoid the situation can result in a fatal or serious injury.
 CAUTION Causes (/consequences) Possible consequences if ignored ► Corrective action	This symbol alerts you to a dangerous situation. Failure to avoid this situation can result in minor or more serious injuries.
 NOTICE Cause/situation Possible consequences if ignored ► Action/note	This symbol alerts you to situations that can result in damage to property and equipment.

Symbols




-  Additional information, tip
-  Permitted or recommended
-  Forbidden or not recommended

Table of Contents

1	Basic safety instructions	4	9	Maintenance	131
1.1	Requirements for personnel	4	9.1	Maintenance of the entire measuring point ..	131
1.2	Designated use	4			
1.3	Occupational safety	4	10	Repair	136
1.4	Operational safety	4	10.1	Spare parts	136
1.5	Product safety	4	10.2	Device view Mycom S	136
2	Incoming acceptance and product identification	5	10.3	Mycom S spare parts list	137
2.1	Incoming acceptance	5	10.4	Control unit spare parts list	137
2.2	Product identification	5	10.5	Pneumatic and hydraulic control unit	138
2.3	Scope of delivery	6	10.6	Spare parts for CYR10 injector	139
2.4	Certificates and approvals	6	10.7	Replacing the device fuse	140
3	Installation	7	10.8	Return	140
3.1	Measuring system	7	10.9	Disposal	140
3.2	Installation conditions	7	11	Accessories	141
3.3	Installation	10	11.1	Offline configuration	141
3.4	Post-installation check	14	11.2	Assemblies	141
4	Electrical connection	15	11.3	Sensors	142
4.1	Wiring	15	11.4	Connection accessories	143
4.2	Post-connection check	37	11.5	Mounting accessories	144
5	Medium connection	38	12	Technical data	145
5.1	Compressed air line	38	12.1	Input	145
5.2	Assemblies	39	12.2	Output	146
5.3	Post-connection check	48	12.3	Power supply	148
6	Operation	49	12.4	Performance characteristics	149
6.1	Display and operating elements	49	12.5	Environment	150
7	Commissioning	54	12.6	Mechanical construction	151
7.1	Special features when commissioning digital sensors	54	13	Appendix	153
7.2	Special features when commissioning ISFET sensors	54	13.1	Operating matrix	153
7.3	Function check	54	13.2	Connection examples	166
7.4	Switching on	55	13.3	Wiring example for external program start ..	167
7.5	First start up	56	13.4	Buffer tables	167
7.6	Device configuration	61			
7.7	Diagnosis	105			
7.8	Calibration	113			
8	Diagnostics and troubleshooting	121		Index	169
8.1	Troubleshooting instructions	121			
8.2	System error messages	121			
8.3	Process-specific errors	125			
8.4	Device-specific errors	128			
8.5	Response of outputs to errors	129			

1 Basic safety instructions

1.1 Requirements for personnel

- ▶ Installation, commissioning, operation and maintenance of the measuring system must be carried out exclusively by specially trained technical personnel.
- ▶ The technical personnel must be authorized to perform the tasks by the owner-operator.
- ▶ The electrical connection may only be established by an electrical technician.
- ▶ The technical personnel must have read and understood these Operating Instructions and must follow the instructions they contain.
- ▶ Faults at the measuring point may only be rectified by authorized and properly trained personnel.

 Repairs not described in the Operating Instructions provided may only be carried out directly at the manufacturer's or by the Service Organization.

1.2 Designated use

Topclean S CPC30 is a fully automated measuring and cleaning system for pH and ORP measurement.

The system is supplied complete with power supply cables and bottle hoses. The hazardous area version (Ex version) of Topclean S CPC30 allows operation even in explosive atmospheres.

If the device is used for any purpose other than that described, this poses a threat to the safety of people and the entire measuring system and is thus not permitted.

The manufacturer does not accept liability for damage caused by improper or non-designated use.

1.3 Occupational safety

As the user, you are responsible for observing the following safety regulations:

- Explosion protection guidelines (only devices approved for use in explosion hazardous areas)
- Installation guidelines
- Local standards and regulations

1.4 Operational safety

- ▶ Prior to commissioning the entire measuring point, check that all connections are correct. Make sure that electric cables and hose connections are not damaged.
- ▶ Do not commission damaged products. Protect them against unintentional startup. Label and identify the damaged product as defective.
- ▶ If the faults cannot be eliminated, take the products out of service and protect them against unintentional startup.

1.5 Product safety

The product is designed to meet state-of-the-art safety requirements, has been tested and left the factory in a condition in which it is safe to operate.

The applicable regulations and European Directives have been taken into account.

2 Incoming acceptance and product identification

2.1 Incoming acceptance

- Make sure the packaging is not damaged!
- Inform your supplier of any damage to the packaging. Please keep the damaged packaging until any issues have been resolved.
- Make sure the contents are undamaged!
- Inform your supplier of any damage to the contents. Please keep the damaged goods until any issues have been resolved.
- Make sure the delivery is correct and nothing is missing. Check the delivery against the delivery papers and your order.
- Pack the product for storage and transportation in such a way as to protect it reliably against impact and moisture. The original packaging offers the best protection. Also, keep to the approved environment (see "Technical data").
- If you have any queries, contact your supplier or local Sales Office.

2.2 Product identification

2.2.1 Nameplate

You can find the following information on the nameplate:


- Manufacturer details
- Order code
- Extended order code
- Serial number
- Operating conditions
- Safety warning symbols

Compare the order code indicated on the nameplate against your order.

2.2.2 Identifying the product

The order code and serial number of your device can be found in the following locations:

- On the nameplate
- In the delivery papers

 To establish the version of your product, enter the order code from the nameplate into the search field at the following address:
www.products.endress.com/order-ident

2.3 Scope of delivery

The scope of delivery of the system comprises:

- 1 Mycom S CPM153 transmitter
- 1 CPG30 control unit
- 1 CYR10 injector
- 1 multihose
- 1 canister for cleaning liquid
- 1 communication/power supply cable CPG30 / Mycom S CPM153
- 1 pressure reduction valve with pressure gauge
- 1 device identification card
- 1 operating manual BA00235C/07/EN
- For version with HART communication
 - 1 operating manual for field communication with Topclean S CPC30, BA00301C/07/EN
- For version with PROFIBUS interface
 - 1 operating manual for field communication with Topclean S CPC30, BA00298C/07/EN
- For hazardous area version: Safety Instructions XA00236C/07/A3
- Accessories where applicable

If you have any queries, please contact your supplier or local Sales Office.

2.4 Certificates and approvals

Declaration of conformity

The product meets the statutory requirements of the harmonized European standards. The manufacturer confirms the product complies with the standards by affixing to it the **CE** mark.

3 Installation

3.1 Measuring system

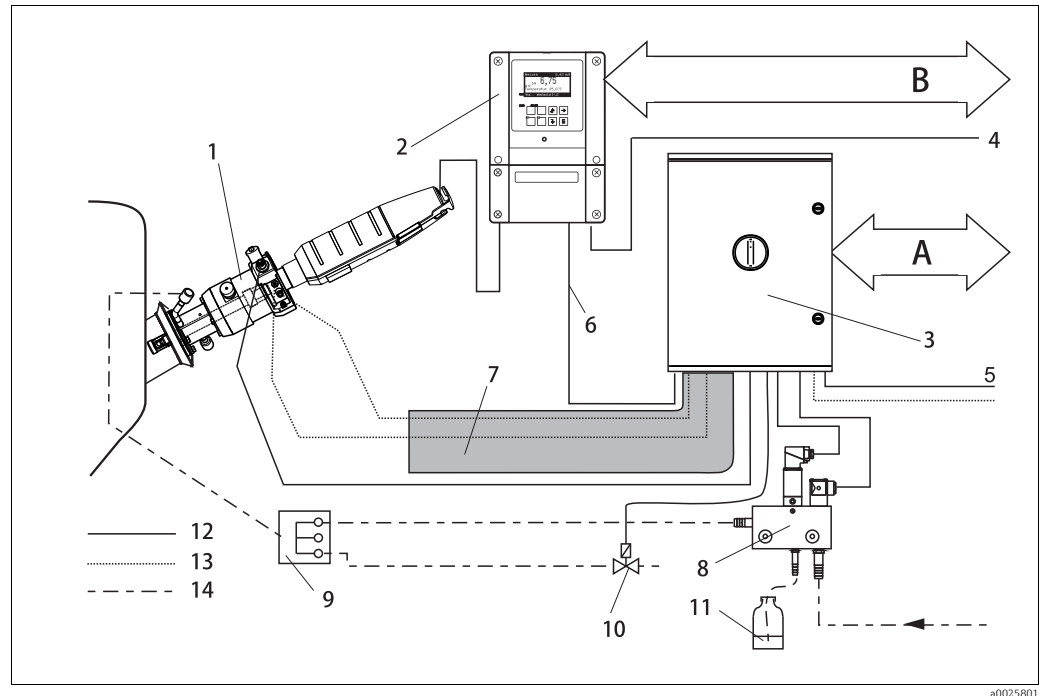


Fig. 1: Complete measuring system (example)

- | | | | |
|---|---------------------------------------|----|--|
| 1 | CPA875 assembly with pH/ORP electrode | 9 | Rinsing block |
| 2 | Mycom S CPM153 transmitter | 10 | Additional valve (optional) |
| 3 | CPG30 control unit | 11 | Cleaning solution |
| 4 | Power supply for Mycom S CPM153 | 12 | Electric cable |
| 5 | Power supply for CPG30 control unit | 13 | Compressed air |
| 6 | Communication/power supply cable | 14 | Liquids/cleaning mixture |
| 7 | Multihose | A | Status and control signals |
| 8 | CYR10 injector | B | Hold input, six relay contacts, two 0/4 to 20 mA current outputs |

3.2 Installation conditions

3.2.1 Types of mounting

You can choose from the following types of mounting for the individual components:

Device	Wall mounting	Post/pipe mounting	Panel mounting
CPG30 control unit	Mounting kit contained in scope of delivery.	not applicable	not applicable
Mycom S CPM153, protected	Required: 2 screws Ø 6 mm (0.24") 2 wall plugs Ø 8 mm (0.31")	Mounting kit contained in scope of delivery.	Mounting kit contained in scope of delivery.
Mycom S CPM153, for field installation	If installed outdoors, weather protection cover CYY102-A required (see Accessories).	Weather protection cover CYY102-A and 2x round post fixtures required (see Accessories).	Not usual

3.2.2 Spacing

The graphic below illustrates the maximum horizontal and vertical spacing for the system when installing the components.

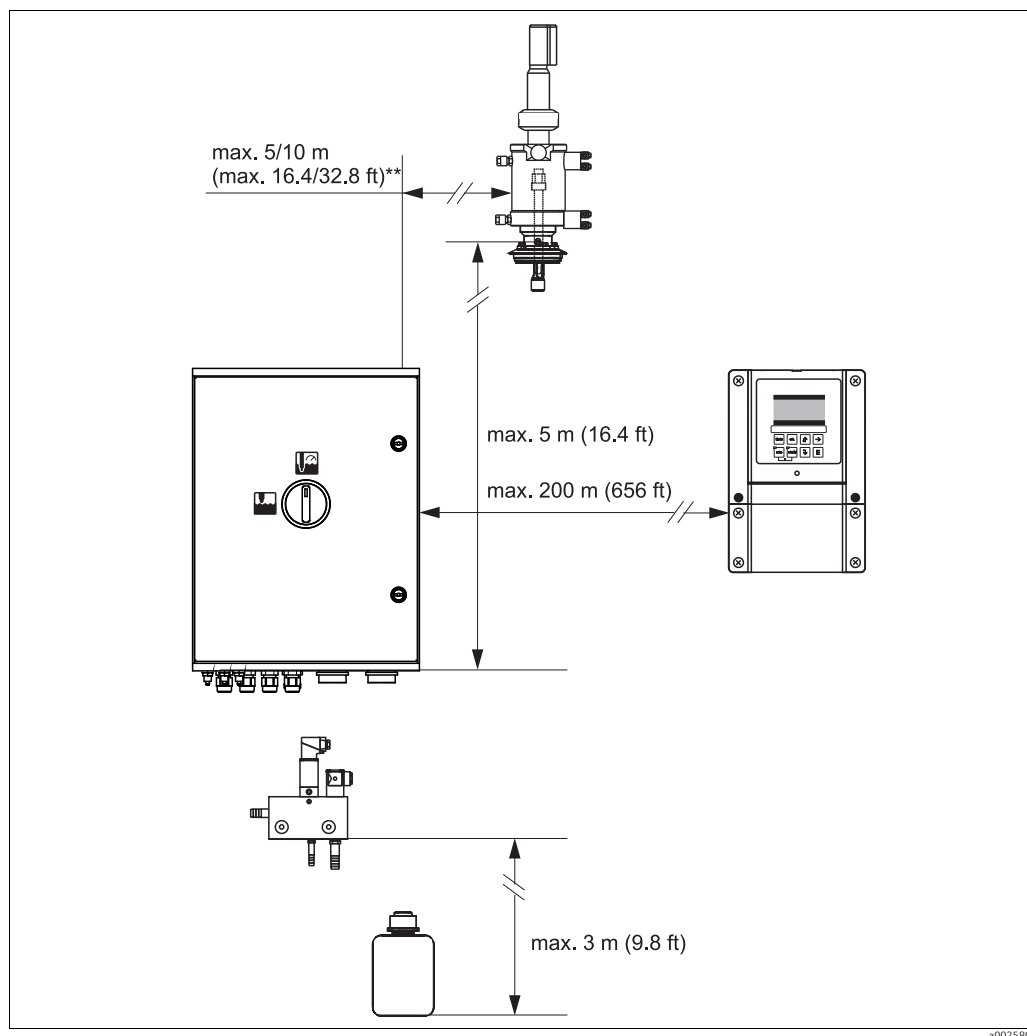


Fig. 2: Maximum spacing for Topclean S CPC30 system components

* when using the multihoses supplied as standard

** depending on the multihose version ordered

3.2.3 Rinse water and compressed air

Compressed air

Specification:

4 to 6 bar (58 to 87 psi), filtered, 50 µm, free from oil and condensate

Connection:

Bulkhead gland OD 6 mm (0.24"), connection to CPG30 control unit via pressure reduction valve supplied

Rinse water

Specification:

Tap water, 2 to 6 bar (29 to 87 psi), filtered, 100 µm

Connection:

Connection to CYR10 (water filter, see "Accessories" section)

3.2.4 Assembly installation

- A

Glass electrode:
- B

ISFET sensor Tophit:
- Installation angle of at least 15 ° to the horizontal

No restrictions, 0 to 180° recommended

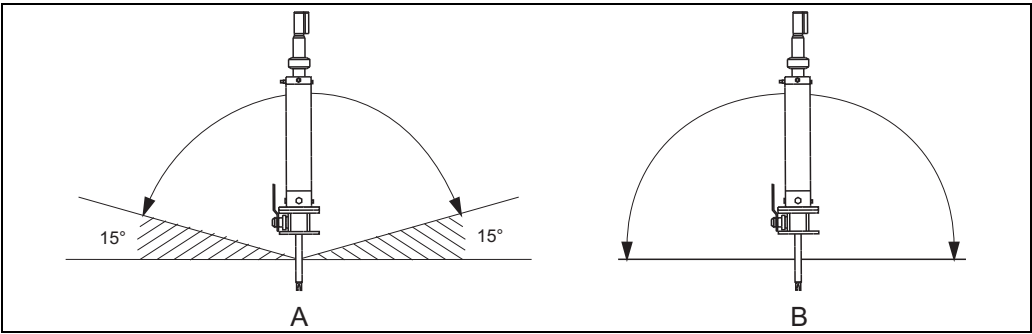


Fig. 3: Permitted orientation depending on the sensor used

3.2.5 Dimensions

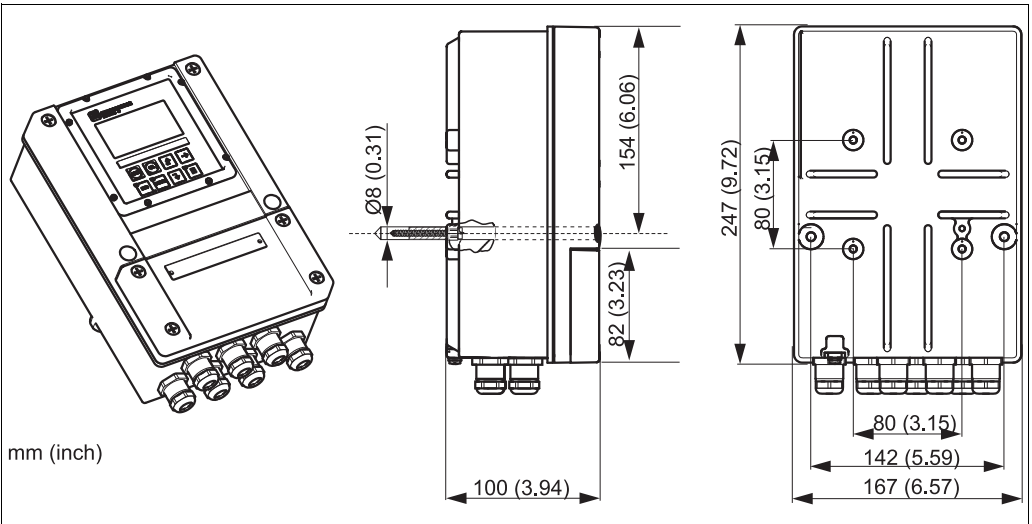


Fig. 4: Dimensions of Mycom S

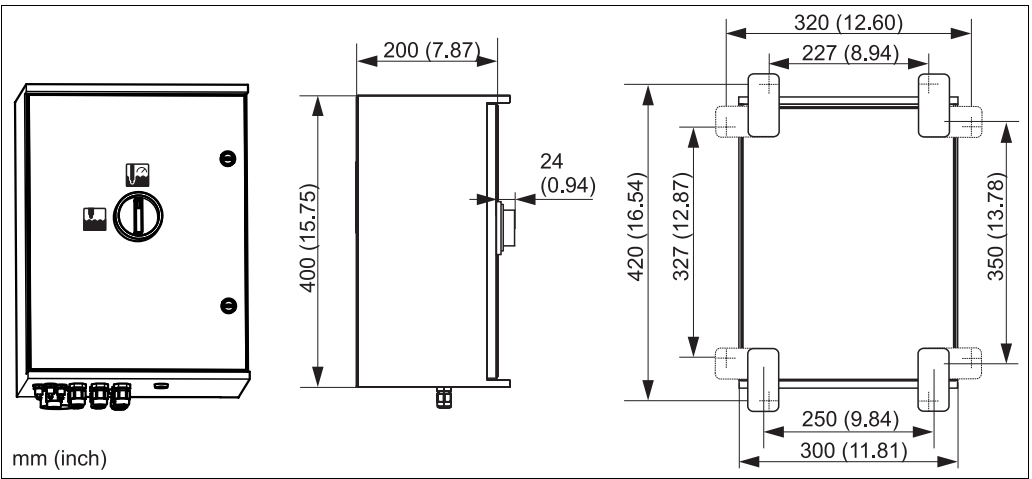


Fig. 5: Dimensions of CPG30 control unit

3.3 Installation

3.3.1 Installation instructions

- The Mycom S transmitter is normally used as a field device. It can also be installed as a panel-mounted device.
- Mycom S is suitable for wall mounting with securing screws and for post mounting to cylindrical pipes.
- Always install the transmitter horizontally in such a way that the cable entries are always pointing downwards.

3.3.2 Wall mounting

NOTICE

Climatic influences (rain, snow, direct sunlight etc.)

Function impairment and even total measuring system failure

- ▶ Make sure the maximum permitted ambient temperature range of -20 to +60 °C (-4 to 140 °F) is observed. Avoid direct sunlight.
- ▶ Always mount the wall-mount housing in such a way that the cable entries point downwards.

Control unit

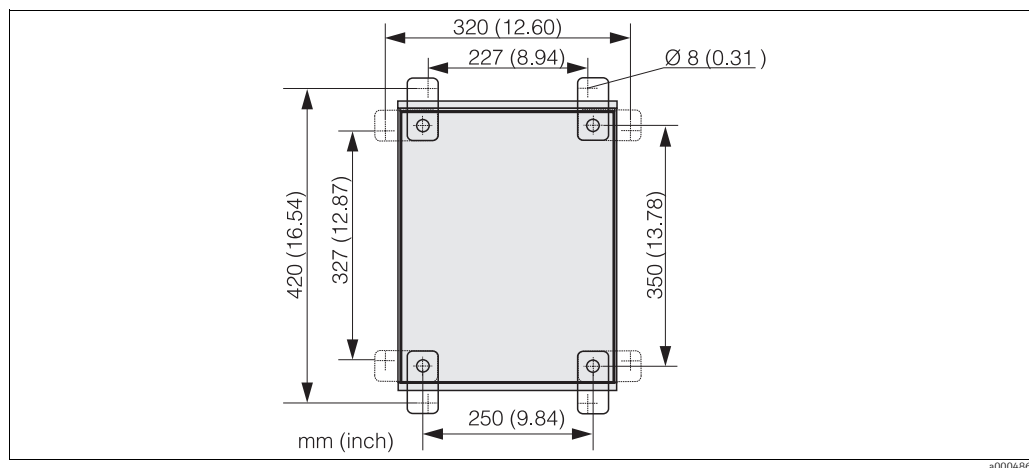


Fig. 6: Dimensions for wall mounting with wall securing kit (part of scope of delivery)

Proceed as follows to wall-mount the unit:

1. Please note that the maximum suction height for buffer and cleaner is 2.5 m (8.2 ft.) when using the standard multihoses supplied. Bore the holes as per the graphic above.
2. Screw the elements of the wall securing set supplied to the rear wall of the housing.
3. Secure the housing to the wall without any inclination.

Transmitter

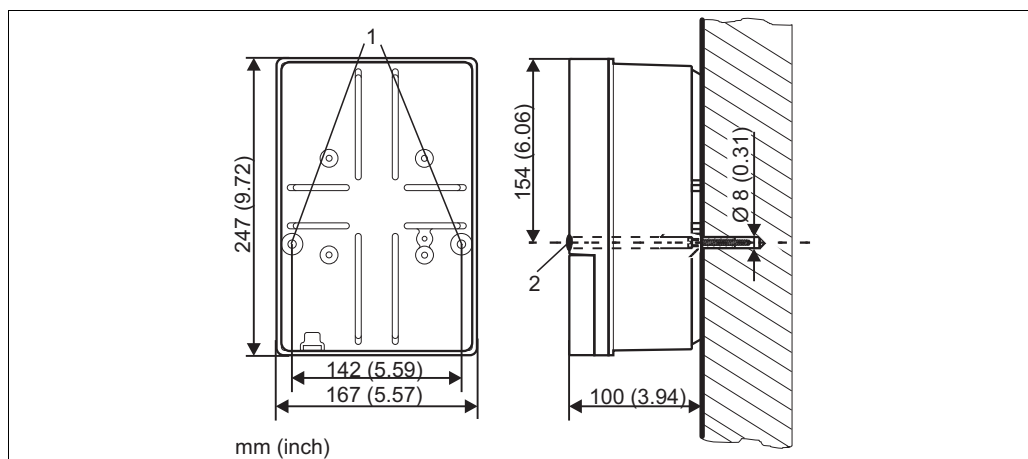


Fig. 7: Dimensions for wall mounting, securing screw: \varnothing 6 mm (0.24"), wall plug: \varnothing 8 mm (0.31")

- 1 Mounting bore holes
- 2 Plastic caps

Proceed as follows to wall-mount the unit:

1. Bore the holes as per Fig. 7.
2. Push the two securing screws through the mounting bore holes from the front (item 1).
3. Mount the transmitter housing on the wall as shown.
4. Cover the bore holes with the plastic caps (item 2).

3.3.3 Post mounting and panel mounting

i You need a special mounting kit to secure the transmitter to horizontal and vertical posts or pipes (max. Ø 70 mm (2.76")) and for panel mounting.

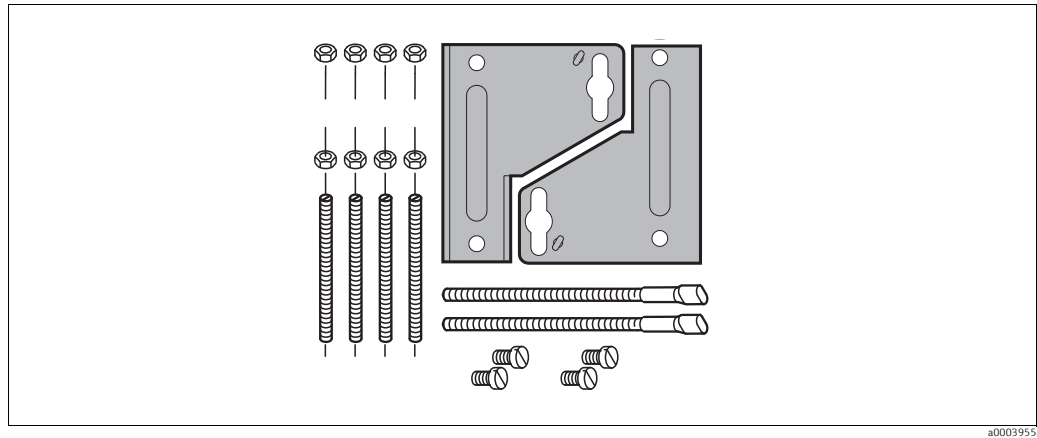


Fig. 8: Mounting kit

Panel mounting

Proceed as follows to panel-mount the transmitter:

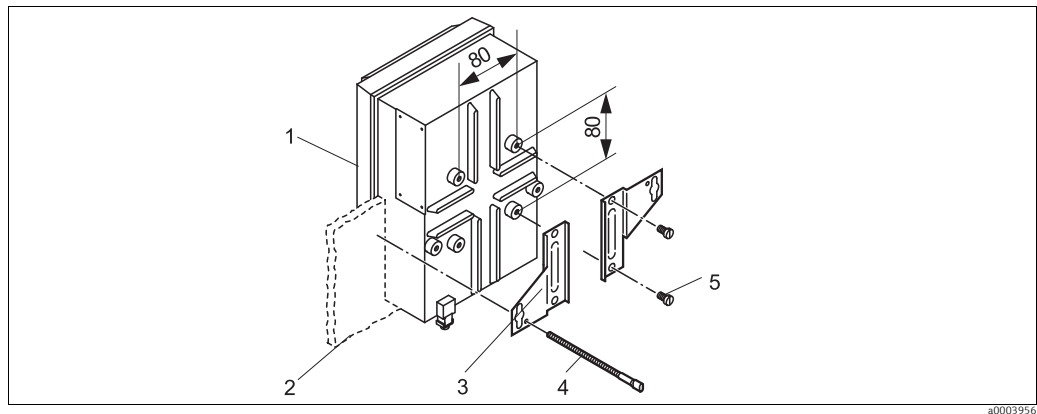


Fig. 9: Panel mounting

1. Make the necessary mounting cutout, measuring 161 x 241 mm (6.34" x 9.49"). The installation depth is 134 mm (5.28").
2. Unscrew the top housing section (item 1).
3. Secure the securing plates (item 3) to the transmitter housing base using the securing screws (item 5) in accordance with Fig. 9.
4. Secure the transmitter to the panel (item 2) using the clamping screws (item 4).
5. Place the flat seal (see "Accessories" section) on the housing base.
6. Screw the top housing section back on.

Post mounting

For post mounting the transmitter, proceed as follows:

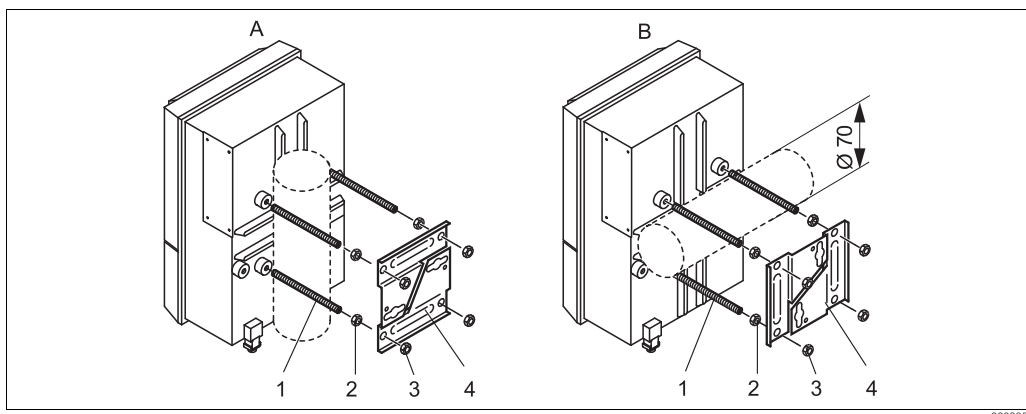


Fig. 10: Post mounting

A Vertical mounting
B Horizontal mounting

1. Screw the four securing screws (item 1) into the threaded openings on the transmitter.
2. Counter every securing screw with a nut (item 2).
3. Set the transmitter to the desired position on the post or pipe.
4. Push the securing plates (item 4) onto the securing screws in accordance with Fig. 10.
5. Screw a nut (item 3) onto each securing screw and tighten it so that the transmitter is securely fastened to the post or pipe.

You can also secure the field device to a square universal post in conjunction with the weather protection cover. These can be acquired as accessories, see "Accessories" section.

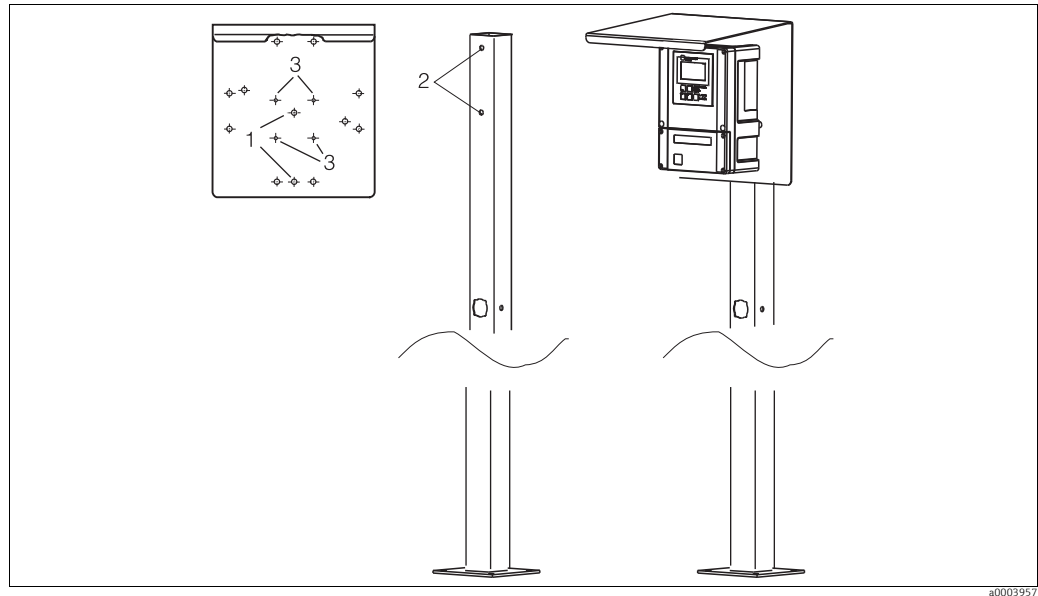


Fig. 11: Mounting field device with universal posts and weather protection cover

For mounting the weather protection cover, proceed as follows:

1. Screw the weather protection cover with 2 screws (bores 1) to the upright post (bores 2).
2. Secure the field device to the weather protection cover. To do so, use the bores (3).

3.4 Post-installation check

- After installation, check the transmitter and control unit for damage.
- Check whether the transmitter and control unit are protected against moisture and direct sunlight.

4 Electrical connection

WARNING

The device is live!

Improper connection can cause injury or death


- ▶ The electrical connection may only be established by an electrical technician.
- ▶ The electrical technician must have read and understood these Operating Instructions and must follow the instructions they contain.
- ▶ **Prior** to starting the connection work, make sure that voltage is not applied to any cable.

4.1 Wiring

4.1.1 Overview

Note the following points:

- Connect unused signal wires from input and output lines to the internal PE rail of the transmitter.
- The current/resistance input may only be connected with a shielded cable, whereby the shield must be connected to the PE rail of the transmitter.
- Make sure that the grounding in the connection compartment cover is connected to the PE rail in the housing via the PE line.

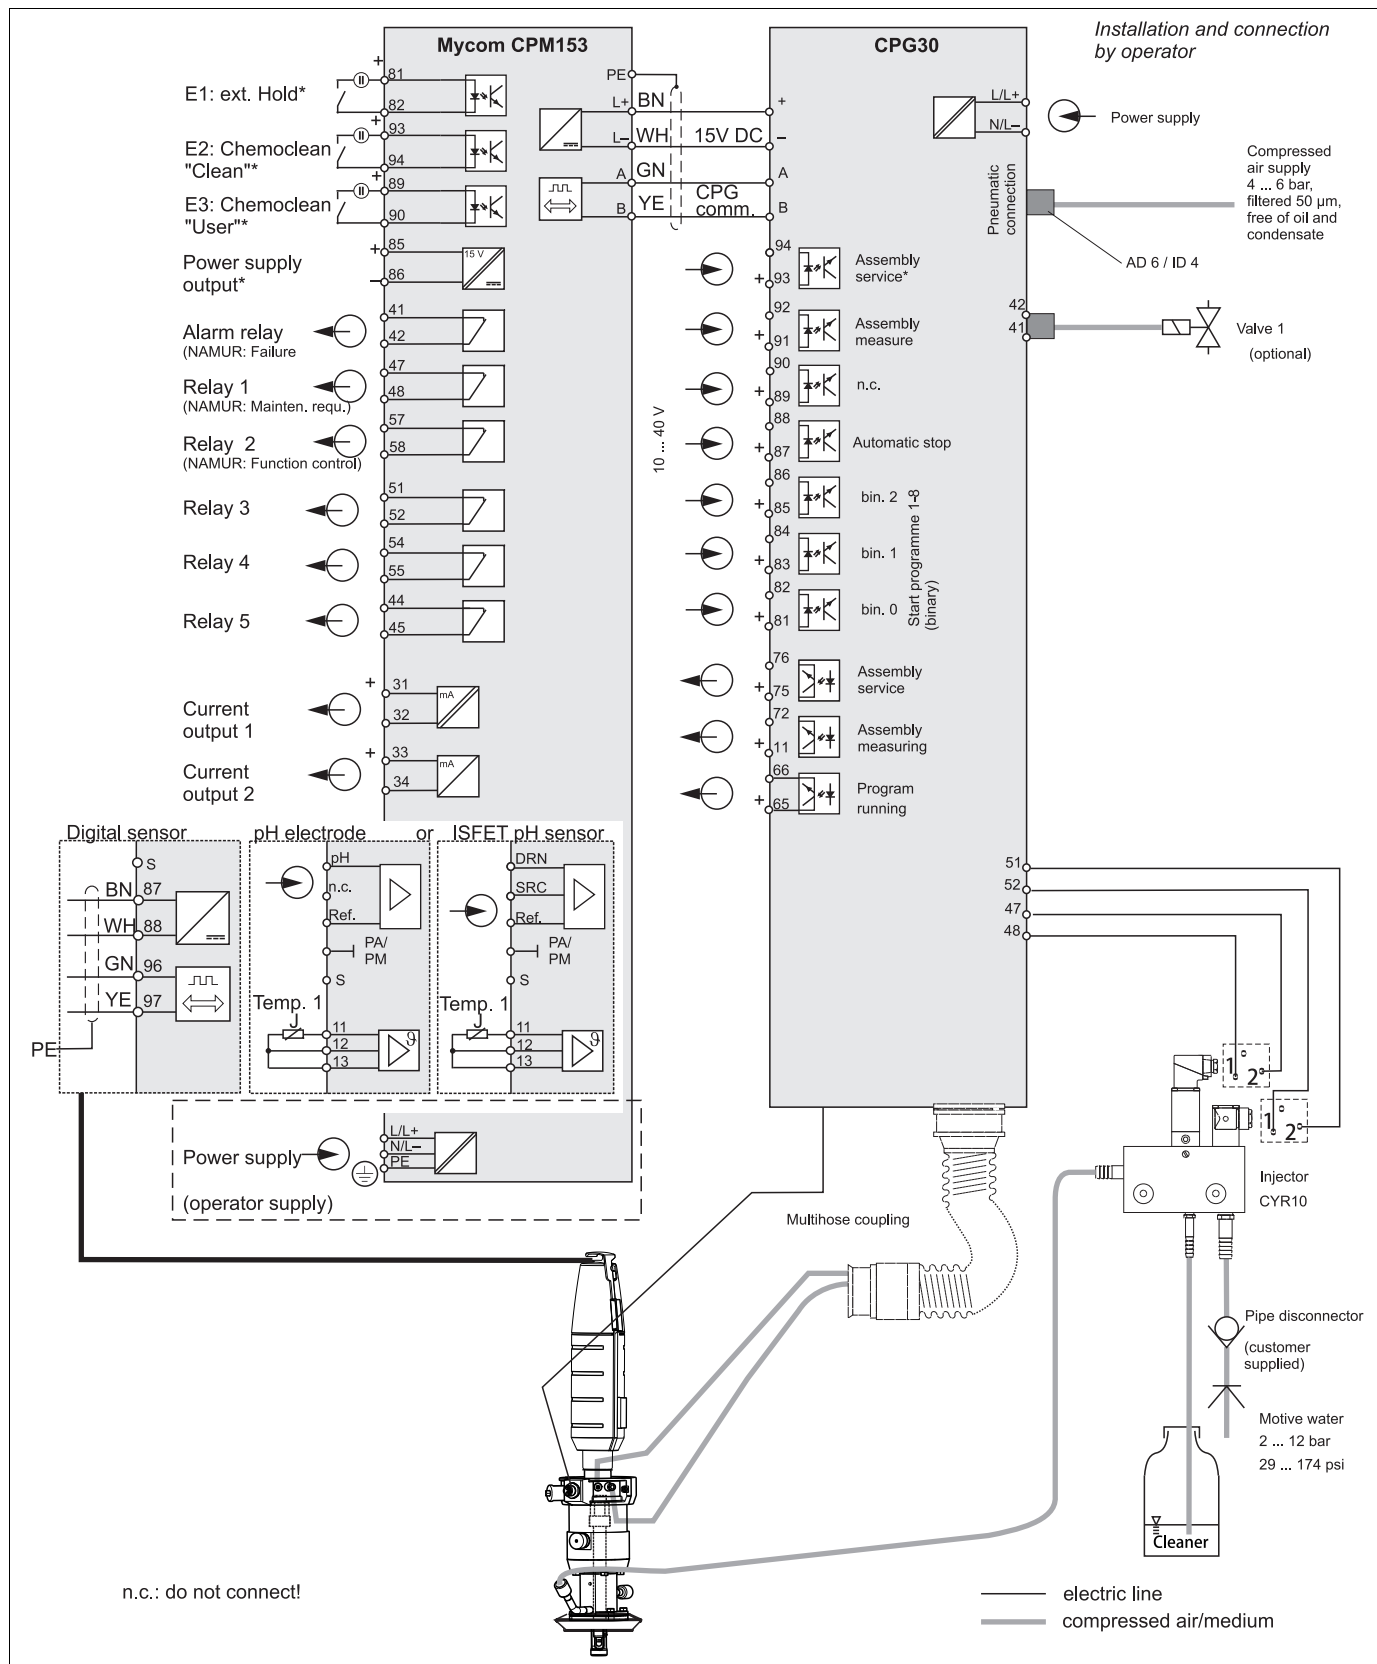

a0025/99-en

4.1.2 Connection compartment sticker, Mycom S CPM153

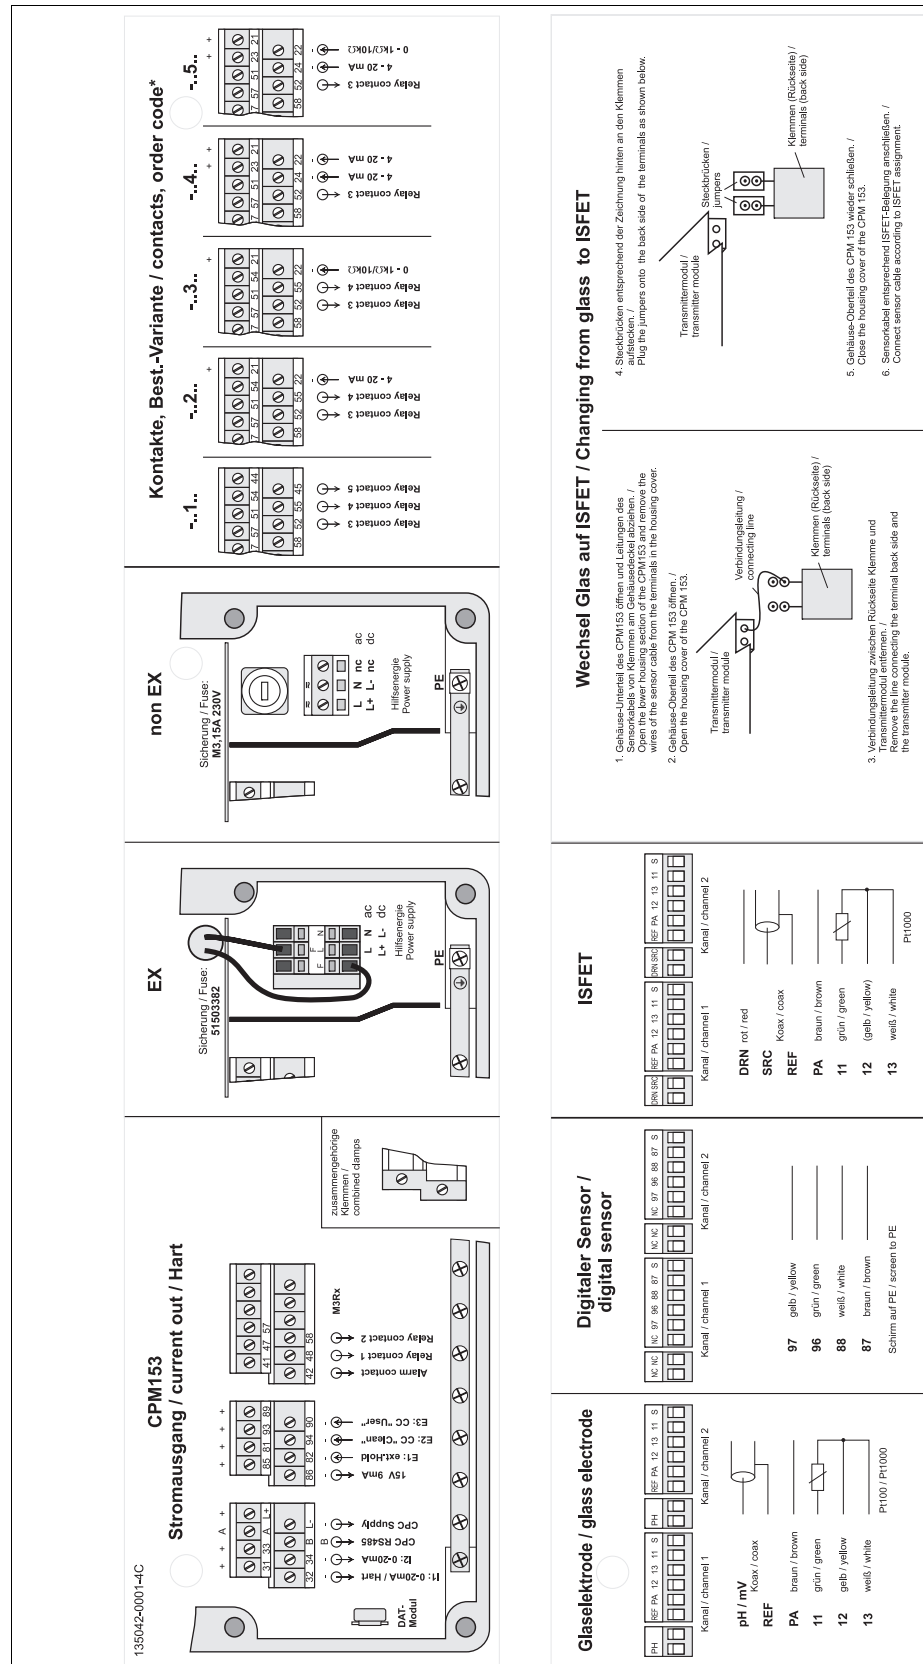


Fig. 13: Connection compartment sticker, Mycom S CPM153

DRN Drain
SRC Source
REF Reference

4.1.3 Power supply and communication connection between transmitter and control unit

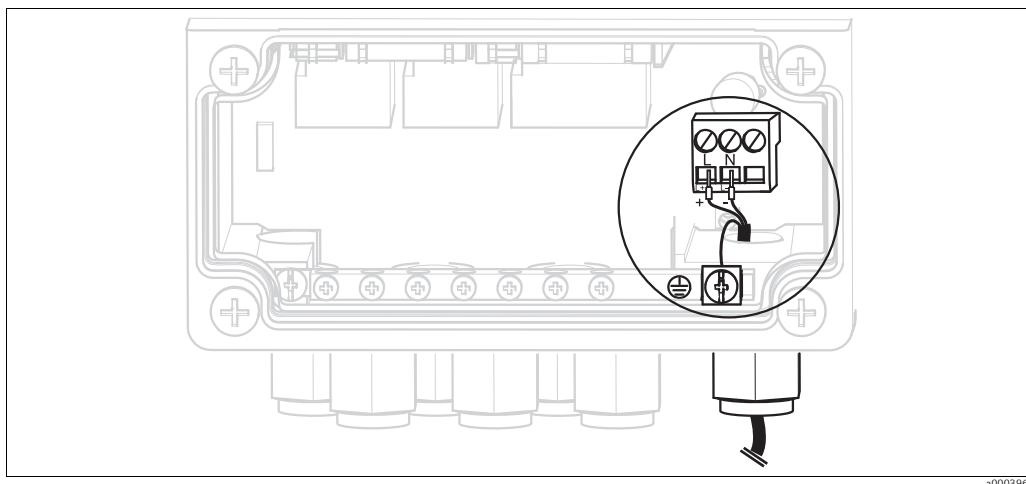


Fig. 14: Connecting the power supply for Mycom S

Mycom S power supply:

1. Guide the power cable through the right Pg cable gland and into the Mycom housing.
2. Connect the green/yellow core to the PE terminal.
3. Connect the two other cable cores to terminals "L" and "N".

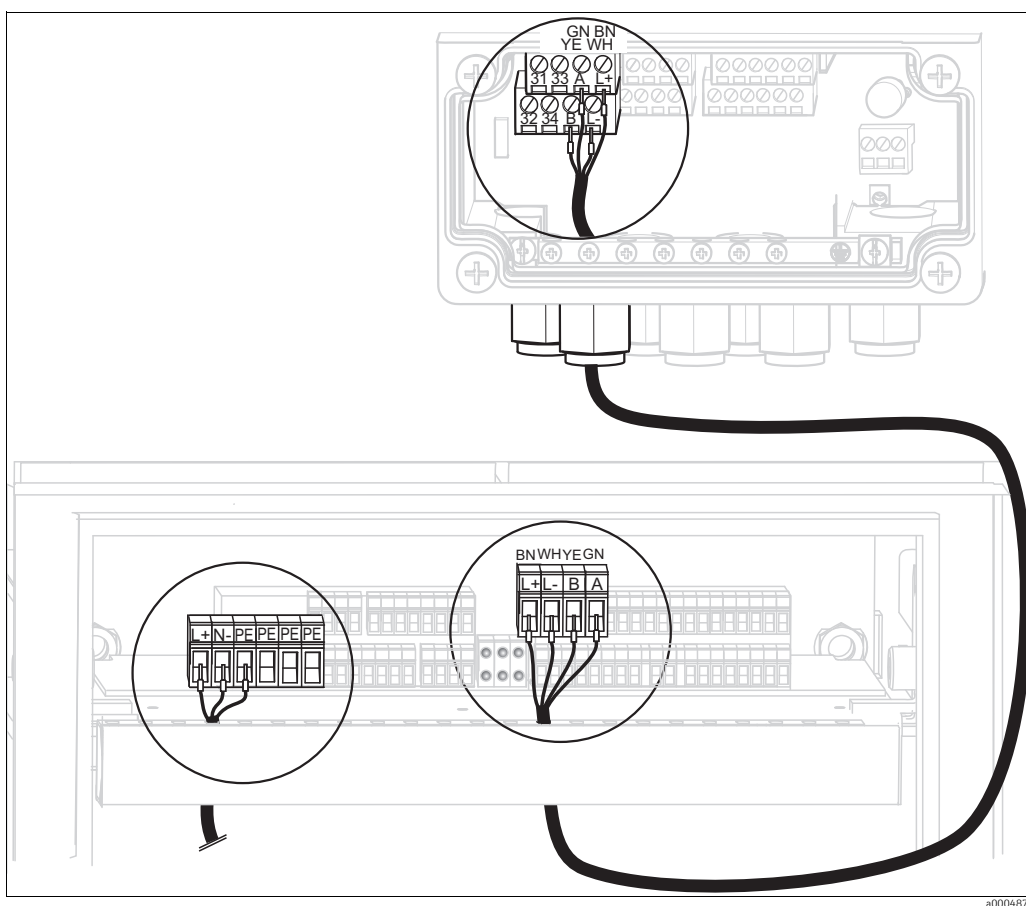


Fig. 15: Connecting power supply for control unit and communication connection

Control unit power supply

1. Guide the voltage cable through a suitable Pg gland and into the control unit housing.
2. Connect the green/yellow core to the PE terminal.
3. Connect the two other cable cores to terminals "L+" and "N-" (bottom terminal block, left).

Communication connection between Mycom and control unit

1. Guide the end of the communication cable with the black shield wire through a suitable Pg gland on the Mycom.
2. Guide the other end of the communication cable through a Pg gland on the control unit.
3. Connect the cable cores as follows:

Cable core	Mycom terminal	Control unit terminal
Yellow (YE)	Terminal B	Terminal B
Green (GN)	Terminal A	Terminal A
White (WH)	Terminal L-	Terminal L-
Brown (BN)	Terminal L+	Terminal L+
Black (BK)	PE grounding rail	n.c.

4.1.4 CYR10 injector

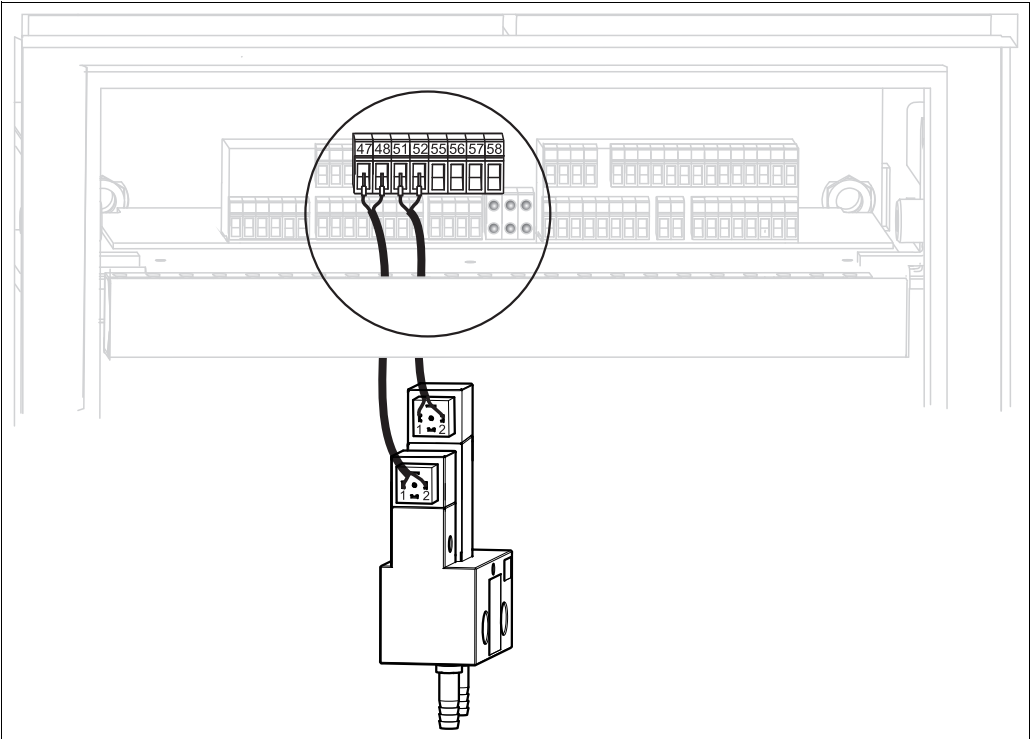


Fig. 16: Connecting the CYR10 injector

- 1. Guide the cables of the CYR10 through a suitable Pg gland.
- 2. Connect the cable cores as follows:

Cable core	CYR10 connection	Control unit terminal
Positive wire for motive water	Terminal 1 on front (lower) connector	Terminal 47
Negative wire for motive water	Terminal 2 on front (lower) connector	Terminal 48
Positive wire for cleaner	Terminal 1 on rear (upper) connector	Terminal 51
Negative wire for cleaner	Terminal 2 on rear (upper) connector	Terminal 52

4.1.5 Analog sensors

Measuring cables

You require shielded special measuring cables to connect pH and ORP sensors to the transmitter. You can use the following multicore and preterminated cable types:

Sensor type	Cable	Extension
Electrode without temperature sensor	CPK1	VBA / VBM box + CYK71 cable
Electrode with temperature sensor Pt 100 and TOP68 plug-in head	CPK9	VBA / VBM box + CYK71 cable
ISFET sensor with temperature sensor Pt 100 / Pt 1000 and TOP68 plug-in head	CPK12	VBA / VBM box + CYK12 cable
pH individual electrode with separate reference electrode and separate temperature sensor	CPK2	VBA / VBM box + PMK cable

For further information on the cables and junction boxes, please refer to the "Accessories" section.

Preparing cables

NOTICE

Danger of incorrect measurement.

- Always protect connectors, terminals and cables against moisture.

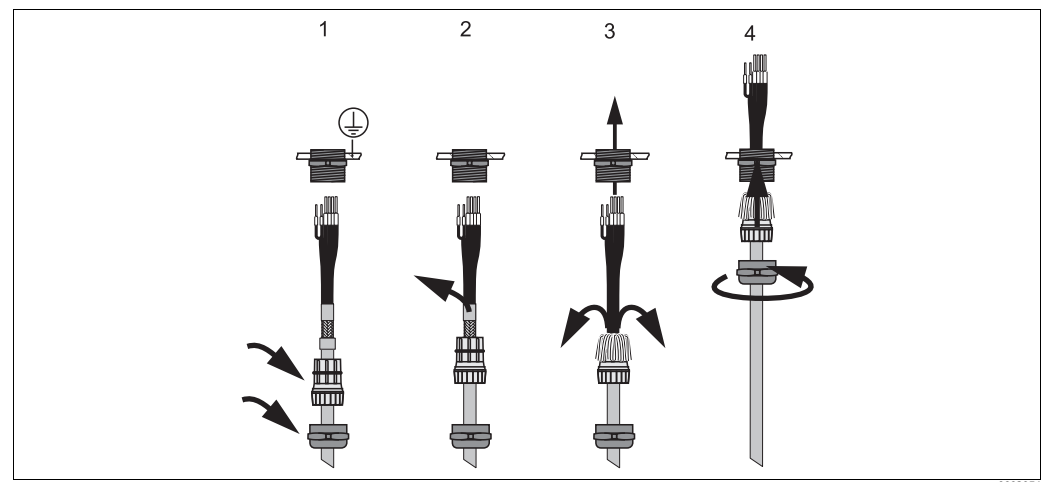


Fig. 17: Outer shield connection with metal cable gland

1. Slide the cable gland and the clamping ring over the cable.
2. Remove the inner insulation.
3. Remove the outer shield from the cable and fold it back over the clamping ring.
4. Guide the sensor cable through the cable opening of the device and screw the gland closed. The shield contact is automatic here.

pH/ORP glass electrodes

Connect the cable cores in the device as follows:

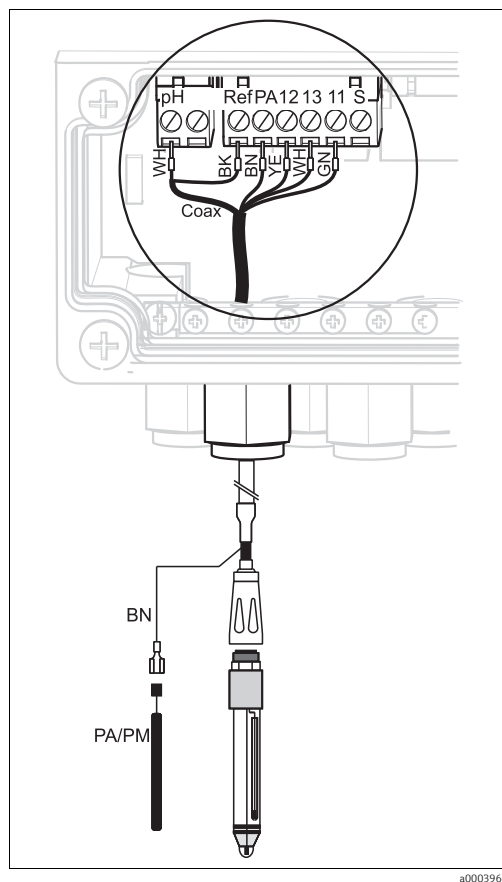
Connection with PML (symmetrical)

Fig. 18: Connecting pH glass electrode with PML

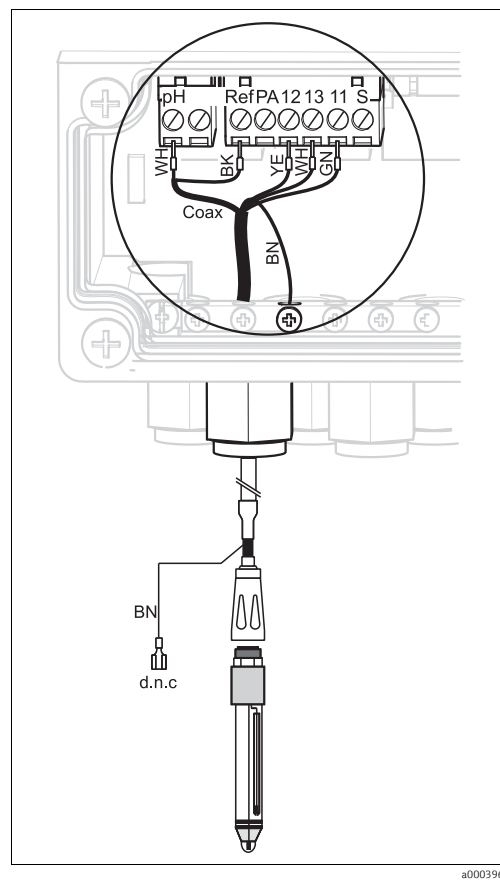
Connection without PML (unsymmetrical)

Fig. 19: Connecting pH glass electrode without PML
d.n.c. do not connect

Note the following points:

- The yellow (YE), white (WH) and green (GN) cable cores are not applicable when using CPK1.
- The outer shield of the cable is grounded via the metal gland.

ISFET sensors

Connect the cable cores in the device as follows:

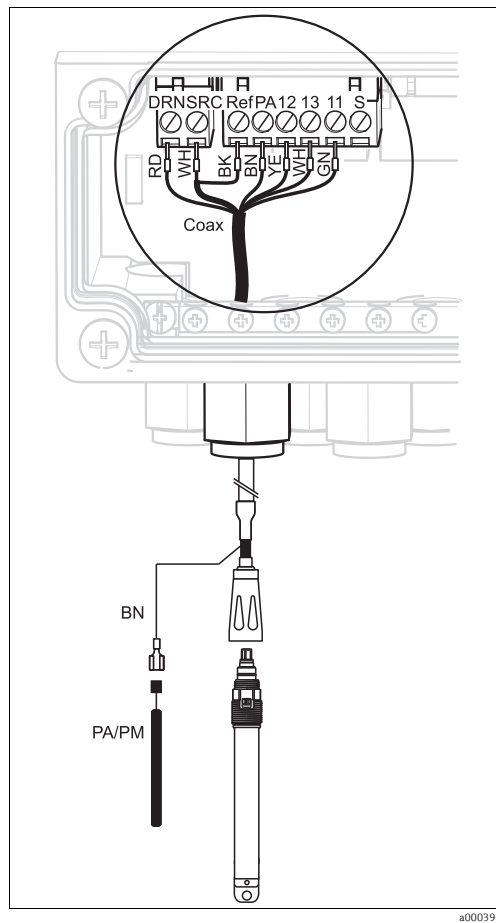
Connection with PML (symmetrical)

Fig. 20: Connecting ISFET sensors with PML

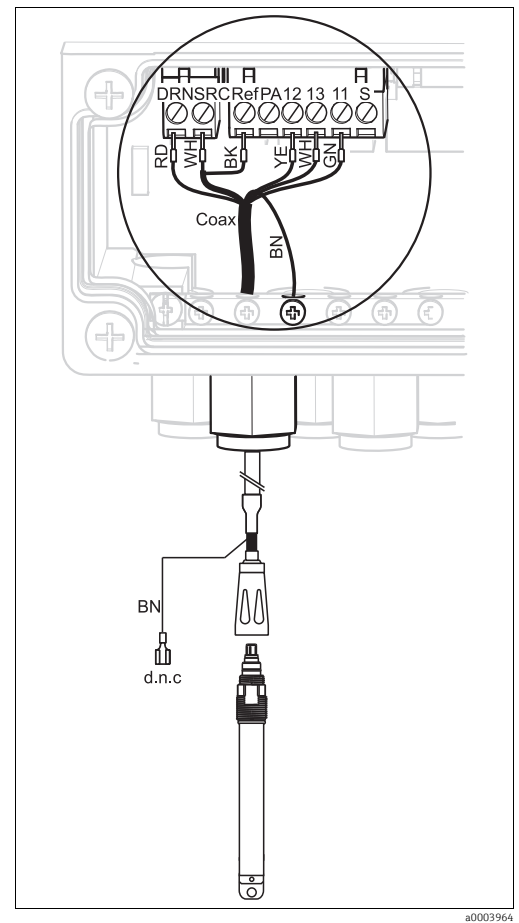
Connection without PML (unsymmetrical)

Fig. 21: Connecting ISFET sensors without PML

d.n.c. do not connect

Note the following points:

- The outer shield is grounded via the metal gland.

Changing the pH input from glass electrode to ISFET sensor

In the glass/ISFET version (CPC310-xx2xxxxxxx), Topclean S is supplied for measurement with glass electrodes by default.

Proceed as follows to change the connection:

1. Open the device housing base.
2. If a glass electrode is connected, disconnect the wires of the sensor cable.
3. Remove the "pH" terminal on the housing cover (see Fig. 22) from the device and replace it with the "DRN/SRC" terminal supplied.

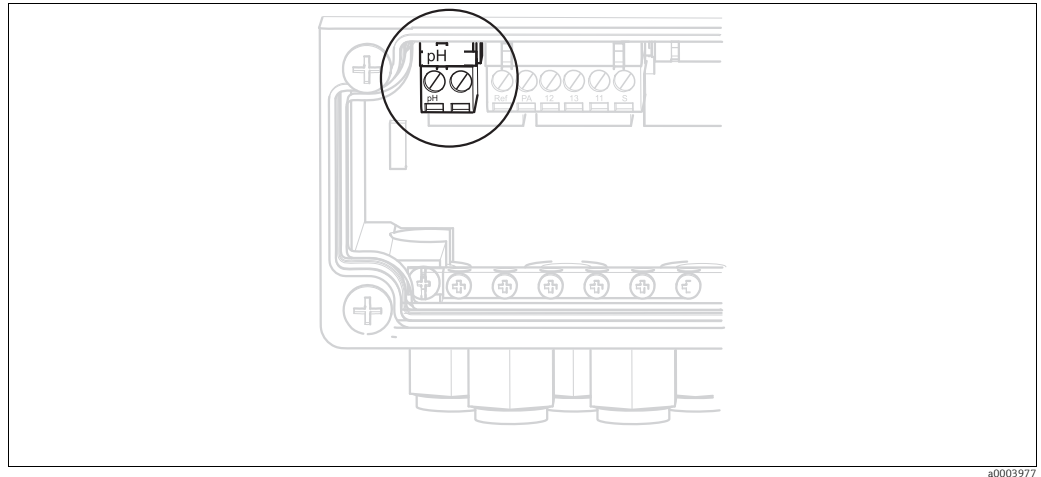



Fig. 22: pH terminal on housing cover

4. Open the top housing section of the device.
 5. On the right-hand side of the housing cover, disconnect the red cable to the pH input at both ends (see Fig. 23).
 6. Pin up the jumpers supplied as illustrated in Fig. 24.
 7. Connect the sensor cable in accordance with the ISFET assignment.
 8. In the First start up, change the electrode type to "ISFET".
-  Proceed accordingly to switch from ISFET sensors to glass electrodes.

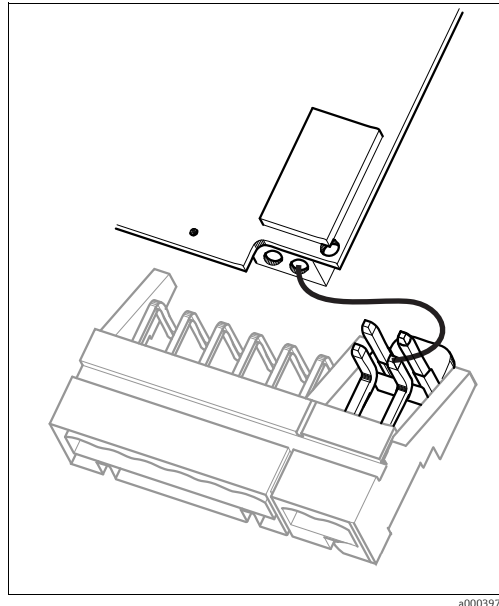


Fig. 23: pH input module in the housing cover with cable (red) for connecting glass electrodes

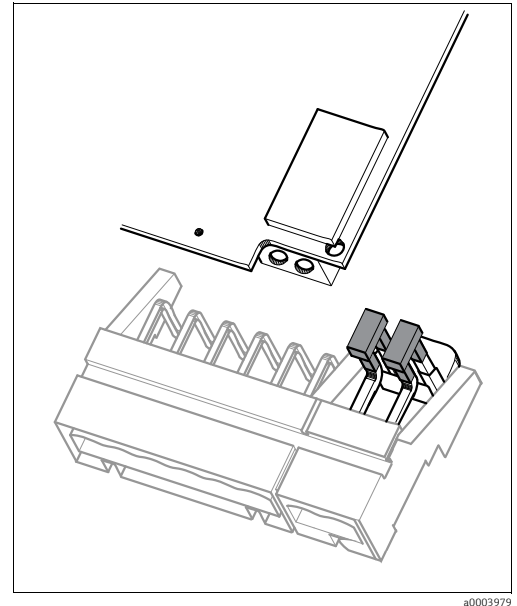


Fig. 24: pH input module in the housing cover with jumper for connecting ISFET sensors

4.1.6 Digital sensors with Memosens technology

Measuring cables

You require the Memosens CYK10 data cable to connect digital sensors:

Sensor type	Cable	Extension
Digital sensors with temperature sensor	CYK10	RM junction box + CYK81 cable

Preparing cables

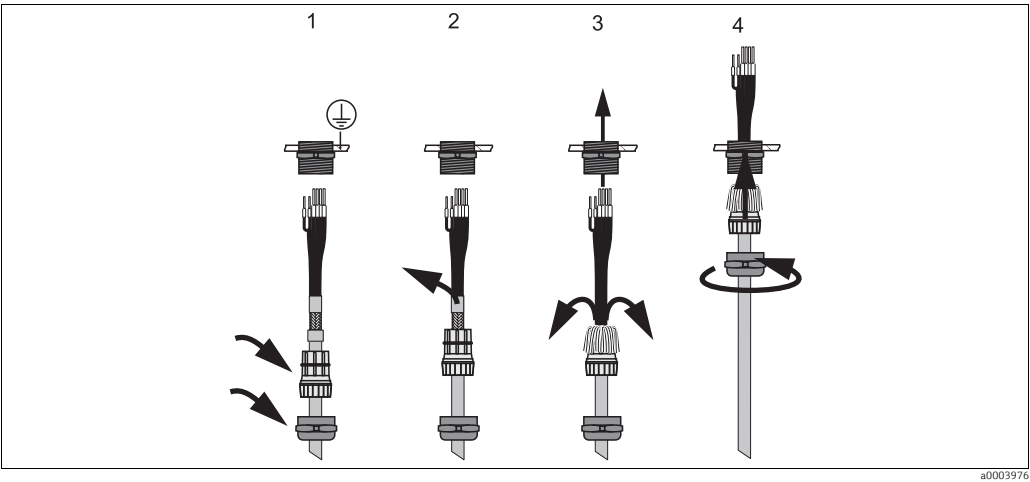


Fig. 25: Outer shield connection with metal cable gland

1. Slide the cable gland and the clamping ring over the cable.
2. Remove the inner insulation.
3. Remove the outer shield from the cable and fold it back over the clamping ring.
4. Guide the sensor cable through the cable opening of the device and screw the gland closed. The shield contact is automatic here.

Connecting digital sensors

Connect the cable cores in the device as follows:

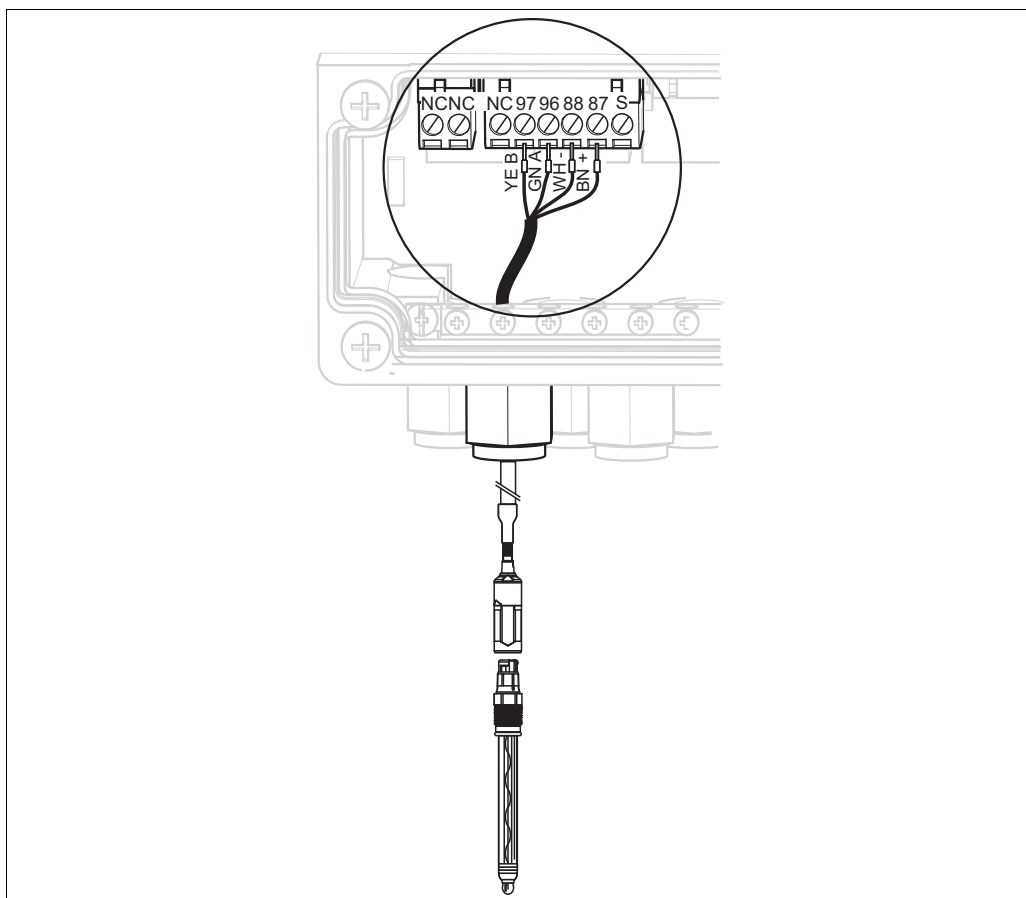


Fig. 26: Connecting digital sensors with Memosens technology

a0003965



The outer shield of the cable is grounded via the metal gland.

4.1.7 Current outputs

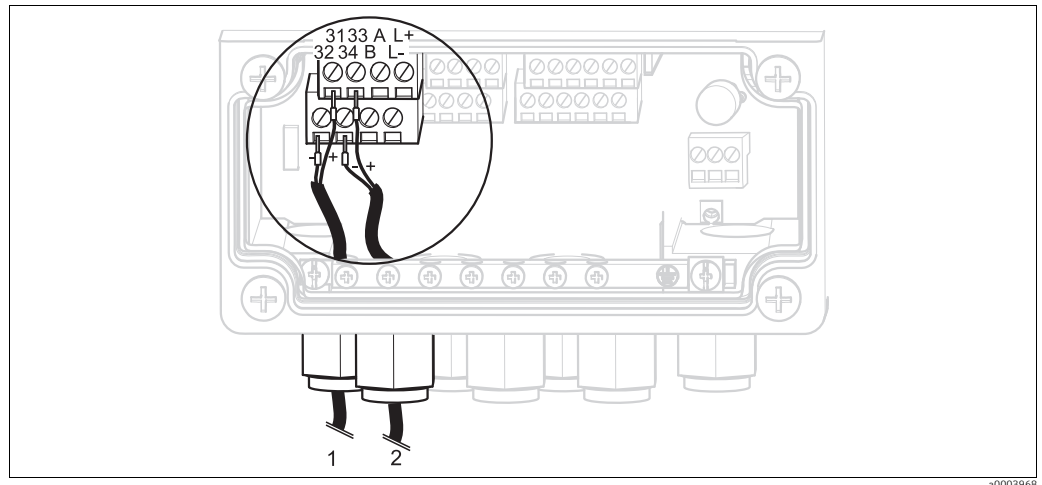


Fig. 27: Connecting current outputs

If you want to output the measured value to external switching units or a PLC, connect these devices to current outputs 1 and 2 of the transmitter. You can also output a controller actuating variable via current output 2.

Current output coding

With device versions CPM153-AxA/Bxx (2 current outputs) and CPM153-AxC/Dxx (2 current outputs with HART), the current outputs can be operated as active or passive outputs. Jumpers on the controller module M3CH allow recoding. For non-Ex devices, these modules may be recoded to active outputs.

i Passive current outputs must be powered with external voltage.

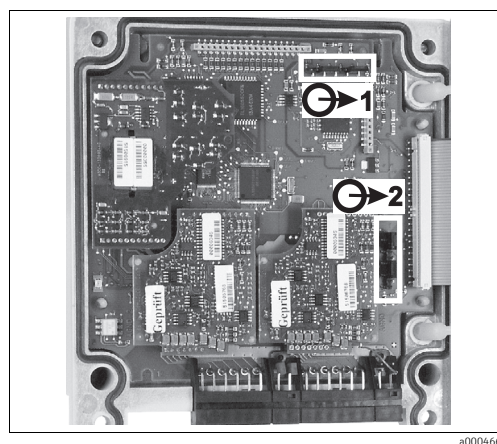


Fig. 28: Coding of the current outputs (interior view of the top housing section)

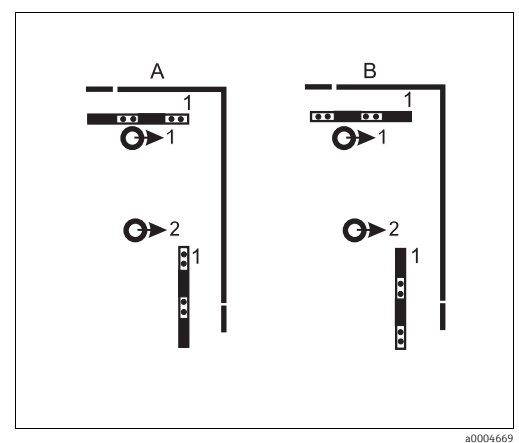


Fig. 29: Current output coding

A Coding for passive output
B Coding for active output

4.1.8 Mycom relays

Mycom S CPM153 has one fault-signaling contact and five additional contacts. You can use the additional contacts to control controllers, limit contactors and the supply of Chemoclean water and Chemoclean cleaner. The additional contacts are configured via the "Set up 1 > Relays" menu.

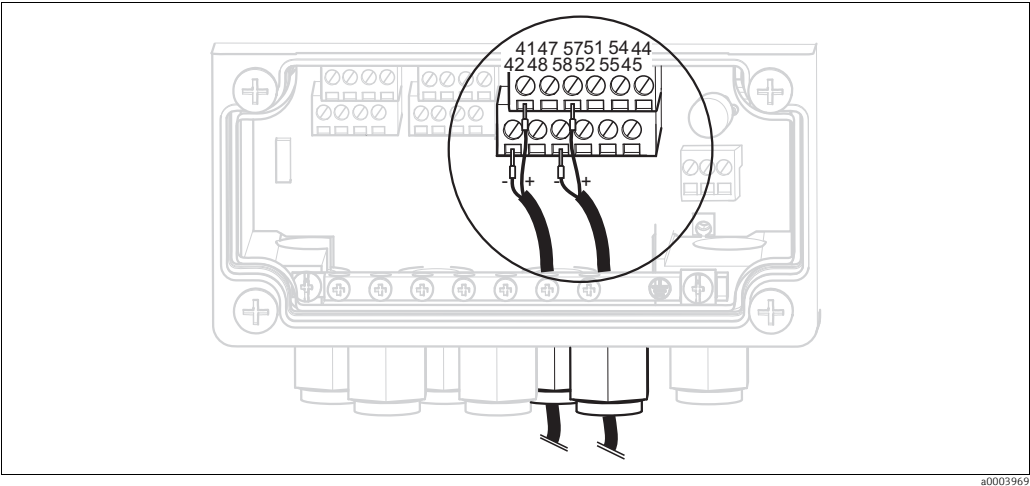


Fig. 30: Relay connection




Connect the relays as follows:

Relay	Mycom S terminal
Alarm	Terminals 41 and 42
Relay 1	Terminals 47 and 48
Relay 2	Terminals 57 and 58
Relay 3	Terminals 51 and 52
Relay 4	Terminals 54 and 55
Relay 5	Terminals 44 and 45

- Please note the following when assigning functions to the relays:
- The assignment of functions to the individual relays is essentially user-configurable. When using the NAMUR assignment, however, the functions are preset for the alarm relay and for the first two relays (see NAMUR assignment below).
 - The NC/NO contact type can be switched by software.
 - You can assign up to three relays to the controller.

NAMUR assignment

When using the NAMUR assignment (based on the recommendations of the interest group for process control technology in the chemical and pharmaceutical industry), the functions are set for the relays as follows:

Relay	NAMUR assignment ON	Terminal
ALARM	Failure	41 42 
RELAY 1	Maintenance required	47 48 
RELAY 2	Function check	57 58 

Function check assignment

The function check as per NAMUR is active if:

- Calibration is active.
- The assembly is in the Service position.
- Mycom is configured.
- A Topclean cleaning program is running.
- A Chemoclean program is running.
- An error occurs which triggers the function check (for assignment, see the "System errors" section).

4.1.9 External inputs (PLC to CPG30) and outputs (CPG30 to PLC)

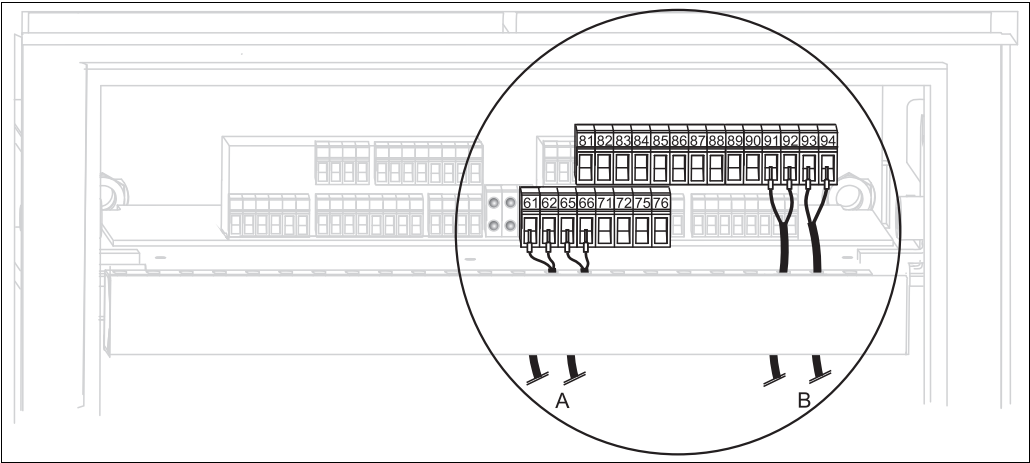


Fig. 31: Connecting external inputs and outputs, e.g. external assembly position control and assembly feedback signal

- A External outputs
- B External inputs

External inputs

- 1. If you want to control the assembly position via an external PLC, connect the control as follows:

Control	Control unit terminal
"Measure" position	Terminals 91 and 92
"Service" position	Terminals 93 and 94

- 2. If you want to control the cleaning programs of Topclean S via an external PLC, connect the binary contacts of the control unit.
See the "Set up 2 - Topclean S" section for the coding for the individual cleaning programs.

Contact	Control unit terminal
Contact 0	Terminals 81 and 82
Contact 1	Terminals 83 and 84
Contact 2	Terminals 85 and 86

- 3. If you want to stop program cycles via an external PLC, connect the control for the automatic stop system to terminals "87" and "88".
The running program is then finished and no new program is started as long as a signal is applied to terminals 87/88.
The "Interval" program is stopped immediately.

External outputs

1. If you want to relay the position of the assembly to an external PLC, connect the outputs of the control unit as follows:

Feedback	Control unit terminal
"Assembly in Measuring Position" feedback signal	Terminals 61 and 62
"Assembly in Service Position" feedback signal	Terminals 65 and 66

2. If you want to relay the status of the cleaning programs to an external PLC, connect the "Program running" feedback signal to terminals "71" and "72".

4.1.10 External inputs (PLC to Mycom)

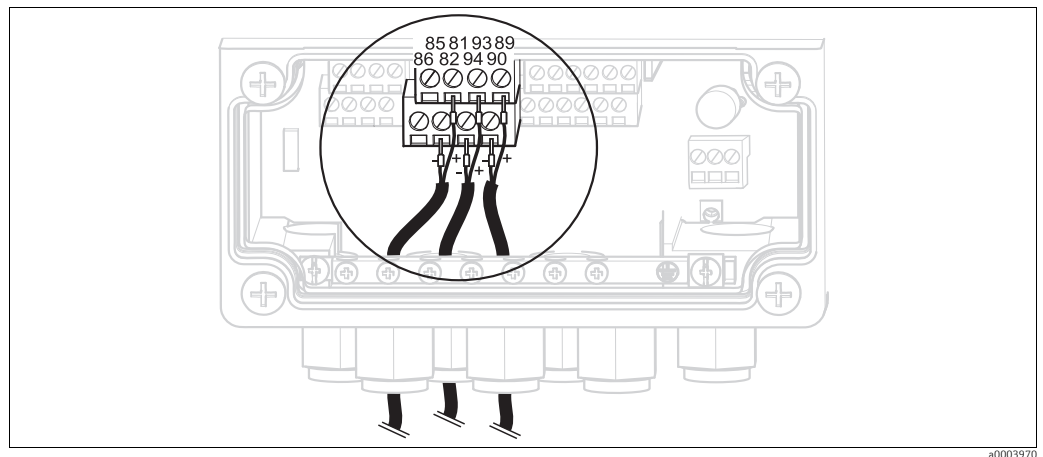


Fig. 32: Connecting external inputs

If you want to activate the hold function for Mycom via an external PLC, connect the input to terminals 81 and 82 of the device (power supply is required).

4.1.11 Additional valve for back pressure water, superheated steam etc.

If you are using a device with control for an additional external valve, you can select the "Back pressure water" and "Sterilization" functions in the Topclean S cleaning and user programs. The valves are assigned in "Set up 2 > Topclean > Config. Topclean". See section "Set up 2 - Topclean".

What is back pressure water?

In processes where the medium is fibrous or tends to form buildup, assemblies with a ball valve for shutting off the medium are used e.g. Cleanfit P CPA473 or CPA474. To keep the rinse chamber free of medium, the back pressure water valve opens automatically before the assembly moves out of the process. The counterpressure in the rinse chamber caused by the back pressure water prevents the ingress of medium into the chamber. The back pressure water pressure must then be greater than the pressure of the medium. The back pressure water starts to be pumped one second before the assembly goes to the Service position.

Connecting the external valve

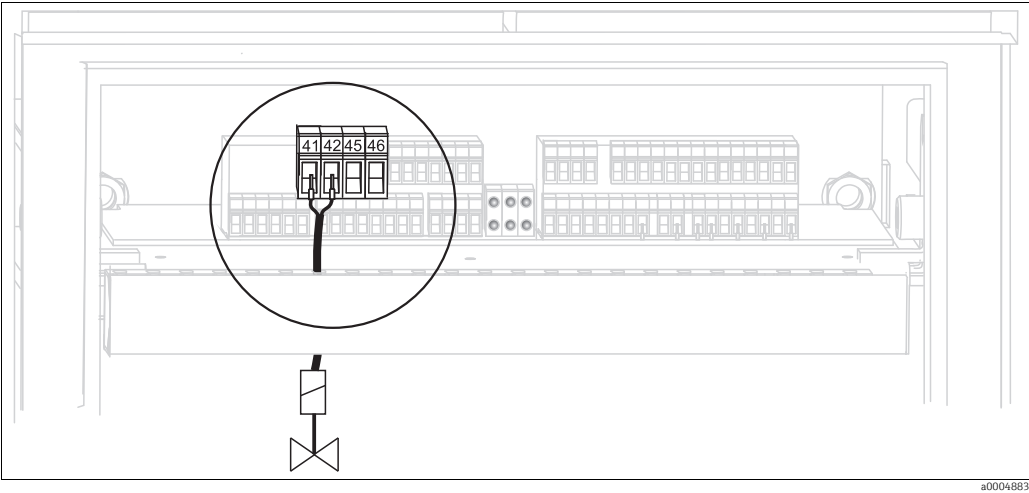


Fig. 33: Connecting the external valve

Connect the external additional valve as follows:

Control	Control unit terminal
Positive wire	Terminal 41
Negative wire	Terminal 45

NOTICE

The wrong supply voltage can destroy the valves.

- Make sure you have the correct supply voltage for the valves.

4.1.12 Inductive limit position switches

In series 47x assemblies, the system is supplied by default with pneumatic limit position switches for feedback of the assembly position. If you are using inductive limit position switches, connect them as described in the following instructions. Series 87x assemblies are always fitted with inductive limit position switches.

Inductive limit position switches of Cleanfit CPA471, CPA472, CPA475 assemblies

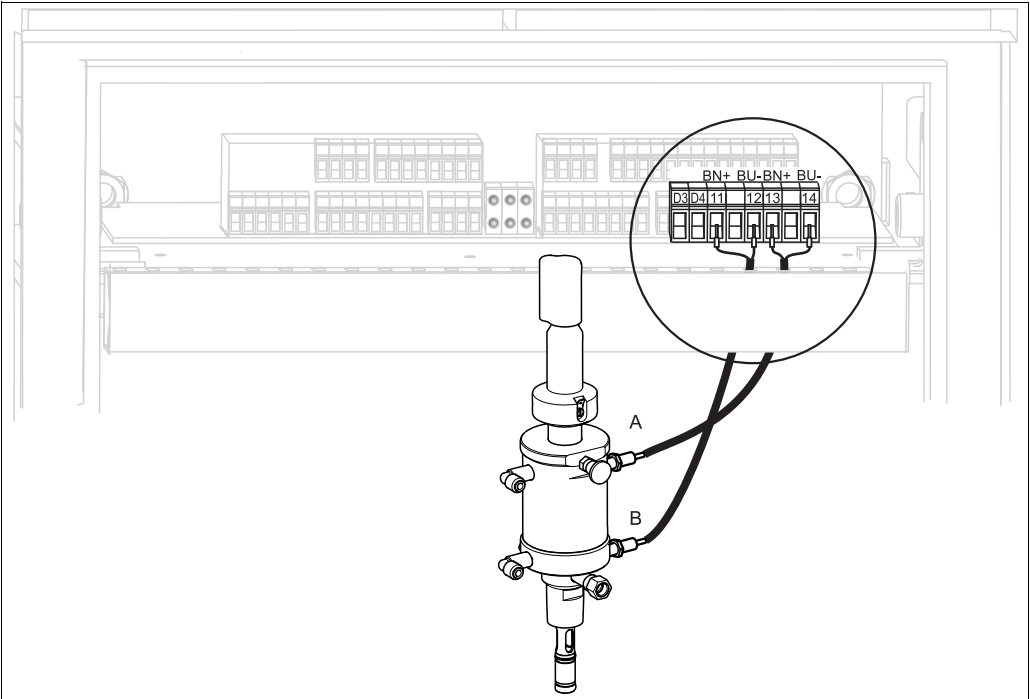


Fig. 34: Connecting inductive limit position switches of CPA471, CPA472, CPA475 assemblies

- A "Service" feedback signal
- B "Measure" feedback signal

- If you are using a CPA471, CPA472 or CPA475 assembly with inductive limit position switches for assembly position feedback, remove the wires from terminals 11 to 14.
- Connect the upper limit position switch (A) for the "Service" feedback signal:

Wire	Control unit terminal
Brown (BN)	Terminal 13 (+)
Blue (BU)	Terminal 14 (-)

- Connect the lower limit position switch (B) for the "Measure" feedback signal:

Wire	Control unit terminal
Brown (BN)	Terminal 11 (+)
Blue (BU)	Terminal 12 (-)

Inductive limit position switches of CPA473, CPA474 assemblies

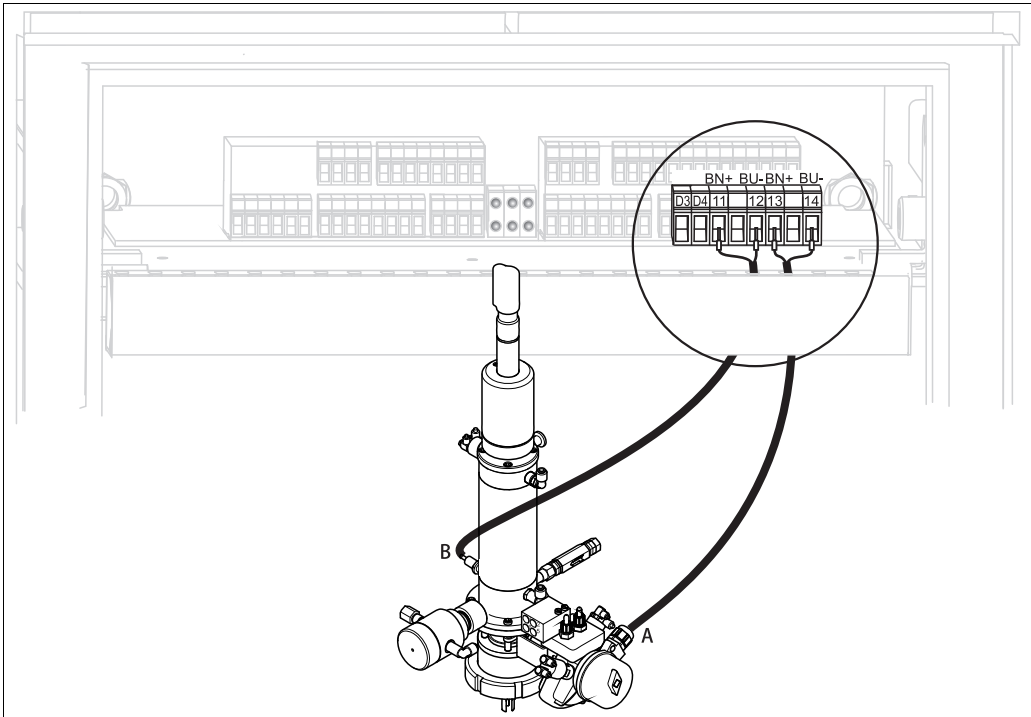


Fig. 35: Connecting inductive limit position switches of CPA473, CPA474 assemblies

A "Service" feedback signal
B "Measure" feedback signal


- 1. If you are using a CPA473 or CPA474 assembly with inductive limit position switches for assembly position feedback, remove the wires from terminals 11 to 14.
- 2. Connect the limit position switch (A), located beside the ball valve, for the "Service" feedback signal:

Cable core	Control unit terminal
Brown (BN)	Terminal 13 (+)
Blue (BU)	Terminal 14 (-)

- 3. Connect the limit position switch (B), located opposite the ball valve, for the "Measure" feedback signal:

Cable core	Control unit terminal
Brown (BN)	Terminal 11 (+)
Blue (BU)	Terminal 12 (-)

Inductive limit position switches of CPA871, CPA875 assemblies

 Can only be used in the non-hazardous area.

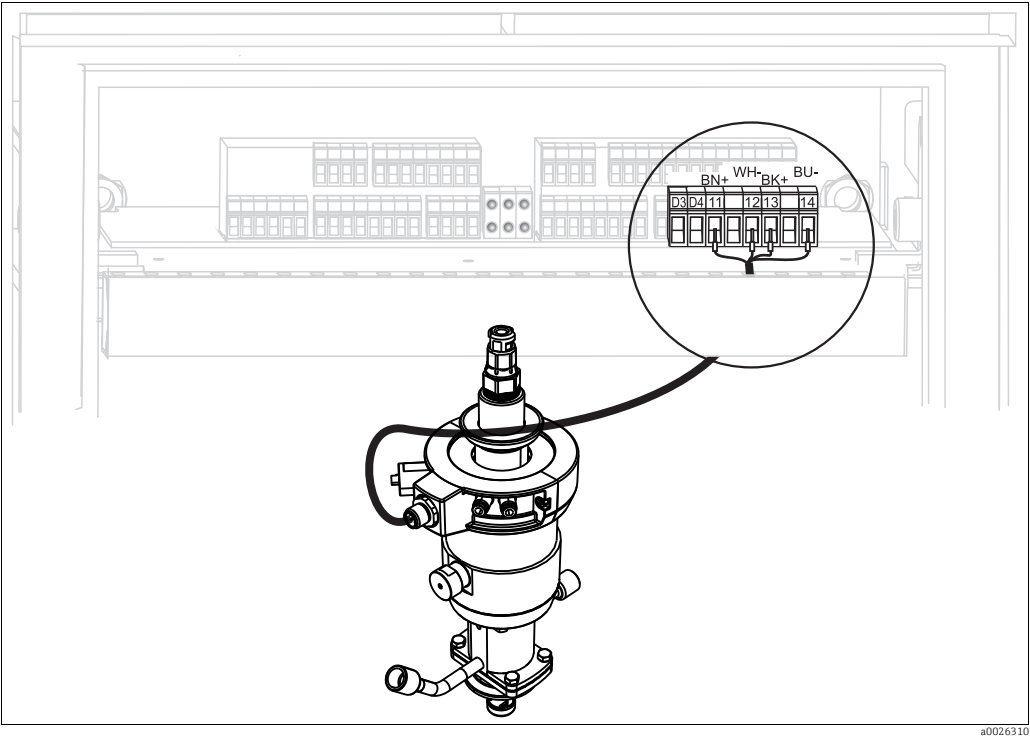


Fig. 36: Connecting inductive limit position switches of CPA871, CPA875 assemblies

1. If you are using a CPA871 or CPA875 assembly, remove the wires from terminals 11 to 14.
2. Connect the plug side of the connecting cable to the assembly.
3. Connect the four wires of the connecting cable to CPG30 as follows:

Wire	Control unit terminal
Brown (BN)	Terminal 11 (+)
White (WH)	Terminal 12 (-)
Black (BK)	Terminal 13 (+)
Blue (BU)	Terminal 14 (-)

Checking the jumper

Check that the jumper is in the correct position on the CPC30 board.

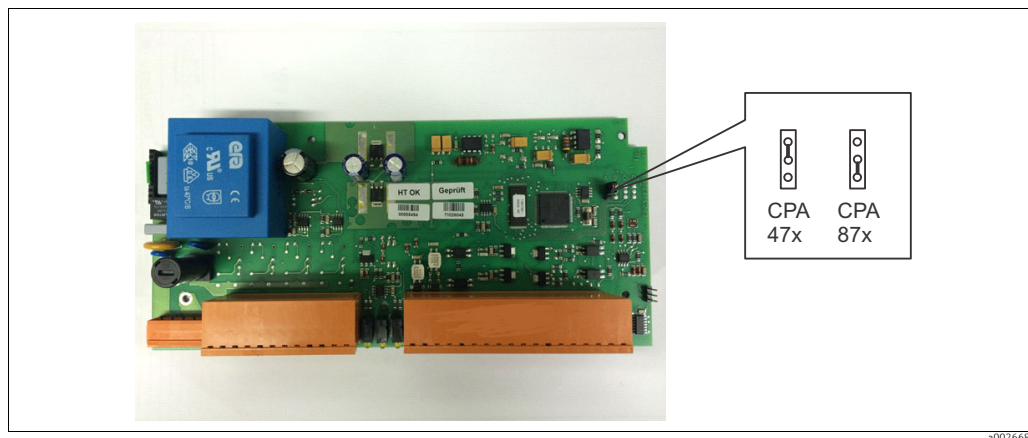


Fig. 37: Position of jumper

The position of the jumper can be queried in software version 1.28 and higher.

4.2 Post-connection check

After the electrical connection, carry out the following checks:

Device status and specifications	Remarks
Are the transmitter and cables damaged on the outside?	Visual inspection

Electrical connection	Remarks
Does the supply voltage match the specifications on the nameplate?	100 to 230 V wide area 24 V AC / DC
Do the cables used fulfill the required specifications?	Use a genuine Endress+Hauser cable to connect the sensor, see "Accessories" section.
Are the mounted cables strain relieved?	
Is the cable type route completely isolated?	Along the whole cable length, run the power supply and signal line cables separately to avoid any mutual influence. Cable channels are best.
No loops and cross-overs in the cable run?	
Are the signal lines correctly connected in accordance with the wiring diagram?	
Are all the screw terminals tightened?	
Are all the cable entries installed, tightened and sealed? Cable run with "water sag"?	"Water trap": cable loops downwards so that water can drip off.
Are the PE distributor rails grounded (if present)?	Grounding at place of installation
Are all the housing covers installed and tightened?	Check seals for damage.

5 Medium connection

5.1 Compressed air line

The compressed air line and a T-piece must be provided by the customer.

Compressed air specifications: 4 to 6 bar (58 to 87 psi), filtered, 50 µm, free from oil and condensate.

1. Screw the pressure gauge into the thread of the pressure reduction valve.
You can use the pressure reduction valve to regulate the air pressure (6 bar (87 psi) is optimum).
2. Connect the compressed air supply to the pressure reduction valve.
Pay attention to the installation direction of the pressure reduction valve. You can identify the flow direction from the arrows at the top of the square block of the valve.
3. From the output of the pressure reduction valve, connect the compressed air line via a T-piece to connection I (pump drive), and connect it to connection E (compressed air for purging) with the red coupling with a pressure of 4 to 6 bar (58 to 87 psi). Tighten the couplings **finger-tight** (approx. 0.5 Nm).

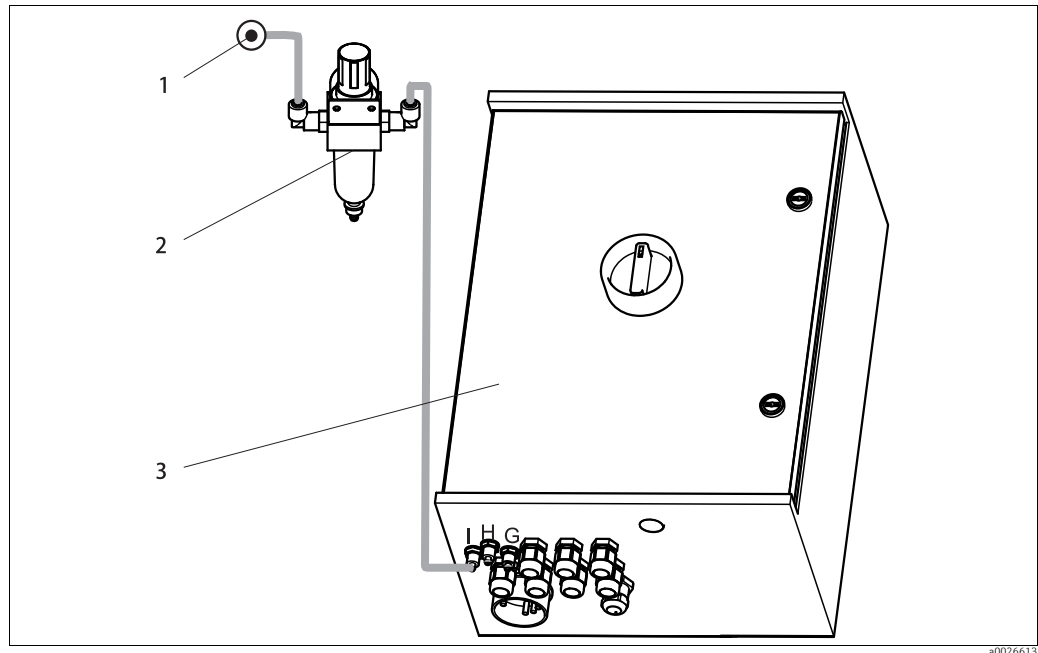


Fig. 38: Compressed air connection on CPG30

- | | |
|---|--------------------------|
| 1 | Compressed air source |
| 2 | Pressure reduction valve |
| 3 | CPG30 |

5.2 Assemblies

5.2.1 Cleanfit CPA472/472D

With pneumatic limit position switches

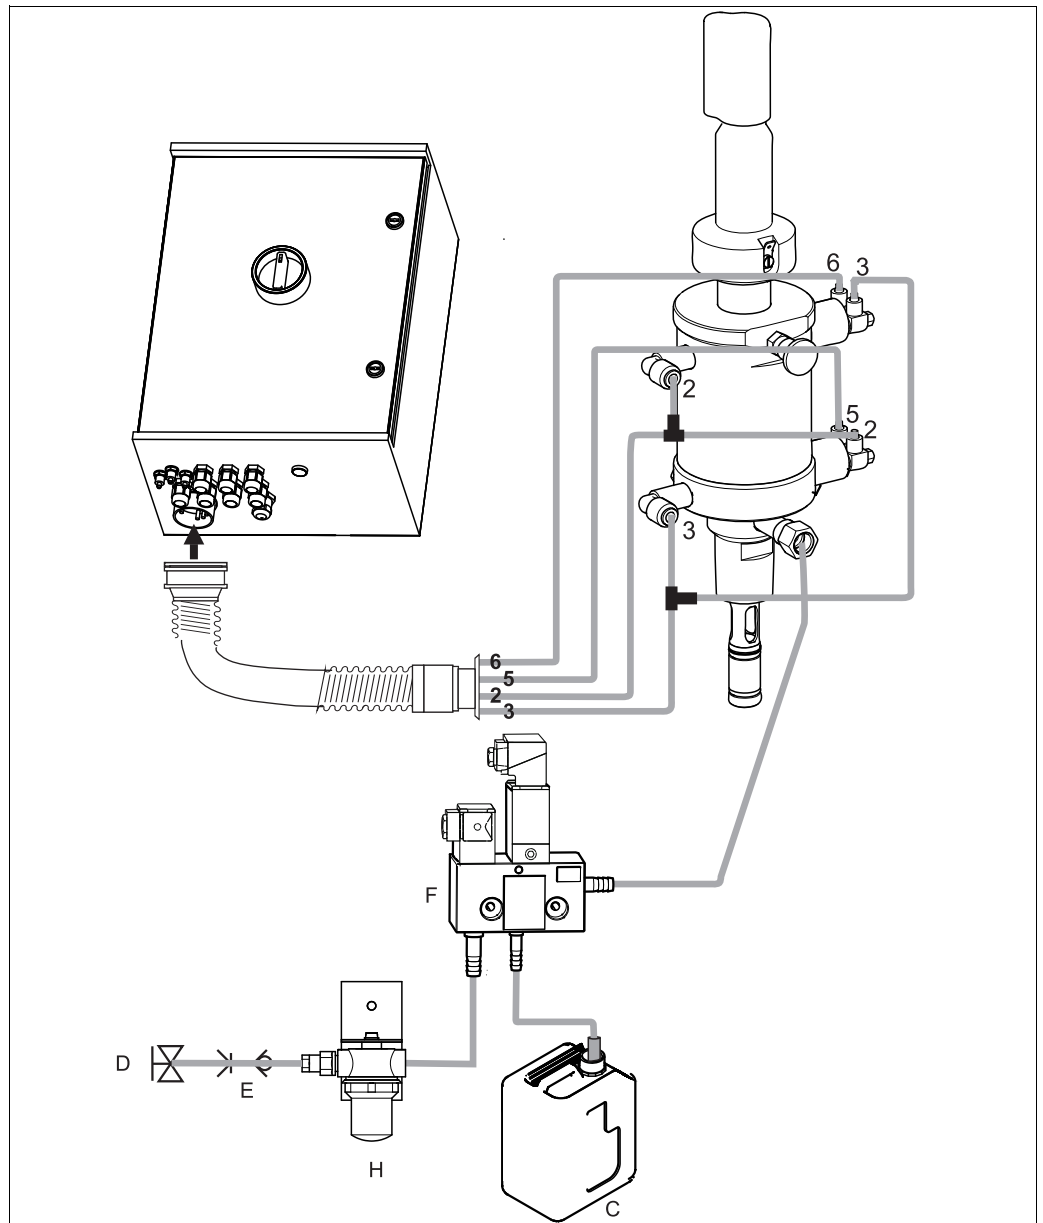


Fig. 39: Connecting CPA472, CPA472D assemblies with pneumatic limit position switches

- C Cleaner
- D Motive water 2 to 7 bar (29 to 102 psi)
- E Backflow preventer (provided by the customer)
- F CYR10
- H Water filter (optional)

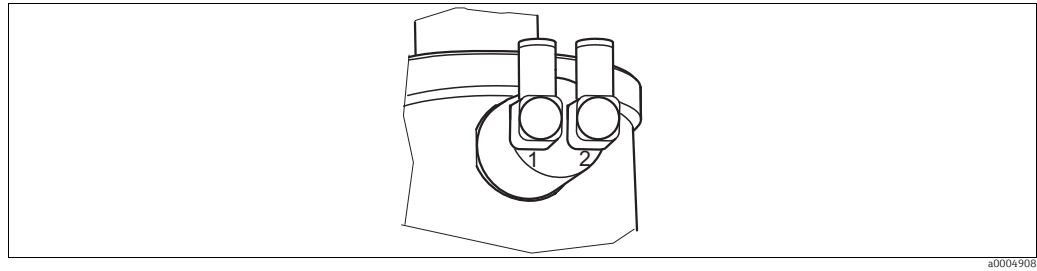


Fig. 40: Pneumatic limit position switch

- 1 Input
2 Output

1. Connect the multihose to the bayonet lock ensuring it is strain relieved and free of any kinks.
2. Connect **hose no. 5** for "Measure" position feedback from the Topclean multihose to connection 2 (= output) of the assembly's **lower** limit position switch.
3. Connect **hose no. 2** for the "Measure" position from the multihose via a T-section to the **upper** G $\frac{1}{4}$ coupling and to connection 1 (= input) of the assembly's **lower** limit position switch.
4. Connect **hose no. 6** for "Service" position feedback from the multihose to connection 2 (= output) of the assembly's **upper** limit position switch.
5. Connect **hose no. 3** for the "Service" position from the multihose via a T-section to the **lower** G $\frac{1}{4}$ coupling and to connection 1 (= input) of the assembly's **upper** limit position switch.
6. Connect the pipe for motive water (D) via backflow preventer (E) to the G $\frac{3}{8}$ connection of CYR10.
7. Connect the pipe for the cleaner (C) to the G $\frac{1}{4}$ connection of CYR10.
8. Connect the pipe from the CYR10 to the rinse chamber inlet of the assembly.

Note the following points:

- The maximum hose length for the cleaner is 10 m (32.8 ft):
- Maximum suction height: 5 m (16.4 ft)
- Maximum horizontal conveying width: 10 m (32.8 ft)
- Pressure resistance of internal components: up to 7 bar (102 psi)
- Maximum suction height of cleaner: 2 m (6.56 ft)

With inductive limit position switches

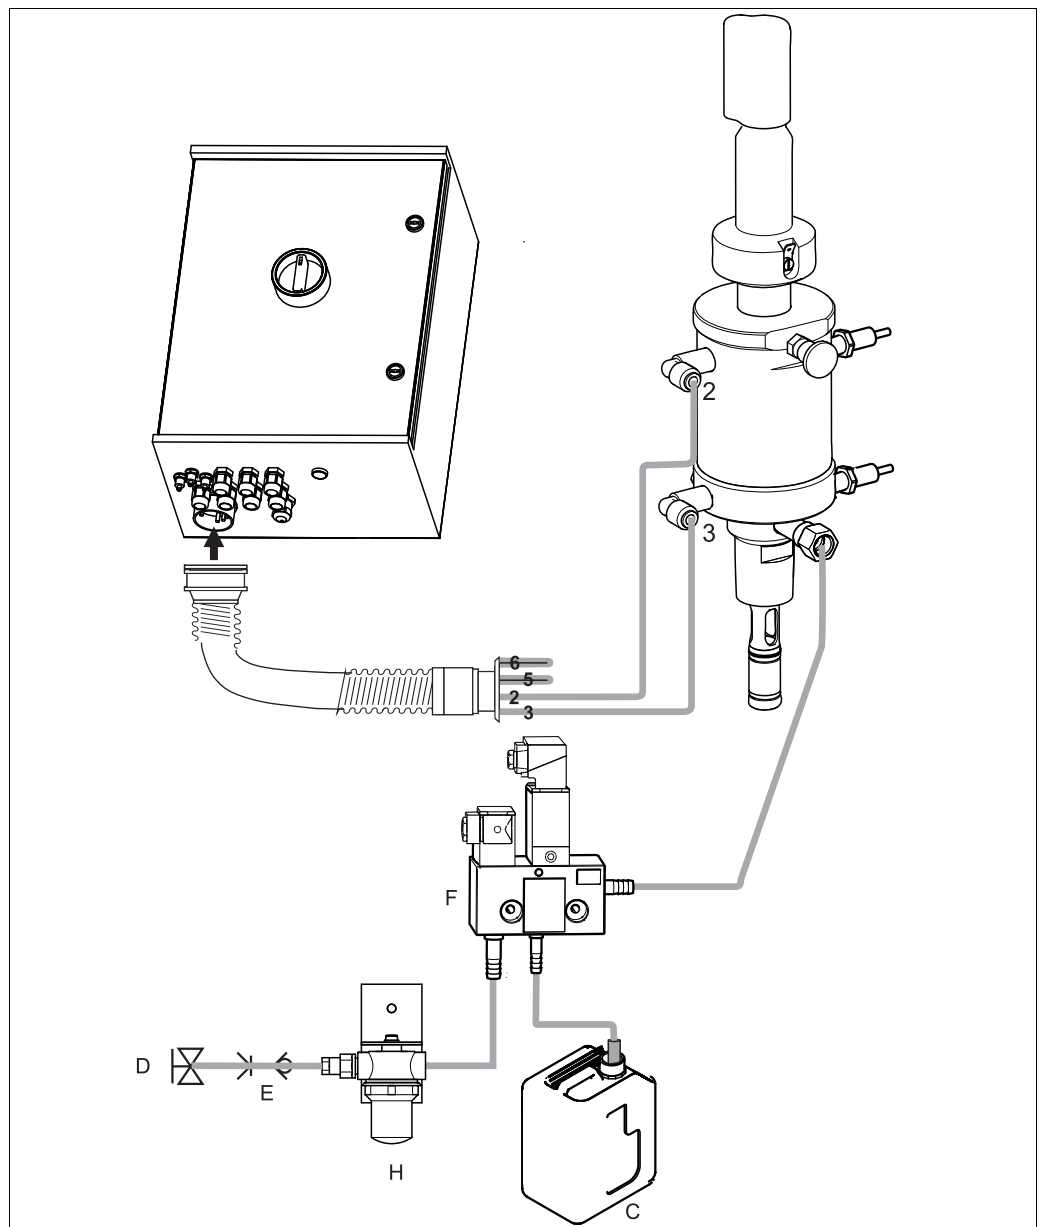


Fig. 41: Connecting CPA471, CPA472, CPA475 assemblies with inductive limit position switches

- C Cleaner
- D Motive water 2 to 7 bar (29 to 102 psi)
- E Backflow preventer (provided by the customer)
- F CYR10
- H Water filter (optional)

1. Connect the multi-hose to the bayonet lock ensuring it is strain relieved and free of any kinks.
2. Fold hoses no. 5 and no. 6 back into the multi-hose.
3. Connect **hose no. 2** for the "Measure" position from the multi-hose via a T-section to the **upper** G $\frac{1}{4}$ coupling and to connection 1 (= input) of the assembly's **lower** limit position switch.
4. Connect **hose no. 3** for the "Service" position from the multi-hose via a T-section to the **lower** G $\frac{1}{4}$ coupling and to connection 1 (= input) of the assembly's **upper** limit position switch.

5. Connect the pipe for motive water (D) via backflow preventer (E) to the G 3/8 connection of CYR10.
6. Connect the pipe for the cleaner (C) to the G 1/4 connection of CYR10.
7. Connect the pipe from the CYR10 to the rinse chamber inlet of the assembly.

Note the following points:

- The maximum hose length for the cleaner is 10 m (32.8 ft):
- Maximum suction height: 5 m (16.4 ft)
- Maximum horizontal conveying width: 10 m (32.8 ft)
- Pressure resistance of internal components: up to 7 bar (102 psi)
- Maximum suction height of cleaner: 2 m (6.56 ft)

5.2.2 Cleanfit CPA473/474

With pneumatic limit position switches

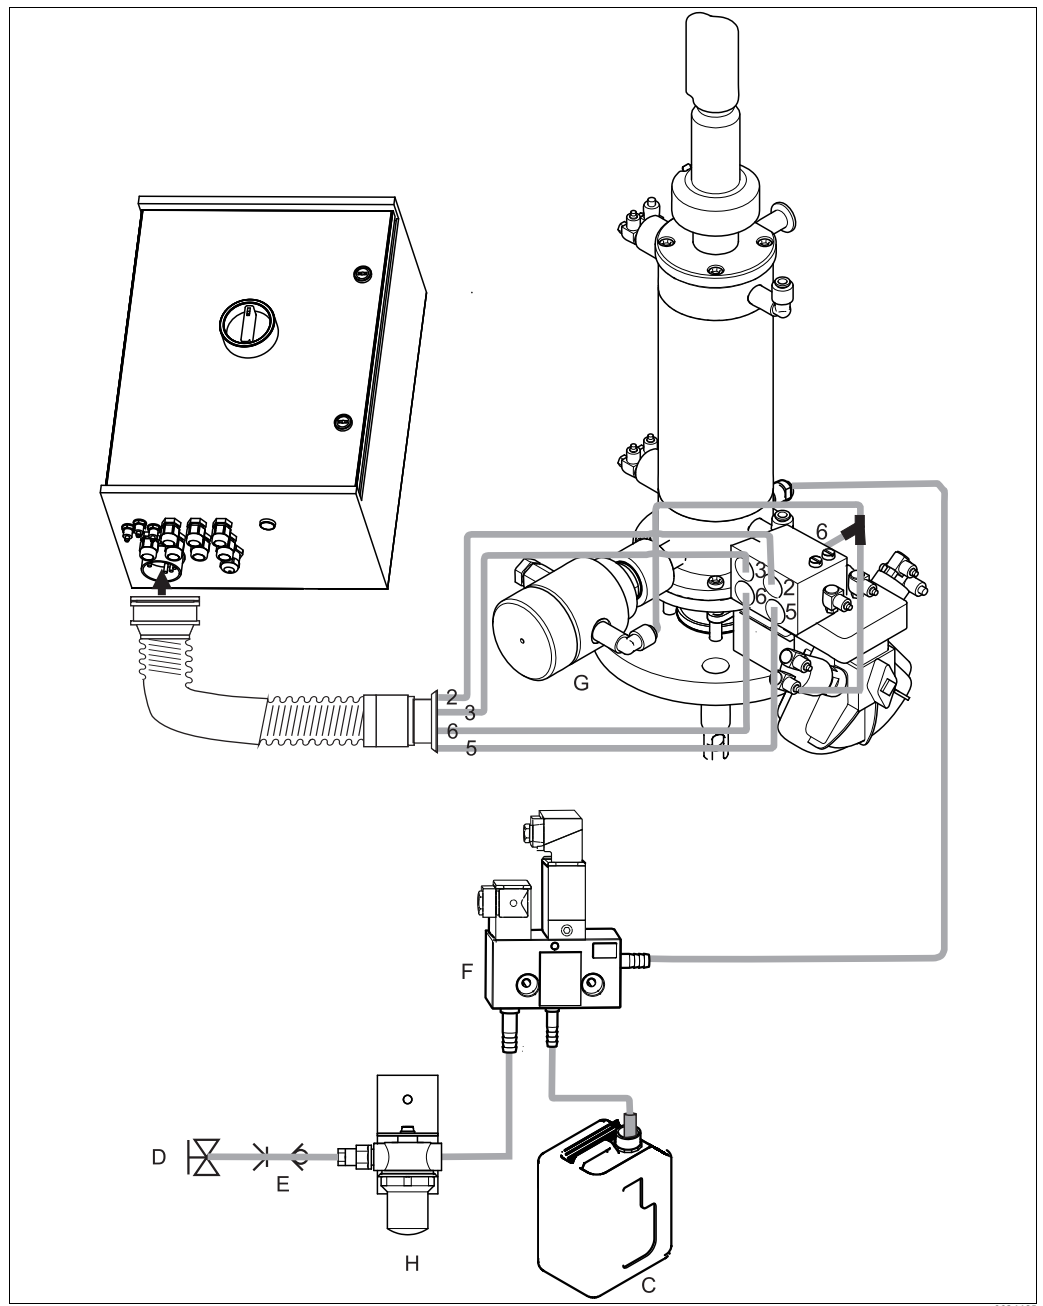


Fig. 42: Connecting CPA473, CPA474 assemblies with pneumatic limit position switches

- C Cleaner
- D Motive water 2 to 7 bar (29 to 102 psi)
- E Backflow preventer (provided by the customer)
- F CYR10
- G Outlet safety seal (optional)
- H Water filter (optional)

1. Connect the multi-hose to the bayonet lock ensuring it is strain relieved and free of any kinks.
2. Connect **hose no. 5** for "Measure" position feedback from the Topclean multi-hose to **limit position switch 5** of the assembly.
3. Connect **hose no. 2** for "Measure" position feedback from the multi-hose to **limit position switch 2** of the assembly.

4. Connect **hose no. 6** for "Service" position feedback from the multihose to **limit position switch 6** of the assembly.
5. Connect **hose no. 3** for the "Service" position to **limit position switch 3** of the assembly.
6. Connect the pipe for motive water (D) via backflow preventer (E) to the G 3/8 connection of CYR10.
7. Connect the pipe for the cleaner (C) to the G 1/4 connection of CYR10.
8. Connect the pipe from the CYR10 to the rinse chamber inlet of the assembly.
9. If you are using a pneumatic outlet safety seal (G):
 - Cut the compressed air pipe from the pneumatic connection block, **input 6**, to the corresponding limit position switch on the ball valve drive.
 - Connect each end of the cut hose to the Y-piece supplied.
 - Connect the third connection of the Y-piece to the compressed air connection of the outlet safety seal.

Note the following points:

- The maximum hose length for the cleaner is 10 m (32.8 ft):
- Maximum suction height: 5 m (16.4 ft)
- Maximum horizontal conveying width: 10 m (32.8 ft)
- Pressure resistance of internal components: up to 7 bar (102 psi)
- Maximum suction height of cleaner: 2 m (6.56 ft)

With inductive limit position switches

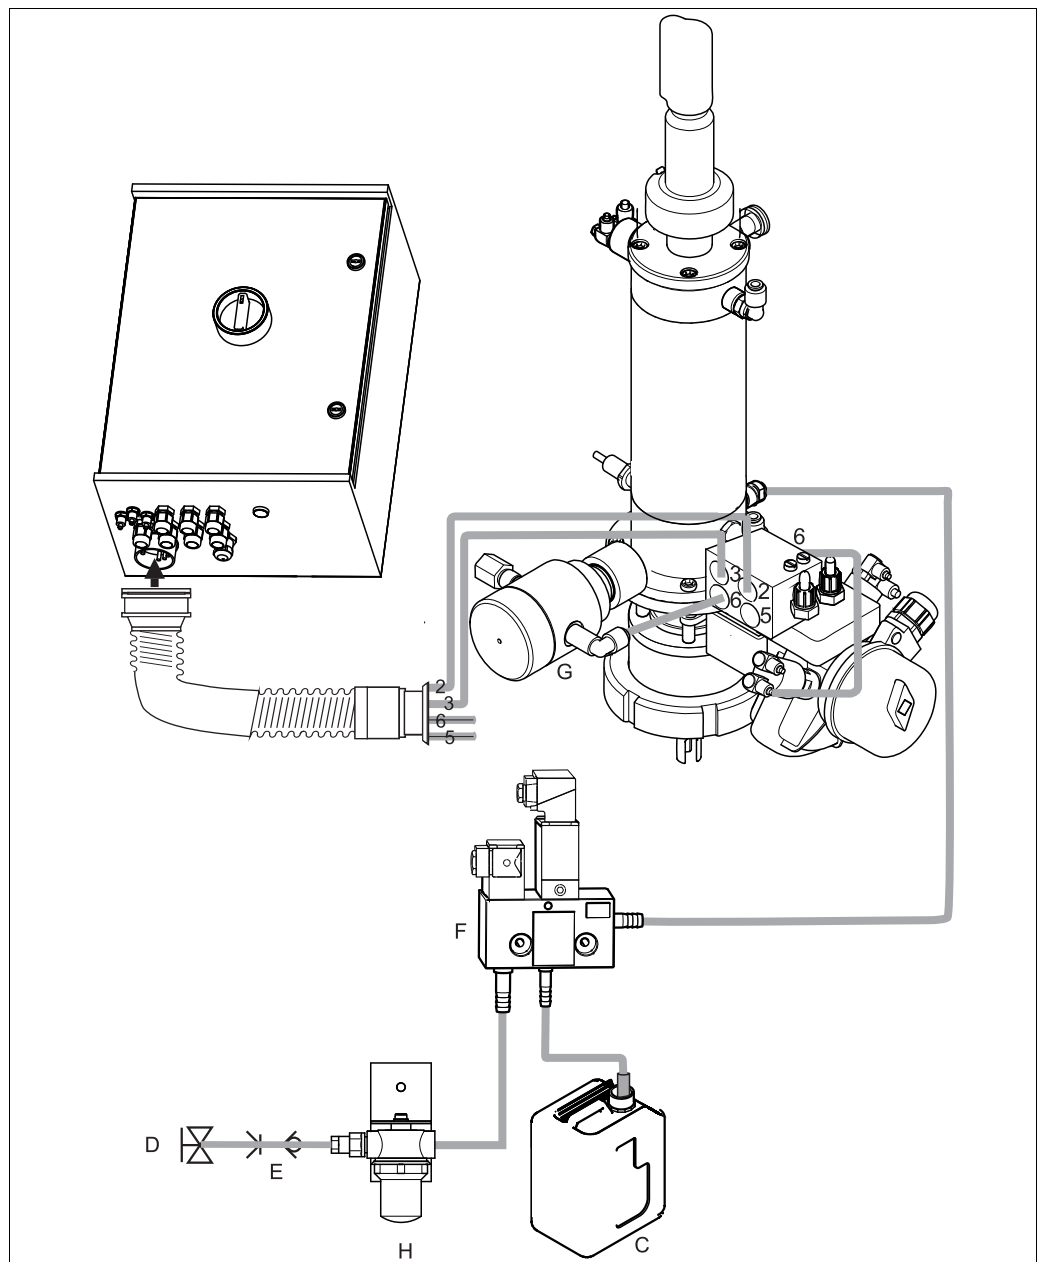


Fig. 43: Connecting CPA473, CPA474 assemblies with inductive limit position switches

- C Cleaner
- D Motive water 2 to 7 bar (29 to 102 psi)
- E Backflow preventer (provided by the customer)
- F CYR10
- G Outlet safety seal (optional)
- H Water filter (optional)

The assembly is delivered with the hoses already connected. All you have to do is connect the compressed air for pneumatic operation of the ball valve.

1. Connect the multihose to the bayonet lock ensuring it is strain relieved and free of any kinks.
2. Fold **hoses no. 5** and **no. 6** back into the multihose.
3. Connect **hose no. 2** for the "Measure" position from the multihose to **limit position switch 2** of the assembly.
4. Connect **hose no. 3** for the "Service" position to **limit position switch 3** of the assembly.

5. Connect the pipe for motive water (D) via backflow preventer (E) to the G 3/8 connection of CYR10.
6. Connect the pipe for the cleaner (C) to the G 1/4 connection of CYR10.
7. Connect the pipe from the CYR10 to the rinse chamber inlet of the assembly.
8. If you are using a pneumatic outlet safety seal (G):
 - Connect the pneumatic limit position switch (marked "2" (= output)) of the ball valve to **input 6** of the pneumatic connection block.
 - Connect **output 6** of the pneumatic connection block to the compressed air connection of the outlet safety seal.

Note the following points:

- The maximum hose length for the cleaner is 10 m (32.8 ft):
- Maximum suction height: 5 m (16.4 ft)
- Maximum horizontal conveying width: 10 m (32.8 ft)
- Pressure resistance of internal components: up to 7 bar (102 psi)
- Maximum suction height of cleaner: 2 m (6.56 ft)

5.2.3 Cleanfit CPA871/875

The CPA871 and CPA875 assemblies are always equipped with inductive limit position switches. Only connect the device in the non-hazardous area.

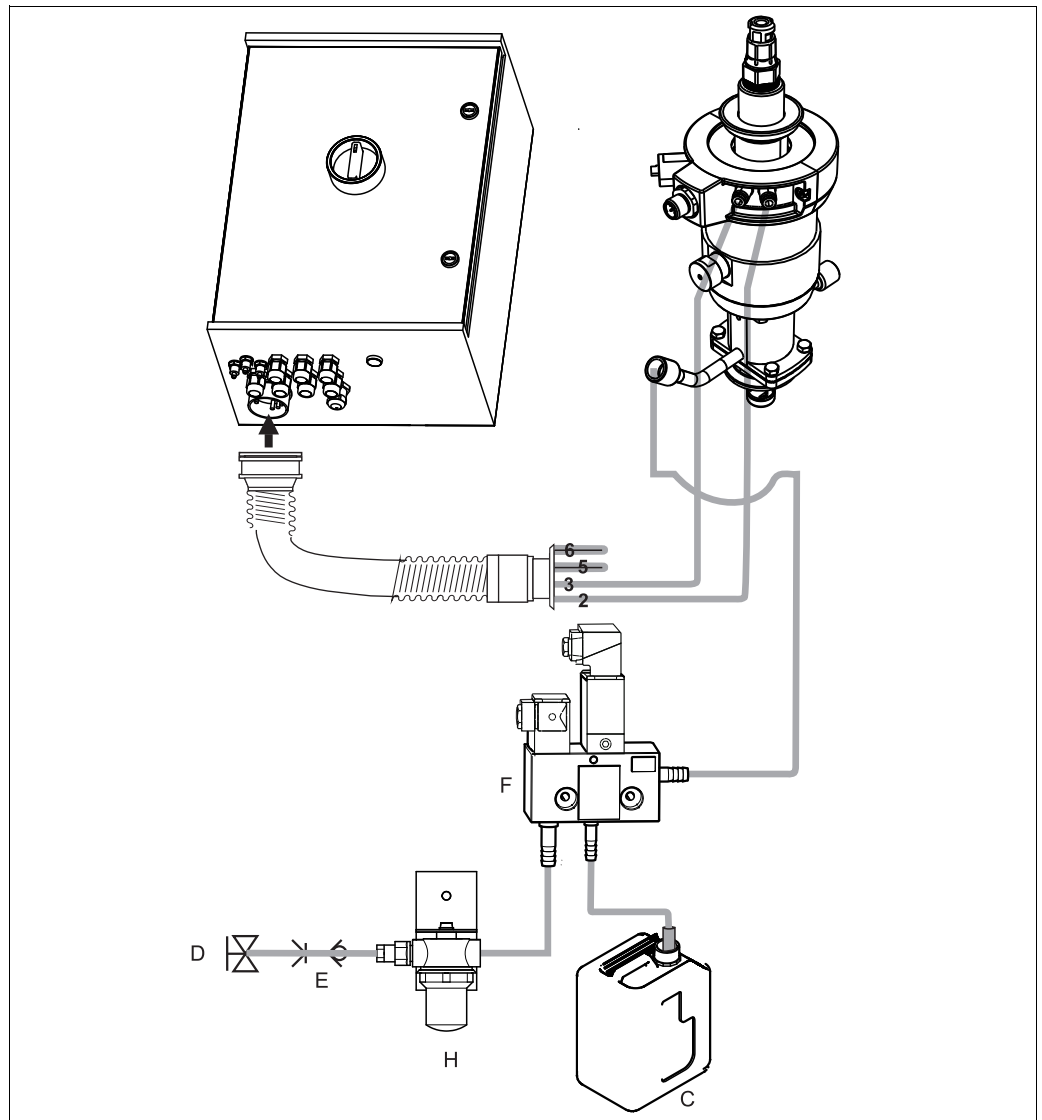


Fig. 44: Connecting CPA871 and CPA875 assemblies

- C Cleaner
- D Motive water 2 to 7 bar (29 to 102 psi)
- E Backflow preventer (provided by the customer)
- F CYR10
- H Water filter (optional)

1. Connect the multihose to the bayonet lock ensuring it is strain relieved and free of any kinks.
2. Fold hoses no. 5 and no. 6 back into the multihose.
3. Connect **hose no. 2** for the "Measure" position from the multihose to the assembly connection marked "IN".
4. Connect **hose no. 3** for the "Service" position from the multihose to the assembly connection marked "OUT".
5. Connect the pipe for motive water (D) via backflow preventer (E) to the G 3/8 connection of CYR10.
6. Connect the pipe for the cleaner (C) to the G 1/4 connection of CYR10.

7. Connect the pipe from the CYR10 to the rinse chamber inlet of the assembly.

Note the following points:

- The maximum hose length for the cleaner is 10 m (32.8 ft):
- Maximum suction height: 5 m (16.4 ft)
- Maximum horizontal conveying width: 10 m (32.8 ft)
- Pressure resistance of internal components: up to 7 bar (102 psi)
- Maximum suction height of cleaner: 2 m (6.56 ft)

5.3 Post-connection check

Device status and specifications	Remarks
Are all the hoses firmly mounted and leaktight?	Visual inspection
Is the multihose placed sheltered?	Use a protection pipe if necessary.

6 Operation

6.1 Display and operating elements

6.1.1 Display

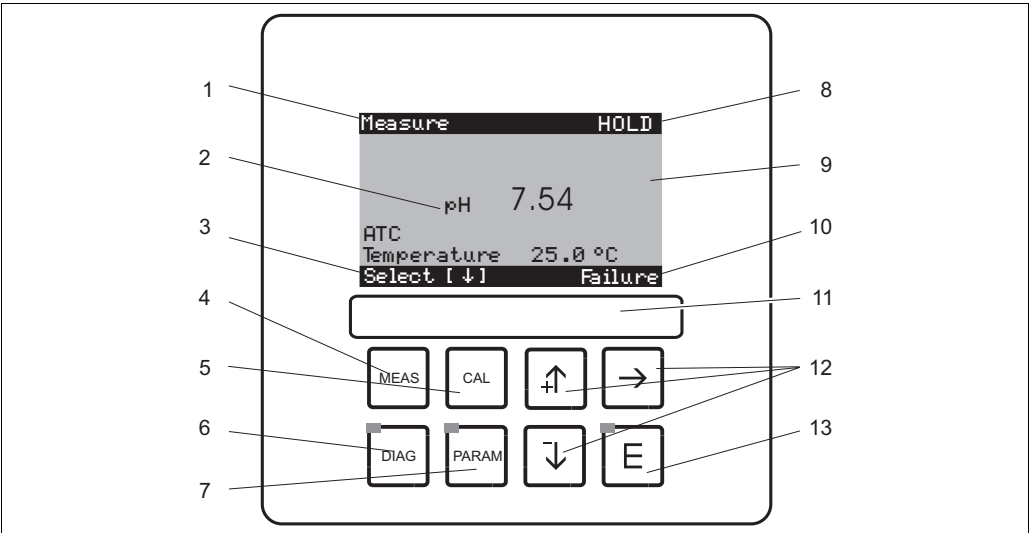




Fig. 45: Operating elements

- 1 Current menu
- 2 Current parameter
- 3 Navigation row: arrows for scrolling; **E** for browsing; note for Cancel
- 4 Measuring mode key
- 5 Calibration key
- 6 Diagnosis menu key
- 7 Parameter entry menu key
- 8 HOLD displayed, if HOLD active
- 9 Current main measured value
- 10 "Failure", "Warning" displayed if the NAMUR contacts respond
- 11 Labeling field
- 12 Arrow keys for selecting and entering
- 13 Enter key



6.1.2 Function of the keys


	"PARAM" takes you to the configuration menu. "PARAM" allows you to return to the previous "return field" from any point in the menu. These are marked in bold in the overview of the menu.
	"DIAG" takes you to the device diagnosis menu.
	"MEAS" switches to Measuring mode. This displays the measured values. Use the arrow keys to scroll through the various measured value readings. Press "MEAS" to exit any of the "PARAM", "DIAG", "CAL" menus without terminating the settings / calibration.
	"CAL" switches to the calibration menu of the sensors.

	<p>"Enter" moves you one step forward in a menu or confirms a selection you made.</p> <p>LED lit Green: everything OK. Red: an error has occurred.</p>
	<ul style="list-style-type: none"> ■ You can scroll through the items with the arrow keys, and then highlight your selection (if there is a choice offered). ■ Increase/decrease numbers by one level with "+" / "-". Go to the next number with the "right arrow" (editor type 1) or ■ "Activate" with the "right arrow" and scroll through the selection with "+" / "-" (editor type 2) (for information on editor types, see the "Menu editor types" section)


6.1.3 Service switch






The service switch is located on the housing front of the control unit. There are two possible switch positions:

	<p>Service/Off: (horizontal switch setting)</p> <ul style="list-style-type: none"> ■ The sensor moves into the rinse chamber. ■ "Hold" is active for the outputs.
	<p>Measure/On: (vertical switch setting)</p> <p>After moving from the service position, a query appears asking whether a program should be launched or the sensor should be moved into the process without cleaning. Only those programs are offered which have already been edited.</p>

 The service switch always has priority (Emergency Stop function). This means that any program running is interrupted as soon as you operate the service switch.

6.1.4 Measuring menus

You can choose between different measuring menus. Use the arrow keys to scroll between the different menus. Switch between the current measured value characteristic and the data logger using the Enter key .

 <p>a0004131-en</p>	 <p>a0004132-en</p>	 <p>a0004913</p>	
<p>The current measured value is displayed.</p>	<p>If you have activated the data logger, you can see the current measured value characteristic here (Record mode). If you have activated both data loggers, press the arrow key to switch to the view of the second measured value characteristic.</p>	<p>In this display you can see the measured value, the kind of temperature compensation and the related temperature.</p>	
 <p>a0004914-en</p>	 <p>a0001912-en</p>		
<p>In this display, you can see the current and voltage values and the contact states of the relay at a glance. Active relay = ■ (with function)</p>	<p>In this display, you can see the measured value, the status of automatic, cleaning, external control and the status of a cleaning program that is running.</p>		

6.1.5 Operation access authorization

Access codes

Functions can be protected by four-digit access codes to protect the transmitter against unintentional and undesired changes to the configuration and the calibration data. All the functions are freely accessible provided no codes have been defined.

Access authorization has the following levels.

- **Display level** (can be accessed without a code)
The complete menu can be viewed. The configuration cannot be altered. No calibration is possible. On this level, only the control parameters for new processes can be changed in the "DIAG" menu branch.
- **Maintenance level** (can be protected by the service code)
This code permits calibration.
The temperature compensation menu item can be used with this code.
The factory functions and the internal data can be viewed.
Factory setting: Code = 0000, i.e. the levels are not protected.
In case you have mislaid/forgotten the supplied service code, contact your service office for a universally valid service code.
- **Specialist level** (can be protected by the specialist access code)
All menus can be accessed and changed.
Factory setting: Code = 0000, i.e. the levels are not protected.
In case you have mislaid/forgotten the supplied specialist code, contact your service office for a universally valid specialist code.


To activate the codes (= functions locked) see the item "PARAM > Setup 1 > Access codes". Enter your desired codes here. If the code is activated, you can only edit the protected areas with the rights mentioned above.

Note the following points:

- Note down the selected code as well as the universal code and keep it in a place where unauthorized persons do not have access to it.
- If you reset the code to "0000", all the levels are freely accessible again for editing. The codes can only be reset in the "Specialist" menu.

Locking configuration via the key pad


Locking operation



Press the **CAL** and **DIAG** keys simultaneously to lock in-field configuration of the device.

At the code prompt, the code appears as "9999". Only the settings in the "PARAM" menu can be seen.

Unlocking operation




Press the **MEAS** and **PARAM** keys simultaneously to unlock operation.

6.1.6 Menu editor types

Depending on the type of setting, the functions for device configuration can be selected in two different ways.

Editor type E1

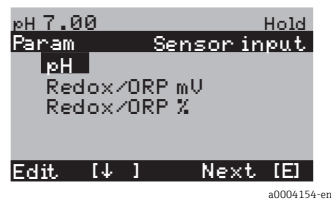


a0004154-en

For functions that can be selected directly from a specified range of options. "Edit" is displayed on the editing line.

- A selection can be highlighted with the arrow keys.
- Confirm the option selected by pressing **[E]**(=Enter).

Editor type E2

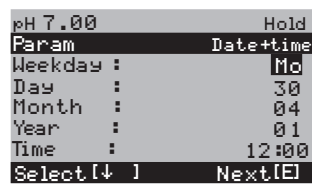

a0004155-en

For settings that have to be defined more specifically, e.g. weekday, time. "Select" is displayed on the editing line.

- An option can be highlighted with the arrow keys **[↑]** and **[↓]** (e.g. "Mo").
- Activate the selected option with the right arrow key **[→]**. The highlighted option flashes.
- Scroll through the options (e.g. weekdays) using the arrow keys **[↑]** and **[↓]**.
- Confirm the option selected by pressing **[E]**(=Enter).
- After making your selection and confirming it by pressing **[E]** (no flashing display), you can exit the item by pressing **[E]**.

7 Commissioning

7.1 Special features when commissioning digital sensors

pH sensors with Memosens technology save the calibration data. For this reason, commissioning these sensors is different to commissioning standard electrodes.

Proceed as follows:

1. Install the transmitter and the assembly.
2. Connect the transmitter and the sensor cable.
3. Configure the transmitter for your specific requirements (see "System configuration" section).
4. Connect the factory-calibrated sensor with Memosens technology and immerse it in the medium or buffer.
5. The saved sensor-specific calibration data are automatically transmitted to the transmitter.
6. The measured value is displayed.
Normally, you can accept this value without calibrating the sensor.
Calibration is only necessary in the following instances:
 - When strict accuracy requirements must be met
 - When the sensor has been in storage for over 3 months
7. Check the measured value transfer to the process control system or the signal processing unit.

7.2 Special features when commissioning ISFET sensors

Switch-on behavior

A closed control loop is created once the measuring system is switched on. During this time (approx. 5 to 8 minutes), the measured value adjusts to the real value. This settling behavior occurs every time the liquid film between the pH-sensitive semiconductor and the reference lead is interrupted (e.g. caused by dry storage or intensive cleaning with compressed air). The settling time in question depends on how long the interruption lasts.

Sensitivity to light

Like all semiconductor elements, the ISFET chip is sensitive to light (measured value fluctuations). However, this only affects the measured value if the sensor is directly exposed to sunlight. For this reason, avoid direct sunlight when calibrating. Normal ambient light does not affect measurement.

7.3 Function check

⚠ WARNING

Incorrect connection, incorrect supply voltage

Safety hazards for staff and device malfunctions

- Check that all connections have been established correctly as per the wiring diagram.
- Make sure that the supply voltage matches the voltage indicated on the nameplate.

NOTICE



If pumps, valves or similar are actuated in an uncontrolled manner, this could damage devices.

- Make sure no danger is posed for the measuring point.

7.4 Switching on

Before first start-up, make sure you understand how to operate the device. Please refer in particular to the "Basic safety instructions" and "Operation" sections.

We recommend the following procedure for commissioning:

1. Connect Mycom S CPM153 to the power supply.
2. Switch the service switch "OFF" or switch it to the Service position .
3. Wait for initialization of CPM153 and the control unit.
Function of the green "Alive LED":
 - Frequency of approx. 2 pulses per second: communication is active.
 - Frequency of approx. 1 pulse per second: establishing communication.
 - LED lit constantly: no communication..
 If the LED does not light up, check the power supply for terminal L+/L- (12 to 15 V DC).
4. Only initial commissioning:
Run the "First start up" (see "First start up" section).
5. Switch the service switch to the Measure position  or "On".
6. Configure parameters: select a function for the additional valves (optional).
7. Start the "User 3" quick-test program and check the entire system for leaks.
Program start:
"PARAM > Specialist > Manual operation > Topclean > Status messages (Enter) > Start program > Clean"
8. Now configure the complete system via the menu.

First commissioning

On first switch-on, the device starts automatically with the First start up menu. This asks you about the most important device settings. After you close the menu, the device is ready for use and measurement in its standard configuration.


Note the following points:



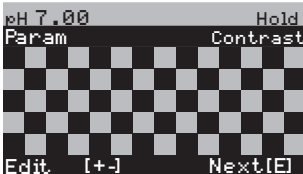






- You must completely run through the First start up menu. If you do not, the device will not be operational. If you interrupt the First start up, it will start again at the next power-up until **all** the items have been processed and completed.
- You have to enter the specialist access code (factory setting 0000) to configure.



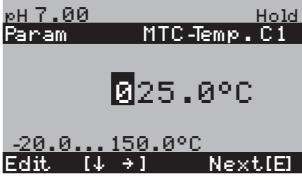
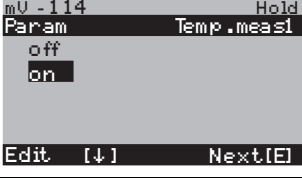
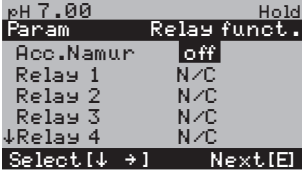
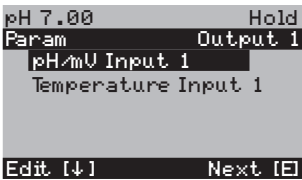
7.5 First start up



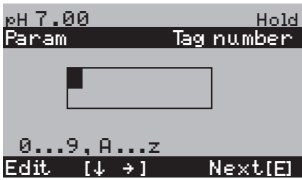
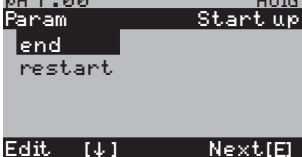
The First start up menu allows you to configure the most important functions of the transmitter. It is started automatically during initial commissioning and can be called any time via the menu structure.

To enter the menu, select:

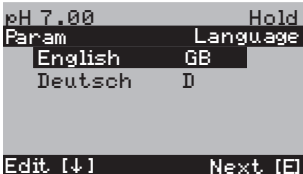 > Specialist > Spec. access code: 0000 > First start up

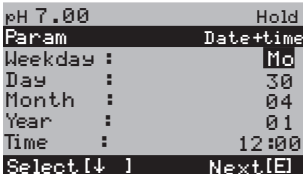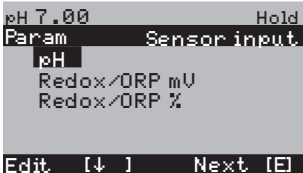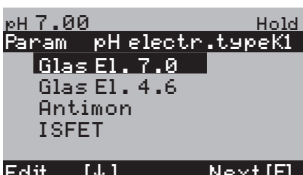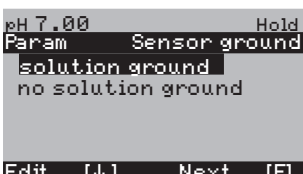Function	Options	Info
<p>Language</p> 	<p>Selection</p> <ul style="list-style-type: none"> English Language ordered <p>Factory setting English</p>	<p> "Language ordered" refers to the language that you chose for your device via the order code ("Language version").</p> <p>All the other settings remain if the other language is selected.</p>
<p>Contrast</p> 		<p>Contrast setting where applicable</p> <p>You can increase or reduce the contrast of the display with the arrow keys  and .</p>
<p>Date + time</p> 	<p>Weekday</p> <p>Day</p> <p>Month</p> <p>Year</p> <p>Time</p>	<p>Enter the complete date and time here. These data are used for the logbooks and the automatic cleaning system.</p>
<p>Operating mode</p> 	<p>Selection</p> <ul style="list-style-type: none"> pH Redox/ORP: mV Redox/ORP: % <p>Factory setting pH</p>	<p>Note the following points:</p> <ul style="list-style-type: none"> If the operating mode changes, all the user settings are automatically reset. If you want to save your settings, use a DAT module. The Redox/ORP:% mode is not available for ORP sensors with Memosens technology whose SW version is ≤ 2.01.00.
<p>Electrode type K1</p> 	<p>Selection</p> <ul style="list-style-type: none"> Glass el. 7.0 Glass el. 4.6 Antimony ISFET <p>Factory setting Glass 7.0</p>	<p>Specify the sensor that is used (only pH).</p> <p>Note the following points:</p> <ul style="list-style-type: none"> The type of electrode does not have to be selected for digital sensors. The temperature sensor defaults to Pt 1000 when you change from a glass or antimony electrode to ISFET. Pt 100 is selected when the situation is the reverse. The glass/ISFET version of Mycom S is factory set for measurement with glass electrodes.
<p>Type of connection</p> 	<p>Selection</p> <ul style="list-style-type: none"> Solution ground No solution ground <p>Factory setting Solution ground</p>	<p>Specify whether you are measuring with solution ground (symmetrically, with PML) or no solution ground (unsymmetrically, without PML).</p> <p>Note the following points:</p> <ul style="list-style-type: none"> The type of connection does not have to be selected for digital sensors with Memosens technology. With digital data transmission there is no need for symmetrical high-impedance connections.

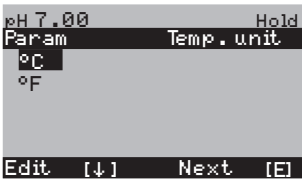
Function	Options	Info
Temperature unit 	Selection <ul style="list-style-type: none"> °C °F Factory setting °C	
Temperature compensation, temp.sensor input 1 	Selection <ul style="list-style-type: none"> ATC C1 MTC MTC+Temp Factory setting ATC C1	Only for pH measurement: ATC: Automatic temperature compensation using temperature sensor MTC: Temperature compensation with manual input MTC+Temp: Temperature compensation with temperature entered manually. The temperature measured with a temperature sensor is displayed, however
MTC temperature, temp. sensor input 1 	-20.0 to 150.0 °C Factory setting 25.0 °C	Only available with pH and MTC or MTC+Temp selected in the previous field.
Temperature measurement 	Selection <ul style="list-style-type: none"> Off On Factory setting On	Only available with ORP measurement.
Contact functions 	Activation and subsequent entry <ul style="list-style-type: none"> NAMUR <ul style="list-style-type: none"> On Off Relay 1-5 <ul style="list-style-type: none"> N/C Controller Limit CCW CCC Factory setting NAMUR: off Relay 1-5: N/C	You can specify the function of the five relays here. When you switch on NAMUR, relays 1 and 2 are assigned and are not available for other functions (see "Namur assignment" section). Controller: Relay contact for controller output Limit: Limit contactor function CCW: Chemoclean Water. Water supply for the ChemoClean function. CCC: Chemoclean Cleaner. Cleaner supply for the ChemoClean function. (Together, CCC and CCW form the "ChemoClean" function. You can find information on ChemoClean in the "Set up 2 - Chemoclean" section.)
Output 1, output variable 	Selection <ul style="list-style-type: none"> pH/mV input 1 Temperature input 1 Factory setting pH/mV input 1	Select the measured value to be output at current output 1.

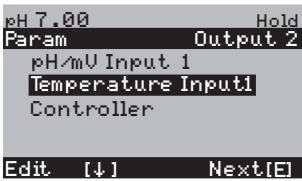

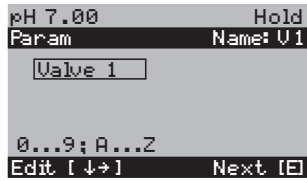

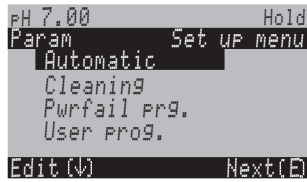

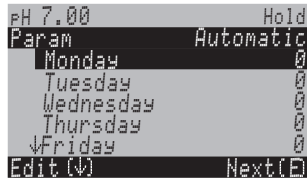







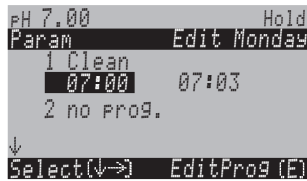


Function	Options	Info
<p>Output 2, output variable</p> 	<p>Selection</p> <ul style="list-style-type: none"> pH/mV input 1 Temperature input 1 Continuous controller <p>Factory setting Temperature input 1</p>	<p>Select the measured value to be output at current output 2.</p> <p>Continuous controller: The controller actuating variable is output via the current output (see also Controller menu).</p> <p> Danger of data loss. If you change the assignment for the current output from "continuous controller" to a different function after you have configured the controllers, the complete controller configuration is reset to default values.</p>
<p>Tag number</p> 	<p>0 to 9; A to Z</p>	<p>Enter your client-specific device number here (32-digit tag number). This is saved in the DAT module which is obtainable as an option.</p>
<p>Exit First start up</p> 	<p>Selection</p> <ul style="list-style-type: none"> End Restart <p>Factory setting End</p>	<p>Specify whether you want to save the settings and exit the First start up menu or run through the menu again to make corrections.</p>


7.5.1 Configuring Clean program (via automatic program)

The following example illustrates how to configure the Clean cleaning program for your Topclean. A description of all the cleaning functions and cleaning programs is provided in the "Set up 2 - Topclean S" section.

To enter the menu, select:

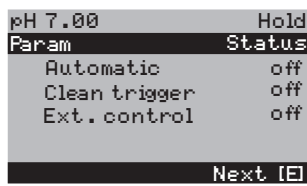 > Specialist > Set up 2 > Topclean > Set up Topclean

Display	User input
	The current status of the cleaning functions is displayed. Press  to continue.
	Press  to continue.
	Select "Automatic" and press  to confirm.
	Select the day you want to edit, e.g. Monday and press  to confirm.
	Select "Edit day" and press  to confirm.
	Press  . The option "No prog." is activated. Select the Clean program by pressing  . Press  .
	Press  and  to edit Clean.

Display	User input
<p>pH 7.00 Hold Param Clean 01 Assembly service 02 Water 60s 03 Cleaner 3s 04 Wait 120s ↓ 05 Water 60s Select [↓] EditLine [E]</p>	Use the arrows to select the program step you wish to change, e.g. water. Press [E] to edit.
<p>pH 7.00 Hold Param Time Water 0040s 0...9999s Edit [↓→] Next [E]</p>	Use the arrows to set the required conveying time for water. Press [E] to return to the list of program steps.
<p>pH 7.00 Hold Param Clean 01 Assembly service 02 Water 60s 03 Cleaner 3s 04 Wait 120s ↓ 05 Water 60s Select [↓] EditLine [E]</p>	Where necessary, change the other program steps. The program time is calculated automatically.
<p>pH 7.00 Hold Param Edit Monday 1 Clean 07:00 07:03 2 no Prog. ↓ Select [↓→] EditProg [E]</p>	Press [↓] and [→] and use the arrows to set the start time for Clean, e.g. 07:00. Press [E] to confirm. The completion time is calculated automatically.  To test the automatic function, allow the system a lead time of min. 10 minutes when entering the time.
<p>pH 7.00 Hold Param Topclean Set up Topclean Activate Topclean Edit [↓] Next [E]</p>	When the configuration is finished and you want to start Clean via the automatic program, you must activate this automatic program. To do so, press [←] until you reach the first Topclean selection. Select "Activate Topclean" and press [E] to confirm.
<p>pH 7.00 Hold Param Contr. progr. Automatic on Ext. control off Clean trigger off Power reset off Select [↓→] Next [E]</p>	Select the status for "Automatic". Press the [→] and [↓] arrows to set the automatic system to "On". Press [E] to confirm. The automatic system is now activated. The selected cleaning programs are started automatically on the set weekday at the specified time. This is based on the time set in the "Enter date and time" field (see the "Set up 1 - Display" section).
	Press [MEAS] to return to the measuring mode.


7.6 Device configuration


7.6.1 Set up 1 - Sensor input

In this item, you change the settings for measured value acquisition, such as the operating mode, the measuring principle, the electrode type etc.

Apart from measured value damping, you have already made all the settings for this menu at the first commissioning with the First start up menu. You can change the selected values in this menu.


You have to enter your specialist access code to access the parameter setting menu.



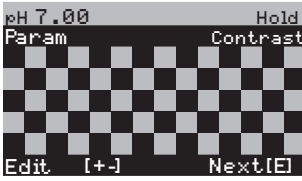


To enter the menu, select:  > Specialist > Set up 1 > Sensor input".

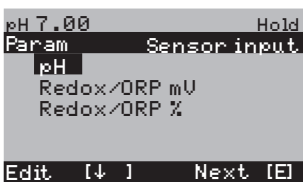Function	Options	Info
Operating mode 	Selection <ul style="list-style-type: none"> ■ pH ■ Redox/ORP: mV ■ Redox/ORP: % Factory setting pH	Note the following points: <ul style="list-style-type: none"> ■ If the operating mode changes, all the user settings are automatically reset. If you want to save your settings, use the DAT module. ■ The Redox/ORP:% mode is not available for ORP sensors with Memosens technology whose SW version is ≤ 2.01.00.
Electrode type K1	Selection <ul style="list-style-type: none"> ■ Glass el. 7.0 ■ Glass el. 4.6 ■ Antimony ■ ISFET Factory setting Glass 7.0	Specify the sensor that is used (only pH). Note the following points: <ul style="list-style-type: none"> ■ The type of electrode does not have to be selected for digital sensors. ■ The temperature sensor defaults to Pt 1000 when you change from a glass or antimony electrode to ISFET. Pt 100 is selected when the situation is the reverse.
Type of connection	Selection <ul style="list-style-type: none"> ■ Solution ground ■ No solution ground Factory setting Solution ground	Specify whether you are measuring with solution ground (symmetrically, with PML) or no solution ground (unsymmetrically, without PML). Note the following points: <ul style="list-style-type: none"> ■ The type of connection does not have to be selected for digital sensors with Memosens technology. With digital data transmission there is no need for symmetrical high-impedance connections.
Measured value damping	Activation and subsequent entry <ul style="list-style-type: none"> ■ pH/ORP 00 to 30 s ■ Temperature 00 to 30 s Factory setting 00 s	The mean value over the set time is displayed. 00s = no attenuation


7.6.2 Set up 1 - Display


To enter the menu, select:

 > Specialist > Set up 1 > Display"

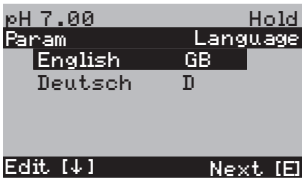Function	Options	Info
Language 	Selection <ul style="list-style-type: none"> English Language ordered Factory setting English	 "Language ordered" refers to the language that you chose for your device via the order code ("Language version"). All the other settings remain if the other language is selected.
Contrast 		Contrast setting where applicable You can increase or reduce the contrast of the display with the arrow keys  and  .
Date + time	Weekday Day Month Year Time	Enter the complete date and time here. These data are used for the logbooks and the automatic cleaning system.
Display format	Selection <ul style="list-style-type: none"> pH00.00 pH00.0 Factory setting pH00.00	Only available for pH operating mode: Specify whether the measured values are to be displayed to one or two decimal places.
Temperature unit	Selection <ul style="list-style-type: none"> °C °F Factory setting °C	
Tag number	0 to 9; A to Z	Enter your client-specific device number here (32-digit tag number). This is saved in the DAT module which is obtainable as an option.

7.6.3 Set up 1 - Access codes

To enter the menu, select:
 > Specialist > Set up 1 > Access codes"

Function	Options	Info
Service code 	0000 to 9997 Factory setting 0000	Enter the service code. This code allows access to the calibration menu and the temperature compensation menu item. 0000 = No security locking
Specialist code	0000 to 9997 Factory setting 0000	Enter the specialist code. This code allows access to all the menu items. 0000 = No security locking

NOTICE


Danger of misuse





- Make sure that the codes you enter and the universal codes are protected against misuse by unauthorized persons.
- Note down the codes and keep them in a place where unauthorized persons do not have access (see also "Access authorization - Operation" section).


7.6.4 Set up 1 - Current outputs

The transmitter is equipped with two current outputs.

To enter the menu, select:


 > Specialist > Set up 1 > Current output



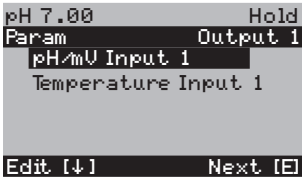
Function	Options	Info
Current output	Selection <ul style="list-style-type: none"> Output 1 Output 2 	Select the current output that you want to configure.
Output 1 (or 2)		
Output variable 	Selection <ul style="list-style-type: none"> pH/mV input 1 Temperature input 1 Continuous controller (only current output 2) Factory setting Output 1: pH/mV input 1 Output 2: Temperature input 1	Select the measured value to be output at current output 2. Continuous controller: The controller actuating variable is output via the current output (see also Controller menu).  Danger of data loss. If you change the assignment for the current output from "continuous controller" to a different function after you have configured the controllers, the complete controller configuration is reset to default values.
Note	!!Caution!! The configuration is changed.	Notice on the display if the setting of the current outputs is changed. Press  to confirm the change. Press  to cancel the change.
Current range	Selection <ul style="list-style-type: none"> 0 to 20 mA 4 to 20 mA Factory setting 4 to 20 mA	Select the current range for the current outputs.
Note	!!Caution!! Current output 0-20 mA and error current = 2.4 mA is critical.	Error current is in the measured current range if "0 to 20 mA" is selected for current range and "Min" is selected under Alarm in the "Alarm output" field (see Set up 1 - Alarm). Recommended combinations: <ul style="list-style-type: none"> Current range 0 to 20 mA and error current max (22 mA) Current range 4 to 20 mA and error current min (2.4 mA)
Characteristic	Selection <ul style="list-style-type: none"> Linear Table Factory setting Linear	Linear: The characteristic curve is linear from the lower to the upper value. Table: If you do not want the current output characteristic to be linear, you can enter a customer-specific sequence of up to 10 value pairs in a table. Exact adaptation to the non-linear medium behavior can achieve a higher level of accuracy.

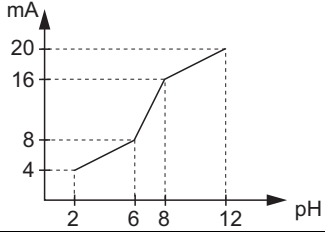Function	Options	Info
Linear		
Measured value limits	Activation and subsequent entry <ul style="list-style-type: none"> 0/4 mA <ul style="list-style-type: none"> -02.00 to 16.00 pH -50 to 150 °C -0500 to 0500 mV 20 mA <ul style="list-style-type: none"> -02.00 to 16.00 pH -50 to 150 °C -0500 mV to 0500 mV Factory setting 0/4 mA: 02.00 pH / 000.0 °C / -0500 mV 20 mA: 12.00 pH / 100.0 °C / 0500 mV	Enter the upper and lower measured value limit. The minimum distance between the upper and lower measured value limit is 2 pH units (e.g.: 0/4 mA: pH 7 and 20 mA: pH 9)
Note	Linear characteristic curve active.	The linear characteristic curve is activated once <input type="button" value="E"/> is pressed by way of confirmation. Cancel with <input type="button" value="PROGRAM"/> .
Table		
Total pairs	01 to 10	Specify the number of table points (value pairs) for your table.
Pairs	Activation and subsequent entry <ul style="list-style-type: none"> pH/ORP/temperature <ul style="list-style-type: none"> -02.00 to 16.00 pH -0500 to 0500 mV -50 to 150 °C mA <ul style="list-style-type: none"> 0.00 to 20.00 mA 	Enter the necessary value pairs. The number of value pairs corresponds to the value entered in the previous field. Example of value pairs with four support points: <div>  <p style="text-align: right; font-size: small;">a0004223</p> </div>
Confirm	Selection <ul style="list-style-type: none"> OK Delete pair(s) Factory setting OK	Are the value pairs OK or do you want to delete elements? Delete: In the screen that follows, select the row to be deleted, delete with <input type="button" value="→"/> and press <input type="button" value="E"/> to confirm.
Table status information	Table valid	Table status. If invalid, then back to the previous field.
Activate	Table active	The table is active once <input type="button" value="E"/> is pressed by way of confirmation. Cancel with <input type="button" value="PROGRAM"/> .

7.6.5 Set up 1 - Relays

To enter the menu, select:

 > Specialist > Set up 1 > Relays

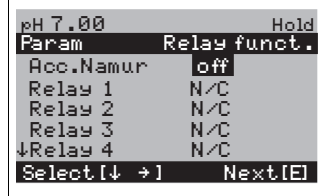Function	Options	Info
<p>Contact functions</p> 	<p>Activation and subsequent entry</p> <ul style="list-style-type: none"> ■ NAMUR <ul style="list-style-type: none"> - On - Off ■ Relay 1-5 <ul style="list-style-type: none"> - N/C - Controller - Limit - CCW - CCC <p>Factory setting NAMUR: off Relay 1-5: N/C</p>	<p>You can specify the function of the five relays here.</p> <p>When you switch on NAMUR, relays 1 and 2 are assigned and are not available for other functions (see "Namur assignment" section).</p> <p>Controller: Relay contact for controller output The controller relays are configured in the " > Set up 2 > Controller settings" menu.</p> <p>Limit: Limit contactor function The limit contacts are configured in the " > Set up 2 > Limit switch" menu.</p> <p>CCW: Chemoclean Water. Water supply for the ChemoClean function.</p> <p>CCC: Chemoclean Cleaner. Cleaner supply for the ChemoClean function. (Together, CCC and CCW form the "ChemoClean" function. You can find information on ChemoClean in the "Set up 2 - Chemoclean" section.)</p> <p>Note the following points:</p> <ul style="list-style-type: none"> ■ Danger of data loss. If the controller is already completely configured for output via relays and you reduce the number of relays assigned to the controller, then the complete controller configuration is reset to the default values. ■ If you change the relay assignment for the controllers here, you must use the Controller menu to reassign a relay to all the functions selected there. Example: Relays 4 and 5 are assigned to the controller and you change the controller assignment to relays 5 and 6 (number of relays remains 2) (no data loss, provided that the number of assigned relays is not reduced!). ■ You can only activate NAMUR if the required relays 1 and 2 (cf.) are free.

Function	Options	Info
Namur contacts	Selection <ul style="list-style-type: none"> Active open Active closed Factory setting Active closed	<p>Only available if NAMUR is activated: Select the assignment of the NAMUR contacts as an NC contact (contact open if relay is active) or an NO contact (contact closed if relay is active).</p> <p>If the NAMUR function is enabled, the Alarm, Relay 1 and Relay 2 contacts are given the following functions:</p> <ul style="list-style-type: none"> "Failure" = Fault-signaling contact (terminals 41/42): Failure alarms are active if the measuring system is not working correctly or if process parameters have reached a critical value. "Maintenance required" = Relay 1 (terminals 47/48): Warning messages become active when the measuring system is working correctly but requires maintenance or a process parameter has reached a value which requires intervention. "Function check" = Relay 2 (terminals 57/58): This contact is active during calibration, maintenance, configuration and during the automatic cleaning/calibration cycle.
Controller contacts	Selection <ul style="list-style-type: none"> Active open Active closed Factory setting Active closed	<p>Only available if the controller has been selected as a relay function: Select the assignment of the controller contacts as "Active open" or "Active closed".</p>
Limit contacts	Selection <ul style="list-style-type: none"> Active open Active closed Factory setting Active closed	<p>Only available if the limit switch has been selected as a relay function: Select the assignment of the limit contacts as "Active open" or "Active closed".</p>
Contact type: Fault signalling contact	Selection <ul style="list-style-type: none"> Active on Active pulse Factory setting Active on	<p>Only when NAMUR function = off</p> <p>Active on: active for as long as an error is present.</p> <p>Active pulse: active for 1 second when an alarm signal occurs.</p>
Chemoclean notice	Chemoclean is always an "Active closed" contact.	<p>Only available if the full Chemoclean function (CCC and CCW) is selected in the first field of the contact configuration: With the Chemoclean function, the valves of the CYR10 injector are actuated with an "Active closed" contact.</p>

7.6.6 Set up 1 - Temperature

The pH value requires temperature compensation for two reasons:

1. Temperature effect of the electrode:
The electrode slope is dependent on the temperature. Therefore this effect must be compensated for temperature changes (Temperature compensation, see below).
2. Temperature effect of the medium:
The medium pH value is also temperature dependent. For high-accuracy measurements, the pH value related to temperature can be entered in table form (Medium temperature compensation, see below).

Temperature compensation

- ATC: Automatic temperature compensation: The medium temperature is measured with a temperature sensor. Via the temperature input in the Mycom S CPM153, this temperature is used to adjust the electrode slope to the medium temperature.
- MTC: Manual temperature compensation: This is advisable in processes which run at a constant temperature. Here, you enter the temperature value manually to adjust the electrode slope to the medium temperature.
- MTC+Temp.: The pH value is corrected with the temperature manually entered. On the display however, the value which appears is what the temperature sensor measures in the medium.

Medium temperature compensation

For medium temperature compensation, tables can be created in the CPM153 for three different media. Before starting the process, the most suitable table for the active medium can be selected.




Procedure:





- Take a sample from the process. The pH value should be as near as possible to the set point of the process.
- In the laboratory, heat the sample to at least the process temperature.
- During cooling, record the value pairs for pH and temperature at those temperatures at which you later wish to take measurements (e.g. process temperature and ambient temperature in the laboratory).
- Enter these recorded value pairs in the table ("Enter value pairs" field). As a reference temperature ("Enter reference temperature" field) select the temperature at which the set point of the process is defined (e.g. ambient temperature in the laboratory).

Temperature compensation menu

To enter the menu, select:

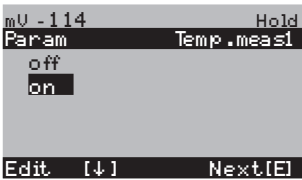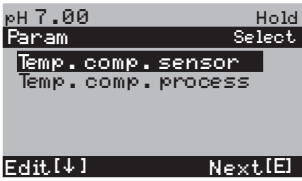"PARAM" > Specialist > Set up 1 > Temperature"

Function	Options	Info
Temperature measurement 	Selection <ul style="list-style-type: none"> ■ Off ■ On Factory setting On	Only available with ORP measurement
Select temperature compensation 	Selection <ul style="list-style-type: none"> ■ Temp. comp. sensor ■ Temp. comp. process (only for pH operating mode) Factory setting Temp. comp. sensor	Only available with pH measurement Select the necessary temperature compensation. Temp. comp. sensor: Automatic (ATC) or manual (MTC) temperature compensation Temp. comp. process: Compensation of the medium temperature using customer-specific tables (see below)
Temperature compensation sensor		
Temperature compensation	Selection <ul style="list-style-type: none"> ■ ATC C1 ■ MTC ■ MTC+Temp Factory setting ATC C1	Only for pH measurement: ATC: Automatic temperature compensation using temperature sensor MTC: Temperature compensation with manual input MTC+Temp: Temperature compensation with temperature entered manually. The temperature measured with a temperature sensor is displayed, however  The type of temperature compensation selected here is active during measuring operation. For the calibration, you must configure the desired compensation in the "Calibration" menu.
MTC temperature	-20.0 to 150.0 °C Factory setting 25.0 °C	Only available with pH and MTC or MTC+Temp selected in the previous field
Temperature sensor	Selection <ul style="list-style-type: none"> ■ Pt100 ■ Pt1000 ■ NTC 30K Factory setting Pt100	Select the temperature sensor that matches your sensor
Adjust temp. reading	-5.00 to +5.00 °C Factory setting 0.0 °C	You can change/adjust the value currently measured with the temperature sensor. The temperature difference is stored internally as an offset value.
Offset value	-5.0 to +5.0 °C	You can edit or reset the offset value resulting from the previous field here.
Temperature compensation process		
Select medium compensation	Selection <ul style="list-style-type: none"> ■ Select temp. table ■ Edit table ■ Reference temperature Factory setting Select temp. table	Select temp. table: You activate an existing table. Edit table: You create a specific table to suit your requirements. Reference temperature: You enter a temperature to which your measured values refer.

Function	Options	Info
Select temp. table		
Medium	Selection <ul style="list-style-type: none"> ■ Medium 1 ■ Medium 2 ■ Medium 3 ■ Off Factory setting Off	Select a medium. Off: No medium compensation
Edit table		
Medium for compensation curve	Selection <ul style="list-style-type: none"> ■ Medium 1 ■ Medium 2 ■ Medium 3 Factory setting Medium 1	Select a medium. You can enter compensation curves in the form of tables for three different media.
Number of points	02 to 10 Factory setting 02	Specify the number of table points (value pairs) for the table.
Pairs	Activation and subsequent entry <ul style="list-style-type: none"> ■ °C -20 to 150 °C ■ pH -2.00 to 16.00 pH 	Enter the temperature and the related pH/ORP values of your medium (number of required value pairs = number of table points specified in the previous field).
Confirm	Selection <ul style="list-style-type: none"> ■ OK ■ Delete element(s) 	Are the value pairs OK or do you want to delete elements? Delete: In the screen that follows, select the row to be deleted, delete with  and press  to confirm.
Table status information	Table valid	The table is active once  is pressed by way of confirmation. Cancel with  .
Reference temperature		
Reference temperature	-20 to 150 °C Factory setting 25 °C	Enter the temperature to which the medium temperature shall be compensated. Here, enter the temperature at which the pH set point of the process is defined, (e.g. the ambient temperature in the laboratory).

7.6.7 Set up 1 - Alarm

The transmitter continuously monitors the most important functions. When an error occurs, an error message is set that can trigger one of the following actions:



- The fault-signaling contact is made active.
- Current output 1 and 2 output the set error current (2.4 or 22 mA). Exception: If you selected the "Continuous controller" function for current output 2 (see "Set up 1 - Current output" section), this output does not output an error current.
- Chemoclean cleaning is started.

In the list of error messages in the Troubleshooting section, you can see how the error numbers are assigned according to the factory settings. However, in the "ALARM" menu, you have the option of outputting the error messages individually to the alarm relay, the current output or as a cleaning trigger.

Alarm menu

To enter the menu, select:

"PAHAM" > Specialist > Set up 1 > Alarm"

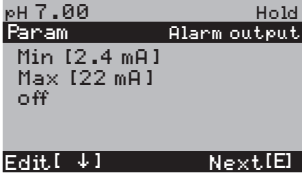Function	Options	Info
Error current 	Selection <ul style="list-style-type: none"> ■ Min (2,4 mA) ■ Max (22 mA) ■ Off Factory setting Max (22 mA)	Set the error current at which an error message is active.
	 Current output 0 to 20 mA and error current = 2.4 mA is critical.	The error current is in the measured current range if the current range selected is "0 to 20 mA" and "Min" was selected in the previous field. Recommended combinations: <ul style="list-style-type: none"> ■ Current range 0 to 20 mA and error current max (22 mA) ■ Current range 4 to 20 mA and error current min (2.4 mA)
Alarm delay	0 to 2000 s Factory setting 0 s	Specify the delay time from when the error occurs to when the alarm is triggered.
Error/contact assignment	Activation and subsequent entry <ul style="list-style-type: none"> ■ R (alarm relay) <ul style="list-style-type: none"> - On - Off ■ I (error current) <ul style="list-style-type: none"> - On - Off ■ CC (Chemoclean) <ul style="list-style-type: none"> - On - Off 	The function the error triggers can be individually assigned to each error: R: Assignment to alarm relay. An activated error triggers an alarm. I: This error triggers an error current. CC: Chemoclean. This error triggers cleaning.
Dosage time alert	Activation and subsequent entry <ul style="list-style-type: none"> ■ Function <ul style="list-style-type: none"> - On - Off ■ Time <ul style="list-style-type: none"> 2 to 9999 s Factory setting Function: Off Time: 2 s	Activate or deactivate the alarm if the dosage time is overshoot. Time: Enter the maximum dosing time permitted. After this time has elapsed, an alarm is output.

7.6.8 Set up 1 - Hold

The current outputs can be "frozen" for each menu. This means that the value which you define in this menu is output. With hold, "Hold" appears in the display. This function can also be activated externally via the Hold input (see the "Connecting external inputs" section). The on-site hold has a higher priority than an external hold.

Note the following points:


- If Topclean S is activated as the hold source, hold is active as soon as the assembly goes to the Service position.
- If a hold is active, no new automatic programs are started. They can be started externally or via local operation where necessary.
- You can deactivate Topclean S as the hold source (PARAM > Set up 1 > Hold > CPC off).
- If current output 2 is configured for the controller, it complies with the controller hold (see the last field in the table).

Hold menu

To enter the menu, select:

"PARAM" > Specialist > Set up 1 > Hold"


Function	Options	Info
Activate hold 	Activation and subsequent selection <ul style="list-style-type: none"> ■ CAL <ul style="list-style-type: none"> - On - Off ■ DIAG <ul style="list-style-type: none"> - On - Off ■ PARAM <ul style="list-style-type: none"> - On - Off ■ CPC <ul style="list-style-type: none"> - On - Off Factory setting On	Specify the menus for which the automatic hold should be activated. CAL: Calibration DIAG: Service/diagnosis PARAM: Configuration menu
Hold current	Selection <ul style="list-style-type: none"> ■ Last ■ Fixed ■ Min (0/4 mA) ■ Max (22 mA) Factory setting Last	Specify which current value should be output in the event of a hold. Last:= The current value is "frozen". Fixed:= The value set in the next field is output in a hold. Min / Max: The minimum and maximum current value is output.
Fixed current	0 to 100% Factory setting 0 %	Only available if "Fixed" was selected in the previous field: Specify the hold current. The number can be set between 0 % = 0/4 mA and 100 % = 20 mA
Holdtime	0 to 999 s Factory setting 010 s	The hold remains active for the given holdtime after leaving the CAL, PARAM, DIAG menus. During the hold delay time, the "Hold" indicator flashes in the display.


Function	Options	Info
Controller hold	Selection Freeze actuating variable? <ul style="list-style-type: none"> ■ On ■ Off Factory setting Off	<p>Specify whether the actuating variable (dosing) should be frozen during a hold.</p> <p>On: During an active hold, the last actuating variable is output.</p> <p>Off: During a hold, no dosing takes place. PWM or PFM relays remain in the dropped-out state. An actuator drive is controlled until it is closed.</p> <p> If the set value is output via an actuating variable with feedback, the actuator remains active. It also reacts in the hold should the position suddenly change.</p>








7.6.9 Set up 1 - Calibration



pH operating mode

To enter the menu, select:

 > Specialist > Set up 1 > Calibration"

Function	Options	Info
Calibration	Selection <ul style="list-style-type: none"> ■ Offset ■ Manual calibration ■ Special buffer table ■ Cal. settings ■ Calibration timer Factory setting Offset	Select the initial settings for the calibration. Offset: Enter a fixed value by which the pH value is shifted. Manual calibration: Make initial settings for the function of the CAL key. Special buffer table: Edit tables for the special buffer. Cal settings: General calibration settings Calibration timer: Timer for calibration intervals
Offset		
Enter the offset	Activation and subsequent entry <ul style="list-style-type: none"> ■ Act. PV 1/2 -2.00 to 16.00 pH ■ Offset 1/2 -2.00 to 2.00 pH Factory setting Offset: 0.00 pH	Act. PV: The current measured value (primary value) is displayed with an offset and can be edited. Offset: The pH value difference between the measured value and the displayed value is displayed and can be edited. If you start operation with a set offset value, "OFFSET" is shown on the top right of the display.
Manual calibration		
Calibration parameter	Selection <ul style="list-style-type: none"> ■ Enter spec. buffer ■ Manual buffer ■ Buffer table ■ Auto. buffer recognition Factory setting Buffer table	Specify the type of calibration with which calibration takes place when the "CAL" button is pressed. Enter spec. buffer: Entry of zero point and sensor slope. Manual buffer: During calibration, enter the buffer value. Buffer table: If the same buffer values are always used, you can select this function. Auto. buffer recognition: The Mycom S transmitter automatically recognizes the buffer values used.
Buffer type	Selection <ul style="list-style-type: none"> ■ DIN 19267 ■ E+H ■ NBS / DIN 19266 ■ Merck+Riedel ■ Special buffer Factory setting E+H	Only available for "Buffer table" and "Auto. buffer recognition". Select the buffer type for local calibration. Spec. buffer table: The tables for special buffers, which are to be defined in the "Special buffer table" option, are used.  You can find the buffer tables for the buffers on offer in the Appendix.
Buffer 1	Selection <ul style="list-style-type: none"> ■ Buffer 2.0 ■ Buffer 4.01 ■ Buffer 6.98 ■ Buffer 9.18 ■ Buffer 10.90 (option depends on the buffer type) Factory setting Buffer 6.98	Only available for buffer table: Select the pH value for buffer 1 of the two-point calibration.


Function	Options	Info
Buffer 2	Selection <ul style="list-style-type: none"> ■ Buffer 2.0 ■ Buffer 4.01 ■ Buffer 9.18 ■ Buffer 10.90 (option depends on the buffer type) Factory setting Buffer 4.01	Only available for buffer table: Select the pH value for buffer 2 of the two-point calibration.
Special buffer		
Number of buffers	2 to 3 Factory setting 2	Enter the desired number of buffers. A minimum of 2 and a maximum of 3 user-specific buffers can be saved with a table.  You must individually run through the following four fields for each buffer.
Select buffer	1 to 3 Factory setting 1	Select one of the buffer tables for editing.
Total pairs	2 to 10 Factory setting 10	Specify the desired number of table points (value pairs) for the buffer table. Pair: pH and temperature
Pairs	Activation and subsequent entry <ul style="list-style-type: none"> ■ °C -20 to 150 °C ■ pH -2.00 to 16.00 pH 	Enter the temperature and the related pH values of your medium (number of required value pairs = number of table points specified in the previous field).
Confirm	Selection <ul style="list-style-type: none"> ■ OK ■ Delete element(s) 	Are the value pairs OK or do you want to delete elements? Delete: In the screen that follows, select the row to be deleted, delete with  and press  to confirm.
Note	Table valid	The table is active once  is pressed by way of confirmation. Cancel with  .
Cal. settings		
Temperature compensation	Selection <ul style="list-style-type: none"> ■ ATC ■ MTC 	Select the temperature compensation for the calibration.  The setting is only active during calibration. During operation, the setting you selected in the "Temperature" menu applies.
Slope	5.00 to 57.00 mV/pH Factory setting 25.00 mV/pH	If the slope entered is undershot, an alarm (error no. 032 / E035) can be triggered (for error activation, see "Set up 1 - Alarm" section). Example: The specified slope of the electrode is 59 mV/pH at 25 °C. You enter 55 mV/pH as the slope here. Then an alarm can be triggered if the slope measured < 55 mV/pH.  The upper limit value for the slope is programmed into the device. An alarm is triggered if a slope of 65 mV/pH is overshoot.

Function	Options	Info
Zero point	0.05 to 2.00 pH Factory setting 1.30 pH	If the zero point deviates from the reference zero point by the value entered here, an alarm (Error No. 033) can be triggered (for error activation, see "Set up 1 - Alarm" section). Example: The specified zero point of the electrode is 7.00 pH (for electrode with pH 7 internal buffer). Enter 0.05 pH as the zero point deviation. Then an alarm can be triggered if the measured zero point is < 6.95 pH or > 7.05 pH.
SCC (Sensor Condition Check)	Selection <ul style="list-style-type: none"> ■ On ■ Off Factory setting Off	This function monitors the electrode status or the degree of electrode aging. Possible status messages: "Electrode OK", "Low wear" or "Replace electrode". The electrode status is updated after each calibration. When the "Replace electrode" message appears, an error message may be displayed (E040, E041).  This function is only available for glass electrodes. If you combine a glass electrode and an ISFET sensor, you can use the SCC function without restriction. However, the function only monitors the glass electrode.
Isothermic compensation	Activation and subsequent entry <ul style="list-style-type: none"> ■ Function <ul style="list-style-type: none"> - On - Off ■ Uis 0.00 to 16.00 pH Factory setting Function: off Uis: 0.00 pH	Here, you activate the isothermic compensation and enter the isothermic intersection point (Uis). Function off: For E+H electrodes. Function on: Only if the isothermic intersection point ≠ zero point of the electrode. The bigger the difference between the isothermic intersection point and the zero point, the greater the measuring error in the event of temperature variations. Uis: Enter the intersection point at which the isotherms of the electrode meet.  When you activate the isothermic compensation the electrode has to be calibrated before measuring.
Stability criteria	Activation and subsequent entry <ul style="list-style-type: none"> ■ Threshold 01 to 10 mV ■ Length 03 to 70 s Factory setting Threshold: 02 mV Length: 20 s	During calibration, the mV value may change during the given period ("duration") at maximum by the stated amount ("threshold"), so that the calibration is considered as stable. Therefore you can adjust accuracy and timing individually to your process.
Calibration timer		
Calibration timer	Activation and subsequent entry <ul style="list-style-type: none"> ■ CAL timer <ul style="list-style-type: none"> - On - Off ■ Warning 0001 to 9999 h Factory setting CAL timer: off Warning: 0001 h	If no calibration is undertaken in the set time, an error message appears (E115). CAL timer on: Activate the timer Warning: Enter the time within which the next calibration must take place. Time: Displays the remaining time until an error message appears (count down).

ORP operating mode

To enter the menu, select:

 > Specialist > Set up 1 > Calibration"


Function	Options	Info
Calibration	Selection <ul style="list-style-type: none"> ■ Offset ■ Manual calibration ■ Cal. settings ■ Calibration timer Factory setting Offset	Select the initial settings for the calibration. Offset: Enter a fixed value by which the mV value is shifted. Manual calibration: Make initial settings for the function of the CAL key. Cal settings: General calibration settings Calibration timer: Timer for calibration intervals
Offset		
Enter the offset	Activation and subsequent entry <ul style="list-style-type: none"> ■ Act. PV 1/2 0000 to 1500 mV ■ Offset 1/2 0000 to 1500 mV Factory setting Offset: 0000 mV	Act. PV: The current measured value (primary value) is displayed with an offset and can be edited. Offset: The mV value difference between the measured value and the displayed value is displayed and can be edited. If you start operation with a set offset value, "OFFSET" is shown on the top right of the display.
Manual calibration		
Calibration parameter	Selection <ul style="list-style-type: none"> ■ Enter data abs. ■ Calibration abs. ■ Enter data rel. (only Redox/ORP: % operating mode) ■ Calibration rel. (only Redox/ORP: % operating mode) Factory setting Enter data abs.	Specify the type of calibration with which calibration takes place when the "CAL" button is pressed. Data entry abs.: Enter the electrode offset in mV. Calibration abs.: Use a ORP buffer Enter data rel.: Entry of two % calibration points to each of which one mV value is assigned. Calibration rel.: Use of a detoxified and unchanged sample as the buffer.
Cal. settings		
Zero point	1 to 1500 mV Factory setting Function: off Maintenance: 10.50 pH Failure: 11.00 pH	If the zero point deviates from the reference zero point by the value entered here, an alarm (Error No. 033) can be triggered (for error activation, see "Set up 1 - Alarm" section).
SCC (Sensor Condition Check)	Selection <ul style="list-style-type: none"> ■ On ■ Off Factory setting Off	This function monitors the electrode status or the degree of electrode aging. Possible status messages: "Electrode OK", "Low wear" or "Replace electrode". The electrode status is updated after each calibration. When the "Replace electrode" message appears, an error message may be displayed (E040, E041).  This function is only available for glass electrodes. If you combine a glass electrode and an ISFET sensor, you can use the SCC function without restriction. However, the function only monitors the glass electrode.



Function	Options	Info
Stability criteria	Activation and subsequent entry <ul style="list-style-type: none"> ■ Threshold 01 to 10 mV ■ Length 03 to 70 s Factory setting Threshold: 02 mV Length: 10 s	During calibration, the mV value may change during the given period ("duration") at maximum by the stated amount ("threshold"), so that the calibration is considered as stable. Therefore you can adjust accuracy and timing individually to your process.
Calibration timer		
Calibration timer	Activation and subsequent entry <ul style="list-style-type: none"> ■ CAL timer <ul style="list-style-type: none"> - On - Off ■ Warning 0001 to 9999 h Factory setting CAL timer: off Warning: 0001 h	If no calibration is undertaken in the set time, an error message appears (E115). CAL timer on: Activate the timer Warning: Enter the time within which the next calibration must take place. Time: Displays the remaining time until an error message appears (count down).

7.6.10 Set up 2 - Data log

The data log records two freely selectable parameters with their date and time. You can start it using the measuring menus: Use the arrow keys to scroll through the measuring menus until you reach the Record mode of the data log. Pressing the key brings you to the Scroll mode of the data log. Here you can open the saved measured values with their date and time.

To enter the menu, select:

 > Specialist > Set up 2 > Data log"

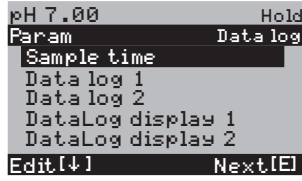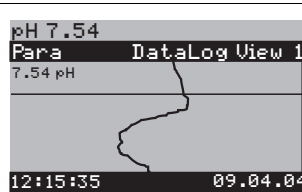Function	Options	Info
Data log 	Selection <ul style="list-style-type: none"> Sample time Data log 1 Data log 2 DataLog display 1 DataLog display 2 Factory setting Sample time	Using the data log you can record <ul style="list-style-type: none"> one parameter with 500 sequential measuring points two parameters each with 500 sequential measuring points.
Sample time		
Enter the sample time	2 to 36000 s Factory setting 00005 s	Enter the time interval after which the next measured value is recorded in the data logger.
Data log		
Data log 1 (or 2)	Activation and subsequent entry <ul style="list-style-type: none"> Input <ul style="list-style-type: none"> pH/mV input 1 Temp Function <ul style="list-style-type: none"> On Off Factory setting Input: pH/mV input 1 Function: off	Select the measured value to be recorded and activate the function with "On".
Recording range	Activation and subsequent entry <ul style="list-style-type: none"> Min <ul style="list-style-type: none"> -2.00 to 16.00 pH -1500 to 1500 mV -50 to 150 °C Max <ul style="list-style-type: none"> -2.00 to 16 pH -1500 to 1500 mV -50 to 150 °C Factory setting Min: 2.00 pH Max: 12.00 pH	Specify the recording range. Values outside the range defined here are not recorded.
DataLog display		
		View of recorded data You can call up the data recorded in the past with the date and time.

7.6.11 Set up 2 - Check systems

SCS electrode monitoring

The Sensor Check System monitors the pH and reference electrode for incorrect measurement and complete failure.

SCS identifies the following reasons for incorrect measurement:

- Electrode glass breakage
- Fine short circuits in the pH measuring circuit, also e.g. moisture or dirt bridges at terminal points
- Contamination or clogging of the reference electrode
- Leak current for ISFET sensor

The following three monitoring methods are used:

- Monitoring the pH electrode for high resistance (alarm if a minimum impedance is undershot, approx. 500 k Ω).
This function cannot be selected for antimony and ISFET electrodes.
- Monitoring of impedance of the reference electrode (alarm if set threshold value overshoot).
This function can only be selected for symmetrically high-resistance measurement.
- Monitoring of leak current for ISFET sensors (early warning E168 at $I_{LEAK} > 200$ nA, error E008 at $I_{LEAK} > 400$ nA).

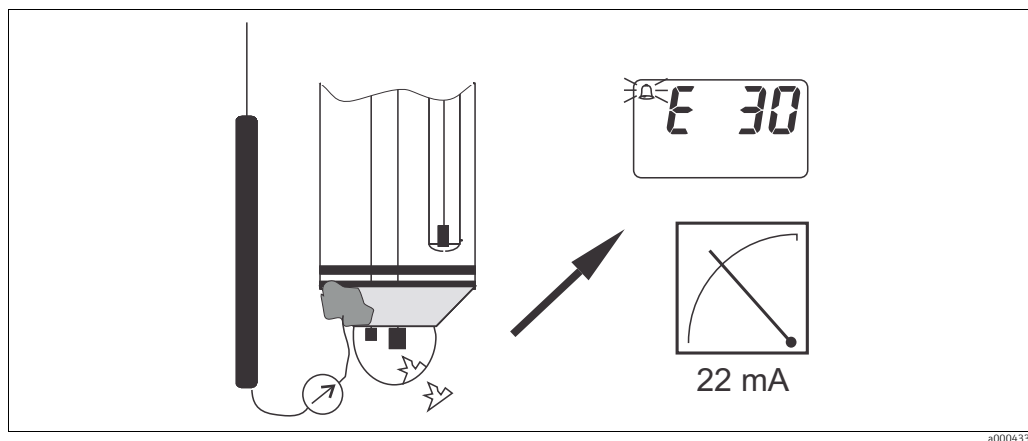


Fig. 46: SCS alarm

NOTICE

Incorrect handling triggers false alarm

- Do not remove standard electrodes from the process without a hold! Since SCS is measured against PML, no contact between the inner conductor and PML would otherwise trigger an alarm. In the case of digital sensors, SCS is not measured against PML.

PCS alarm (Process Check System)

The PCS monitors the measuring signal for changes. If the measuring signal does not change by more than 0.5% (of full scale value of the selected measuring range) during the time entered, an alarm (E152) is triggered. The reason for such sensor behavior can be contamination, cable rupture or similar.

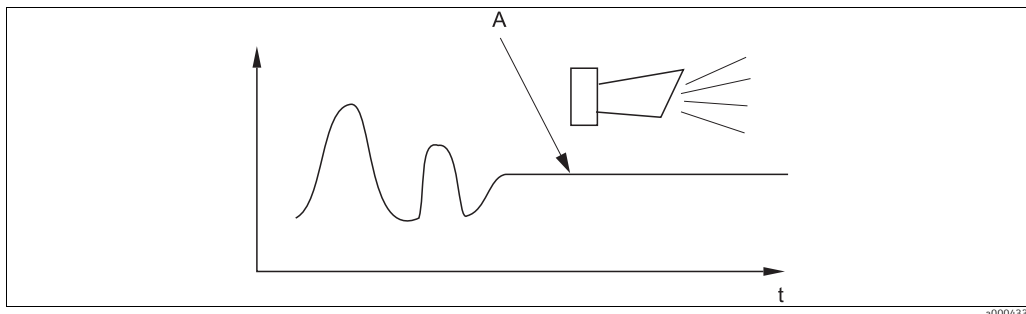


Fig. 47: PCS alarm (live check)


A Constant measuring signal = alarm triggered after PCS alarm time has elapsed



Note the following points:

- The electrode must be symmetrically connected (with PML) to monitor the reference.
- Any PCS alarm pending is automatically deleted as soon as the sensor signal changes.
- Due to its semiconductor component, the ISFET sensor is sensitive to light and responds with measured value fluctuations. For this reason, avoid direct sunlight when calibrating and operating. Normal ambient light does not affect measurement.


Check menu

To enter the menu, select:

 > Specialist > Set up 2 > Check"

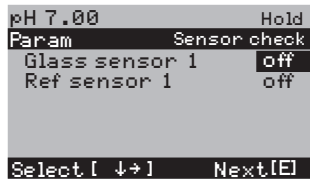Function	Options	Info
SCS (Sensor Check System) 	Activation and subsequent entry ■ SCS - On - Off ■ Ref sensor - Off - light - medium - heavy - very heavy blockage Factory setting Glass sensor 1: Off Ref. sensor 1: Off	Select the check mode. SCS: Glass breakage detection Ref. sensor: Blockage detection
PCS (Process Check System)	Activation and subsequent entry ■ PCS input - Off - 1 h - 2 h - 4 h Factory setting Off	If the measuring signal does not change during the entered time by ± 0.02 pH / ± 5 mV / $\pm 0.25\%$, an alarm is signaled with error message E152.  An active PCS alarm signal will be deleted automatically as soon as the sensor signal changes.

7.6.12 Set up 2 - Controller settings

 The following sections describe the controller configuration of the transmitter.


Transmitter configuration


Please configure the transmitter relays in the following order:


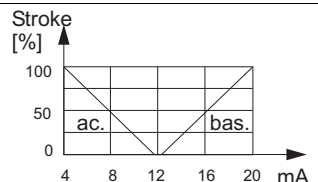
1. Actuators
2. Sensory mechanism
3. Characteristic curve:

In the user settings (see below) you switch directly to a controller simulation and can check the settings made and change them if necessary.

To enter the menu, select:

 > Specialist > Set up 2 > Controller settings"

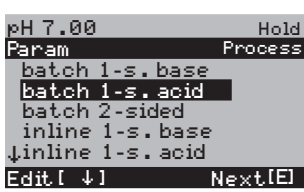Function	Options	Info
Process 	Selection <ul style="list-style-type: none"> ■ Batch 1-s. base ■ Batch 1-s. acid ■ Batch 2-sided ■ Inline 1-s. base ■ Inline 1-s. acid ■ Inline 2-sided Factory setting Batch 1-s. base	Select the process type that describes your process. One-sided: Control using acid or base. Two-sided: Control using acid and base. You can only select this function if you have defined two controllers (in the "Relays" menu and/or via the current output 2).
External hardware	Selection <ul style="list-style-type: none"> ■ Type ■ Characteristic Factory setting Characteristic	For correct operation, you must completely configure these submenus. Type: Here, you can select and configure the method which the controller uses to output the actuating variable. Characteristic: Here, you enter the controller parameters (neutral zone, set point, etc.). With this selection, you can also reach the "active measuring menu".
Type for "1-sided"		
Control type	Selection <ul style="list-style-type: none"> ■ Pulse length ■ Pulse frequency ■ Current output (only if the "Continuous controller" option is selected for current output 2) 	Select the type of control for your process.
Pulse length		
Actuator	Activation and subsequent entry <ul style="list-style-type: none"> ■ Relay: n.c., Rel. x ■ Period: 001.0 to 999.9 s ■ Min. off time: 000.4 to 100.0 s Factory setting Relay: n.c. Period: 010.0 s Min. off time: 000.4 s	Select the settings for the actuator. Relay: Select the relay; you can choose from the relays that you assigned to the controller in "Set up 1 - Relays". Period: Period length T in seconds Min. off time: Minimum switch-on time; shorter pulses are not forwarded to the relay and therefore conserve the actuator.
Pulse frequency		

Function	Options	Info
Actuator	Activation and subsequent entry ■ Relay: n. c., Rel. x ■ Max. frequency 060 to 120 min ⁻¹ Factory setting Relay: n.c. Max. frequency: 120 min ⁻¹	Select the settings for the actuator. Relay: Select the relay; you can choose from the relays that you assigned to the controller in "Set up 1 - Relays". Max. pulse frequency: Enter the maximum pulse frequency; pulses with a higher frequency are not forwarded to the relay.
Current output		
Current range	Selection ■ 0 to 20 mA ■ 4 to 20 mA Factory setting 4 to 20 mA	Select the current range to be output at the current output.
Current value	Selection ■ 20 mA ■ 0/4 mA Factory setting 0/4 mA	Assign the current value that corresponds to 100 % dosing medium provision.
Type for "2-sided"		
Control signal (only possible if you selected the continuous controller under current output 2)	Selection ■ 1 output ■ 2 outputs Factory setting 2 outputs	1 output: For control using the current output in the "split range" method. Control logics are required which can control two valves/pumps via one current input. 2 outputs: The valves are controlled by relays.
1 output		
Current range	Selection ■ 0 to 20 mA ■ 4 to 20 mA Factory setting 4 to 20 mA	Select the current range to be output at current output 2. The neutral position (= current value which the controller outputs when it is not dosing) is in the middle of the selected range. For 0 to 20 mA, the neutral position is at 10 mA, for 4 to 20 mA at 12 mA.
Current value	Selection ■ 20 mA ■ 0/4 mA Factory setting 0/4 mA	Assign the current value that corresponds to 100 % of acid dosing.  From the current value selection for the dosing of 100 % acid, you can derive the current ranges for acid/base dosing (see Fig. 48) in the "split range" method.
		 <p style="text-align: right;">a0004343-en</p>
		Fig. 48: Two-sided control via one current output

Function	Options	Info
2 outputs		
Control type	Activation and subsequent entry <ul style="list-style-type: none"> ■ Acid <ul style="list-style-type: none"> - Pulse length - Pulse frequency ■ Alkali <ul style="list-style-type: none"> - Pulse length - Pulse frequency Factory setting Acid: Pulse length Base: Pulse length	Select the type of control for your process.
For acid/base dosing in each case: Actuator (only for pulse length)	Activation and subsequent entry <ul style="list-style-type: none"> ■ Relay: n.c., Rel. x ■ Period: 001.0 to 999.9 s ■ Min. off time: 000.4 to 100.0 s Factory setting Relay: n.c. Period: 010.0 s Min. off time: 000.4 s	Select the settings for the actuator. Relay: Select the relay; you can choose from the relays that you assigned to the controller in "Set up 1 - Relays". Period: Period length T in seconds Min. off time: Minimum switch-on time; shorter pulses are not forwarded to the relay and therefore conserve the actuator.
For acid/base dosing in each case: Actuator (only for pulse frequency)	Activation and subsequent entry <ul style="list-style-type: none"> ■ Relay: n. c., Rel. x ■ Max. frequency: 060 to 120 min⁻¹ Factory setting Relay: n.c. Max. frequency: 120 min ⁻¹	Select the settings for the actuator. Relay: Select the relay; you can choose from the relays that you assigned to the controller in "Set up 1 - Relays". Max. pulse frequency: Enter the maximum pulse frequency; pulses with a higher frequency are not forwarded to the relay.
Characteristic		
Characteristic type	Selection <ul style="list-style-type: none"> ■ Linear ■ Segmented 	Select the characteristic type. Linear characteristic: Corresponds to a constant control gain. Segmented characteristic: Corresponds to a range-dependent control gain.
Linear characteristic		
Settings	Activation and subsequent entry <ul style="list-style-type: none"> ■ Start neutral zone: -2.00 to 7.00 pH ■ End neutral zone: 7.00 to 16.00 pH ■ Control point: -2.00 to 16.00 pH (depends on start neutral and end neutral zone) ■ K_R 1: 00.00 to 99.99 ■ K_R 2: 00.00 to 99.99 Factory setting Start neutral: 6.50 pH End neutral: 7.50 pH Control point: 7.00 pH K _R 1: 01.00 K _R 2: 01.00	Select the settings for linear control gain. Control point: The value that is to be set. Start neutral: Start neutral zone End neutral: End neutral zone K_R 1 (only with base dosing): gain for base dosing K_R 2 (only with acid dosing): gain for acid dosing

Function	Options	Info
Process speed	Selection <ul style="list-style-type: none"> Fast process Standard process Slow process User settings Factory setting Rapid process	Select the speed of the process. If you have no experience in setting control parameters, these defaults fast/standard/slow process are intended as an aid to adapting the controller behavior to the process. Select a default and use the "controller simulation" (see below) to check if these settings are relevant for your process. Enter all the characteristic values yourself with the user settings.
Values for user settings (only if "User settings" is selected for the process speed)	Activation and subsequent entry <ul style="list-style-type: none"> K_R 1 00.00 to 99.99 K_R 2 00.00 to 99.99 Tn 1 000.0 to 999.9 Tn 2 000.0 to 999.9 Tv 1 000.0 to 999.9 Tv 2 000.0 to 999.9 Factory setting K _R 1: 01.00 K _R 2: 01.00 Tn 1: 000.0 Tn 2: 000.0 Tv 1: 000.0 Tv 2: 000.0	Enter the characteristic values for the user settings. (Index 1 only for base dosing, index 2 only for acid dosing) K_R 1: Gain for base dosing K_R 2: Gain for acid dosing Tn: Integral action time Tv: Derivative action time
Controller simulation	Selection <ul style="list-style-type: none"> On Off Factory setting Off	Here, you can switch a configuration loop on or off. The hold is removed with an active controller simulation. Simulation on: The characteristic values entered in the previous field are used in the next field for simulating the controller behavior. Off: Press <input type="button" value="E"/> to leave the controller simulation.
Simulation on	Activation and subsequent entry <ul style="list-style-type: none"> Function <ul style="list-style-type: none"> automatic manual Set -2.00 to 16 pH Act. y -100 to 100 % (only if function = manual) 	Function: Here, you set whether a set value calculated by the controller ("auto"), or a set value y entered by the user ("manual") is to be output. Set: Displays the current set point. If necessary, you can change the set point. The other points (start/end of neutral zone, optimization points, control points) change accordingly. Act: Displays the current actual/measured value. y: With the "auto" function: Displays the set value determined by the controller. With the "manual" function, you can enter a set value here. Values < 0 % mean a dosing of acid, values > 0 % mean a dosing of base.

Function	Options	Info
Segmented curve		
Settings	<p>Activation and subsequent entry</p> <ul style="list-style-type: none"> Start neutral zone -2.00 to 7.00 pH End neutral zone 7.00 to 16.00 pH Control point -2.00 to 16.00 pH (depends on start neutral and end neutral zone) Opt. pt. X1 2.00 to 7.00 pH (depends on start neutral zone) Opt. pt. Y1 00.00 to 99.99 Opt. pt. X2 7.00 to 16.00 pH (depends on end neutral zone) Opt. pt. Y2 00.00 to 99.99 Ctrl.pnt.1 2.00 to 7.00 pH (depends on opt. pt. X1) Ctrl.pnt. 2 7.00 to 16.00 pH (depends on opt. pt. X2) <p>Factory setting Start neutral: 6.50 pH End neutral: 7.50 pH Control point: 7.00 pH Opt. pt X1: 05.00 pH Opt. pt Y1: 0.20 Opt. pt X2: 09.00 pH Opt. pt Y2: -0.20 Control point 1: 02.00 pH Control point 2: 12.00 pH</p>	<p>Enter the characteristic values for range-dependent control gain.</p> <p>Control point: The value that is to be set.</p> <p>Start neutral: Start neutral zone</p> <p>End neutral: End neutral zone</p> <p>Optimization point 1 and 2: Entry with x and y coordinates</p> <p>Control point 1: For measured values < control point 1, the dosing is 100% base.</p> <p>Control point 2: For measured values > control point 2, the dosing is 100% acid.</p>
Parameter	<p>Activation and subsequent entry</p> <ul style="list-style-type: none"> Tn 1 000.0 to 999.9 Tn 2 000.0 to 999.9 Tv 1 000.0 to 999.9 Tv 2 000.0 to 999.9 <p>Factory setting Tn 1: 000.0 Tn 2: 000.0 Tv 1: 000.0 Tv 2: 000.0</p>	<p>Enter the parameters for the segmented curve.</p> <p>(Index 1 only for base dosing, index 2 only for acid dosing)</p> <p>Tn: Integral action time</p> <p>Tv: Derivative action time</p>
Controller simulation	<p>Selection</p> <ul style="list-style-type: none"> On Off <p>Factory setting Off</p>	<p>Here, you can switch a configuration loop on or off. The hold is removed with an active controller simulation.</p> <p>Simulation on: The characteristic values entered in the previous field are used in the next field for simulating the controller behavior.</p> <p>Off: Press E to leave the controller simulation.</p>

Function	Options	Info
Simulation on	Activation and subsequent entry <ul style="list-style-type: none"> ■ Function <ul style="list-style-type: none"> – automatic – manual ■ Set <ul style="list-style-type: none"> – 2.00 to 16 pH ■ Act. ■ y <ul style="list-style-type: none"> – 100 to 100 % (only if function = manual) 	<p>Function: Here, you set whether a set value calculated by the controller ("auto"), or a set value y entered by the user ("manual") is to be output.</p> <p>Set: Displays the current set point. If necessary, you can change the set point. The other points (start/end of neutral zone, optimization points, control points) change accordingly.</p> <p>Act: Displays the current actual/measured value.</p> <p>y: With the "auto" function: Displays the set value determined by the controller. With the "manual" function, you can enter an actuating variable here.</p> <p>Values < 0 % mean a dosing of acid, values > 0 % mean a dosing of base.</p>

To best adapt the controller parameters to the process, we recommend the following:

1. Set values for the controller parameters ("Settings for user" field for linear curve or "Parameter" field for segmented curve).
2. Deflect the process.
"Simulation" field: Set function to "Manual" and enter a set value. Using the actual value, you can observe how the process is deflected.
3. Switch the function to "auto". Now you can observe how the controller returns the actual value to the set point.
4. If you want to set other parameters, press the "Enter" key and you will return to the "Characteristic value for user settings" field. During this time, the controller continues to run in the background.
5. Press the "Enter" key to return to the "Select controller simulation" field, where you can continue or exit the simulation.



Always exit controller simulation with "Simulation off" in the "Select simulation" field. Otherwise, the simulation will continue to run in the background.

7.6.13 Set up 2 - Limit switch

The transmitter has several possibilities for assigning a relay contact. Switch-on and switch-off points and pickup and dropout delays can be assigned to the limit contactor. In addition, you can configure an alarm threshold to output an error message and to start a cleaning function in conjunction with this. These functions can be used for both the primary value and for temperature measurement.

Please refer to Abb. 49 for a clear illustration of the relay contact states.

- When the measured values increase (maximum function), the relay contact is closed as of t_2 after the switch-on point (t_1) has been overshoot and the pickup delay has elapsed ($t_2 - t_1$).
The alarm contact switches if the alarm threshold (t_3) is reached and the alarm delay ($t_4 - t_3$) has also elapsed.
- When the measured values decrease, the alarm contact is reset when the alarm threshold (t_5) is undershot as is the relay contact (t_7) after the dropout delay ($t_7 - t_6$).
- If the pickup and dropout delays are set to 0 s, the switch-on and switch-off points are also switch points of the contacts.

Settings can also be made for a minimum function in the same way as for a maximum function.

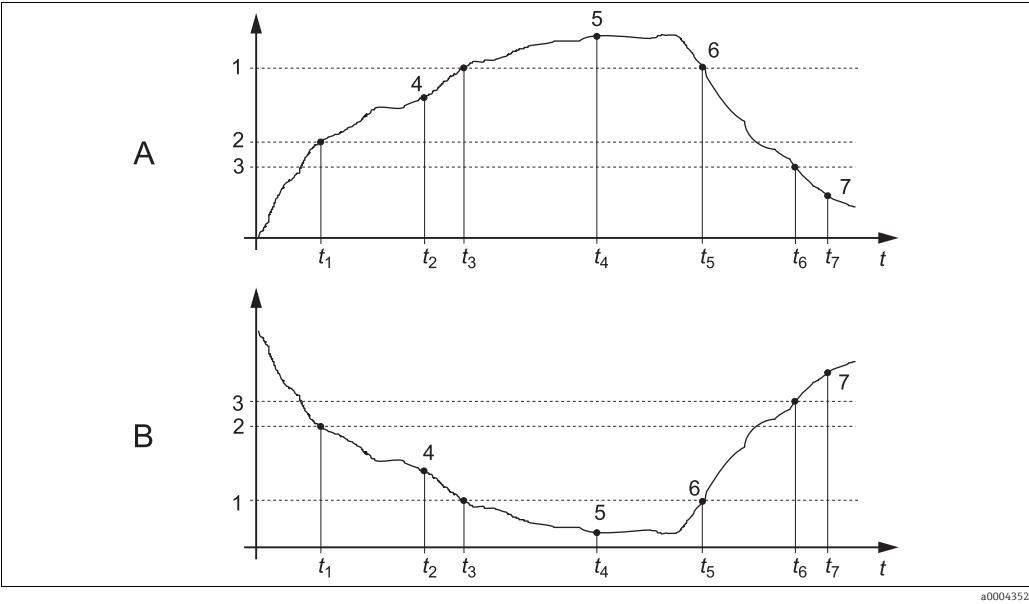



Fig. 49: Illustration of the alarm and limit value functions

- | | | | |
|---|---|---|------------------|
| A | Switch-on point > switch-off point: Max. function | 1 | Alarm threshold |
| B | Switch-on point < switch-off point: Min. function | 2 | Switch-on point |
| | | 3 | Switch-off point |
| | | 4 | Contact ON |
| | | 5 | Alarm ON |
| | | 6 | Alarm OFF |
| | | 7 | Contact OFF |

Limit switch menu

To enter the menu, select:


"PARAM" > Specialist > Set up 2 > Limit switch"

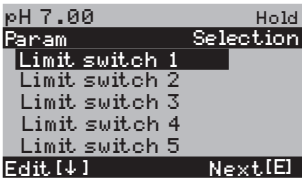Function	Options	Info
Limit contactor 	Selection <ul style="list-style-type: none"> ■ Limit switch 1 ■ Limit switch 2 ■ Limit switch 3 ■ Limit switch 4 ■ Limit switch 5 	Select the limit switch that you want to configure. There are five limit contactors available.
Limit switch 1 to 5	Activation and subsequent entry <ul style="list-style-type: none"> ■ Function <ul style="list-style-type: none"> - On - Off ■ Assign <ul style="list-style-type: none"> - pH/mV input 1 - Temperature input 1 ■ On-value: <ul style="list-style-type: none"> -2.00 to 16.00 pH -1500 to 1500 mV -3000 to 3000% -50 to 150 °C ■ Off-value <ul style="list-style-type: none"> -2.00 to 16.00 pH -1500 to 1500 mV -3000 to 3000% -50 to 150 °C Factory setting Function: off Assign: pH/mV input On-value: 16.00 pH Off-value: 16.00 pH	Configure the limit switch. Function: Activate the function as a limit switch Assign: Select the measured value for which the limit value should apply. On-value: Entry of the value at which the limit value function is activated. Off-value: Entry of the value at which the limit value function is deactivated.
Limit switch configuration	Activation and subsequent entry <ul style="list-style-type: none"> ■ On delay <ul style="list-style-type: none"> 0 to 2000 s ■ Off delay <ul style="list-style-type: none"> 0 to 2000 s ■ Alarm limit <ul style="list-style-type: none"> -2.00 to 16.00 pH -1500 to 1500 mV -3000 to 3000% -50 to 150 °C Factory setting On delay: 0 s Off delay: 0 s Alarm limit: 16.00 pH	Configure the delays and the alarm limit for the limit switch. On delay: Entry of the switch-on delay Off delay: Entry of the switch-off delay Alarm limit: Entry of the value at which the fault signalling contact switches.

7.6.14 Set up 2 - Controller quick adjustment

In this menu, you can make a quick adjustment to the controller set point:

To enter the menu, select:

 > Specialist > Set up 2 > Contr. quick adj."

Function	Options	Info
<div><div>Controller quick adjustment</div><div><div>pH 7.00</div><div>Hold</div></div><div><div>Param</div><div>Quick adjustm.</div></div><div><div>Function</div><div>set</div><div>act.</div></div><div><div>7.00 pH</div><div>6.58 pH</div></div><div><div>Select [→]</div><div>Next [E]</div></div></div>	<div>Activation and subsequent entry</div> <div>■ Set point</div> <div>-1.64 to 15.64 pH</div>	<div>Enter the set point for the controller function.</div>

7.6.15 Set up 2 - Topclean

Use this menu item to configure the cleaning and calibration cycles and how cleaning and calibration are triggered.

Configuration of the programs


Select the cleaning program to suit your measuring point. You can adjust all the programs to suit your needs and preferences and deactivate them again if necessary (e.g. the program steps water, cleaner, control of additional valves, number of repeats and sequence of steps). Furthermore, you have the option of configuring special user programs yourself.

Control of cleaning and calibration programs

You can choose from the following ways to control cleaning and calibration programs:

- Automatic:
Weekly program that automatically starts the selected cleaning program for every weekday. You can freely select the cleaning program for every weekday.
- Cleaning:
Select the cleaning program that is started in the event of an SCS alarm or an error message that has been configured accordingly.
- Power failure program:
Select the cleaning program that is automatically started after a power supply, air supply or communication failure.
- Ext. control:
The cleaning programs can be started via a process control system. The program is started by a 3-bit signal. Please refer to the table in the "Function overview of the cleaning and calibration programs" section for the binary encoding of the individual programs.
To configure the program controlled externally, select it in the Automatic control mode and make the settings there for water, cleaner, buffer solution etc.
Please refer also to the "Connecting the external inputs and outputs to the control unit" section for the electrical connection of the binary encoding for an external program start.

Activating the control types

To activate the control type for the cleaning and calibration programs, switch the desired function on ( > Set up 2 > Topclean> Activate Topclean).

Program editor

User program: You can configure your specific cleaning program in the program editor.

Selecting the cleaning programs

You have a choice of five cleaning programs in total.

- Clean

This program is permanently assigned to one function. You can set the cleaning times or repeat cycles. You can select and configure this program within all the control types mentioned above. Please note that the selected parameters are used for all control types. The parameters selected in the Clean program also apply for the Clean Int. program. You can also start this program manually (see "Manual operation" section).

- Clean S

Clean S is permanently assigned to one function. You can set the cleaning times or repeat cycles. You can select and configure this program within all the control types mentioned above. Please note that the selected parameters are used for all control types. You can also start this program manually (see "Manual operation" section).

- User 1/2/3 programs:

The user programs allow you to define the program sequence freely. A simple way of programming is to copy predefined programs to user programs and adapt them. To configure these programs, enter the program editor and proceed as follows:

1. Edit the program
2. Configure the program

Then you can select these programs within all the functions listed above or start them manually (see "Manual operation" section).

- Clean Int:

This program for cleaning cycles is permanently assigned to one function. You can set the cleaning times, repeat cycles and intervals.

You can only select and configure this program within the "Automatic" function.

Please note that the selected parameters are taken for all weekdays on which you set the Clean Int. program and for the Clean program.

Interval cleaning allows you to define cleaning intervals for a given period of time (max. 1 day).

In practice, two different operating modes are used - interval measuring and interval cleaning:

- In the case of interval cleaning, the sensor is mainly in the process. The sensor is cleaned at the specified intervals.
 - In the case of interval measuring, the sensor is mainly in the service position (aggressive media). It is then moved into the process for measuring at the specified intervals.
- If the sensor remains in the service position for a long time, set the compressed air to 0 s to prevent the sensor from drying out.

Examples of program sequences

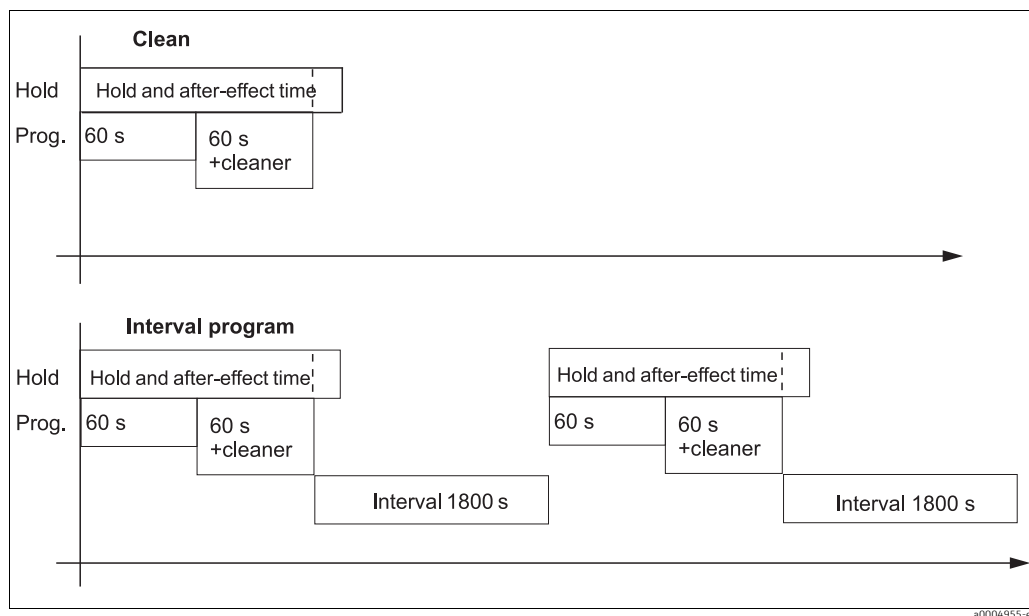


Fig. 50: Example of the program sequence for "Clean" and "Clean Int"

- Clean Int runs from 08:00 to 12:00 (midday) at an interval of 10 minutes (program time + measuring time + dwell time).
This means that cleaning is started every 10 minutes: 08:00, 08:10 etc.
The last cycle starts at 11:50.
Clean Int runs from 08:00 to 11:00 at an interval of 50 minutes.
This means that cleaning is started every 50 minutes: 08:00, 08:50, 09:40. The last cycle is started at 09:40. The cycle due to start at 10:30 cannot be started since it would not finish until 11:20, 20 minutes after the set end time for the Clean Int program.

Aborting the program

Once a program has been started (Clean, Clean S), it goes through the entire cycle (safety concept). No other programs can be started during this time.
The service switch on the front door of the control unit is of highest priority. If you move the switch to the "Service" position, you can even interrupt running programs.
The Clean Int. program can be interrupted by a steady signal at the "Automatic stop" digital input. For this, the assembly must be in the "Measure" position. When the signal at the input is stopped, the Clean Int. program is continued.

Note the following points:

- The appendix contains a wiring example for external control of the cleaning programs.
- You can select the control signal for an external additional valve for your device under the order code **"External valve control"**.
- In the user-definable user programs, you can use external additional valves as required, e.g. for superheated steam, a second cleaner, cooling air, organic cleaners or similar.

Function overview of cleaning programs

Function → Program ↓	Cleaning	Sterilization *	Back pressure water*	Control via binary contacts		
				bin. 0	bin. 1	bin. 2
				Term. 81/82	Term. 83/84	Term. 85/86
Clean (cleaning)	✓	–	Control for 1 valve required	1	0	0
Clean S (cleaning + sterilization)	✓	Control for 1 valve required	–	0	0	1
User 1 (user definable)	✓	The external valve can be used as required, e.g. for superheated steam, organic cleaner, 2nd cleaner, cooling air. Device control for 1 valve is required.		1	0	1
User 2 (user definable)	✓			0	1	1
User 3 (user definable)	✓			1	1	1

Note the following points:

- "1" = Voltage of 10 to 40 V (duration approx. 400 mS) applied at contacts bin 0 to bin 2 (terminals 81 to 86). For non-Ex devices, this auxiliary energy can be taken from the 15 V auxiliary voltage output of Mycom S CPM153.
- "0" = 0 V
- *The "Sterilization" and "Back pressure water" functions are **only** available for device versions with external valve control.


Program sequences

Standard programs				Optional programs
Clean		Clean S		User 1 - User 3
01	Assembly service	01	Assembly service	01
02	Water 20 s	02	Steam 1200 s	02
03	Cleaner 15x	03	Wait 600 s	03
04	Wait 30 s	04	Repeat steril. 0x	04
05	Water 30 s	05	Assembly meas.	05
06	Compressed air 20 s	06	-----	06
07	Repeat clean. 0x	07	Prog. time:_____	07
08	Assembly meas.	08		08
09	-----	09		09
10	Prog. time:_____	10		10
11		11		11
12		12		12
13		13		13
14		14		14
15		15		15
16		16		16
17		17		17
18		18		18 (up to 25 program steps possible)
19		19		




Configuration menu

To enter the menu, select:

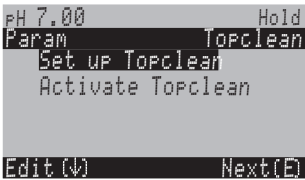"PARAM" > Specialist > Set up 2 > Topclean"

Function	Options	Info
Select function 	Selection <ul style="list-style-type: none"> Set up Topclean Activate Topclean Factory setting Set up Topclean	Set up: Create or edit a Topclean program. Activate: Switch Topclean functions on or off.
Configuration		
Note	Automatic: off Clean trigger: off Ext. control: off	Current system status
Assignment of additional valves (if available)	Activation and subsequent selection <ul style="list-style-type: none"> Valve <ul style="list-style-type: none"> Sterilization Back pressure water User Factory setting None	Assign the required function to the additional valve. Back pres. water: If the back pressure water (sealing water) function is selected, you can pump back pressure water every time the assembly is moved (see User program). Note the following points: <ul style="list-style-type: none"> Two valves are displayed but only the first row can be edited. If you change the function of the additional valve, sterilization or back pressure water is no longer available in the set programs. If you have changed the function, you must check the assignment in the user programs.
Valve name	0 to 9; A to Z Factory setting Valve 1 (or 2)	You can enter names (max. eight characters) for the additional valves. These names are automatically adopted with the program steps.
Function of the cleaning system	Selection <ul style="list-style-type: none"> Automatic Interval program Cleaning Power failure program Prog. editor Factory setting Automatic	Select Prog. editor to adapt the cleaning or calibration programs to your needs or select a control type to which you want to assign a program. Automatic: Weekly program that starts the selected cleaning or calibration program at the set times. Interval program: Program that starts at defined intervals. Cleaning: Program that is started if the sensor is dirty or clogged (SCS). Power failure program: Program that is automatically started after a power supply or communication failure. Prog. editor: Adapt the cleaning and calibration programs to your needs and preferences.
Program editor		
Select program	Selection <ul style="list-style-type: none"> Clean Clean S User 1 User 2 User 3 Factory setting Clean	Select the program that you want to edit.

Function	Options	Info
Select the editing function	Selection <ul style="list-style-type: none"> ■ Insert progr. ■ Edit ■ Set up ■ Prog.time ■ Change name Factory setting Insert program	Select the desired editing function. Insert progr.: You can insert a predefined program into the selected program. Edit: You can add or delete program steps. Set up: You can set the times and repeat cycles of the selected program. Prog. time: The total duration of the selected program is displayed. Change name: You can give the selected program any name of your choice.
Insert program		
Select a program	Selection <ul style="list-style-type: none"> ■ No prg. ■ Clean ■ Clean S ■ User 1 ■ User 2 ■ User 3 Factory setting No prg.	Select the program that should be copied into the selected program.
Edit		
Select rows	Selection <ul style="list-style-type: none"> ■ 01 ■ 02 ... Factory setting 01	Select the row you want to edit. A maximum of 28 lines is possible.
Edit the row	Selection <ul style="list-style-type: none"> ■ Edit ■ Delete ■ Move to ■ Insert 	Select the editing function for the selected row. Edit: The function for the selected item is changed, e.g. "Water" changed to "Cleaner". Delete: The selected function is deleted (you are not asked to confirm that you really want to delete) Move to: The selected function is moved to another position. Insert: A new item is inserted ahead of the selected item. In the case of Insert/Edit , all the possible program steps are displayed, e.g. Valve 1 open, Valve 1 closed, Water, Cleaner etc..
Setup		
Change program steps	Selection <ul style="list-style-type: none"> ■ Water 0 s ■ Cleaner 0 s ■ Wait 0 s ... 	Select the program step that you want to change.
Enter values	0 to 9999 s 0x (depending on the selected program step)	Enter the desired value for the selected program step. Wait: Specify how long the system should remain in its current state. Back to: Specify how often a loop should be repeated. Air: Specify how long compressed air should flow.
Prog.time		
Prog.time	0 to 9999 s	The total duration of the selected program is displayed. The display cannot be edited.
Change name		

Function	Options	Info
Change name	0 to 9; A to Z	You can enter any name for the selected program.
Automatic		
Select the day	Selection <ul style="list-style-type: none"> Monday Wednesday Thursday Friday Saturday Sunday Factory setting Monday	Select the day that you want to edit.
Select the editing function for the day	Selection <ul style="list-style-type: none"> Edit day Copy day Factory setting Edit day	Edit day: You edit the cleaning cycle for the selected day. Copy day: The day selected in the previous field is copied to the day you select in the following field.
Edit day		
Select programs	Activation and subsequent entry <ul style="list-style-type: none"> Clean 18:22 18:23 Interval 18:24 18:54 No progr. Factory setting No progr.	Select the cleaning programs for the day and enter the times for the start of cleaning. If you select the interval program, also enter the time when cleaning should finish. The start and finish times are always displayed. Example: Clean 18:22 (start time) 18:23 (finish time)  10 program starts are possible per day.
Copy day		
Select day	Selection <ul style="list-style-type: none"> Tuesday Wednesday Thursday Friday Saturday Sunday Factory setting Tuesday	Select the day to which you want to copy the day previously selected (e.g. Monday).  Danger of data loss. When one day is copied to another, the cleaning programs of the target day are overwritten.
Interval program		
Select program Enter interval	Activation and subsequent entry <ul style="list-style-type: none"> Program <ul style="list-style-type: none"> Clean Clean S User 1 User 2 User 3 Interval 0 to 36000 s Factory setting Program: Clean Interval: 3600 s	Program: Select the program that should be started at the defined intervals. Interval: Enter the time that should elapse between the end of one program cycle and the start of the next program cycle.  Enter an interval of at least 10 minutes here so that the program cycles can be ended and started correctly.

Function	Options	Info
Cleaning		
Select program	Selection <ul style="list-style-type: none"> ■ No progr. ■ Clean ■ Clean S ■ User prog. Factory setting No progr.	Select the program that should be started if the electrode is fouled or clogged.
Power failure program		
Note	The selected program is started after a network communication or air supply failure.	
Select program	Selection <ul style="list-style-type: none"> ■ No progr. ■ Clean ■ Clean S ■ User prog. Factory setting Clean	Select the program that should be started if the network communication or air supply fails.
Activate Topclean		
Activate control programs	Activation and subsequent selection <ul style="list-style-type: none"> ■ Automatic <ul style="list-style-type: none"> – On – Off ■ Ext. control <ul style="list-style-type: none"> – On – Off ■ Clean trigger <ul style="list-style-type: none"> – On – Off ■ Power reset <ul style="list-style-type: none"> – On – Off 	Activate the control programs via which a program should be started.
Activate back pressure water	Activation and subsequent selection <ul style="list-style-type: none"> ■ Function <ul style="list-style-type: none"> – On – Off ■ Relay <ul style="list-style-type: none"> – Water – Valve 1 – Valve 2 ■ Length: 01 to 30 s Factory setting Function: on Relay: water Length: 05 s	Specify whether and when back pressure water should be pumped. Back pressure water is pumped into the rinse chamber before and after the assembly is moved. This is useful in processes with media that are fibrous or tend to form buildup as the counterpressure in the rinse chamber caused by the back pressure water prevents the ingress of medium into the chamber. Function: If you activate the function, back pressure water is pumped into the assembly rinse chamber every time the assembly is moved. Relay: Specify the valve via which the assembly water should be pumped. <ul style="list-style-type: none"> ■ Water: Via the water connection on the rinsing block ■ Valve 1, Valve 2: Via additional valve 1 or 2 Length: Specify how long back pressure water should be pumped before and after the assembly is moved.

7.6.16 Set up 2 - Chemoclean

Chemoclean is a system to automatically clean sensors. Water and cleaner are pumped to the sensor via the injector (e.g. CYR10) via two contacts.

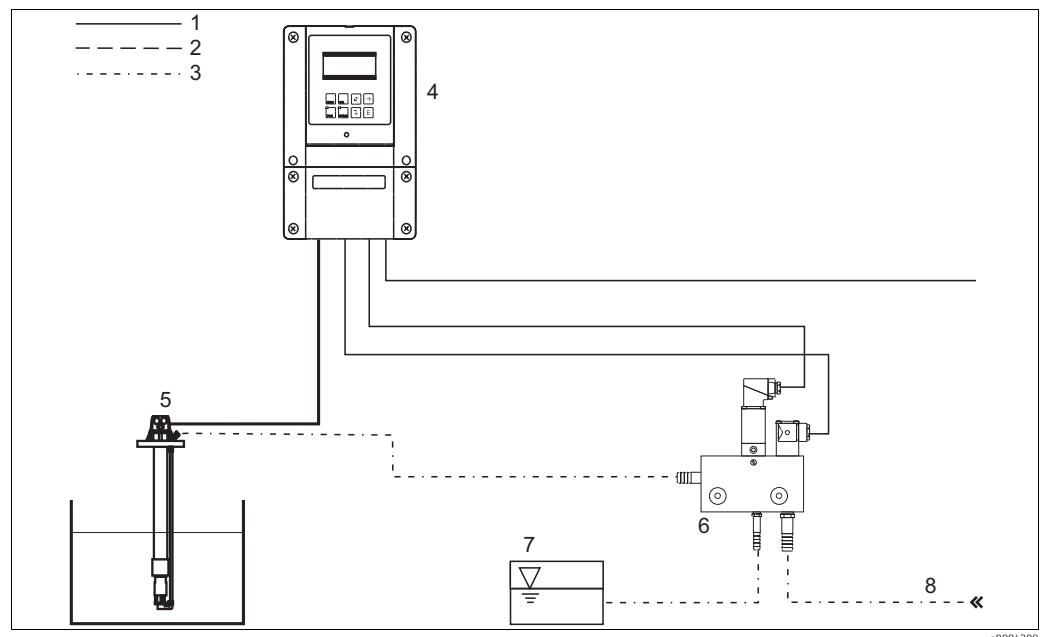


Fig. 51: Chemoclean cleaning

- | | | | |
|---|-----------------------|---|--------------------|
| 1 | Electric cable | 5 | Immersion assembly |
| 2 | Compressed air | 6 | CYR10 injector |
| 3 | Water/cleaning liquid | 7 | Cleaning liquid |
| 4 | Mycom S transmitter | 8 | Motive water |

Operation

- Switch the Chemoclean function on in the "Set up 1 - Relays" menu. Make sure that the corresponding contacts are connected to the injector (see connection examples in the appendix).
- The cleaning cycles are configured in the "Set up 2 - Chemoclean" menu. Here, the automatic or event-controlled cleaning can be adapted to the process conditions. One or more of the following controls are possible:
 - Weekly program (see below): any number of cleaning cycles can be started on each weekday.
 - External control: a start can be triggered via the digital inputs. For this, external control must be activated in the "Select contr. progr." field (Ext. control "On").
 - Power failure: cleaning is started after a power failure.

Manual operation

Rapid onsite cleaning can be performed via manual operation. For this, select > Manual operation > Chemoclean". Press twice ("Start cleaning").

Automatic:

Each day can be programmed individually. For this, select > Set up 2 > Chemoclean > Automatic".

The following programs are available:

- Clean: Cleaning is triggered by entering the start time.
- Interval program: Cleaning is carried out at intervals with a defined spacing. This program cannot be started directly via the binary inputs.
- User: User-defined cleaning programs (create in Program Editor).

Program sequences

Monday: 2 x cleaning (at 11:00 and at 18:00) with water for 120 s, of which 60 s are additionally with cleaner. Between 18:20 and 24:00, clean every 30 min. (= 1800 s) with water for 120 s, of which 60 s are additionally with cleaner.

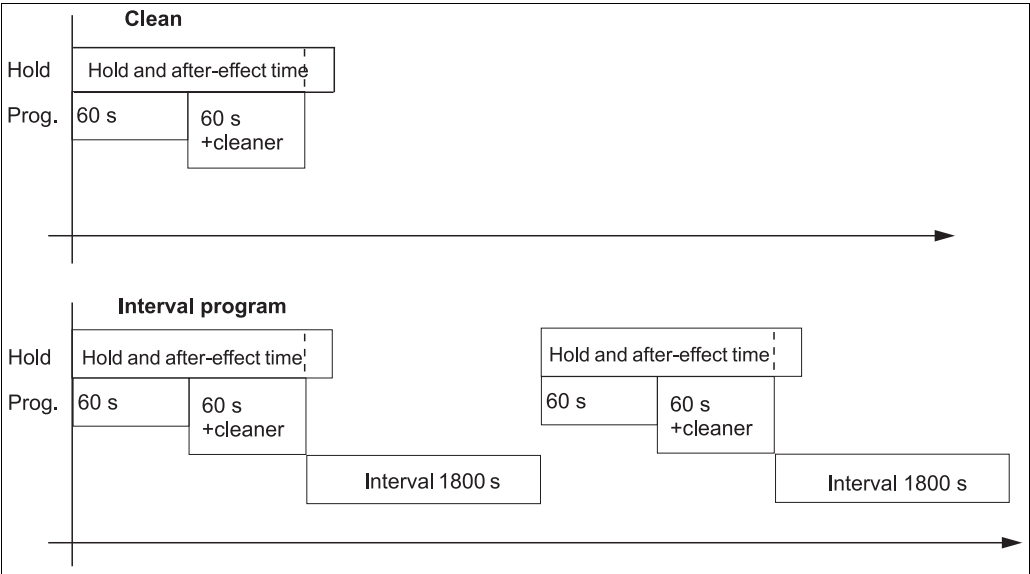


Fig. 52: Graphic representation of the above cleaning example


Required settings according to the example (bold: to be entered by the user):


"Automatic > Weekday > Edit day" field		"Edit prog. > Clean > Setup" field		"Interval program" field	
Clean		01 Water	60 s	Program	Clean
11:00	11:02	02 +Cleaner	60 s	Interval	1800 s
Clean		03 Water	0 s		
18:00	18:02	04 Repeat clean	0 x		
Interval program					
18:20	23:59				

Chemoclean menu

To enter the menu, select:


"PARAM" > Specialist > Set up 2 > Chemoclean"

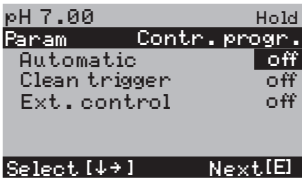




Function	Options	Info
Control programs 	Activation and subsequent entry <ul style="list-style-type: none"> ■ Automatic <ul style="list-style-type: none"> - On - Off ■ Clean trigger <ul style="list-style-type: none"> - On - Off ■ Ext. control <ul style="list-style-type: none"> - On - Off Factory setting Automatic: off Clean trigger: off Ext. control: off	Select the function which will trigger Chemoclean cleaning.
Note	Automatic: off Clean trigger: off Ext. control: off	Current system status
Configuration menu	Selection <ul style="list-style-type: none"> ■ Automatic ■ Interval program ■ Prog. editor Factory setting Automatic	Select the configuration menu. Automatic: You can select cleaning programs for every weekday here. Interval program: Program that starts at defined intervals. Prog. editor: You can adapt the cleaning programs to your needs and preferences here.
Edit the program		
Select program	Selection <ul style="list-style-type: none"> ■ Clean ■ User prog. 	Select the program that you want to edit.
Select the editing function	Selection <ul style="list-style-type: none"> ■ Insert program ■ Edit ■ Set up ■ Prog.time ■ Change name Factory setting Insert program	Select the desired editing function. Insert progr.: You can insert a predefined program into the selected program. Edit: You can add, change or delete program steps. Set up: You can set the times and repeat cycles of the selected program. Prog. time: The total duration of the selected program is displayed. Change name: You can give the selected program any name of your choice.
Program time		
Prog.time	0 to 9999 s	The total duration of the selected program is displayed. The display cannot be edited.
Automatic		
Select the day	Selection <ul style="list-style-type: none"> ■ Monday ■ Wednesday ■ Thursday ■ Friday ■ Saturday ■ Sunday Factory setting Monday	Select the day you that want to edit.



Function	Options	Info
Select the editing function for the day	Selection <ul style="list-style-type: none"> Edit day Copy day Factory setting Edit day	Edit day: You edit the cleaning cycle for the selected day. Copy day: The day selected in the previous field is copied to the day you select in the following field.
Edit day		
Select programs	Activation and subsequent entry <ul style="list-style-type: none"> No progr. Clean 18:22 18:23 Interval 18:24 18:54 Factory setting No prog.	Select the cleaning programs for the day and enter the times for the start of cleaning. If you use the interval program, also enter the time when cleaning should finish. The start and finish times are always displayed. Example: Clean 18:22 (start time) 18:23 (finish time)
Copy day		
Select day	Selection <ul style="list-style-type: none"> Tuesday Wednesday Thursday ... Factory setting Tuesday	Select the day to which you want to copy the day previously selected (e.g. Monday).  Danger of data loss. When one day is copied to another, the cleaning programs of the target day are overwritten.
Interval program		
Select program Enter interval	Activation and subsequent entry <ul style="list-style-type: none"> Program <ul style="list-style-type: none"> Clean User prog. Interval 0 to 36000 s Factory setting Program: Clean Interval: 3600 s	Program: Select the program that should be started at the defined intervals. Interval: Enter the time that should elapse between the end of one program cycle and the start of the next program cycle.
Change name	0 to 9; A to Z	You can enter any name for the interval program.

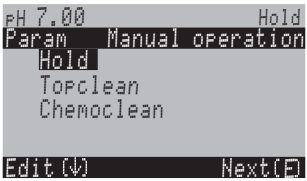7.6.17 Manual operation


To enter the menu, select:






 > Specialist > Manual operation"


Function	Options	Info
Manual operation 	Selection <ul style="list-style-type: none"> ■ Hold ■ Topclean ■ Chemoclean 	You can activate a manual hold, start the Chemoclean program or start the Topclean program. The settings you make here are only active in this menu. Nothing is saved when you leave. You leave the manual operation menu with  ,  or  .
Hold		
Activate hold	Selection <ul style="list-style-type: none"> ■ Hold on ■ Hold off Factory setting Hold off	Activate/deactivate the HOLD. The "HOLD" function freezes the current outputs as soon cleaning/calibration is undertaken.  If the controller function is on current output 2, it behaves as defined in "controller hold" (see also "Set up 1 - Hold" section).
Topclean		
Note	Automatic off Cleaning trigger off Ext. control off	Displays the status of the system.
Select function	Selection <ul style="list-style-type: none"> ■ Retract assembly ■ Start program ■ Stop program 	You can move the assembly manually or start/stop a program.
Retract assembly		
Ass. position	Selection <ul style="list-style-type: none"> ■ Assembly service ■ Assembly meas. 	Select the position into which the assembly should move.
Note	Automatic off Clean trigger off Ext. control off	Displays the status of the system.
Start program		
Select program	Selection <ul style="list-style-type: none"> ■ No prog. ■ Clean ■ Clean S ■ Userprog. 1 to 3 	Select the program that you want to start. If a program is already running, the new program is not started until the program running has finished.
Note	Automatic off Clean trigger off Ext. control off Clean running Water 10s Cleaner 3s	The status of the system is displayed. The program currently running is displayed with the time remaining for water, cleaner etc.
Stop program		
Note	Automatic off Clean trigger off Ext. control off	The current program is stopped. The status of the system is displayed.
Chemoclean		
Note	Automatic: off Clean trigger: off Ext. control: off	System status

Function	Options	Info
Chemoclean cleaning	<div>Selection</div> <div><div>■ No prg.</div><div>■ Clean</div></div> <div>Factory setting</div> <div>No prg.</div>	<div>No prg.: Here, each external program start is suppressed.</div> <div>Clean: Here, you can start the Clean program.</div> <div> Leave this item by pressing .</div>

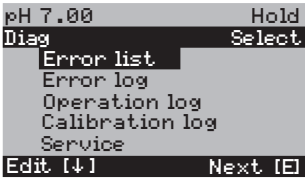


7.7 Diagnosis


To enter the menu, press .

Function	Options	Info
Diagnosis 	Selection <ul style="list-style-type: none"> ■ Error list ■ Error log ■ Operating log ■ Calibration log ■ Ext. sensor data (only for digital sensors with Memosens technology) ■ Service 	Error list: Displays the current active errors. (For a complete error list and a description, see the "Troubleshooting" section). Error log: Lists the 30 errors last reported with the date and time. Operating log: Lists the 30 operating steps last recorded with the date and time. Calibration log: Lists the last 30 calibrations performed with the date and time. Ext. sensor data: Lists the data saved in the sensor, e.g. sensor identification, calibration data, hours of operation etc. Note the following points: <ul style="list-style-type: none"> ■ Use the arrow keys to scroll through the lists. ■ Leave the lists by pressing .
Calibration log		
Calibration data	<ul style="list-style-type: none"> ■ 1 Enter spec. buffer ■ Zero point ■ Slope ■ El. condit. ■ <Date> <time> 	1 Enter spec. buffer: Displays the calibration method used. Zero point: Displays the zero point calculated during calibration. Slope: Displays the slope calculated during calibration. Electrode condition: Displays the electrode condition. <Date> <time>: Displays the date and time of the calibration.
If you are using a digital sensor with Memosens functionality, the following data are displayed when you press  :		
	<ul style="list-style-type: none"> ■ SNR ■ Sensor change date ■ <Date> <time> 	Displays the serial number of the calibrated sensor and the date and time of the sensor change.
Ext. sensor data (only for sensors with Memosens technology) The transmitter indicates that data are being read from the sensor. When reading is finished, the display automatically switches to the next menu point. If the system does not switch automatically, you can call up the data last read out by pressing  or return to measuring operation by pressing  .		
Data of the digital sensor	Selection <ul style="list-style-type: none"> ■ Identification ■ Calibration data ■ Comp. temperature ■ Sensor status ■ Sensor info 	Select the data which are stored the digital sensor and are to be displayed.
Identification		
Manufacturer data	<ul style="list-style-type: none"> ■ ID ■ SW ID ■ HW version ■ SW version 	ID: Displays the module ID of the sensor. SW ID: Displays the software ID of the sensor. HW version: Displays the hardware version of the digital sensor. SW version: Displays the software version of the digital sensor.
	<ul style="list-style-type: none"> ■ Check date ■ SAP ■ SN 	Check date: Displays the date of the sensor's factory inspection. SAP: Displays the SAP number of the sensor. SN: Displays the serial number of the sensor electronics.

Function	Options	Info
Calibration data		
	<p>pH:</p> <ul style="list-style-type: none"> ■ Slope ■ Isoth. point. <ul style="list-style-type: none"> – pH – mV ■ C-ZeroPnt <p>ORP:</p> <ul style="list-style-type: none"> ■ Offset ■ Buffer ■ D. Ist. Cl. 	<p>Slope: Displays the slope of the sensor.</p> <p>Isoth. point: Displays the mV and pH components of the isothermic intersection point.</p> <p>C-zero pnt: Displays the chain zero point of the digital sensor.</p> <p>Offset: Displays the calibrated ORP offset.</p> <p>Buffer: Displays the value of the buffer.</p> <p>D. Ist. cal.: Displays the difference to the last calibration.</p>
	<ul style="list-style-type: none"> ■ Method ■ No. of cal. ■ Snlc ■ Calibration date 	<p>Method: Displays the method that was used to calibrate the digital sensor. Select the calibration method in the "Set up 1 > Calibration" menu.</p> <p>No. of cal.: Displays the number of calibrations carried out with the digital sensor.</p> <p>Snlc: Displays the serial number of the transmitter with which the last calibration was performed.</p> <p>Calibration date: Displays the date of the last calibration of the digital sensor.</p>
	<ul style="list-style-type: none"> ■ Buffer 1 ■ Buffer 2 ■ D. slp ■ D. zropnt 	<p>Only available for digital pH sensors.</p> <p>Buffer 1: Displays the pH value of the first buffer that was used in the last calibration.</p> <p>Buffer 2: Displays the pH value of the second buffer that was used in the last calibration.</p> <p>D. slp: Displays the change in the slope compared to the preceding calibration.</p> <p>D. zropnt: Displays the change in the chain zero point compared to the preceding calibration.</p>
Temperature compensation		
Temperature offset	<ul style="list-style-type: none"> ■ Offset ■ Snlc ■ Calibration date 	<p>Offset: Displays the calibrated temperature offset.</p> <p>Snlc: Displays the serial number of the transmitter with which the last temperature calibration was performed.</p> <p>Cal. date: Displays the date of the last temperature calibration</p>
Sensor status		
	<ul style="list-style-type: none"> ■ Period ■ No. of steril. ■ T (max) 	<p>Period: Displays the total hours of operation of the sensor.</p> <p>No. of steril.: Displays the number of sterilizations performed on the sensor: T > 121 °C (250 °F), at least 20 min.</p> <p>T (max): Displays the maximum temperature at which the sensor was operated.</p> <p> During a sterilization (T > 135 °C (275 °F)) the transmitter goes to Hold and the display shows "SIP" (Sterilization in place).</p>


Function	Options	Info
	Time of operation (h) <ul style="list-style-type: none"> Over 80 °C Over 100 °C < - 300 mV (only pH) > 300 mV (only pH) 	Operating hours of the sensor under the following conditions: <ul style="list-style-type: none"> Operating hours of the sensor at temperatures over 80 °C (176 °F) Operating hours of the sensor at temperatures over 100 °C (212 °F) Operating hours of the sensor at a pH value below -300 mV (= pH 12 @ 25 °C (77 °F)) Operating hours of the sensor at a pH value over +300 mV (= pH 2 @ 25 °C (77 °F))
	<ul style="list-style-type: none"> 1st use Ri GSCS (only pH) 	1st use: Displays when the sensor was connected to a transmitter for the first time. Ri GSCS: Displays the current membrane resistance.
Sensor info		
Range of application	<ul style="list-style-type: none"> Max. rng. Min. rng. Max. temp. Min. temp. 	Max. rng.: Maximum measured value in the sensor application range Min. rng.: Minimum measured value in the sensor application range Max. temp.: Maximum temperature in the sensor application range Min. temp.: Minimum temperature in the sensor application range
Order data	<ul style="list-style-type: none"> Order code OVSN Check date 	Order code: Order code of the sensor OVSN: Overall serial number of the sensor Check date: Displays the date of the sensor's factory inspection.
Service		
Service diagnosis	Selection <ul style="list-style-type: none"> Factory reset Simulation Instrument check DAT download Set up 2 Instrument version Topclean Chemoclean Reset count 	Factory reset: Different data groups can be reset to the factory settings. Simulation: The transmitter behavior can be simulated after entering various parameters. Instrument check: The device functions (display, keys, etc.) can be tested individually. DAT download: Copy data from/into the DAT module. Set up 2: ISFET values and SCS values Instrument version: Device-internal data e.g. serial number can be queried. Topclean S: Test programs, inputs, hardware. Chemoclean (only if the complete ChemoClean function is activated): test programs, inputs, hardware. Reset count: Counter for the number of resets, write access

Function	Options	Info
Factory settings		
Set default	Selection <ul style="list-style-type: none"> ■ Abort ■ Start up data ■ Calibration data ■ Complete reset ■ CPC data ■ Service data ■ Operation log ■ Error log ■ Calibration log 	<p>Here you can select the data which you wish to reset to the factory settings.</p> <p> Danger of data loss. Selecting a point and confirming with  deletes the settings you made in this area! Selecting "Abort" leaves this field without changing the values.</p> <p>Calibration data: All data saved for calibrations such as zero point, slope, and offset</p> <p>Startup data: The remaining data to be set</p> <p>Complete reset: Calibration data + startup data</p> <p>CPC data: Topclean configuration, e.g. cycles of cleaning programs</p> <p>Service data: All data + logs + reset counters</p> <p> Service data / logbooks: These functions are only for authorized service personnel. The service code is required. You can request the service code from Endress+Hauser.</p>
Simulation		
Simulation of current outputs	Activation and subsequent entry <ul style="list-style-type: none"> ■ Simulation <ul style="list-style-type: none"> - On - Off ■ Output 1 0.0 to 22.0 mA ■ Output 2 0.0 to 22.0 mA <p>Factory setting Simulation: off Output 1: 0.0 mA Output 2: 0.0 mA</p>	<p>Adjust the simulation of the current outputs.</p> <p>Simulation off: The frozen values from the last measurement are used for simulation.</p> <p>Simulation on: The current values for the outputs can be changed for the simulation (output 1, output 2).</p>
Simulation of measured value, temperature	Activation and subsequent entry <ul style="list-style-type: none"> ■ Simulation <ul style="list-style-type: none"> - On - Off ■ pH/mV 1 -2.00 to 16.00 pH ■ Temperature -50 to +150 °C <p>Factory setting Simulation: off pH/mV 1: 7.00 pH Temperature: 25.0 °C</p>	<p>Adjust the simulation of the measured values and the temperature.</p> <p>Simulation off: The frozen values from the last measurement are used for simulation.</p> <p>Simulation on: The values can be changed for the simulation.</p>

Function	Options	Info
Simulation of relays	Activation and subsequent entry <ul style="list-style-type: none"> ■ Simulation <ul style="list-style-type: none"> – On – Off ■ Alarm relay <ul style="list-style-type: none"> – On – Off ■ Relay 1 <ul style="list-style-type: none"> – On – Off ■ Relay 2 <ul style="list-style-type: none"> – On – Off Factory setting Simulation: off Alarm relay: off Relay 1/2: off	Adjust the simulation of the relays. Simulation off: The last states are frozen and used for simulation. Simulation on: The contacts (= relays) can either be opened (on) or closed (off).  If you return to the measurement mode with the simulation switched on, "Simul" and "Hold" flash in the display.
Instrument check		
Select test	Selection <ul style="list-style-type: none"> ■ Display ■ Keypad ■ RAM ■ EEPROM ■ Flash 	You can check the function of the transmitter with the device check. Display: All the fields are queried alternately. Defective cells become visible. Keypad: All the keys must be pressed one after the other. If the system is functioning perfectly, the appropriate symbols appear in the display. RAM: "RAM O.K." message if there are no errors. EEPROM: "EEPROM O.K." message if there are no errors. Flash (memory): "Flash O.K." message if there are no errors.
DAT download (only available when DAT module is plugged in)		
DAT operation	Selection <ul style="list-style-type: none"> ■ DAT write ■ DAT read ■ Erase DAT 	Select the desired DAT process DAT write: You save the both the configuration and the logbooks of your transmitter to the DAT module. A security message appears, stating that all the data on the DAT will be overwritten. After confirming, the process of backing up to the DAT memory module is started. DAT read: You copy the configuration that is saved on the DAT memory module to the EEPROM in the transmitter. A security message appears, stating that all the data in the transmitter will be overwritten. After confirming, the process of copying from the DAT memory module is started. Erase DAT: You delete all the data on the DAT memory module. A security message appears, stating that all the data on the DAT will be erased. The data are erased once the message is confirmed.

Function	Options	Info
Set up 2		
Select Set up 2	Selection <ul style="list-style-type: none"> ■ Reset ■ ISFET (only with ISFET sensors) ■ SCS reading 	Display the sensor data. ISFET: Displays the current ISFET sensor data <ul style="list-style-type: none"> ■ Reference [mV] ■ Leak current [μA] SCS reading: Displays the current values of the sensor check system SCS <ul style="list-style-type: none"> ■ Impedance of glass electrode [$M\Omega$] ■ Impedance of reference electrode [$k\Omega$]
Instrument version		
Controller	<ul style="list-style-type: none"> ■ SW version 1.20-xx ■ HW version 1.00 ■ Serial no. 12345678 ■ Card ID M3Cxxx 	You can call up the controller data here. The software version refers to the current device overall software.
Motherboard	<ul style="list-style-type: none"> ■ SW version - - - - ■ HW version 1.00 ■ Serial no. 12345678 ■ Card ID M3G-xx ■ Non-Ex 	You can call up the motherboard data here.
Connector PCB	<ul style="list-style-type: none"> ■ SW version - - - - ■ HW version 1.04 ■ Serial no. 12345678 ■ Card ID M3K-xx 	You can call up the connector PCB data here.
Transmitter	<ul style="list-style-type: none"> ■ SW version 1.22 ■ HW version 1.11 ■ Serial no. 12345678 ■ Card ID MKPx ■ Ex 	You can call up the transmitter module data here.
Relay	<ul style="list-style-type: none"> ■ SW version - - - - ■ HW version 1.00 ■ Serial no. 12345678 ■ Card ID M3R-xx ■ Ex 	You can call up the relay module data here.

Function	Options	Info
Sensor	<ul style="list-style-type: none"> ■ SW version 1.20 ■ HW version 1.00 ■ Serial no. 12345678 ■ ID KSG1 ■ SW ID 1.1.1 ■ Check date xx.xx.xx 	You can call up the sensor data here if you are using digital sensors with Memosens technology.
Serial number for Mycom S	123A567890Z234	You can call up the serial number of the device here; 14-digit number with digits 0 to 9 and A to Z.
Order code for Mycom S	CPM153-A2B00A010	You can call up the order code of the device here; 15-digit code with digits 0 to 9 and A to Z.
CPC data	<ul style="list-style-type: none"> ■ SW version 1.20 ■ HW version 1.00 ■ Serial no. 12345678 ■ Card ID CPGxxx 	You can call up the control unit data here.
Serial number for CPG30	12345678901234	You can call up the serial number of the control unit here; 14-digit number with digits 0 to 9 and A to Z.
Order code for Topclean S	CPC30-A2B00A010	You can call up the order code of the device here; 15-digit code with digits 0 to 9 and A to Z.
Topclean S		
Note	Automatic off Cleaning trigger off Ext. control off	Displays the status of the system.
Component for diagnosis	Selection <ul style="list-style-type: none"> ■ Ext. inputs ■ Hardware 	Select the system component whose status you want to check or change.
Ext. inputs		
Note	Start no prog. AutoStop off Wait trigger off Measuring off Service off	The status of the external digital inputs is displayed.
Hardware		
Valve test	Selection <ul style="list-style-type: none"> ■ Assembly ■ Cleaner ■ Water ■ Compressed air ■ Valve 1 ■ Valve 2 	Select the component to be tested.
Note	Assembly ↑ Service End function Topclean S ready	The component selected previously is tested.

Function	Options	Info
Chemoclean		
Note	Automatic: off Clean trigger: off Ext. control: off	The status of the system is displayed.
Note	With E running program is aborted.	If a Chemoclean program is currently running, you must abort the program with  to be able to perform the diagnosis.
Chemoclean diagnosis	Selection <ul style="list-style-type: none"> ■ Ext. inputs ■ Hardware 	Ext. inputs: The status of the external digital inputs is displayed. Hardware: Select a function to be tested: <ul style="list-style-type: none"> ■ Water ■ Cleaner ■ Water and cleaner
Reset count		
Reset count	0	The number of resets is displayed here. The reset counter is only triggered by the watchdog. You can reset it via "Set default > Service data".
Write count	0	The number of write accesses to the EEPROM is displayed here.


7.8 Calibration

Calibration is required:


- After replacing the electrode
- After periods of downtime (note: a pH glass electrode should never be stored dry!)
- At suitable intervals, depending on the individual process. The necessary interval can range from several times a day to once a quarter. At the start, calibrate more frequently and record the results in the operations log. The data of the last 30 calibrations are also stored in the calibration log. Gradually extend the intervals depending on the deviations that are discovered during the calibration.

The calibration can be protected with the maintenance and the specialist codes. No calibration can be carried out at the display level (see the "Set up 1 - Access codes" section for this purpose).

Procedure

1. If you have not yet configured any initial settings for local calibration, please do so in the  > Set up 1 > Calibration" menu.
2. Set the service switch to "Service" (vertical) or move the assembly into the Service position
3. Remove the sensor.
4. Clean the sensor before calibration.

Note the following points:

- For measurements with PM (potential matching), the PA line must also be immersed in the buffer solution.
- If automatic temperature compensation is selected for calibration (ATC), the corresponding temperature sensor must also be immersed in the buffer solution.
- The device switches automatically to Hold (factory setting) whenever it is calibrated.
- Press  to cancel the calibration. In the dialog field that follows, select "Yes, cancel cal."

The following section describes the calibration procedures for:

pH calibration

- "Manual data entry"
- "Manual calibration with buffer"
- "Calibration with fixed buffer"
- "Calibration with automatic buffer recognition"

ORP absolute calibration

- "Absolute data entry"
- "Absolute calibration"

ORP relative calibration





- "Absolute data entry"
- "Relative data entry"
- "Absolute calibration"
- "Relative calibration"

7.8.1 pH calibration

Manual data entry

The values for sensor zero point and slope are entered manually.

Press  to start calibration.

Function	Options	Info
Note	Calibration with data entry	The type of onsite calibration selected in the calibration settings is displayed.
Temperature	-20.0 to 150.0 °C Factory setting 25.0 °C	Specify the temperature at which calibration takes place (only for "Calibration with MTC"). Press  to confirm.
Zero point	-2.00 to 16.00 pH Factory setting 7.00 pH	Enter the zero point of the electrode. Press 
Slope	5.00 to 99.00 mV / pH Factory setting 59.16 mV/pH	Enter the slope of the electrode. Press 
Calibration	Selection <ul style="list-style-type: none"> ■ Accept ■ Cancel ■ Repeat calibration 	End of calibration Accept: When you confirm with  , the new calibration data are accepted. Cancel: The data are not accepted. Calibration is not repeated. Repeat calibration: The data are rejected and calibration is repeated.
Sensor communication	Waiting for sensor response ...	(digital sensors with Memosens technology only) The transmitter transmits calibration data to the sensor.
Note	<ul style="list-style-type: none"> ■ Data saved ■ Data not saved 	(digital sensors with Memosens technology only) Indicates whether the calibration data could be saved in the sensor. Calibrate the sensor again if the process of saving the data failed.
Note	Electrode submersed?	Ensure that the electrode is in the medium again so measuring can take place.

Manual calibration with buffer, calibration with buffer table, calibration with automatic buffer recognition

- Manual buffer:

The buffer pH value is entered manually. The display then shows the current measured value.








- Buffer table:

In the Calibration menu, you can set two buffer solutions or define them yourself. The selected pH value and buffer type are displayed.

- Automatic buffer recognition:

The device automatically recognizes the buffer used. Preselect the buffer types (e.g. E+H) in the Calibration menu.

Press  to start calibration.



Function	Options	Info
Note	Calibration with manual buffer, (with buffer table/automatic buffer recognition)	The type of onsite calibration selected in the calibration settings is displayed.
Temperature	-20.0 to 150.0 °C Factory setting 25.0 °C	Specify the temperature at which calibration takes place (only for "Calibration with MTC"). Press  to confirm.
Buffer temperature	-20.0 to 150.0 °C Factory setting 25.0 °C	Enter the buffer temperature (only for "Cal with MTC"). Press  to confirm.
Handling instructions	Immerse: pH electrode in buffer 1	Immerse the electrode in buffer 1. Press  to confirm.
Buffer pH value	-2.00 to 16.00 pH Factory setting 7.00 pH	Only for "Manual buffer". Enter the pH value of buffer 1. Press  to confirm.
Stability check	Threshold: 1 to 10 mV Factory setting 2 mV Length: 10 s Factory setting 3 to 70 s	Wait until the pH measurement is stable: Time does not count down. pH value no longer flashes. mV value no longer flashes. Once these values are stable, confirm with  .  Specify the criteria for the stability check in the "Set up 1 > Calibration > Cal settings" menu.
The three previous steps are carried out for buffer 2.		
Calibration value notice	Invalid calibration value	If an error occurs, (e.g. incorrect buffer used), this message is displayed.
Zero point, slope notice	<ul style="list-style-type: none"> Zero point: 7.00 Good Slope: 59.00 Good 	Information on the zero point, slope and quality of the calibration is displayed here.
Electrode condition notice	Electrode condition: good	There are three status messages for the electrode status: "good", "OK", "bad". If the status is displayed "bad", electrode replacement is recommended to ensure the quality of the pH measurement.
Calibration	Selection <ul style="list-style-type: none"> Accept Cancel Repeat calibration 	End of calibration Accept: When you confirm with  , the new calibration data are accepted. Cancel: The data are not accepted. Calibration is not repeated. Repeat calibration: The data are rejected and calibration is repeated.
Sensor communication	Waiting for sensor response ...	(digital sensors with Memosens technology only) The transmitter transmits calibration data to the sensor.
Note	<ul style="list-style-type: none"> Data saved Data not saved 	(digital sensors with Memosens technology only) Indicates whether the calibration data could be saved in the sensor. Calibrate the sensor again if the process of saving the data failed.
Note	Electrode in medium?	Ensure that the electrode is in the medium again so measuring can take place.

7.8.2 ORP calibration

Absolute data entry

The transmitter has a calibrated mV display range. One absolute mV value is set with a single buffer solution (adaptation of the measuring chain offset). A buffer solution preferably with 225 or 475 mV is used.






Press  to start calibration.

Function	Options	Info
Note	Calibration with abs. data entry	The type of onsite calibration selected in the calibration settings is displayed.
Offset	-1500 to +1500 mV Factory setting 0000 mV	Enter the mV value for the electrode offset (electrode offset = deviation of the measured value display from the indicated buffer solution mV value). Press  to confirm. The entered value is effective immediately. The maximum offset is 400 mV.
Note	Offset too high	Error message if the entered offset leaves the maximum range.
Calibration	Selection <ul style="list-style-type: none"> ■ Accept ■ Cancel ■ Repeat calibration 	End of calibration Accept: When you confirm with  , the new calibration data are accepted. Cancel: The data are not accepted. Calibration is not repeated. Repeat calibration: The data are rejected and calibration is repeated.
Sensor communication	Waiting for sensor response ...	(digital sensors with Memosens technology only) The transmitter transmits calibration data to the sensor.
Note	<ul style="list-style-type: none"> ■ Data saved ■ Data not saved 	(digital sensors with Memosens technology only) Indicates whether the calibration data could be saved in the sensor. Calibrate the sensor again if the process of saving the data failed.
Note	Electrode in medium?	Ensure that the electrode is in the medium again so measuring can take place.

Absolute calibration

The transmitter has a calibrated mV display range. One absolute mV value is set with a single buffer solution (adaptation of the measuring chain offset). A buffer solution preferably with 225 or 475 mV is used.

Press  to start calibration.

Function	Options	Info
Note	Calibration with abs. calibration	The type of onsite calibration selected in the calibration settings is displayed.
Handling instructions	Immerse: Electrode in buffer	Immerse the electrode into the buffer. Press  to confirm.
Buffer mV value	-1500 to 1500 mV Factory setting 0225 mV	Enter the buffer mV value. Press  to confirm.
Stability check	Threshold: 1 to 10 mV Factory setting 2 mV Length: 10 s Factory setting 3 to 70 s	Wait until the measurement is stable: Time does not count down. mV value no longer flashes. Once these values are stable, confirm with  .  Specify the criteria for the stability check in the "Set up 1 > Calibration > Cal settings" menu.
Calibration value notice	Invalid calibration value	If an error occurs, (e.g. incorrect buffer used), this message is displayed.
Offset notice	Offset: 0005 mV Good	Information on the offset and quality of the calibration is displayed here.
Calibration	Selection <ul style="list-style-type: none"> ■ Accept ■ Cancel ■ Repeat calibration 	End of calibration Accept: When you confirm with  , the new calibration data are accepted. Cancel: The data are not accepted. Calibration is not repeated. Repeat calibration: The data are rejected and calibration is repeated.
Sensor communication	Waiting for sensor response ...	(digital sensors with Memosens technology only) The transmitter transmits calibration data to the sensor.
Note	<ul style="list-style-type: none"> ■ Data saved ■ Data not saved 	(digital sensors with Memosens technology only) Indicates whether the calibration data could be saved in the sensor. Calibrate the sensor again if the process of saving the data failed.
Note	Electrode in medium?	Ensure that the electrode is in the medium again so measuring can take place.

Relative data input (only for ORP relative)

Entry of two % calibration points to which one mV value is assigned.


Press to start calibration.










Function	Options	Info
Note	Calibration with rel. data entry	The type of onsite calibration selected in the calibration settings is displayed.
Calibration points	Activation and subsequent entry <ul style="list-style-type: none"> ■ 0 to 30% <ul style="list-style-type: none"> ■ Voltage -1500 to +1500 mV ■ 70 to 100% <ul style="list-style-type: none"> ■ Voltage -1500 to +1500 mV Factory setting 20 % Voltage: 0600 mV 80 % Voltage: -600 mV	In this field, create two measured value pairs (pair 1 and pair 2). Measured value pair 1 in the range 0 to 30 %: assign, for example, the voltage 0600 mV to the percentage value 20 %. Measured value pair 2 in the range 70 to 100 %: assign, for example, the voltage -0600 mV to the percentage value 80 %. The settings made are effective immediately after confirming with <input type="button" value="E"/> .
Note	Offset too high	Error message if the entered offset leaves the maximum range.
Calibration	Selection <ul style="list-style-type: none"> ■ Accept ■ Cancel ■ Repeat calibration 	End of calibration Accept: When you confirm with <input type="button" value="E"/> , the new calibration data are accepted. Cancel: The data are not accepted. Calibration is not repeated. Repeat calibration: The data are rejected and calibration is repeated.
Sensor communication	Waiting for sensor response ...	(digital sensors with Memosens technology only) The transmitter transmits calibration data to the sensor.
Note	<ul style="list-style-type: none"> ■ Data saved ■ Data not saved 	(digital sensors with Memosens technology only) Indicates whether the calibration data could be saved in the sensor. Calibrate the sensor again if the process of saving the data failed.
Note	Electrode in medium?	Ensure that the electrode is in the medium again so measuring can take place.

Relative calibration (only for ORP relative)

For calibration, two tanks are filled with a sample of the medium. The contents of the first tank are detoxified and called calibration solution 1.

The contents of the second tank are left unchanged and are called calibration solution 2.

Press  to start calibration.

Function	Options	Info
Note	Calibration with rel. calibration	The type of onsite calibration selected in the calibration settings is displayed.
Handling instructions	Immerse: Electrode in buffer	Immerse the electrode in the detoxified sample. Press  to confirm.
% value buffer	0 to 30% Factory setting 20 %	Enter the relative ORP value of the detoxified sample. Press  to confirm.
Stability check	Threshold: 1 to 10 mV Factory setting 2 mV Length: 10 s Factory setting 3 to 70 s	Wait until the measurement is stable: Time does not count down. mV value no longer flashes. Once these values are stable, confirm with  .  Specify the criteria for the stability check in the "Set up 1 > Calibration > Cal settings" menu.
Handling instructions	Immerse: Electrode in buffer	Immerse the electrode in the unaltered sample. Press 
% value buffer	70 to 100% Factory setting 80 %	Enter the relative ORP value of the unaltered sample. Press  to confirm.
Stability check	<ul style="list-style-type: none"> ■ Time: 10 s ■ mV 1: 0 	Wait until the measurement is stable: Time does not count down. mV value no longer flashes. Once these values are stable, confirm with  .  Specify the criteria for the stability check in the "Set up 1 > Calibration > Cal settings" menu.
Calibration value notice	Invalid calibration value	If an error occurs, (e.g. offset too large), this message is displayed.
Offset notice	Offset: 0005 mV Good	Information on the offset and quality of the calibration is displayed here.
Calibration	Selection <ul style="list-style-type: none"> ■ Accept ■ Cancel ■ Repeat calibration 	End of calibration Accept: When you confirm with  , the new calibration data are accepted. Cancel: The data are not accepted. Calibration is not repeated. Repeat calibration: The data are rejected and calibration is repeated.
Sensor communication	Waiting for sensor response ...	(digital sensors with Memosens technology only) The transmitter transmits calibration data to the sensor.
Note	<ul style="list-style-type: none"> ■ Data saved ■ Data not saved 	(digital sensors with Memosens technology only) Indicates whether the calibration data could be saved in the sensor. Calibrate the sensor again if the process of saving the data failed.

Function	Options	Info
Note	Electrode in medium?	Ensure that the electrode is in the medium again so measuring can take place.

8 Diagnostics and troubleshooting

8.1 Troubleshooting instructions

The transmitter constantly monitors its functions itself. If an error occurs which the device recognizes, this is indicated on the display. The error number is under the unit displayed for the main measured value. If more than one error occurs, you can call these up with the MINUS key.


Refer to the "System error messages" table for the possible error numbers and remedial measures.

Should a malfunction occur without any transmitter error message, please refer to the "Process-related errors" or the "Device-related errors" tables to locate and rectify the error. These tables provide you with additional information on any spare parts required.

8.2 System error messages

In the following error list, you can find a description of all the error numbers occurring. For each error number there is also information on whether the factory setting (= Fact.) of this error triggers:

- an alarm
- an error current
- cleaning

To open the error list, select  > error list.

- The errors are processed in the Alarm menu.
- The second column shows the assignment according to NAMUR work sheet NA64 (failure, maintenance or function check).

Error no.	NAMUR class	Error message	Possible causes/measures	Alarm contact		Error current		Autom. cleaning start	
				Fact.	User	Fact.	User	Fact.	User
E001	Failure	Memory error	Switch device off and on. Where necessary, perform "Set default" under "Diagnosis > Service".	yes		no		—	—
E002	Failure	Data error in EEPROM	If necessary corrective maintenance at factory.	yes		no		—	—
E003	Failure	Invalid configuration	Repeat download.	yes		no		—	
E004	Failure	Incompatible hardware	Module does not match device configuration (e.g. non-Ex module in a device approved for use in explosion hazardous areas).	yes		no		—	
E005	Failure	Unknown CPG ID	Control unit is not recognized. Control unit is not compatible with Mycom S software.	yes		no		—	—
E007	Failure	Error transmitter	Test with a new transmitter	yes		no		—	—
E008	Failure	Glass breakage electrode 1	Impedance of pH glass membrane too low: Check pH sensor, renew if necessary. For ISFET sensor: Leak current > 400 nA. Replace sensor.	yes		no		no	
E010	Failure	Error temperature sensor	Check temperature sensor, sensor type and wiring; where necessary, check transmitter with temperature simulator. ISFET: Check the correct temperature sensor has been selected.	yes		no		no	
E012	Failure	Communication error CPC	Check Topclean S connecting cable.	yes		no		no	

Error no.	NAMUR class	Error message	Possible causes/measures	Alarm contact		Error current		Autom. cleaning start	
				Fact.	User	Fact.	User	Fact.	User
E013	Failure	Assembly did not reach service position	Check assembly position and feedback signals, compressed air present?	yes		no		no	
E014	Failure	Assembly did not reach measuring position	Check the pneumatic hoses to the assembly, assembly mechanically blocked? External power supply 24 V / 220 V (not supply from Mycom) present? Microfuse may be blown.	yes		no		no	
E017	Failure	Error CPC EEPROM	Switch device off and on. Where necessary, perform "Set default" under "Diagnosis > Service". If necessary corrective maintenance at factory.	yes		no		—	—
E024	Failure	CPC program aborted	Control input 87/88 switched: Check ext. control criteria.	yes		no		no	
E027	Failure	Error air supply	Pressure below permitted minimum Connected incorrectly, test: term. D3/D4, Pressure > 2 bar, contact closed: 0 V; Pressure < 2 bar, contact open: 3.2 V	yes		no		no	
E029	Failure	Self-test failure sensor	Error detected during digital sensor self test. Check sensor, replace where necessary.	yes		no		—	
E030	Failure	SCS error reference	Reference impedance too high: check reference element, replace reference or combination electrode where necessary. For ISFET sensor: Leak current > 400 nA	yes		no		—	—
E032	Failure	Slope error sensor 1	Sensor aged or defective; Reference aged, defective or diaphragm blocked;	yes		no		—	—
E033	Failure	Zero point error sensor 1	Buffer solutions too old or contaminated; PML not in the buffer solutions	yes		no		—	—
E034	Failure	Offset error sensor 1		yes		no		—	—
E040	Maintenance	SCC condition electrode 1 bad	Check sensor, replace if necessary; clean where required (deposit buildup on glass membrane or glass membrane run dry; diaphragm blocked)	yes		no		—	
E043	Maintenance	Distance of buffers input 1 too small	Wrong buffers used; buffer entry incorrect; automatic buffer recognition defective	yes		no		—	
E044	Maintenance	Input 1 not stable	PML missing; sensor too old; sensor sometimes dry; cable or plug defective.	yes		no		—	
E045	Failure	Calibration aborted	Repeat calibration and renew buffer solution; replace electrode where necessary.	yes		no		—	
E053	Failure	Actuator failure		yes		no		—	—
E054	Maintenance	Dose time alarm	Dosage time exceeded at total dosage. Dosage interrupted, dosing agent empty or process too inconsistent.	yes		no		—	—
E055	Failure	Under range pH/mV input 1	Measuring line broken; sensor in air or air cushion in assembly,	yes		no		no	
E057	Failure	Over range pH/mV input 1	Potential matching missing in symmetrical measurement; static charging in media with lowest conductivity.	yes		no		no	
E059	Failure	Under range temperature input 1	Temperature sensor defective; Sensor line interrupted or short-circuited;	yes		no		no	
E061	Failure	Over range temperature input 1	Wrong sensor type selected.	yes		no		no	




Error no.	NAMUR class	Error message	Possible causes/measures	Alarm contact		Error current		Autom. cleaning start	
				Fact.	User	Fact.	User	Fact.	User
E063	Maintenance	0/4 mA limit output 1	Measured value outside specified current range:	yes		no		no	
E064	Maintenance	20 mA limit output 1	Check plausibility of measured value;	yes		no		no	
E065	Maintenance	0/4 mA limit output 2	Where necessary, adjust current output assignment for 0/4 mA and/or 20 mA	yes		no		no	
E066	Maintenance	20 mA limit output 2		yes		no		no	
E067	Maintenance	Set point exceeded controller / GWG 1	Dosing devices defective; chemical supply empty;	yes		no		no	
E068	Maintenance	Set point exceeded controller / GWG 2	Measured value incorrect -> check plausibility and function;	yes		no		no	
E069	Maintenance	Set point exceeded controller / GWG 3	Incorrect control direction set; Incorrect relay assigned;	yes		no		no	
E070	Maintenance	Set point exceeded controller / GWG 4	Incorrect control function assigned.	yes		no		no	
E071	Maintenance	Set point exceeded controller / GWG 5		yes		no		no	
E073	Failure	Temperature 1 outside table	Check plausibility of temperature value; adjust or extend table where necessary.	yes		no		no	
E074	Failure	Temperature 2 outside table		yes		no		no	
E075	Failure	Temperature 1 outside table		yes		no		no	
E076	Failure	Temperature 2 outside table		yes		no		no	
E080	Maintenance	Current output range 1 too small	Increase measuring range span for current output assignment.	yes		no		no	
E081	Maintenance	Current output range 2 too small		yes		no		no	
E090	Function check	CPG service switch on	Check on CPG if service was actually carried out.	yes		no		no	
E095	Failure	Incompatible hardware sensor	Digital sensor not compatible with transmitter; It may be that the Ex-version of the sensor is combined with the non-Ex version of the transmitter or vice versa.	yes		no		no	
E100	Function check	Current output simulation on	Check if functions are intentionally selected.	yes		no		no	
E101	Function check	Service function on		yes		no		no	
E106	Function check	Download active	Wait for download to finish.	yes		no		no	
E116	Failure	Download error	Repeat download.	yes		no		no	
E117	Failure	DAT memory module data error	Check with other DAT memory module; when writing to DAT: repeat write process.	yes		no		—	—
E127	Failure	Sensor power fail	Sensor communication established but sensor does not have enough power. Check whether the Memosens connection is correctly inserted and locked.	yes		no		—	
E147	Failure	Sensor communication error	Digital sensor is not correctly plugged in or wired. The transmitter goes into hold. The hold is disabled if the sensor is correctly plugged in or wired and transmits measured values.	no		no		no	

Error no.	NAMUR class	Error message	Possible causes/measures	Alarm contact		Error current		Autom. cleaning start	
				Fact.	User	Fact.	User	Fact.	User
E152	Maintenance	PCS Alarm	Sensor defective or totally contaminated; water flow in bypass interrupted; Air cushion in assembly; measuring line interrupted; Dosing element defective, chemicals empty.	yes		no		no	
E156	Function check	Calibration timed out	Time for calibration!	yes		no		no	
E164	Failure	pH input range 1 over range	Check cable and sensor. Leak current > 200 nA. Early warning. Work can be continued until error E008/E009 occurs.	yes		no		—	
E166	Failure	Ref input range 1 over range		yes		no		—	
E168	Maintenance	SCS message ISFET sensor		yes		no		—	
E171	Maintenance	Current input 1 under range	Measure input signal. Permitted: 4 to 20 mA Check process variables at transmitter. Change range assignment if required.	yes		no		—	
E172	Maintenance	Current/resistor input 1 over range		yes		no		—	
E173	Maintenance	Current input 2 under range		yes		no		—	
E174	Maintenance	Current input 2 over range		yes		no		—	
E175	Maintenance	SCS glass critical sensor	Inspect digital sensor for glass breakage and hairline cracks; check medium temperature. Measurement can continue until the error occurs.	yes		no		—	
E177	Maintenance	SCS reference critical sensor	Inspect digital sensor for contamination and damage; clean sensor. Measurement can continue until the error occurs.	yes		no		—	
E180	Failure	Data error sensor	Digital sensor does not deliver measured values. Sensor possibly incorrectly plugged in or connected; or sensor defective → replace sensor	no		no		no	

8.3 Process-specific errors

Use the following table to locate and rectify any errors occurring.

Error	Possible cause	Tests and / or remedial action	Equipment needed, spare parts
Device cannot be operated, display value 9999	Operation is locked via keypad ("CAL" + "DIAG" keys pressed simultaneously = security locking)	Press "MEAS" and "PARAM" simultaneously to unlock.	
Measuring chain zero-point cannot be adjusted	Reference system contaminated	Test with new sensor	pH/ORP sensor
	Diaphragm clogged	Clean or grind diaphragm	HCl 3 %, file (only for ceramic diaphragm, only file in one direction)
	Measuring line open	pH input on device short-circuit? display pH 7	
	Sensor asymmetry voltage too high	Clean diaphragm or test with another sensor	HCl 3 %, file (only for ceramic diaphragm, only file in one direction)
	Potential matching (PA/PM) transmitter? incorrect medium	Asymm.: no PM or PM at PE Symm.: PM connection mandatory	See the "Connecting analog sensors" section
No calibration possible as sensor settling time is too long	For ISFET sensors: liquid film between semiconductor and reference lead is interrupted due to drying or cleaning with compressed air.	Make sure that the liquid film is established or that the buffer remains in the rinse chamber for more than 6 minutes	
No or slow display change	Sensor contaminated	Clean sensor	See "Cleaning pH/ORP electrodes" section.
	Sensor aging	Replace sensor	New sensor
	Sensor defective (reference lead)	Replace sensor	New sensor
	Problem with diaphragm or missing electrolyte	Check KCl supply (0.8 bar above medium pressure)	KCl (CPY4-x)
Measuring chain slope not adjustable/slope too small	Connection not at high impedance (moisture, dirt)	Check cable, plug connector and junction boxes.	pH simulator, insulation, see "Checking the connecting lines and boxes" section
	Device input defective	Check device directly	pH simulator
	Sensor aging	Replace sensor	pH sensor
Measuring chain slope not adjustable/no slope	Hairline crack in glass membrane	Replace sensor	pH sensor
	Connection not at high impedance (moisture, dirt)	Check cable, plug connector and junction boxes.	pH simulator, insulation, see "Checking the connecting lines and boxes" section
	Semiconductor layer in measuring cable not removed	Check inner coaxial cable, remove black layer	
Permanent, incorrect measured value	Sensor not immersing or protection cap not removed	Check installation position, remove protection cap.	
	Air cushion in assembly	Check assembly and orientation	
	Ground fault at or in the device	Perform test measurement in insulated vessel, possibly with buffer solution.	Plastic vessel, buffer solutions. Behavior when device is connected to process?
	Hairline crack in glass membrane	Replace sensor	pH sensor
	Device in impermissible operating status (no response on pressing key)	Switch device off and on.	EMC problem: if this persists, check the grounding, screens and line routing or have checked by Endress+Hauser Service.
Incorrect temperature reading	Incorrect temperature sensor connection	Check connections using wiring diagram.	Wiring diagram "Electrical connection" section
	Measuring cable defective	Check cables for interruptions/short-circuit/shunt.	Ohmmeter
	Incorrect sensor type	Set type of temperature sensor at the device (Set up 1 > Temperature)	Glass electrode: Pt 100 ISFET: Pt 1000
	Temperature sensor defective	Check sensor	

Error	Possible cause	Tests and / or remedial action	Equipment needed, spare parts
pH value in process incorrect	No / incorrect temperature compensation	ATC: activate function MTC: set process temperature	
	Conductivity of medium too low	Select pH sensor with liquid KCl	e.g. Ceraliquid CPS41, Purisys CPF201
	Flow rate too high	Reduce flow rate or measure in a bypass.	
	Potential in medium	Possibly ground with or at PM pin (connect PM to PE).	Problem occurs particularly in plastic lines.
	Device unsymmetrical and PM connected	Remove PML connection to PM terminal; where necessary ground with/at PM pin (connect PM to PE)	
	Sensor contaminated or build-up on sensor	Clean sensor (see "Cleaning pH/ORP sensors" section)	For heavily contaminated media: Use spray cleaning.
Measured values fluctuate	Interference in measuring cable	Connect cable as per wiring diagram.	See "Electrical connection" section.
	Interference on signal output line	Check line routing, lay line separately if necessary.	Signal output and measuring input lines
	Interference potential in medium	Measure symmetrically (with PML).	Poss. ground medium with PM/PE connection.
	No potential matching (PA/PM) for symmetrical input	Connect PM pin in assembly to device terminal PA/PM.	
Controller/limit contact does not work	Controller switched off	Activate controller.	See "Set up 1 > Relays" section.
	Controller in "Manual / Off" mode	Select "Auto" or "Manual on" mode.	Key pad,  > Manual operation > Relays
	Pick-up delay setting too long	Switch off or shorten pickup delay time.	See "Set up 2 - Limit switch" section.
	"Hold" function active "Auto hold" for calibration, "Hold" input activated, Manual "hold" active using keypad "Hold" active during configuration	Determine cause of hold and eliminate if not desired.	"Hold" is indicated on display when active.
Controller / limit contact work continuously	Controller in operating mode "Manual/on"	Set controller to "Manual/off" or "Auto".	Key pad > Manual operation > Relays
	Dropout delay set too long	Reduce dropout delay time.	See "Set up 2 - Limit switch" section.
	Control circuit interrupted	Check measured value, current output or relay contacts, adjusters, chemical supply.	
No current output signal	Line open or short-circuited	Disconnect both (!!!) lines and measure directly at the device.	mA meter 0–20 mA DC
	Output defective	Replace controller module.	
	Current outputs encoded as passive and no additional power unit connected	Recode current outputs to active (see "Wiring - Current output" section) or connect power unit.	
	Jumpers for current outputs missing	Pin up jumpers as per the desired encoding (see "Wiring - Current outputs" section).	
Fixed current output signal	Current simulation active	Switch off simulation.	Check under  > Service > Simulation".
	Processor system inactive	Switch device off and on.	EMC problem: if it persists, check the installation.
	"Hold" is active	Hold status, see display.	
Incorrect current output signal	Incorrect current assignment	Check current assignment: 0–20 mA or 4–20 mA?	See "Set up 1 - Current outputs" section.
	Incorrect signal assignment	Every current output can be assigned to every measured value (pH or temp).	Check under  > current output"
	Overall burden in the current loop too high (> 500 Ω)	Disconnect output and measure directly at the device.	mA Meter for 0–20 mA DC

Error	Possible cause	Tests and / or remedial action	Equipment needed, spare parts
Data cannot be saved	No DAT memory module present		DAT available as accessory, see the "Accessories" section.
CPG30 control unit not working	No supply voltage	Check connection	
	Fuse defective	Check fuse and replace where necessary	
	Switch to "Service"	Turn switch to "Measure"	
No cleaner conveyance	Tank empty	Check error messages Test functions in manual mode	Indicator LEDs CPG30: V1: additional valve 1 active V2: additional valve 2 active MEAS: assembly in measurement mode Alive: LED flashes irregularly if function OK
	Line blocked		Pressure switch feedback (see item number 440 in "Spare parts" section), "normally closed contact" type ("NC"): no pressure = closed with pressure = open
Assembly remains in the "Service" position	No compressed air	Check error messages Test functions in manual mode	Indicator LEDs CPG: V1: additional valve 1 active V2: additional valve 2 active
	Switch to "Service"	Disconnect pressure switch and check with ohmmeter	MEAS: Assembly in measurement mode
	Incorrect position feedback signal		Alive: LED flashes irregularly if function OK
Assembly remains in the "Measure" position	No compressed air		Pressure switch feedback (see item number 440 in "Spare parts" section), "normally closed contact" type ("NC"): no pressure = closed
	Switch to "Measure"		with pressure = open
	Incorrect position feedback signal		
Assembly permanently retracts	Pneumatic hoses to assembly connected incorrectly.	Check pneumatic hoses.	
Assembly retracts several times without correct feedback	Pneumatic connections interchanged	See "Pneumatics and hydraulics, CPG" section. ■ Hose 2 "Measure" to valve 5 in front ■ Hose 3 "Service" to valve 5 at rear	
	Feedback not correctly connected	See "Pneumatics and hydraulics, CPG" section. ■ Hose 5 "Measure" feedback (terminal 11/12) ■ Hose 6 "Service" feedback (terminal 13/14)	
	Feedback switch is wrongly adjusted	Feedback switch under pressure ■ Opened: terminal 11/12-13/14 = 14 V ■ Closed: terminal 11/12-13/14 = 0 V	
	Assembly has been proceeded manually. Feedback signal is therefore undefined.	Position change via Manual Operation menu	



8.4 Device-specific errors

The following table helps you during the diagnosis and points to any spare parts required.

Depending on the degree of difficulty and the measuring equipment present, diagnosis is carried out by:

- Trained operator personnel
- The user's trained electrical technicians
- Company responsible for system installation/operation
- Endress+Hauser Service

Information on the exact spare part designations and on how to install these parts can be found in the "Spare parts" section.

Error	Possible cause	Tests and / or remedial action	Execution, tools, spare parts
Display dark, no light-emitting diode active	No line voltage	Check whether line voltage is present.	Electrician / e.g. multimeter
	Incorrect supply voltage or too low	Compare actual line voltage and nameplate data.	User (data for energy supply company or multimeter)
	Connection defective	Terminal not tightened; Insulation jammed; Wrong terminals used.	Electrical technician
	Device fuse defective	Compare line voltage and the nameplate data and replace fuse.	Electrical technician/suitable fuse; See "Spare parts" section.
	Power unit defective	Replace power unit, note version.	Local diagnosis: All 6 LEDs on the M3G module must be lit.
	Central module defective (if all 6 LEDs on the M3G power unit are lit)	Replace central module, note version.	Onsite diagnosis by Endress+Hauser Service, test module necessary
	Ribbon cable loose or defective	Check ribbon cable, renew if necessary.	Cable soldered onto M3G module side.
Display dark, light-emitting diode active	Central module defective (module: M3Cx-x)	Replace central module M3Cx-x. Pay attention to version.	Onsite diagnosis by Endress+Hauser Service, test module necessary
Display is on but – No change in display and/or – Device cannot be operated	Device or module in device not correctly installed	Check module connections	Perform using the device view in the "Spare parts" section.
	Operating system in impermissible state	Switch device off and on.	Poss. EMC problem: if this persists, check the installation or have checked by Endress+Hauser Service.
Device gets hot	Voltage wrong/too high	Compare line voltage and nameplate data.	User, electrical technician
	Power unit defective	Replace power unit.	All 6 red LEDs on the M3G module must be lit.
Incorrect measured pH / mV value and / or measured temperature value	Transmitter module defective (module: MKxx), please first carry out tests and take measures as per the "Process errors without messages" section.	Test measuring inputs: – Connect pH, ref and PM directly at the device with wire jumpers = display pH 7 – Resistance 100 Ω at terminals 11 / 12 + 13 = display 0 °C	If test negative: replace module (note version). Perform using the device view in the "Spare parts" section.  Display approx. pH 7, value depends on the zero point error in the last calibration.
Current output, current value incorrect	Adjustment not correct	Check with installed current simulation, connect mA meter directly to current output.	If simulation value incorrect: adjustment in factory or new module M3Cx-x required. If simulation value correct: check current loop for load and shunts.
	Load too high		
	Shunt / short-circuit to frame in current circuit		
	Incorrect mode of operation	Check whether 0–20 mA or 4–20 mA is selected.	
No current output signal	Current output stage defective (M3CH-x module)	Check with installed current simulation, connect mA meter directly to current output.	If test negative: Replace central module M3CH-x (pay attention to version).
	Device with PROFIBUS interface	PROFIBUS devices do not have a current output	Info see  > Instrument version".

8.5 Response of outputs to errors

8.5.1 Current output behavior

If an error occurs in the system, an error current is output at the current output. You can set the value of this error current in the Alarm menu (see "Set up 1 - Alarm" section). If you have configured controllers to function via a current output, this output does not output an error current if an error occurs.

8.5.2 Response of contacts to errors

You can set each individual error message to trigger or not to trigger an alarm (see "System error messages" section, processing of errors in the "Set up 1 - Alarm" section). Failure messages always generate an alarm (as per NAMUR).

Behavior with standard setting

Instrument status	Alarm relay	Limit value / Controller
Normal operation	Picked-up (fail-safe behavior)	Appropriate configuration and operating status
Alarm	Dropped out	
Voltage-free	Dropped out	Dropped out

Behavior with NAMUR setting (contacts configured as normally closed contacts)

Instrument status	Alarm relay	Maintenance relay	Function check	Limit value / Controller
Normal operation	Picked up (fail-safe behavior)	Picked up	Picked up	Appropriate configuration and operating status
Failure	Dropped out	Picked up	Picked up	Appropriate configuration and operating status
Maintenance required	Picked up	Dropped out	Picked up	Appropriate configuration and operating status
Function check	Picked up	Picked up	Dropped out	Appropriate configuration and operating status
Voltage-free	Dropped out	Dropped out	Dropped out	Dropped out

8.5.3 Response of contacts to power failure

In the "Set up 1 > Relays" menu, you can define the contacts as NC contacts or NO contacts (see "Set up 1 - Relays" section). In the case of a power failure, the contacts will act according to the setting you make.

8.5.4 Assembly behavior

Problem	CPM153 behavior	CPG behavior	Assembly behavior
CPM153 voltage failure during measurement	No function		
CPM153 voltage failure during maintenance	No function		
CPG voltage failure during measurement	Error message E012	All valves closed	Can be pushed out of the process
CPG voltage failure during maintenance	Error message E012	All valves closed	Stays in service position
Air failure during measurement	Error message E027		Can be pushed out of the process
Air failure during maintenance	Error message E027		Stays in service position
Air failure during automatic cleaning	Error message E027		Stays in service position
Position switch or pressure switch defective	Error message E013 or E014		The assembly waits for 60 seconds until the feedback signal, then it moves again. If there is then no feedback signal after 30 seconds, the assembly remains in the position it has moved to.

9 Maintenance

▲ WARNING

Process pressure and temperature, contamination, electrical voltage

Risk of serious or fatal injury!

- ▶ If the sensor has to be removed during maintenance work, avoid hazards posed by pressure, temperature and contamination.
- ▶ Make sure the device is de-energized before you open it.
- ▶ Switch contacts may be powered by separate circuits. Also de-energise these circuits before you work on the terminals.

Take all the necessary measures in time to guarantee the operational safety and reliability of the entire measuring point.

Measuring point maintenance comprises:

- Calibration
- Cleaning the controller, assembly and sensor
- Cable and connection check

When carrying out all work on the device, please observe any possible effects on the process control or the process itself.

NOTICE

Electrostatic discharge (ESD)

Risk of damaging the electronic components

- ▶ Take personal protective measures to avoid ESD, such as discharging beforehand at PE or permanent grounding with a wrist strap.
- ▶ For your own safety, always use genuine spare parts. With genuine spare parts, the function, accuracy and reliability are also guaranteed after repair.

9.1 Maintenance of the entire measuring point

9.1.1 Cleaning the transmitter

Only clean the front of the housing with commercially available cleaning agents.

In accordance with DIN 42 115, the front is resistant to:

- Ethanol (short periods)
- Diluted acids (max. 2% HCl)
- Diluted bases (max. 3% NaOH)
- Soap-based household cleaners

NOTICE

Forbidden cleaning agents

Danger of damaging the housing surface or housing seal

- ▶ Never use concentrated mineral acids or bases to clean the device.
- ▶ Never use organic cleaners such as benzyl alcohol, methanol, methylene chloride, xylene or concentrated glycerol cleaner.
- ▶ Never use high-pressure steam for cleaning.

9.1.2 Cleaning the sensors

Sensor cleaning is integrated in the Topclean S system. Usually, additional or external cleaning of the sensor is therefore unnecessary. However, before inspecting the sensor, advance external cleaning may be necessary.

⚠ CAUTION

Cleaning not deactivated during calibration or maintenance activities

Risk of injury from medium or cleaner

- ▶ Switch the service switch to "Service" to keep the assembly safely in the Service position.
- ▶ Switch off any connected cleaning system before removing a sensor from the medium.
- ▶ If you want to check the cleaning function and therefore do not switch off cleaning, wear protective clothing, goggles and gloves, or take other suitable measures, to protect yourself.

Please clean fouling on the pH glass electrodes as follows:

- Oily and greasy deposits:
Clean with hot water or temperature-controlled detergent (grease solvers, such as alcohol, acetone, washing-up liquid where applicable).


⚠ CAUTION

Risk of injury from cleaning agents

- ▶ Make sure to protect your hands, eyes and clothing when you use the following cleaning agents.
- Calciferous and metal hydroxide deposits:
Dissolve deposits with diluted hydrochloric acid (3 %) and then rinse carefully with plenty of clear water.
- Sulfide deposits (from flue gas desulfurization or sewage treatment plants):
Use mixture of hydrochloric acid (3 %) and thiocarbamide (usual commercial) and then rinse carefully with plenty of clear water.
- Protein deposits (e.g. food industry):
Use mixture of hydrochloric acid (0.5 %) and pepsin (usual commercial) and then rinse carefully with plenty of clear water.
- Fibers, suspended substances:
Water under pressure, possibly with surface-active agents
- Light biological deposits:
Water under pressure

ORP electrodes:

Carefully clean the metal pins or surfaces mechanically.

-  After mechanical cleaning, the ORP sensor can require several hours conditioning time. For this reason, check the calibration after a day.

ISFET sensors

- Never use acetone to clean ISFET sensors as this can damage the material.
- After cleaning with compressed air, ISFET sensors need approx. 5-8 minutes until the closed-control loop is reestablished and the measured value is adjusted to the real value.

In certain circumstances, you can clean blocked diaphragms mechanically (does not apply to ISFET sensors, Teflon diaphragms and open ring junction electrodes):

- Use a small key file.
- Only file in one direction.

Air bubbles in the electrode:

- Air bubbles can indicate incorrect mounting. For this reason check the orientation.
- The range from 15° to 165° to the horizontal is allowed (with the exception of ISFET sensors).
- Not permitted: horizontal installation or installation with the plug-in head pointing downwards.

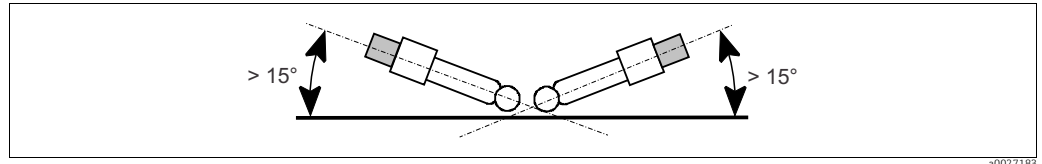


Fig. 53: Permitted angle of installation for glass electrodes

Reference system reduction

The inner metal lead of the reference system (Ag/AgCl) of a combination electrode or a separate reference electrode is usually light-brown and matt. A silver-colored reference system is reduced and therefore defective. The cause is a current flowing through the reference element. Possible causes:

- Incorrect measuring device operating mode selected (PML pin connected, but operating mode without solution ground ("without PML")). See the function description under "Selecting the type of connection".
- Shunt in measuring cable (e.g. due to humidity) between reference line and grounded screen or PA line.
- Measuring device defective (shunt in reference input or entire input amplifier downstream of PE).

9.1.3 Maintenance of digital sensors

Proceed as follows to maintain the digital sensors with Memosens functionality:

1. If an error occurs or the sensor has to be replaced according to the maintenance schedule, take a new or precalibrated sensor from the lab.
In the lab, a sensor is calibrated under optimum external conditions to ensure a higher quality of measurement.
2. Remove the contaminated sensor and insert the new sensor.
3. A calibration is necessary if you are using a sensor which was not precalibrated.
4. The sensor data are automatically taken by the transmitter. No release code is required.
5. Measurement is continued.
6. Take the used sensor back to the lab. Here you can possibly make the sensor ready for use again without the measuring point having to suffer downtime.
 - Clean the sensor. For this purpose, use the cleaning agent indicated for the sensor.
 - Inspect the sensor for cracks or other damage.
 - Regenerate the sensor if it is not damaged. Store it for 24 hours in a 3M KCl solution.
 - Recalibrate the sensor for the next use.

9.1.4 Liquid KCl supply

- The KCl must be free of bubbles. In the case of an unpressurized version, check whether the cotton thread is present in the hose.
- In the event of counterpressure, check whether the pressure in the KCl tank is min. 0.8 bar (12 psi) above the medium pressure.
- The KCl consumption should be low but noticeable. Approx. 1 to 10 ml/day is typical.
- The opening for sensors with a KCl top-up opening at the glass shaft must be clear.

9.1.5 Assembly

Please refer to the corresponding assembly Operating Instructions for information on maintaining and troubleshooting the assembly. Here you can find a description of the procedure for assembly and disassembly, sensor replacement, seal replacement, and information on the material resistance properties, as well as spare parts and accessories.

Weekly checks (recommended timeframe)

- Check the integrity of the upper assembly section with regard to compressed air and check for mechanical damage.
- Check the integrity of the process connection in relation to the process and check for mechanical damage.

Annual checks (recommended timeframe)

- Clean the assembly on the outside if required. To replace seals, the assembly must be clean, dry and, if necessary, decontaminated.
- In the event of inductive feedback: check the switching distance and adjust it if necessary.
- Replace the seals not in contact with the medium (recommended: where necessary, at least 1x year).
- Replace the seals in contact with the medium (at least 1x year, no further recommendations possible as primarily depends on the process, material and frequency of assembly use).
- On completion of the maintenance work, carry out the following final test:
 - Does the assembly move into the Measuring and Service position?
 - Are Service and Measure feedback signals available? (Check using the CPM153 status messages)
 - Process connection and compressed air connections tight?
 - Does the meter display plausible values?

Replacement of the sealing elements is dependent on the type of assembly. Instructions for replacement is contained in the appropriate service kit. You can find the necessary service kit in the operating instructions of your assembly.

9.1.6 Cables, connections and supply lines

Weekly checks (recommended timeframe)

Check the integrity of:

- Compressed air hoses and connections
- Pressurized water hoses and connections
- Hoses and connections of the cleaner tank
- Multihose connections at control unit and assembly

Monthly checks (recommended timeframe)

- If the assembly is located in a humid/wet environment or outdoors and you are using analog sensors, check the sensor plug-in head for leaks or moisture.
- Check that the sensor cables, particularly the external insulation, are in a sound condition. Sensor cables which have become damp on the inside must be replaced. Drying alone is not sufficient!
- Check that the cable connections are tight.

Six-monthly checks (recommended timeframe)

- Check whether the interior and the PCBs in the Mycom S are clean, dry and free of corrosion.
 - If not:
 - Clean and dry the interior and PCBs.
 - In the event of corrosion, replace the affected PCBs where necessary.
 - Check the integrity of the seals and couplings and ensure they are in a sound condition.
- Tighten the terminals in Mycom S.
- If the assembly is located in a dry environment and you are using analog sensors, check the sensor plug-in head for leaks or moisture.

9.1.7 Control unit

Weekly checks (recommended timeframe)

- Check the integrity of compressed air connections:
 - Pneumatic valves
 - Pressure switch

Annual checks (recommended timeframe)

- Check whether the interior and the PCBs of the control unit are clean, dry and free from corrosion.
 - If not:
 - Clean and dry the interior and PCBs.
 - In the event of corrosion, replace the PCBs where necessary.
 - Check the integrity of the seals and couplings and ensure they are in a sound condition.
- Tighten the terminals in the control unit.

9.1.8 CYR10 injector

Weekly checks (recommended timeframe)

- Check the integrity of the hydraulic connections (motive water, cleaner, output).
- Check the level of the cleaning solution and top up if necessary.

Annual checks (recommended timeframe)

- Check that the electrical connections (valve heads) are secure.
- Check that the valve bodies are secure.
- Replace the water valve seal (wear parts set, see "Spare parts kit CYR10" section).
- Replace the cleaner check valve (wear parts set, see "Spare parts kit CYR10" section).

10 Repair

10.1 Spare parts

Please order spare parts from your local Sales Office. For this purpose, use the order numbers listed in the "Spare part kits" section.

You should **always** provide the following additional data when ordering spare parts:

- Device order code
- Serial number
- Software version, if possible

You can take the order code and serial number from the nameplate.

The software version is provided in the device software (see "Operation" section) provided that the device processor system is still working.

10.2 Device view Mycom S

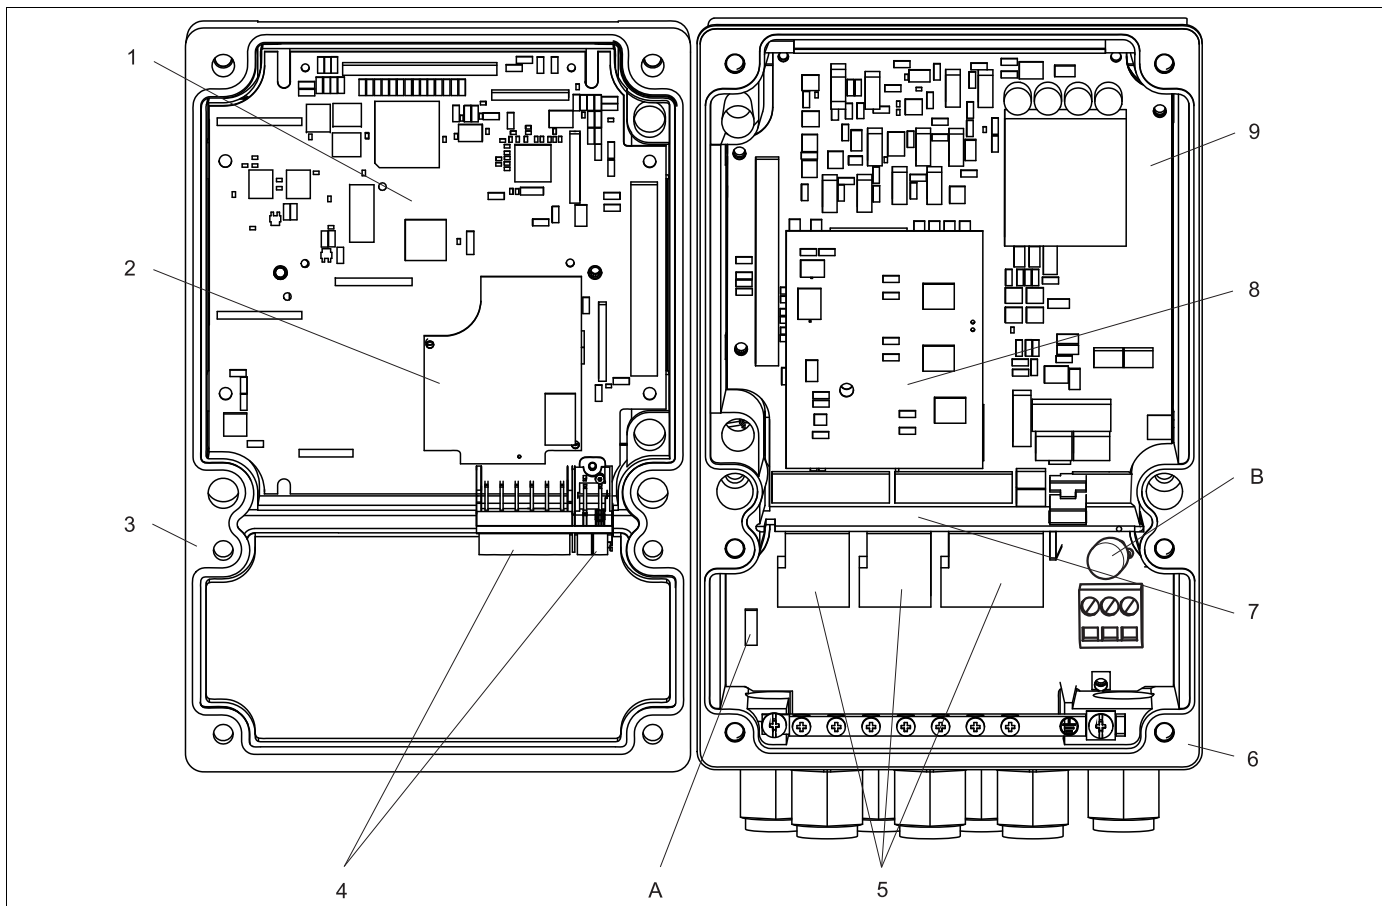


Fig. 54: Interior view

A Slot for DAT module
B Fuse

The interior view contains the components and spare parts of the device. You can take the spare parts and the corresponding order numbers from the following section.

10.3 Mycom S spare parts list

Item No.	Kit description	Contents / Use	Order code
5	Terminal module Standard+HART	Module M3K / non-Ex	51507084
9	Power supply 100 to 230 VAC non-Ex	Module M3G, power unit + 3 relay	51507087
9	Power supply 24 VAC/DC non-Ex	Module M3G, power unit + 3 relay	51507089
2	pH input module, glass + ISFET	Module MKP2 / Ex and non-Ex	51507096
2	pH input module, Memosens	Module MKD1 / Ex and non-Ex	51514966
8	Relay module with 3 additional relays	Module M3R-3 / Ex and non-Ex	51507097
4	Terminal set for pH input, glass, 2 pair	Six-pin terminal + two-pin terminal, two pieces each	51507100
4	Terminal set for pH input, ISFET, 2 pair	Six-pin terminal + two-pin terminal, two pieces each	51507858
	Jumper set	5 sets of all three jumper types	51507102
7	Partition plate for connection compartment	5 piece, partition plates	51507103
3	Top housing section	Top section with keypad sheet, connection compartment cover, hinge, nameplate/ non-Ex	71003923
6	Housing base	For one and two-circuit devices, cpl./non-Ex	51507106

10.4 Control unit spare parts list

Item No.	Kit description	Contents / Use	Order code
3	Electronics module 110/230 VAC non-Ex	Tested, complete module, voltage can be selected with jumpers/non-Ex	51507109
3	Electronics module 24 V DC/AC, non-Ex	Tested, complete module/non-Ex	51507110
2	Terminal block set	All requisite terminal blocks/Ex and non-Ex	51507436
1	Multihose connection	Pneumatic multiple connector in housing installation version/Ex and non-Ex	51507446
	Multihose 5 m	5 hoses in protective hose with pneumatic multiple connector/Ex and non-Ex	51507461
	Multihose 10 m		51508786
7	Assembly feedback pressure switch	Pressure switch, NO contact/Ex and non-Ex	51507447
4	Pneumatic pressure switch	Pressure switch/Ex and non-Ex	51507448

10.5 Pneumatic and hydraulic control unit

- A

Compressed air supply
- V1

Additional valve connection, V1
- V2

Additional valve connection, V2
- M1

Multihose connector Pg 29
- M2

Multihose connector Pg 21
- S1-3

Pressure switch
- V1-9

Valves

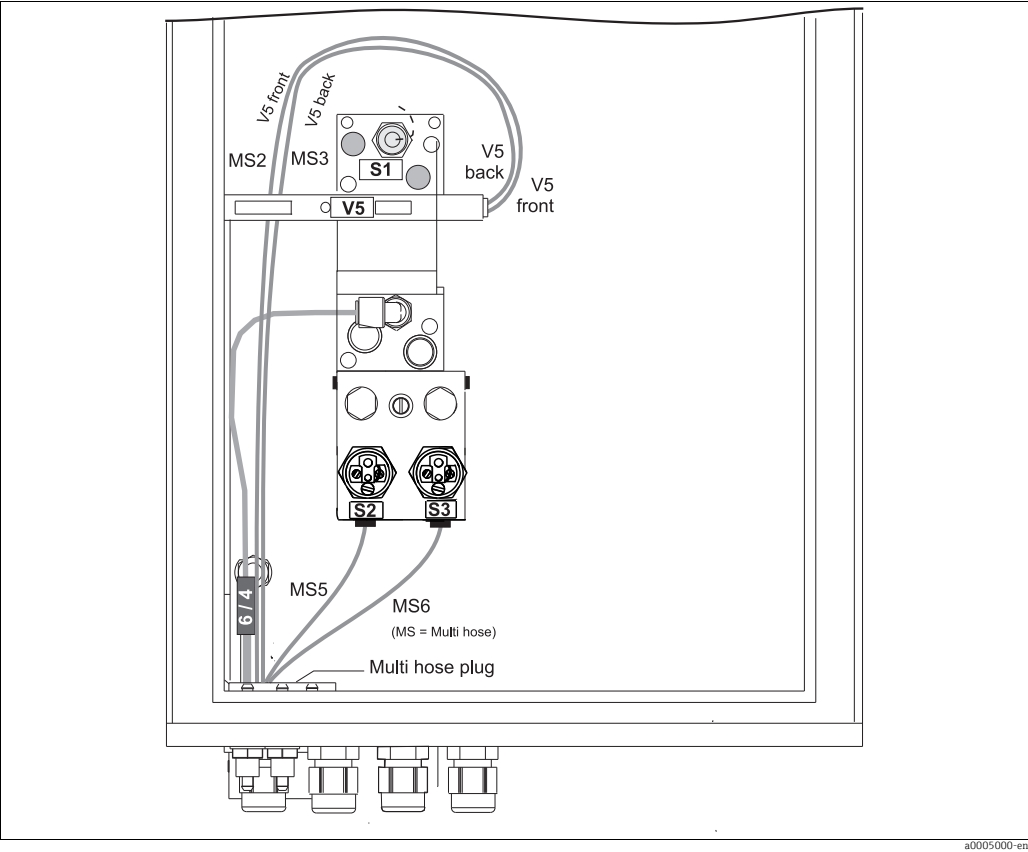


Fig. 55: Pneumatics and hydraulics

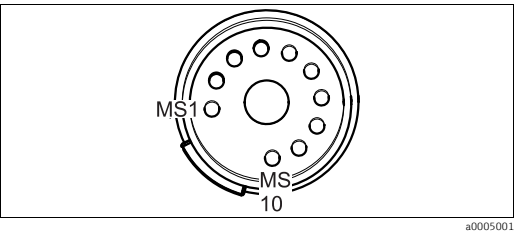


Fig. 56: Multihose connector (from below)

Multihose	Valves (controlled electrically)	Pressure switch	Signal / use
1			Free
2	V5 rear		Assembly in "Measuring" position
3	V5 front		Assembly in "Service" position
4			Free
5		S2	"Measurement" feedback (not used with inductive feedback)
6		S3	"Service" feedback (not used with inductive feedback)
7-10			Free
		S1	Compressed air monitoring

10.6 Spare parts for CYR10 injector

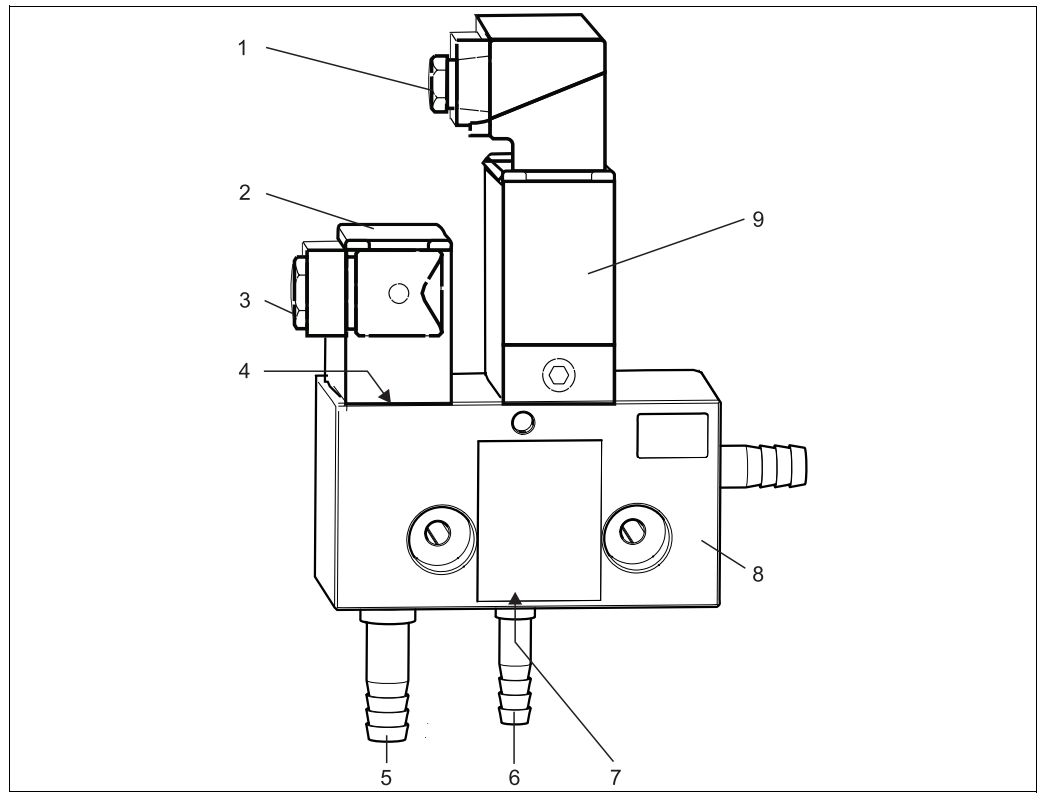


Fig. 57: CYR10 injector spare parts

Item No.	Kit description	Contents / Use	Order code
8	Complete PVC valve block	Basic section with check valve	50069347
2	Motive water valve 230 V AC	Valve body without connection plug	50069349
2	Motive water valve 110 V AC	Valve body without connection plug	50069350
2	Motive water valve 24 V DC	Valve body without connection plug	50069351
9	Cleaning agent valve 230 V AC	Valve complete without connection plug	50069352
9	Cleaning agent valve 110 V AC	Valve complete without connection plug	50069353
9	Cleaning agent valve 24 V DC	Valve complete without connection plug	50069354
3	Connection plug for water valve	Four-pin plug with seal	50072992
1	Connection plug for cleaning agent valve 110 / 230 V AC	Plug with integrated interference suppression	50069345
1	Connection plug for cleaning agent valve 24 V DC		50069346
4	Wear parts set, water valve 110 / 230 V AC	Membrane seal and guide, armature, spring, screws	50086190
4	Wear parts set, water valve 24 V DC		50086191
7	Wear parts set, internal check valve	Valve body, ball, seals	50086192
5	Pressure hose nozzle D 16 G $\frac{3}{4}$ for motive water		50072990
6	Pressure hose nozzle D 12 G $\frac{3}{4}$ for cleaner		50072991

10.7 Replacing the device fuse

⚠ WARNING

Risk of serious or fatal injury from electric shock!

► Make sure the device is de-energized before you open it.

- Position of the fuse holder: "B" in device view.
- Only use a 5 x 20 mm (0.2 x 0.79 in) fine-wire fuse with 3.15 A, medium-blow. All other fuses are not permitted.

10.8 Return

The product must be returned if repairs or a factory calibration are required, or if the wrong product has been ordered or delivered. Legal specifications require Endress+Hauser, as an ISO-certified company, to follow certain procedures when handling products that are in contact with the medium.

To ensure swift, safe and professional device returns:

Visit our website to obtain information about the return procedure and basic conditions

www.services.endress.com/return-material

10.9 Disposal

Electronic components are used in the product. For this reason, the product must be disposed of as electronic waste.

Observe local regulations.

11 Accessories

11.1 Offline configuration

- Parawin
Graphic PC program for offline configuration of the measuring point at the PC. You can switch the language via software. Required operating system: Windows NT/95/98/2000. Offline configuration consists of:
 - ▶ One DAT module
 - ▶ DAT interface (RS 232)
 - ▶ Software
 Order No.: 51507563 (Topclean S / Mycom S)
- RS232 <-> USB adapter
Order No.: 71200843
- Additional memory module for saving or copying configuration, data logs and logbooks;
Order No.: 51507175

11.2 Assemblies

Cleanfit CPA871

- Flexible retractable process assembly for water, wastewater and the chemical industry
- Order according to product structure, www.products.endress.com/cpa871
- Technical Information TI01191C/07/EN

Cleanfit CPA875

- Retractable process assembly for sterile and hygienic applications
- Order according to product structure, www.products.endress.com/cpa875
- Technical Information TI01168C/07/EN

Cleanfit P CPA472, version CPA472-xxxxxx3/4

- Compact plastic retractable assembly for installation in tanks and pipes, for manual or pneumatically remote-controlled operation
- Order according to product structure, www.products.endress.com/cpa472
- Technical Information TI00223C/07/EN

Cleanfit P CPA472D, version CPA472-xxxxxx3/4/5

- Retractable assembly for pH/ORP measurement in tanks and pipes, manual or pneumatic operation, heavy-duty version made from heavy-duty materials
- Order according to product structure, www.products.endress.com/cpa472d
- Technical Information TI00403C/07/EN

Cleanfit P CPA473

- Stainless steel retractable process assembly with ball valve shutoff for very reliable separation of the process medium from the environment
- Order according to product structure, www.products.endress.com/cpa473
- Technical Information TI00344C/07/EN

Cleanfit P CPA474

- Plastic retractable process assembly with ball valve shutoff for very reliable separation of the process medium from the environment
- Order according to product structure, www.products.endress.com/cpa474
- Technical Information TI00345C/07/EN

11.3 Sensors

11.3.1 Glass electrodes

Orbisint CPS11/CPS11D

- pH electrode for process engineering
- With dirt-repellent PTFE junction
- Order according to product structure, www.products.endress.com/cps11 or www.products.endress.com/cps11d
- Technical Information TI00028C/07/EN

Orbisint CPS12/CPS12D

- ORP electrode for process engineering
- With dirt-repellent PTFE junction
- Order according to product structure, www.products.endress.com/cps12 or www.products.endress.com/cps12d
- Technical Information TI00367C/07/EN

Memosens CPS31D

- pH electrode with Memosens technology for drinking water and swimming pool water
- Gel-filled reference system with ceramic junction
- Order according to product structure, www.products.endress.com/cps31d
- Technical Information TI00030C/07/EN

Ceratex CPS31

- pH electrode for drinking water and swimming pool water
- Gel-filled reference system with ceramic junction
- Order according to product structure, www.products.endress.com/cps31
- Technical Information TI00030C/07/EN

Ceraliquid CPS41/CPS41D

- pH electrode with ceramic junction and KCl liquid electrolyte
- Order according to product structure, www.products.endress.com/cps41 or www.products.endress.com/cps41d
- Technical Information TI00079C/07/EN

Ceraliquid CPS42/CPS42D

- ORP electrode with ceramic junction and KCl liquid electrolyte
- Order according to product structure, www.products.endress.com/cps42 or www.products.endress.com/cps42d
- Technical Information TI00373C/07/EN

Ceragel CPS71/CPS71D

- pH electrode with poison-resistant reference with ion trap
- Order according to product structure, www.products.endress.com/cps71 or www.products.endress.com/cps71d
- Technical Information TI00245C/07/EN

Ceragel CPS72/CPS72D

- ORP electrode with poison-resistant reference with ion trap
- Order according to product structure, www.products.endress.com/cps72 or www.products.endress.com/cps72d
- Technical Information TI00374C/07/EN

Orbipore CPS91/CPS91D

- pH electrode with open aperture diaphragm for media with a high dirt load
- Order according to product structure, www.products.endress.com/cps91 or www.products.endress.com/cps91d
- Technical Information TI00375C/07/EN

Orbipore CPS92/CPS92D

- ORP electrode with open aperture diaphragm for media with a high dirt load
- Order according to product structure, www.products.endress.com/cps92 or www.products.endress.com/cps92d
- Technical Information TI00435C/07/EN

11.3.2 ISFET sensors

Tophit CPS471/CPS471D

- Sterilizable and autoclavable ISFET sensor for food and pharmaceuticals, process engineering, water treatment and biotechnology
- Order according to product structure, www.products.endress.com/cps471 or www.products.endress.com/cps471d
- Technical Information TI00283C/07/EN

Tophit CPS441/CPS441D

- Sterilizable ISFET sensor for low-conductivity media, with liquid KCl electrolyte
- Order according to product structure, www.products.endress.com/cps441 or www.products.endress.com/cps441d
- Technical Information TI00352C/07/EN

Tophit CPS491/CPS491D

- ISFET sensor with open aperture diaphragm for media with high dirt load
- Order according to product structure, www.products.endress.com/cps491 or www.products.endress.com/cps491d
- Technical Information TI00377C/07/EN

11.4 Connection accessories

Special measuring cable CPK1

- For pH/ORP electrodes with GSA plug-in head
- Order as per product structure, see Technical Information (TI118C/07/en)

Special measuring cable CPK9

- For pH/ORP electrodes with TOP68 plug-in head, for high-temperature and high-pressure applications, IP 68
- Order as per product structure, see Technical Information (TI118C/07/en)

Special measuring cable CPK12

- For ISFET sensors and pH/ORP electrodes with TOP68 plug-in head
- Order as per product structure, see Technical Information (TI118C/07/en)

CYK10 Memosens data cable

- For digital sensors with Memosens technology (CPSxxD)
- Order as per product structure, see Technical Information (TI376C/07/en)

CYK81 Memosens data cable extension

- Underminated cable for extending sensor connection cables
- 2 x 2 cores, twisted with shield and PVC sheath (2 x 2 x 0.5 mm² + shield), material sold by the meter
- Minimum length: 10 m
- Order No. 51502543

CYK71 measuring cable

- Underminated cable for connecting sensors and extending sensor cables
- Material sold by the meter, order numbers:
 - Non-hazardous area version, black: 50085333
 - Hazardous area version, blue: 51506616

Junction box VBM

- For cable extension, with 10 terminal blocks
- IP 65 (≅ NEMA 4X)
- Aluminum material
- Order numbers:
 - Cable entry Pg 13.5: 50003987
 - Cable entry NPT ½": 51500177

VBA junction box

- For cable extension for pH/ORP sensors, with 10 high-impedance terminal blocks, cable glands
- Polycarbonate material
- Order No. 50005276

Junction box RM

- For cable extension, Memosens or CUS31/CUS41
- With 2 x Pg 13.5
- IP 65 (\cong NEMA 4X)
- Order No. 51500832

11.5 Mounting accessories

- Flat seal for front-panel airtight panel mounting of Mycom S;
Order No.: 50064975
- Filter assembly for rinse water
Order No.: 71031661
- Weather protection cover CYY101 for mounting on the field device, essential for outdoor operation
Material: stainless steel 1.4031;
Order No. CYY101-A

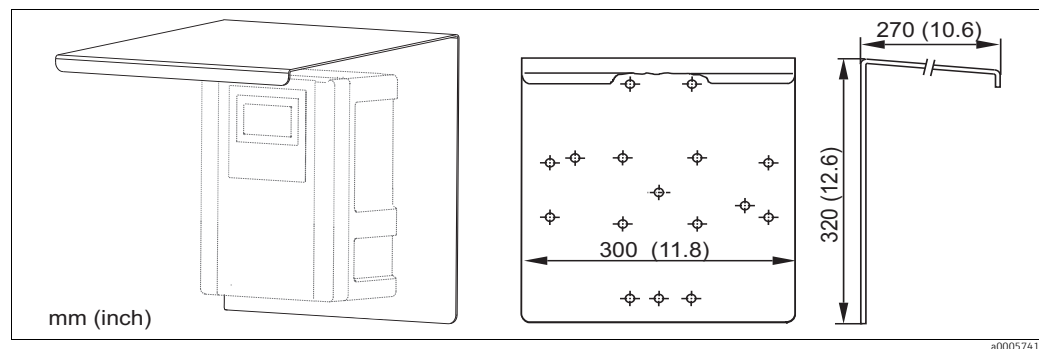


Fig. 58: Weather protection cover for field devices

- Universal post CYY102

Square pipe for mounting transmitters, material: stainless steel 1.4301 (AISI 304);
Order No. CYY102-A

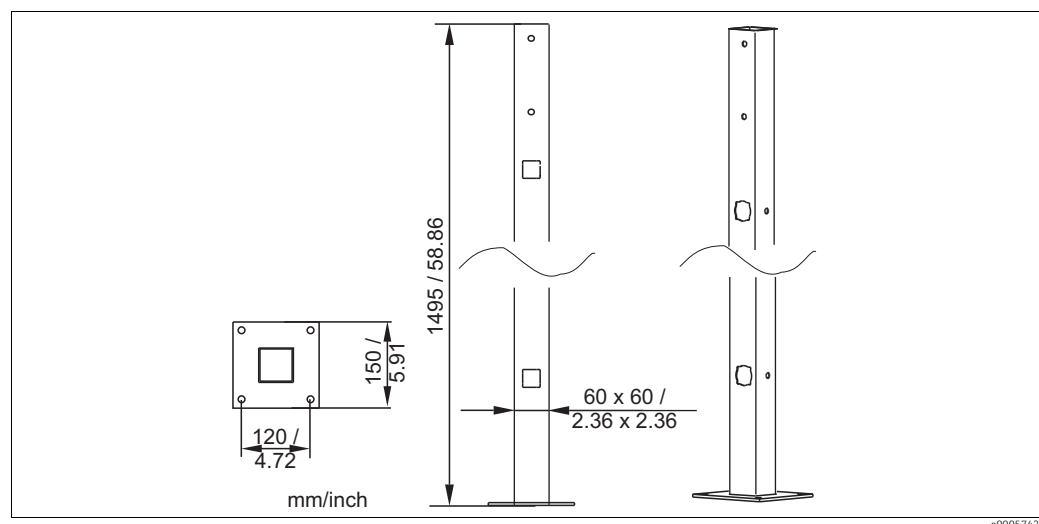





Fig. 59: Universal post CYY102

12 Technical data

12.1 Input

Mycom S CPM153

Measured variable	pH (analog sensors or sensors with Memosens technology) ORP (analog or digital sensors) Temperature	
Measuring range	pH:	-2 to 16 pH
	ORP:	-1500 to +1500 mV / -300 to +300 %
	Temperature:	-50 to +200 °C (-58 to +392 °F)
Input impedance	$> 10^{12} \Omega$ (at rated operating conditions, analog measured value transmission)	
Sensor circuit input current	$< 1.6 \cdot 10^{-12} \text{ A}$ (at rated operating conditions)	
Sensor circuit Ex connection data	 Sensor circuit with type of protection EEx ia IIC (optional). This circuit can also be connected to sensors of category 1G (zone 0). Maximum output voltage U_O : 12.6 V DC Maximum output current I_O : 130 mA Maximum output power P_O : 198 mW Maximum external capacitance C_O : 50 nF (with ISFET sensors 150 nF) Maximum external inductance L_O : 100 μH	
Sensor circuit cable specification	Cable length (analog):	Max. 50 m (164 ft.)
	Cable length (digital):	Max. 100 m (328 ft.)
Current inputs 1 / 2 (passive, optional)	Signal range:	4 to 20 mA
	Input voltage range:	6 to 30 V
	 Intrinsically safe current inputs for connection of intrinsically safe electric circuits with type of protection EEx ia IIC or EEx ib IIC (optional) Maximum input voltage U_i : 30 V DC Maximum input current I_i : 100 mA Maximum input power P_i : 3 W Maximum internal capacitance C_i : 1.1 nF Maximum internal inductance L_i : 24 μH	
Resistance input (active, optional, non-hazardous only)	Resistance ranges (can be switched by software)	0 to 1 k Ω 0 to 10 k Ω
Digital inputs E1-E3	Input voltage:	10 to 50 V
	Internal resistance:	$R_i = 5 \text{ k}\Omega$
	 Intrinsically safe optoelectronic coupler interfaces for connection of intrinsically safe electric circuits with type of protection EEx ia IIC or EEx ib IIC Maximum input voltage U_i : 30 V DC Maximum internal capacitance C_i : negligible Maximum internal inductance L_i : negligible	

CPG30 control unit**Digital inputs**

Input voltage:	10 to 40 V
Internal resistance:	$R_i = 5 \text{ k}\Omega$
Minimum switching signal duration:	500 ms



Intrinsically safe optoelectronic coupler interfaces for connection of intrinsically safe electric circuits with type of protection EEx ia IIC or EEx ib IIC

Maximum input voltage U_i :	30 V DC
Maximum internal capacitance C_i :	negligible
Maximum internal inductance L_i :	negligible

Cable specification for inductive limit position switches

Cable length:	Max. 100 m (328 ft.)
---------------	----------------------

12.2 Output**Mycom S CPM153****Output signal**

0/4 to 20 mA

Signal on alarm

2.4 or 22 mA in the event of an error

Load of active current outputMax. 600 Ω (depends on operating voltage)**Output distribution**

pH:	Adjustable, 0 to 18 pH
ORP:	
Absolute:	Adjustable, 300 to 3000 mV
Relative:	Adjustable, 0 to 600 %
Temperature:	Adjustable, 17 to 200 °C (62.6 to 392 °F)

Passive current output

Operating voltage range:	6 to 30 V
--------------------------	-----------




Ex connection data

Intrinsically safe current circuits for connection of intrinsically safe electric circuits with type of protection EEx ib IIC.

Maximum input voltage U_i :	30 V DC
Maximum input current I_i :	100 mA
Maximum input power P_i :	750 mW
Maximum internal capacitance C_i :	negligible
Maximum internal inductance L_i :	negligible

Overvoltage protection

As per EN 61000-4-5:1995

Auxiliary voltage output (for digital inputs E1 - E3)	Output voltage:	15 V DC
	Output current:	Max. 9 mA
	 Intrinsicly safe current output circuit with type of protection EEx ib IIC.	
	Maximum output voltage U_O :	15.8 V DC
	Maximum output current I_O :	71 mA
	Maximum output power P_O :	1.13 W
	Maximum external capacitance C_O :	50 nF
	Maximum external inductance L_O :	100 μ H
Interface to CPG30	Power supply:	
	Output voltage:	11.5 to 18 V DC
	Output current:	Max. 60 mA
	Communication:	RS 485
	 Intrinsicly safe current output circuit with type of protection EEx ib. IIC.	
Contact outputs	Switching voltage:	Max. 250 V AC / 125 V DC
	Switching current:	Max. 3 A
	Switching power:	Max. 750 VA
	Operating life:	≥ 5 million switching cycles
	 Intrinsicly safe relay contact circuits for connection of intrinsically safe electric circuits with type of protection EEx ia IIC or EEx ib IIC.	
	Maximum input voltage U_i :	30 V DC
	Maximum input current I_i :	100 mA
	Maximum input power P_i :	3 W
	Maximum internal capacitance C_i :	1.1 nF
	Maximum internal inductance L_i :	24 μ H
Controller	Function (adjustable):	Pulse-length controller (PWM) Pulse-frequency controller (PFM) Three-point stepping controller (3-point step) Analog (via current output)
	Controller behavior:	P / PI / PID
	Control gain K_R :	0.01 to 20.00
	Integral action time T_n :	0.0 to 999.9 min
	Derivative action time T_v :	0.0 to 999.9 min
	Max. frequency with pulse-frequency controller:	120 min ⁻¹
	Period length for pulse-length controller:	1 to 999.9 s
	Minimum switch-on period for pulse-length controller:	0.4 s
Limit value and alarm functions	Set point settings:	-2.00 to 16.00 pH
	Hysteresis for switching contacts:	
	pH:	0.1 to 18 pH
	ORP absolute:	10 to 100 mV
	ORP relative:	1 to 3000%
	Alarm delay:	0 to 6000 s
Galvanic isolation	The following are on the same potential:	
	■ Current output 1 and auxiliary voltage ■ Current output 2 and resistance input	
	All other circuits are galvanically isolated from one another.	

CPG30 control unit**Digital outputs**

Optoelectronic coupler, max. switching voltage: 30 V DC
 Max. switching current: 100 mA
 Max. switching power: 3 W



Intrinsically safe optoelectronic coupler control outputs for connection of intrinsically safe electric circuits with type of protection EEx ia IIC or EEx ib IIC.

Maximum input voltage U_i : 30 V DC
 Maximum input current strength I_i : 100 mA
 Maximum input power P_i : 1 W
 Maximum internal capacitance C_i : negligible
 Maximum internal inductance L_i : negligible

Control for external valves**Switched compressed air output:**

Max. pressure: Like supply pressure

12.3 Power supply**Mycom S CPM153****Supply voltage**

Version CPM153-xxxx0xxxx 100 to 230 V AC +10/-15 %
 Version CPM153-xxxx8xxxx 24 V AC/DC +20/-15 %

Cable specifications

Max. cable cross-section: 2.5 mm² (≈14 AWG)

Power consumption

Max. 10 VA

Separation voltage between galvanically isolated circuits

276 V_{rms}

Interface connection data

Mycom S has an alarm contact and five additional contacts. You can assign functions to the contacts available via the software. The NC/NO contact type can also be switched by software. You can assign up to three relays to the controllers.



When using the NAMUR assignment (based on the recommendations of the interest group for process control technology in the chemical and pharmaceutical industry), the functions are specified for the relays as follows:

Relay	Assignment NAMUR on	Assignment NAMUR off	Terminal
ALARM	Failure	Alarm	41 42
RELAY 1	Warning if maintenance required	Can be assigned as required	47 48
RELAY 2	Function check	Can be assigned as required	57 58

Frequency

47 to 64 Hz

Ex connection data

Connection data for 12V power supply

Maximum output voltage U_O :	18.5 V
Maximum output current I_O :	100 mA
Maximum output power P_O :	1.53 W
Maximum external capacitance C_O :	150 nF
Maximum external inductance L_O :	150 μ H

CPG30 control unit**Supply voltage**

Version CPC30-xxxx0xxxxxxx	230 V AC +10/-15 %
Version CPC30-xxxx1xxxxxxx	110 to 115 V AC +10/-15 %
Version CPC30-xxxx8xxxxxxx	24 V AC/DC +20/-15 %

Cable specification

Max. cable cross-section:	2.5 mm ² (\approx 14 AWG)
---------------------------	---

Power consumption

Max. 12 VA

Separation voltage between galvanically isolated circuits276 V_{rms}**Frequency**

47 to 64 Hz

Ex connection data

The hazardous area device versions are powered by the CPM153 transmitter (see the data above).

12.4 Performance characteristics

Reference temperature

25 °C (77 °F), can be set with medium temperature compensation

Measured value resolution

pH:	0.01 pH
ORP:	1 mV / 1 %
Temperature:	0.1 K

Maximum measured error¹⁾

Display	
pH:	Max. 0.2 % of measuring range scope
ORP:	Max. 1 mV
Temperature	Max. 0.5 K
Current outputs:	Max. 0.2 % of current range end value in addition to deviation of display
Current inputs:	Max. 1 % of measuring range scope
Resistance input:	Max. 1 % of measuring range scope

Repeatability

Max. 0.1 % of measuring range

Zero point offset range

pH:	-2 to +16 pH
ORP:	-200 to +200 mV

Slope adjustment

pH:	5 to 99 mV / pH
-----	-----------------

1) According to IEC 746-1, at rated operating conditions

Offset	ORP:	±120 mV
	Temperature:	±5 K

Assignment for ORP relative	Adjustable, Δ for 100% = 150 to 2000 mV
------------------------------------	---

12.5 Environment

Ambient temperature range	-10 to +55 °C (+14 to +131 °F)
	-10 to +50 °C (+14 to +122 °F) (Ex)

Ambient temperature limits	-20 to +60 °C (-4 to +140 °F)
	-10 to +50 °C (+14 to +122 °F) (Ex)

Storage temperature	-30 to +80 °C (-22 to +176 °F)
----------------------------	--------------------------------

Electromagnetic compatibility	Interference emission to EN 61326: 1997 / A1:1998; Class B equipment (residential environments)
	Interference emission to EN 61326: 1997 / A1:1998; Appendix A (industry)

Degree of protection	CPM153:	IP 65
	CPG30:	IP 54

Relative humidity	10 to 95%, non-condensating
--------------------------	-----------------------------

Safety requirements	Complies with general safety requirements acc. to EN 61010. Complies with NAMUR Recommendations NE 21: 08/1998.
----------------------------	--

12.6 Mechanical construction

Mycom S CPM153


Dimensions	Length x breadth x depth:	247 mm x 167 mm x 100 mm (9.72" x 6.57" x 3.94")
	Installation depth:	Approx. 134 mm (5.28")
Weight	Max. 6 kg (13.23 lbs)	
Materials	Housing:	GD-AlSi 12 (Mg content 0.05%), plastic-coated
	Front:	Polyester, UV-resistant

CPG30


Dimensions	Housing	
	Length x breadth x depth:	400 mm x 300 mm x 200 mm (15.8" x 11.8" x 7.87")
	5 liter canister	
	Length x breadth x depth:	190 mm x 250 mm x 150 mm (7.48" x 9.84" x 5.91")
	Req. installation height:	350 mm (13.8")
Weight	Approx. 15 kg (33.1 lbs)	
Materials	Housing:	Polyester GF
	Hoses:	PU, PTFE (wetted)
	Level probes:	Polypropylene
	Canister:	HDPE

13 Appendix


13.1 Operating matrix

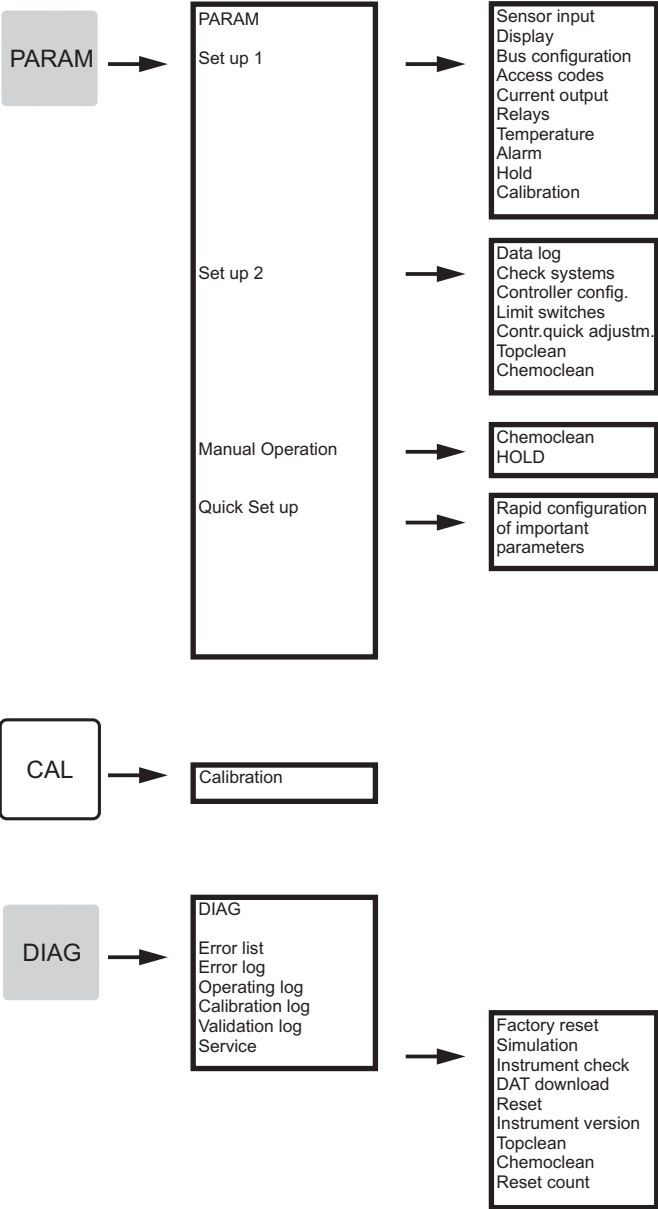

a0005022-en

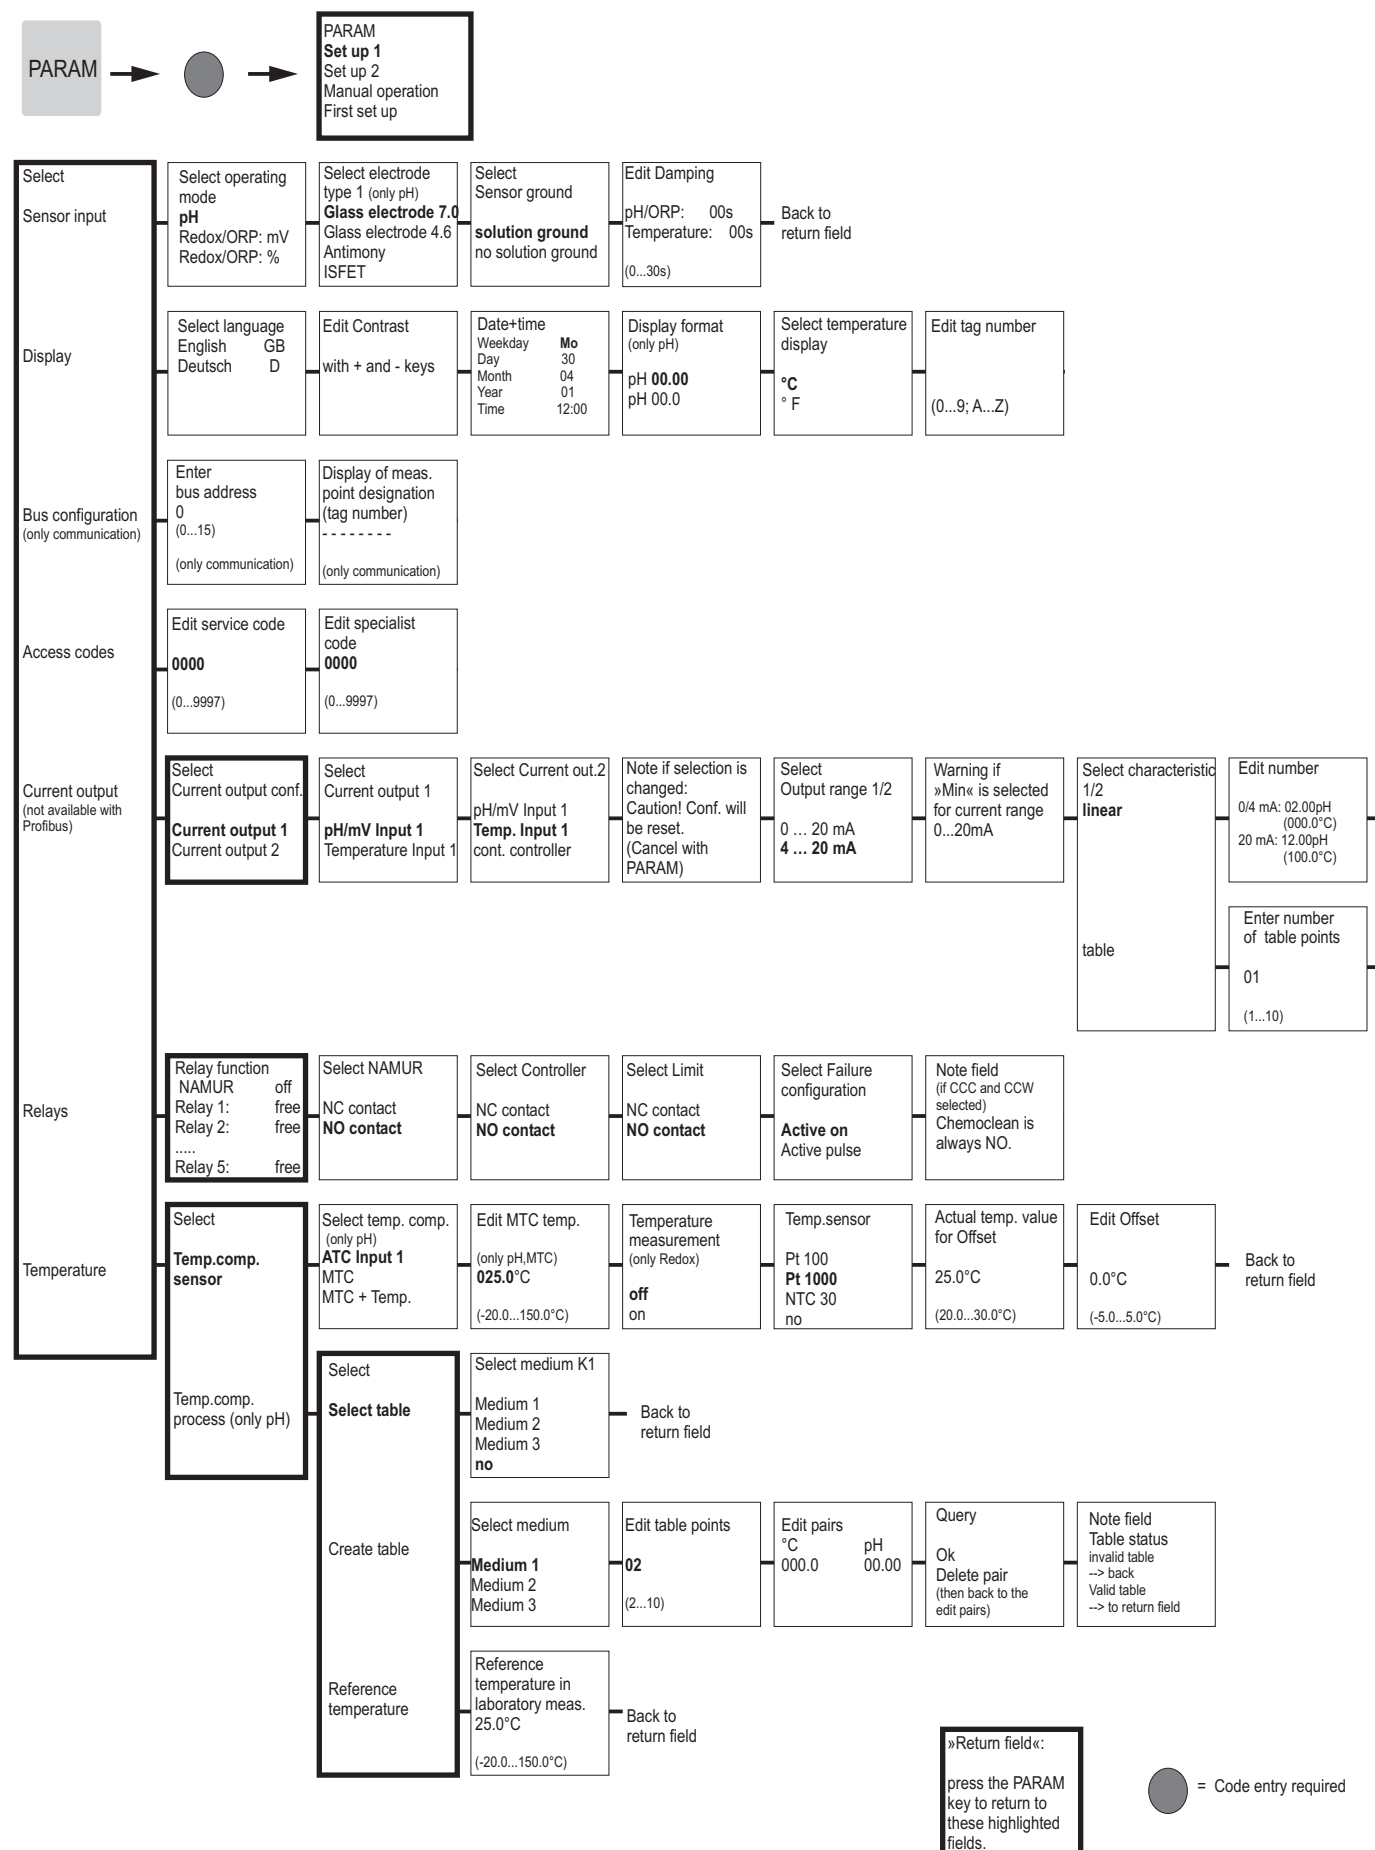


a0005013-en

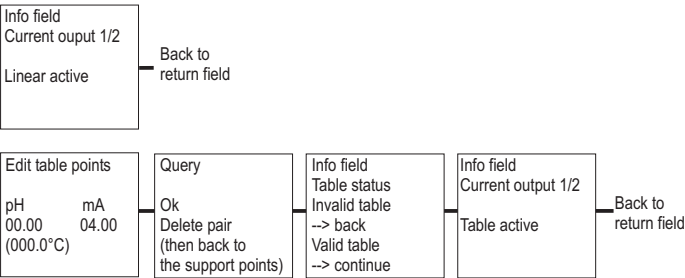

»Return field«:
press the PARAM
key to return to
these highlighted
fields..

 = Code entry required

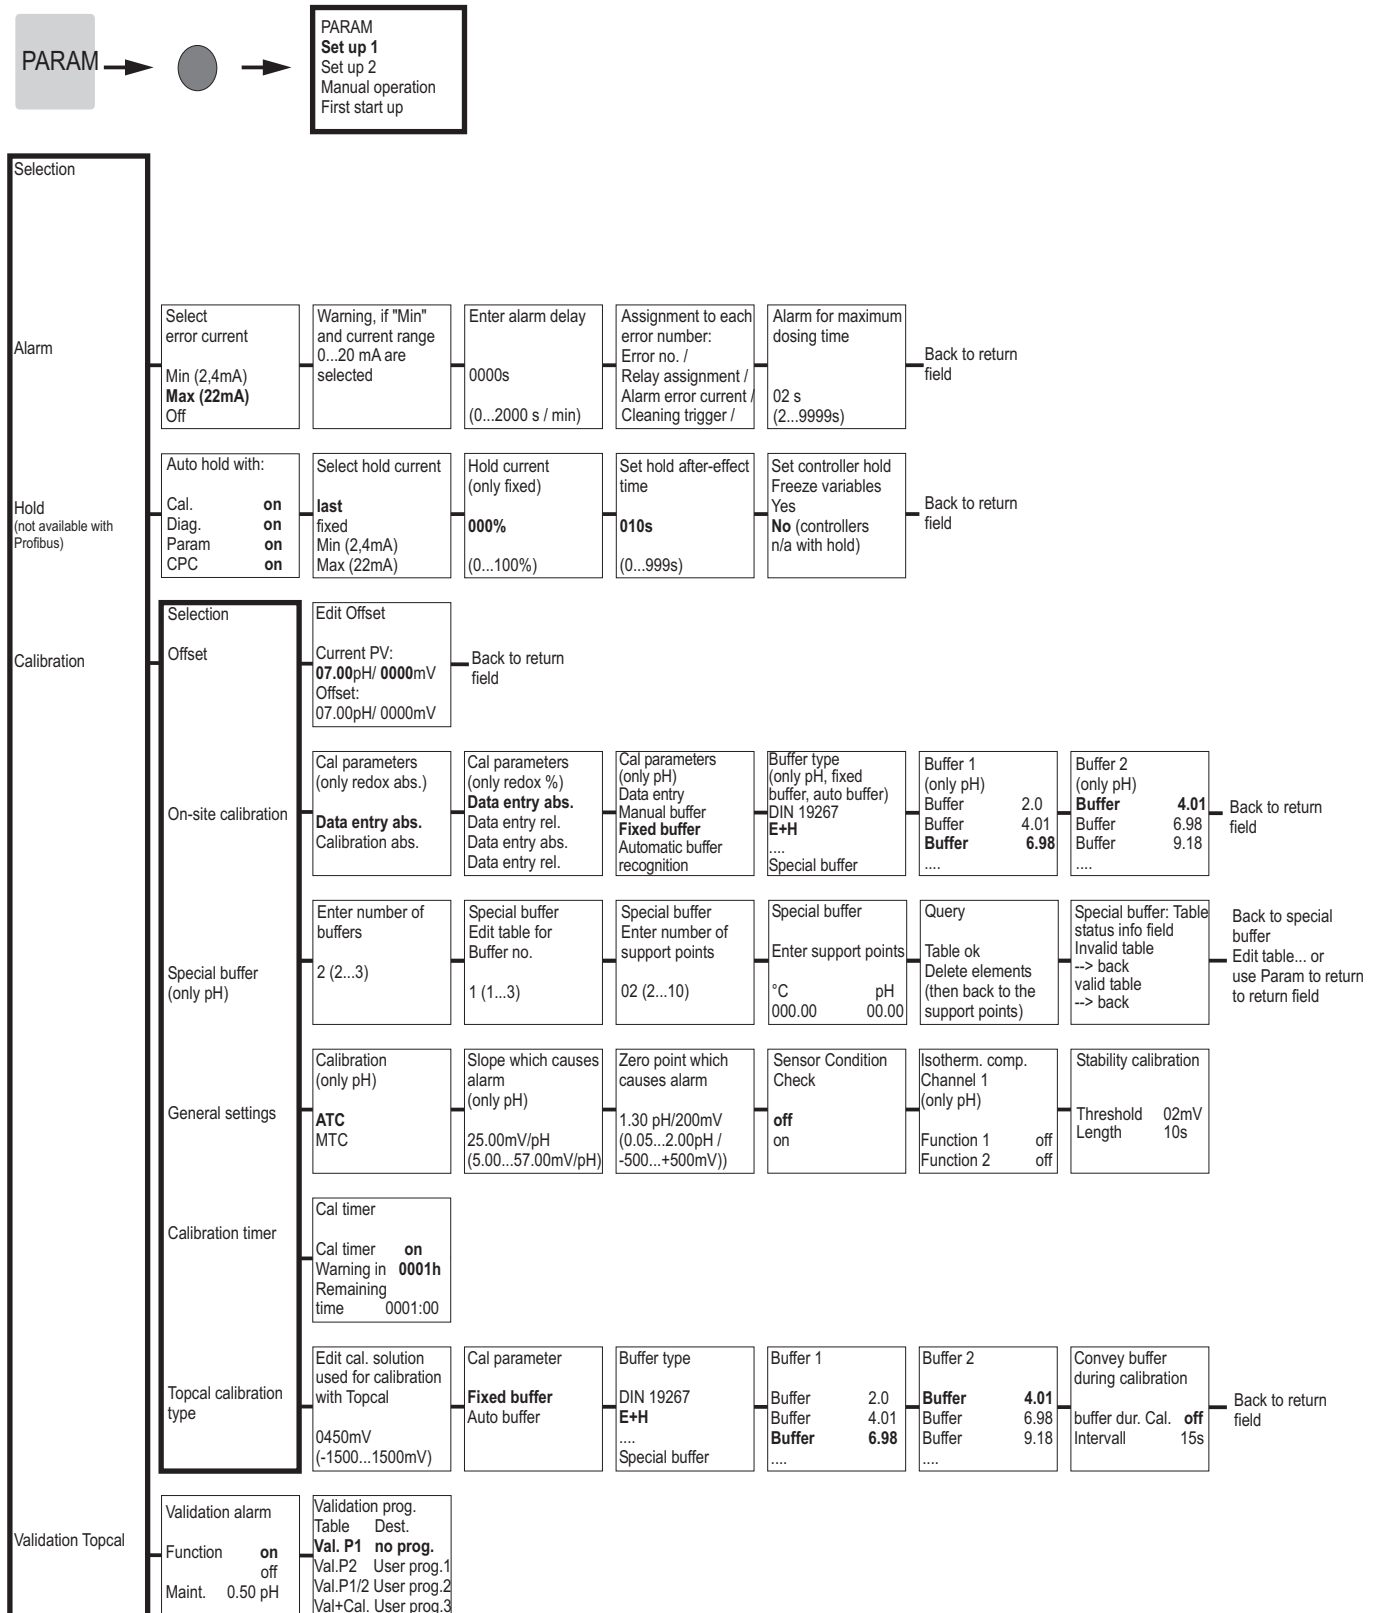


"Return field"

Press the PARAM key to return to these highlighted fields

● = Code entry required

a0005016-en

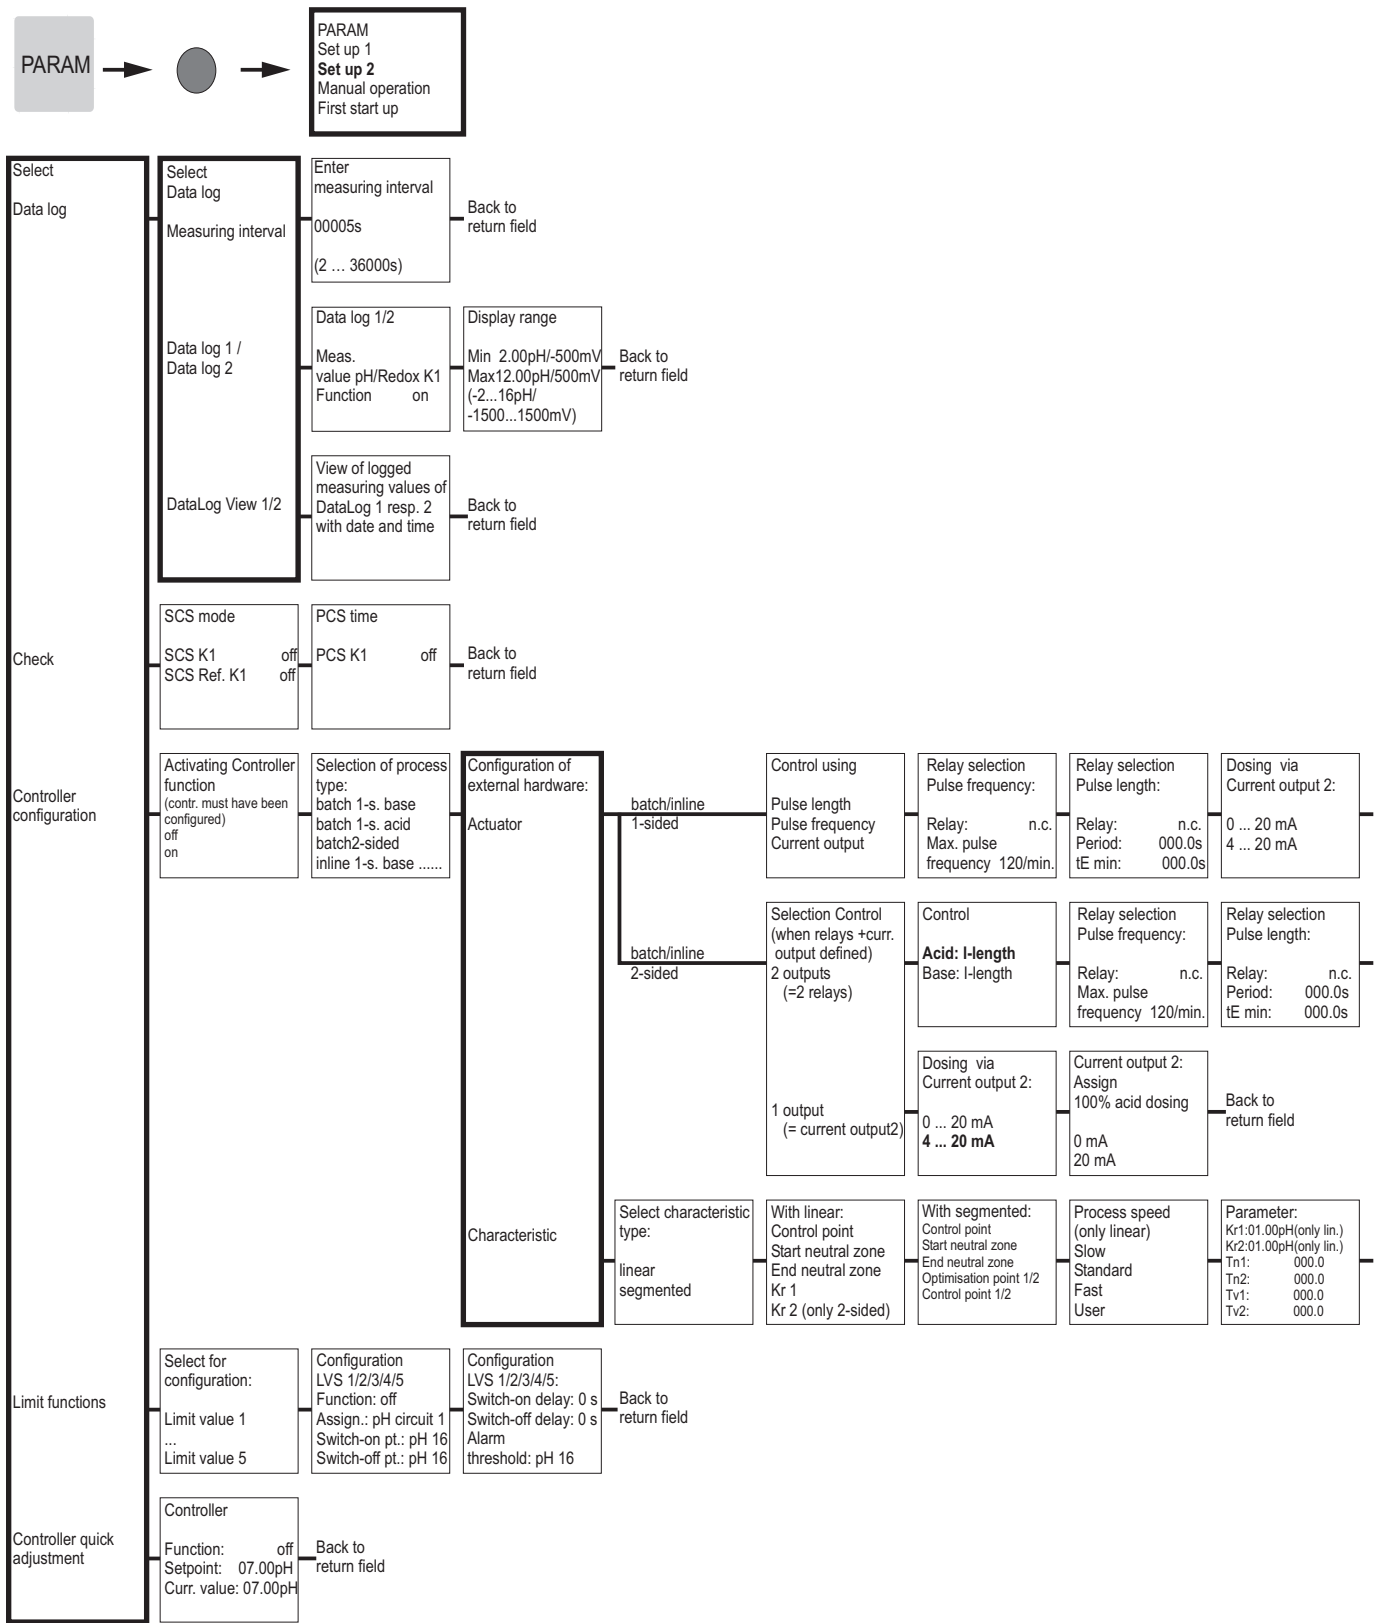

»Return field«:
press the PARAM key to return to the highlighted fields.

● = Code entry required

Current output 2:
Assign
100% acid dosing

0/4 mA
20 mA

Back to
return field

Back to
return field

Activate controller
simulation


off
on


Controller simulation
Function auto
Set: 07.00pH
Act.: 07.00pH
y: 000%



Controller simulation
or back to
return field

»Return field«:
press the PARAM
key to return to
the highlighted
fields.

= Code entry required

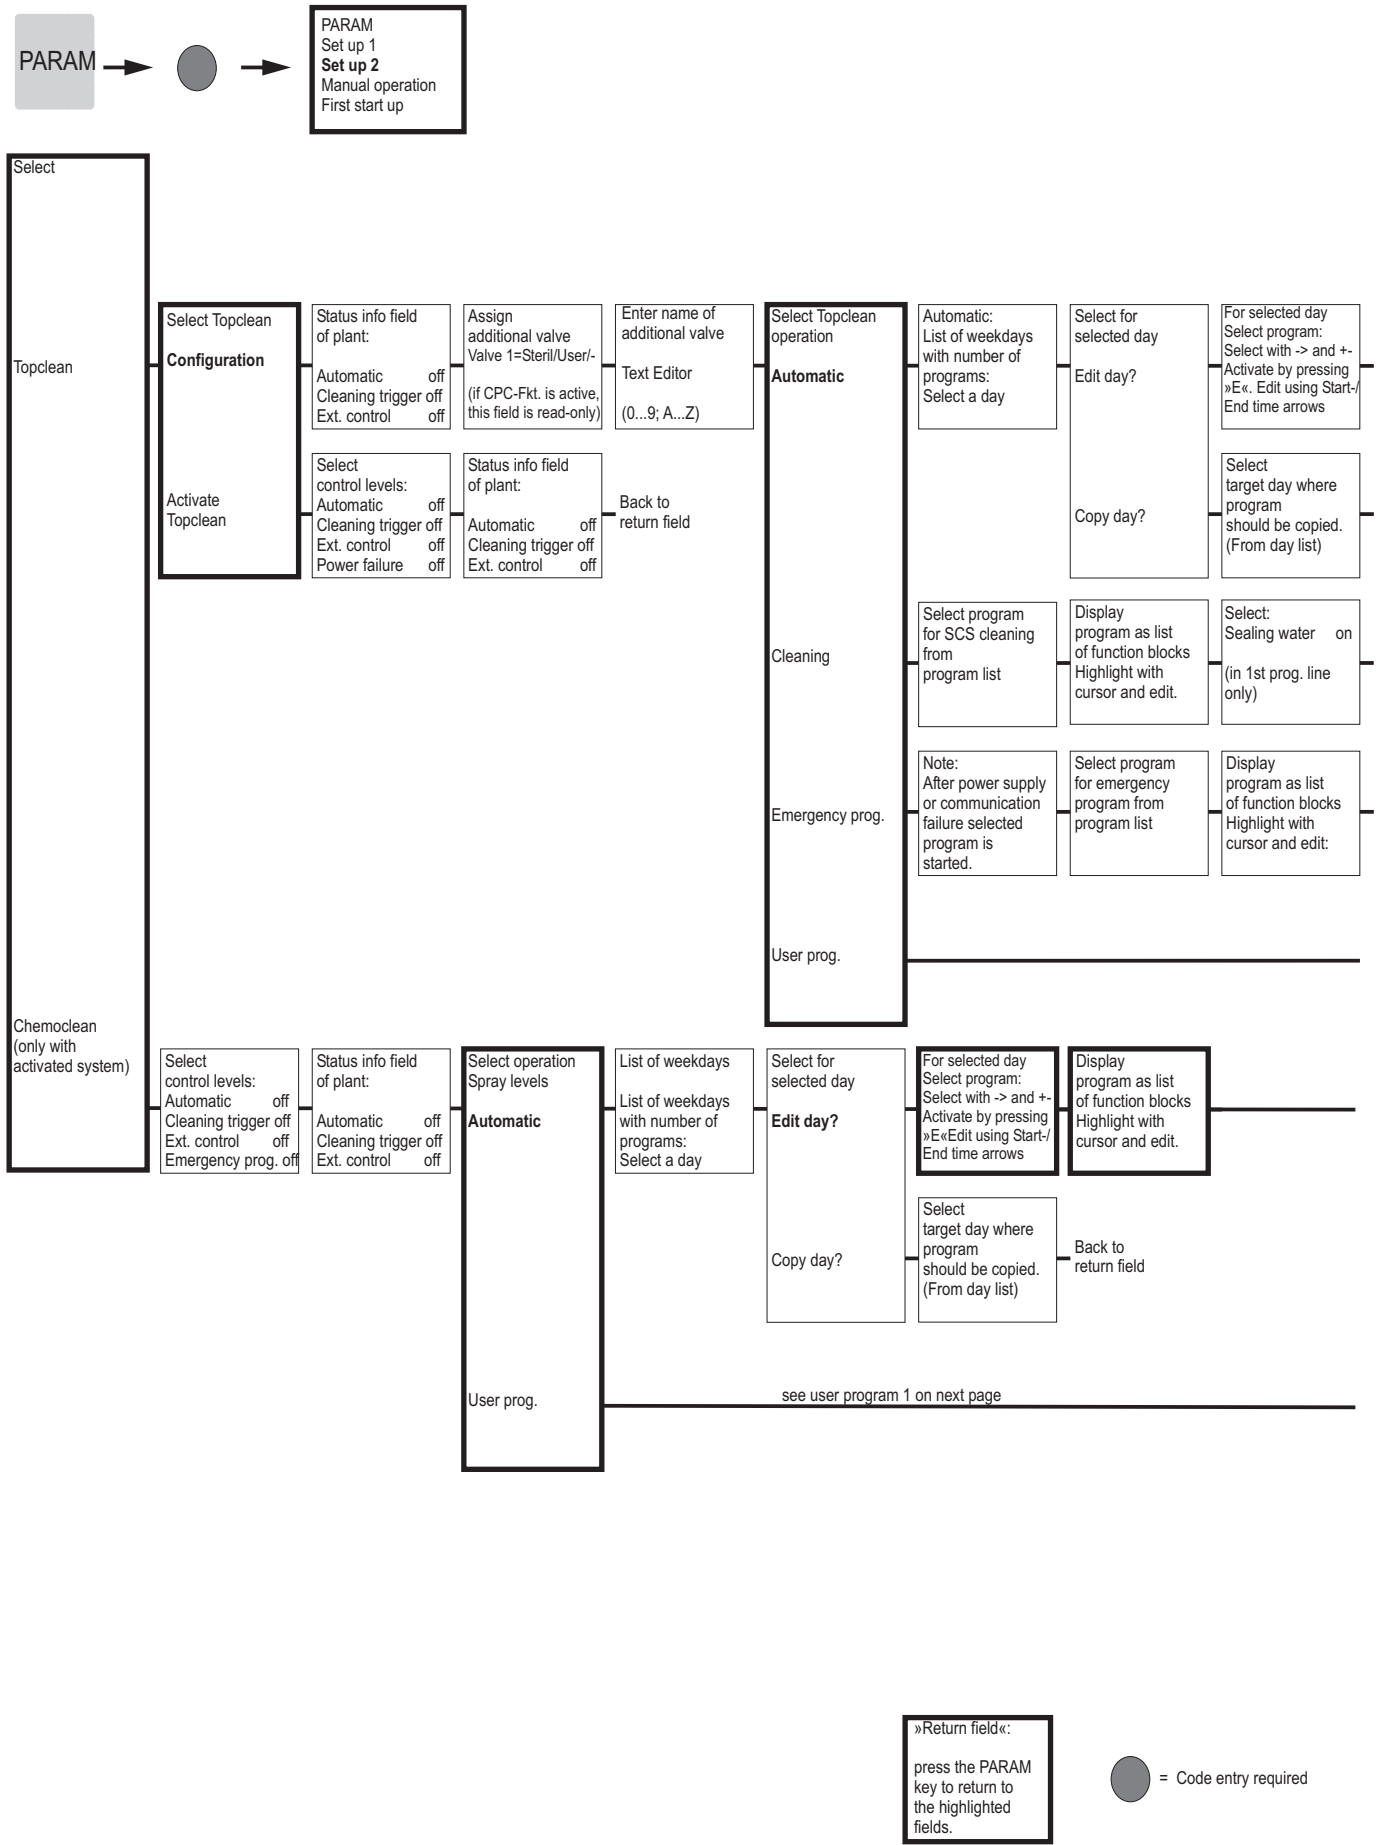


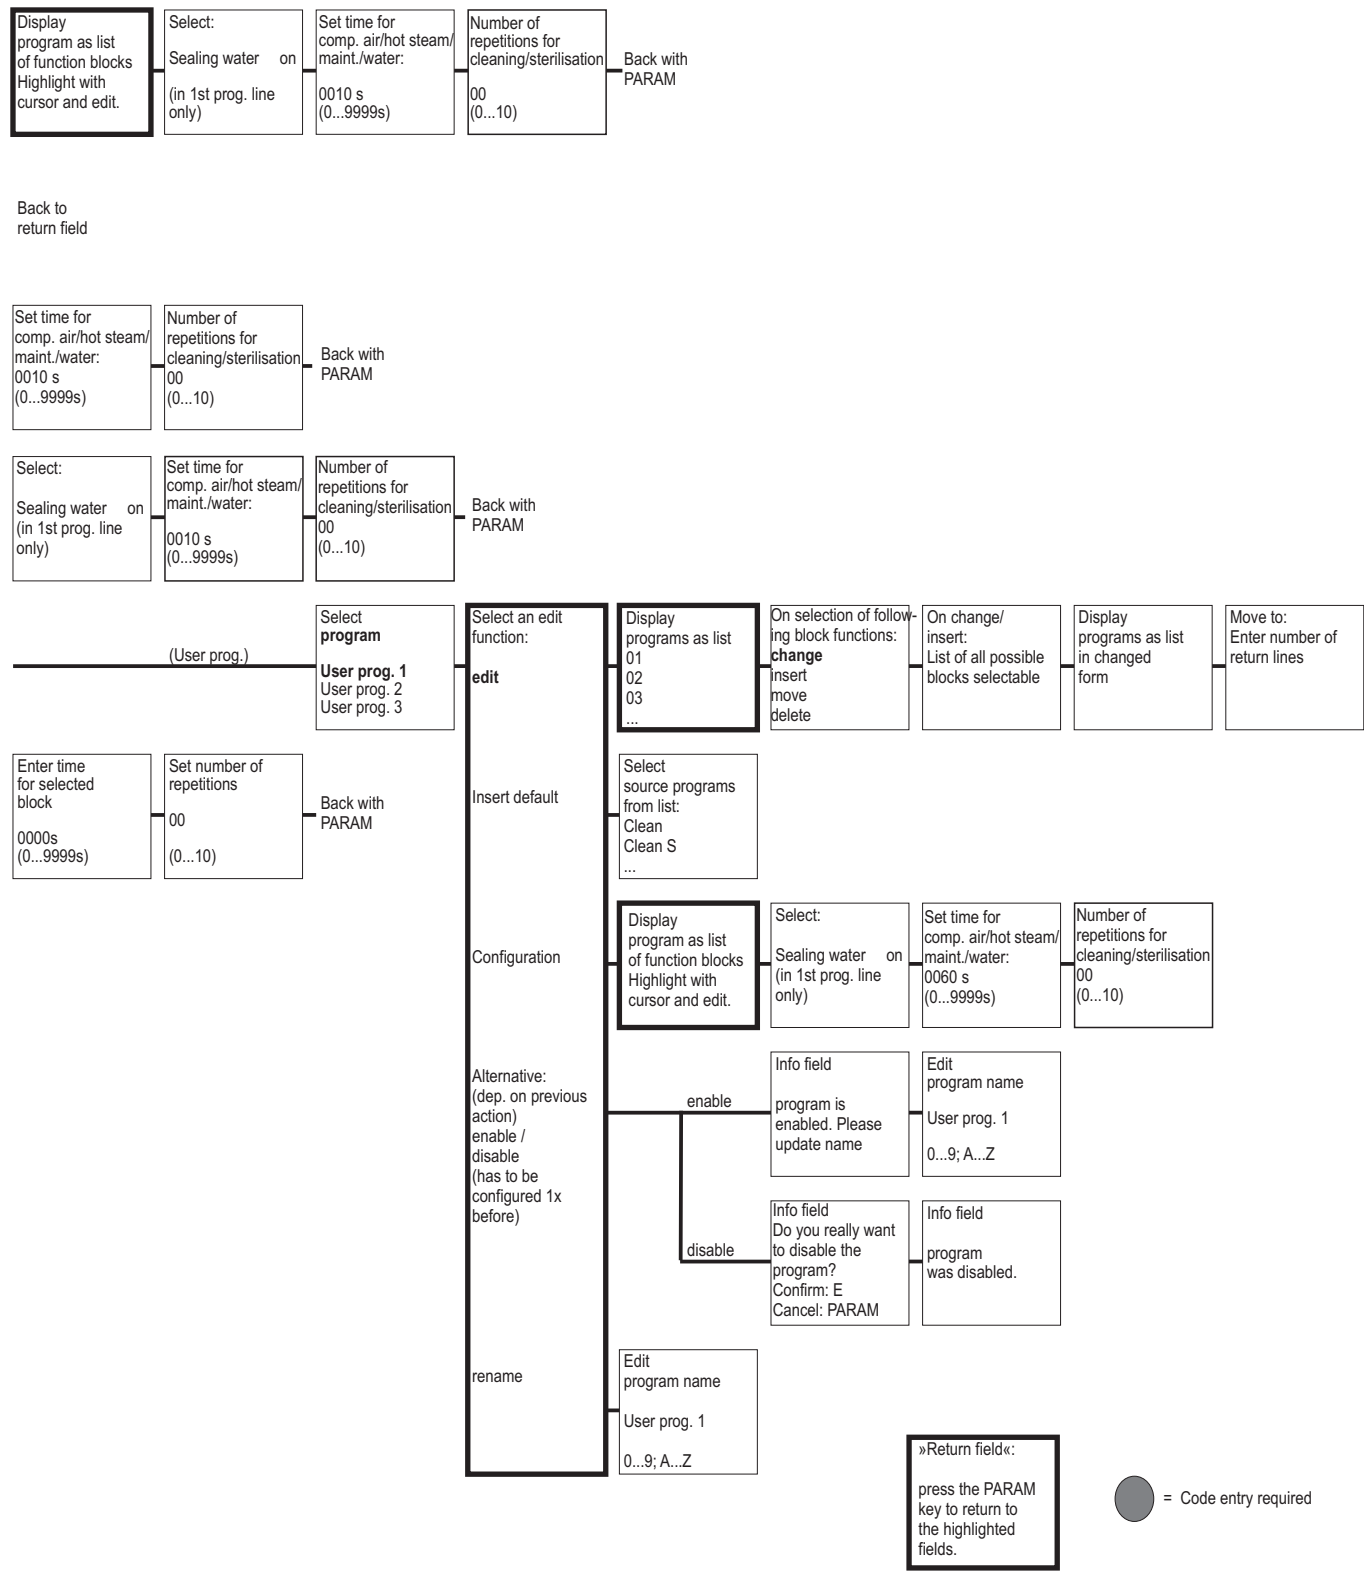


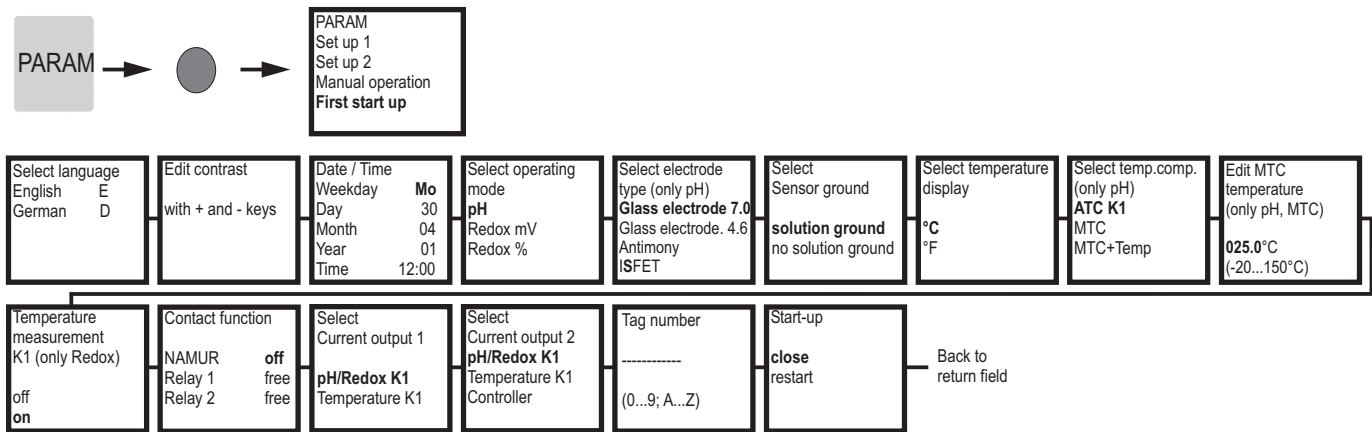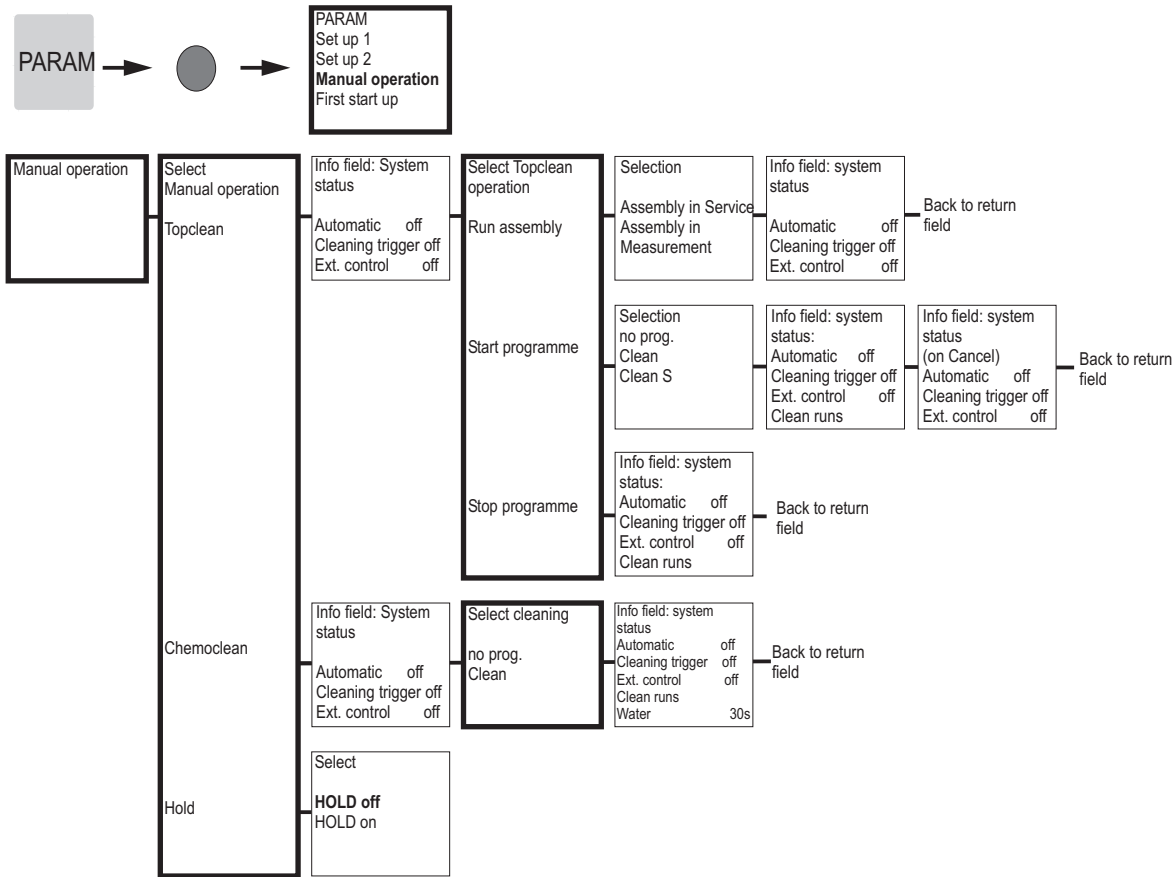


"Return field"
Press the PARAM
key to return to
these highlighted
fields.

= Code entry required

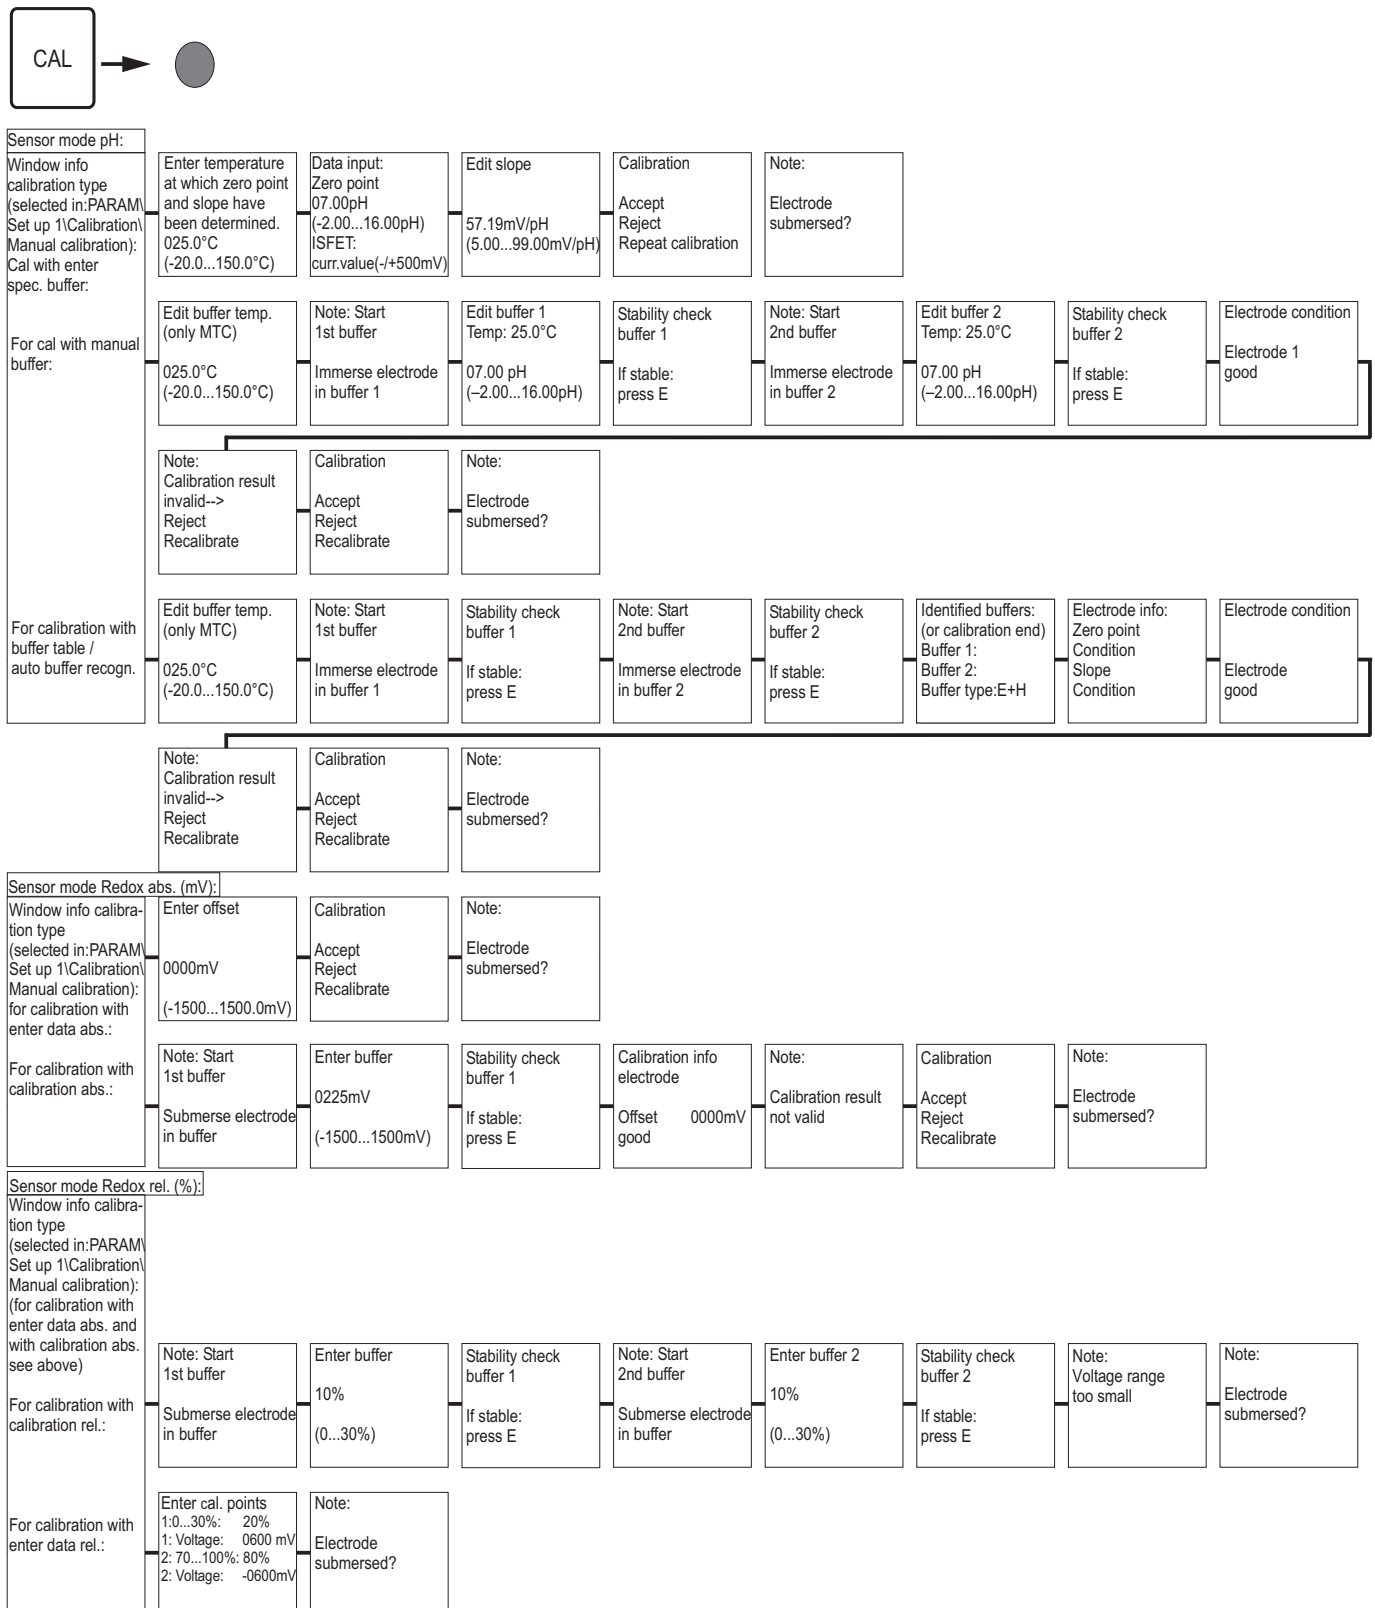

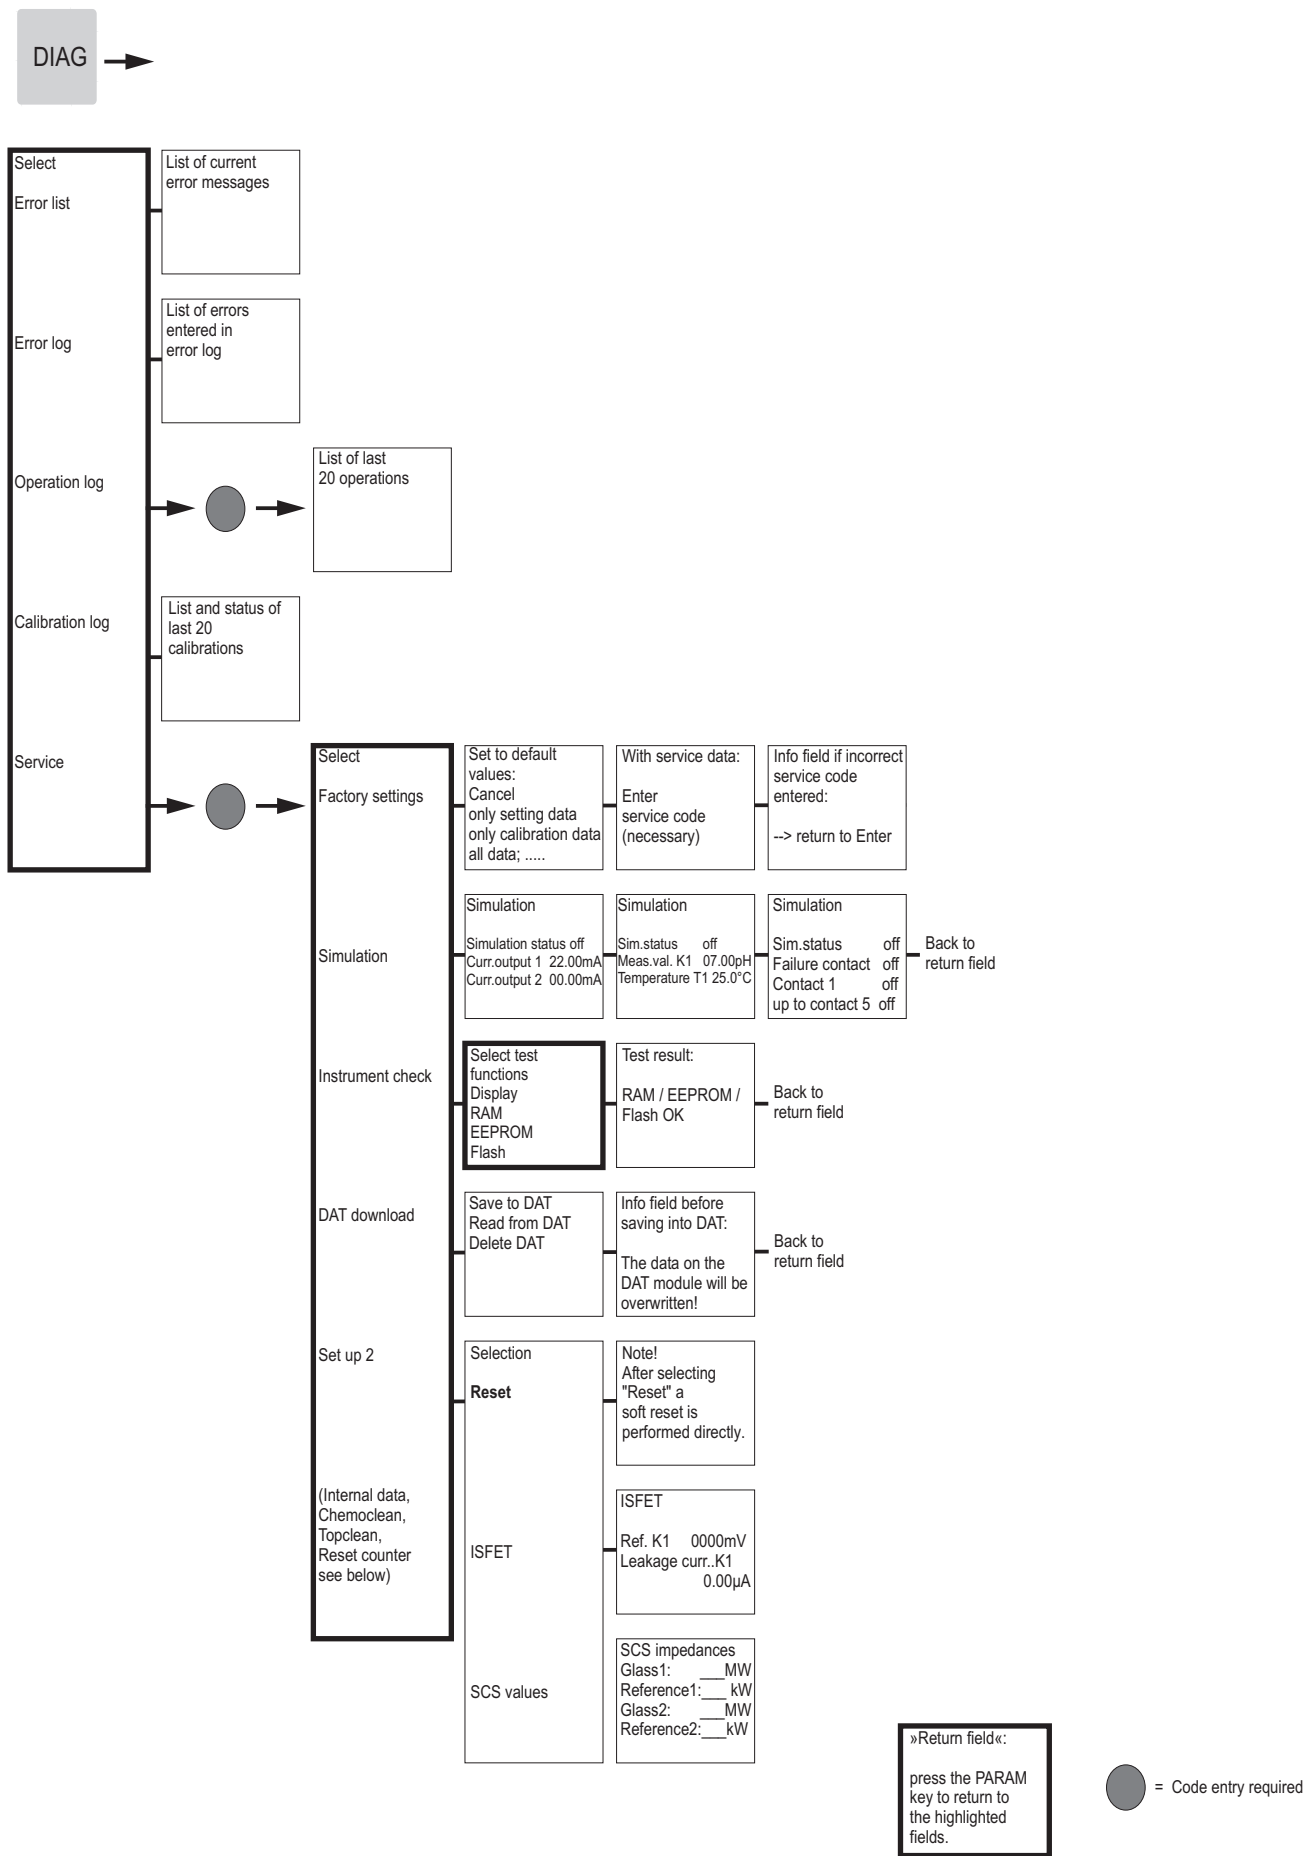

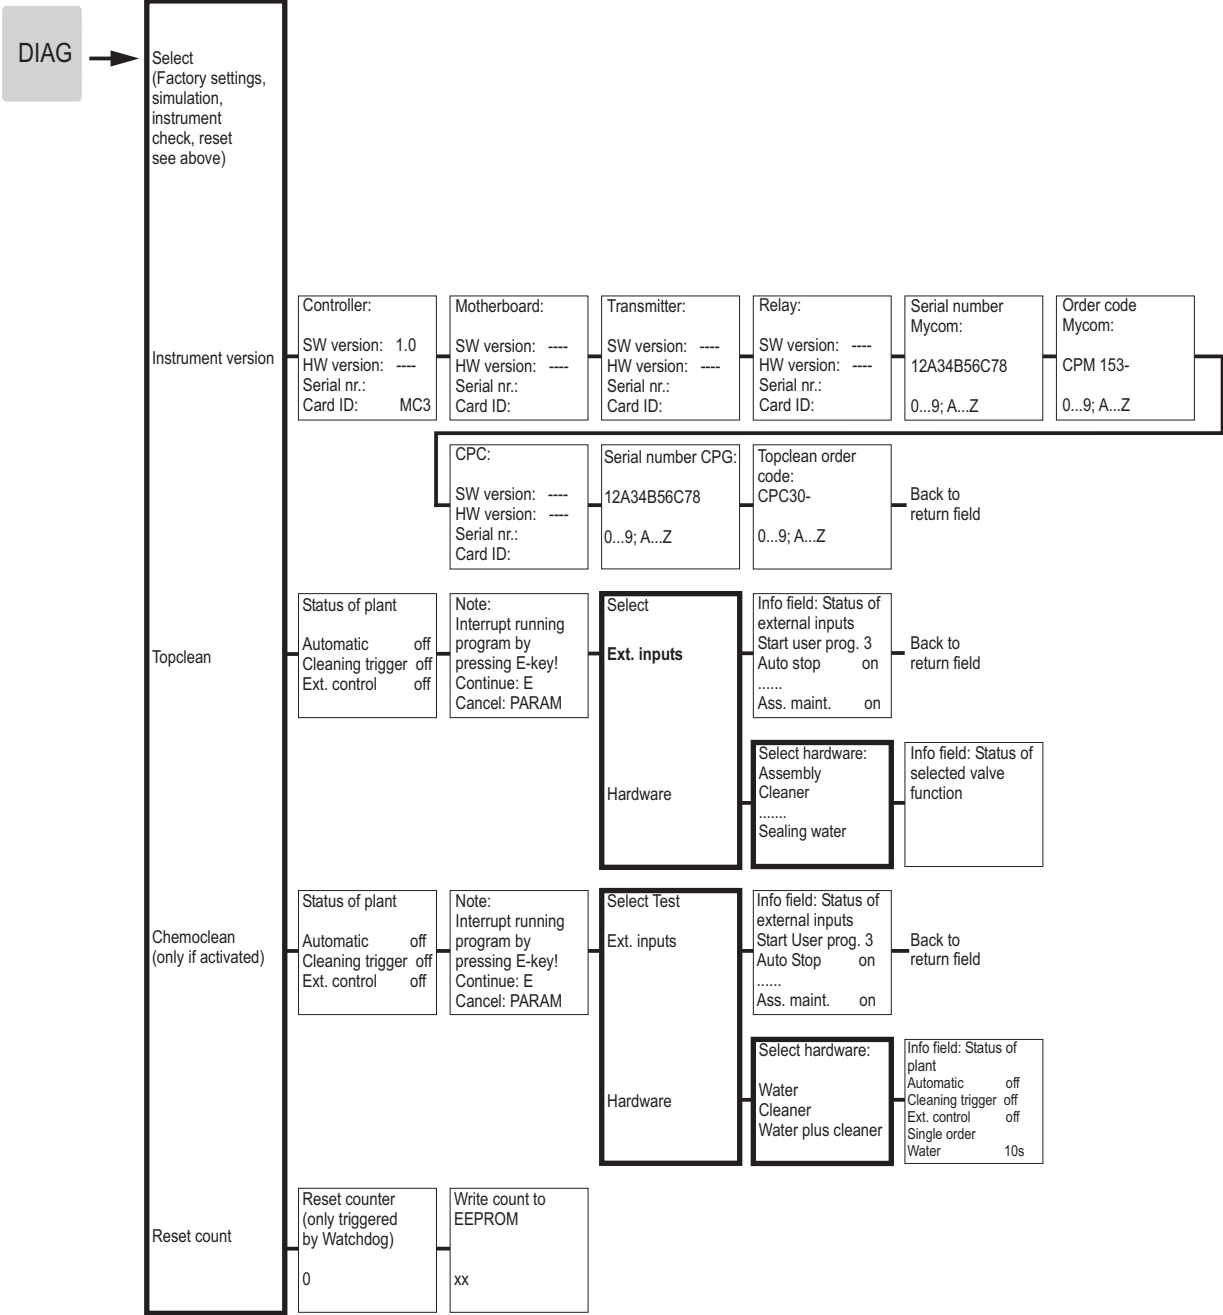

»Return field«:
press the PARAM key to return to the highlighted fields.

● = Code entry required

13.2 Connection examples

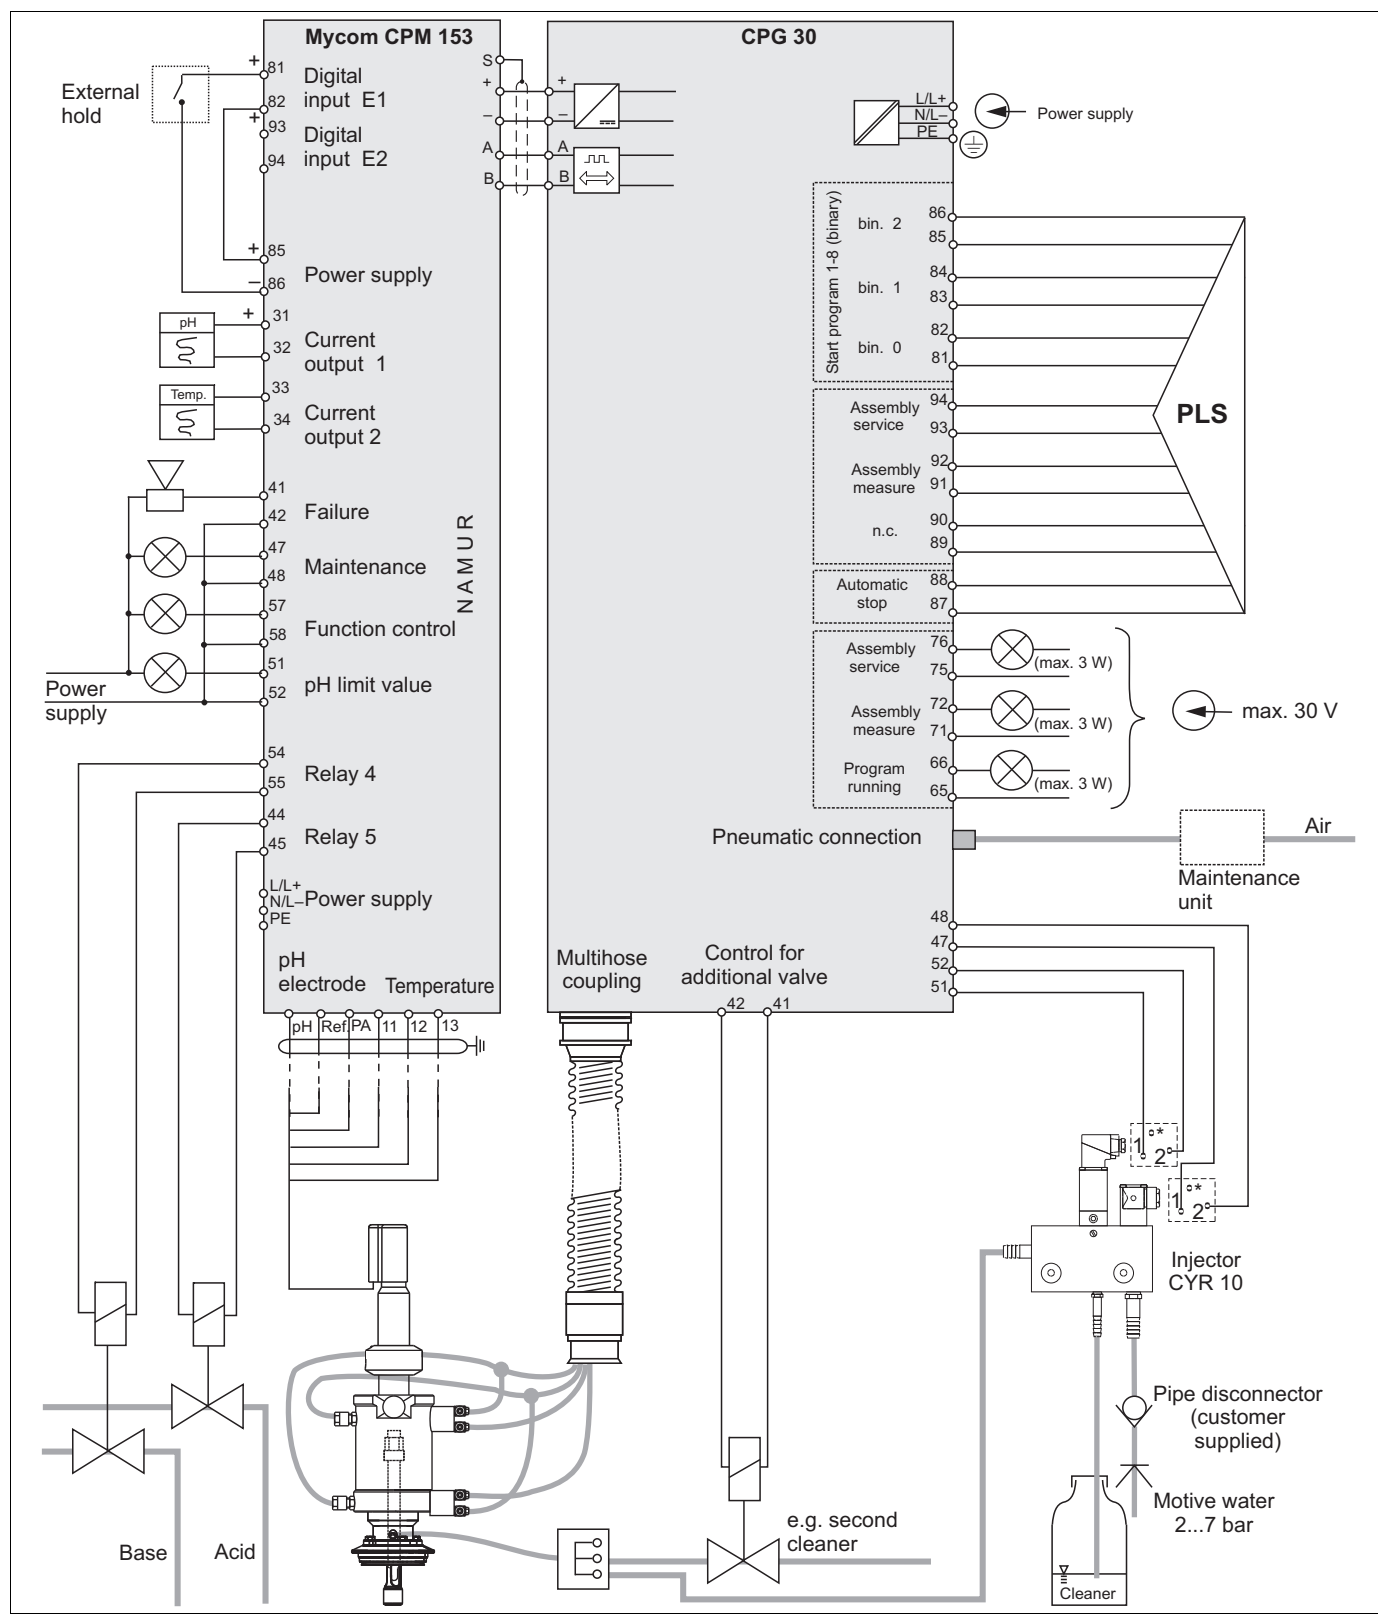


Fig. 60: Connection example, two-sided neutralization, limit value pH, NAMUR contact assignment, pH and temperature at current outputs, additional valve, external control via PCS, assembly status display

13.3 Wiring example for external program start

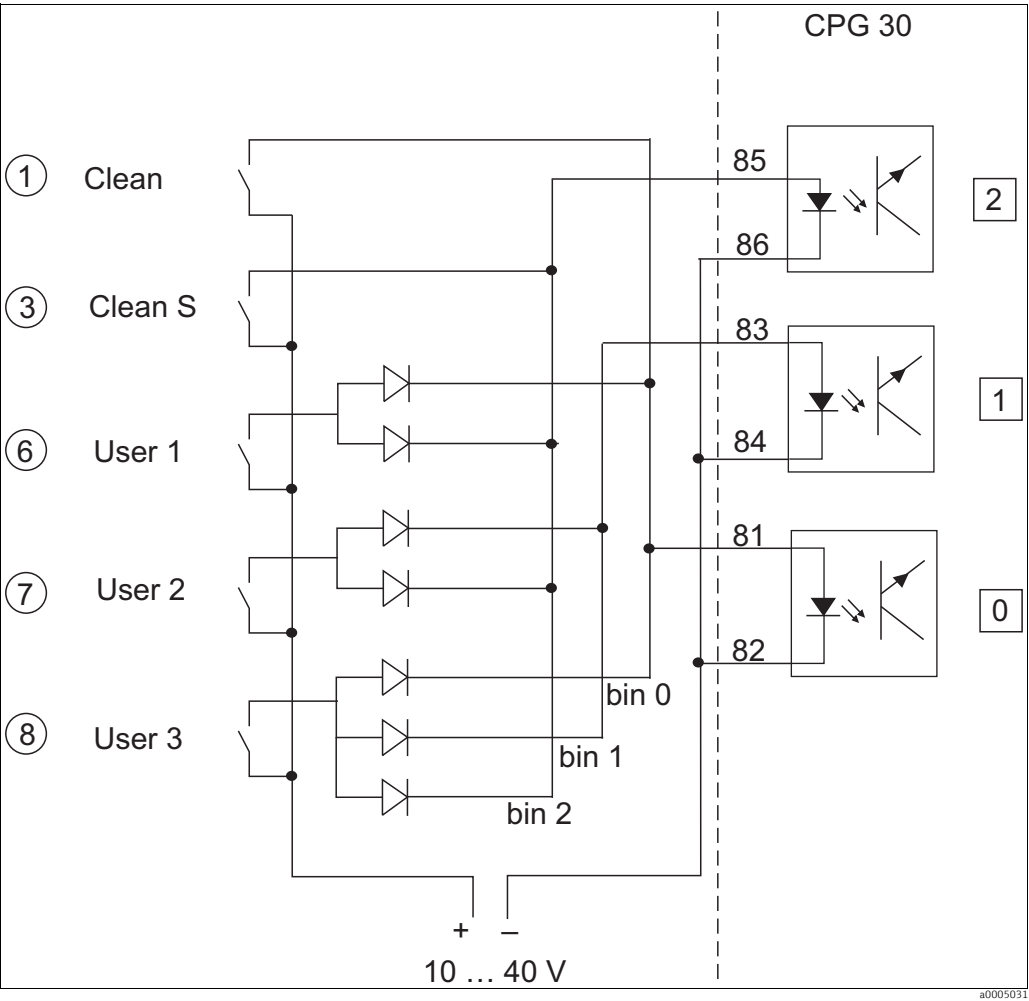


Fig. 61: Power diagram for external control of the cleaning and calibration programs

1-8 Keys to start the cleaning programs
81-86 Terminals for program start
0/1/2 Binary inputs of the CPG30 control unit
10-40V e.g. via power supply input of Mycom S CPM153, terminals 85/86 (15 V)
Diodes 1N4007
3 mA Per optoelectronic coupler input

13.4 Buffer tables

The following buffer tables are stored in Mycom S CPM153.

DIN 19267

°C	0	5	10	15	20	25	30	35	40	45	50	55	60	65	70	75	80	85	90	95
pH	1,08	1,08	1,09	1,09	1,09	1,09	1,10	1,10	1,10	1,10	1,11	1,11	1,11	1,11	1,11	1,11	1,12	1,12	1,13	1,13
	4,67	4,67	4,66	4,66	4,65	4,65	4,65	4,65	4,66	4,67	4,68	4,69	4,70	4,71	4,72	4,73	4,75	4,77	4,79	4,82
	6,89	6,87	6,84	6,82	6,80	6,79	6,78	6,77	6,76	6,76	6,76	6,76	6,76	6,76	6,76	6,77	6,78	6,79	6,80	6,81
	9,48	9,43	9,37	9,32	9,27	9,23	9,18	9,13	9,09	9,04	9,00	8,96	8,92	8,90	8,88	8,86	8,85	8,83	8,82	8,81
	13,95	13,63	13,37	13,16	12,96	12,75	12,61	12,45	12,29	12,09	11,98	11,79	11,69	11,56	11,43	11,31	11,19	11,09	10,99	10,89

Mettler

°C	0	5	10	15	20	25	30	35	40	45	50	55	60	65	70	75	80	85	90	95
pH	2,03	2,02	2,01	2,00	2,00	2,00	1,99	1,99	1,98	1,98	1,98	1,98	1,98	1,99	1,99	2,00	2,00	2,00	2,00	2,00
	4,01	4,01	4,00	4,00	4,00	4,01	4,01	4,02	4,03	4,04	4,06	4,08	4,10	4,13	4,16	4,19	4,22	4,26	4,30	4,35
	7,12	7,09	7,06	7,04	7,02	7,00	6,99	6,98	6,97	6,97	6,97	6,98	6,98	6,99	7,00	7,02	7,04	7,06	7,09	7,12
	9,52	9,45	9,38	9,32	9,26	9,21	9,16	9,11	9,06	9,03	8,99	8,96	8,93	8,90	8,88	8,85	8,83	8,81	8,79	8,77

E+H

°C	0	5	10	15	20	25	30	35	40	45	50	55	60	65	70	75	80	85	90	95
pH	2,01	2,01	2,01	2,00	2,00	2,00	2,00	2,00	2,00	2,00	2,00	2,00	2,00	2,00	2,01	2,01	2,01	2,01	2,01	2,01
	4,05	4,04	4,02	4,01	4,00	4,01	4,01	4,01	4,01	4,01	4,00	4,00	4,00	4,00	4,00	4,00	4,00	4,00	4,00	4,00
	7,13	7,07	7,05	7,02	7,00	6,98	6,98	6,96	6,95	6,95	6,95	6,95	6,96	6,96	6,96	6,96	6,97	6,98	7,00	7,02
	9,46	9,40	9,33	9,28	9,22	9,18	9,14	9,10	9,07	9,04	9,01	8,99	8,96	8,95	8,93	8,91	8,89	8,87	8,85	8,83
	11,45	11,32	11,20	11,10	11,00	10,90	10,81	10,72	10,64	10,56	10,48	10,35	10,23	10,21	10,19	10,12	10,06	10,00	9,93	9,86

NBS/DIN 19266

°C	0	5	10	15	20	25	30	35	40	45	50	55	60	65	70	75	80	85	90	95
pH	1,67	1,67	1,67	1,67	1,68	1,68	1,69	1,69	1,70	1,70	1,71	1,72	1,73	1,74	1,74	1,76	1,77	1,79	1,80	1,81
	4,01	4,01	4,00	4,00	4,00	4,01	4,01	4,02	4,03	4,04	4,06	4,08	4,10	4,11	4,12	4,14	4,16	4,18	4,20	4,23
	6,98	6,95	6,92	6,90	6,88	6,86	6,85	6,84	6,84	6,83	6,83	6,84	6,84	6,85	6,85	6,86	6,86	6,87	6,88	6,89
	9,46	9,39	9,33	9,27	9,22	9,18	9,14	9,10	9,07	9,04	9,01	8,99	8,96	8,94	8,93	8,91	8,89	8,87	8,85	8,83

Merck + Riedel

°C	0	5	10	15	20	25	30	35	40	45	50	55	60	65	70	75	80	85	90	95
pH	2,01	2,01	2,01	2,00	2,00	2,00	2,00	2,00	2,00	2,00	2,00	2,00	2,00	2,00	2,01	2,01	2,01	2,01	2,01	2,01
	4,05	4,04	4,02	4,01	4,00	4,01	4,01	4,01	4,01	4,01	4,00	4,00	4,00	4,00	4,00	4,00	4,00	4,00	4,00	4,00
	7,13	7,07	7,05	7,02	7,00	6,98	6,98	6,96	6,95	6,95	6,95	6,95	6,96	6,96	6,96	6,96	6,97	6,98	7,00	7,02
	9,24	9,16	9,11	9,05	9,00	8,95	8,91	8,88	8,85	8,82	8,79	8,76	8,73	8,72	8,70	8,68	8,66	8,65	8,64	8,64
	12,58	12,41	12,26	12,10	12,00	11,88	11,72	11,67	11,54	11,44	11,33	11,19	11,04	10,97	10,90	10,80	10,70	10,59	10,48	10,37

a0004718

Index

A

Access authorization	52
Access code	63
Accessories	141
Cable	143
Installation outdoors	144
Junction boxes	143
Panel mounting	144
Sensors	142
Alarm	71
Approvals	6

B

Back pressure water	32
Buffer tables	167

C

Calibration	113
pH	114
Redox	116
Calibration log	105
Calibration settings	
pH	74
Redox	77
Certificates	6
Check	
Electrical connection	37
Function	54
Installation	14
Medium connection	48
Check systems	80
Chemoclean	99
Cleaning	
Sensor	132
Transmitter	131
Cleaning program function overview	93
Cleaning programs	91
Configuration	95
Configuration example	59
Control	90
Function overview	93
Selection	91
Sequences	94
Code	63
Codes	52
Commissioning	54
Digital sensors	54
ISFET sensors	54
Switching on	55
Compressed air	8
Configuration	61
Configuration of cleaning programs	95
Connection	
Additional valve	32
Analog sensors	21
Communication connection	18

Current outputs	27
CYR10 injector	20
Digital sensors	25
External inputs	31
External inputs, control unit	30
External outputs, control unit	30
Inductive limit position switches	33
Overview	15
Power supply	18
Relay	28
Connection examples	166
Control	
Actuators	82
Characteristic	84
One-sided	82
Pulse frequency	82
Pulse length	82
Two-sided	82
Control of cleaning programs	90
Control unit	
Pneumatic	138
Control unit spare parts list	137
Controller quick adjustment	90
Controller settings	82
Current outputs	64
Coding	27
CYR10 injector spare parts list	139

D

DAT module	109
Data log	79
Designated use	4
Device configuration	61
Device fuse	140
Diagnosis	105
Diagnosis code	121
Diagnostics	121
Differential conductivity	92
Display	49, 62
Disposal	140

E

Editor types	53
Electrical connection	15
Electrical technician	15
Electrode connection	21
Error	
Device-specific errors	128
Error messages	121, 125
Troubleshooting	121
Error log	105

F

First start up	56
Function of the keys	49

H

Hold 72

I

Incoming acceptance 5

Installation..... 7

Panel mounting..... 12

Post mounting..... 12

Remarks 10

Wall mounting 10

Installation conditions

Assembly 9

Dimensions 9

Spacing..... 8

Types of mounting 7

K

Key function 49

L

Limit switch..... 88

M

Maintenance 131

Assembly 134

Cable..... 134

Connections..... 134

Control unit 135

CYR10 injector..... 135

Digital sensors..... 133

Entire measuring point 131

Liquid KCl supply..... 133

Supply lines 134

Manual operation..... 103

Measuring menus..... 51

Measuring system..... 7

Mechanical construction 151

Medium connection 38

Compressed air 38

Mycom interior view 136

Mycom spare parts list..... 137

N

Nameplate 5

NAMUR 29

O

Occupational safety 4

Operating matrix..... 153

Operation..... 49

Operation log..... 105

Operational safety 4

Output error response mode 129

P

Panel mounting..... 12

PCS 81

Performance characteristics..... 149

pH calibration

Automatic buffer recognition 114

Buffer table 114

Manual buffer 114

Manual data entry..... 114

pH/ISFET changeover..... 23

Pneumatic control unit..... 138

Post mounting 12

Post-connection check 37

Post-installation check..... 14

Power supply 148

Process Check System..... 81

Process error 125

Product identification..... 5

Program sequences..... 94

Pulse frequency..... 82

Pulse length..... 82

Q

Quick commissioning 56

Quick startup 56

R

Redox calibration

Absolute 117

Absolute data entry..... 116

relative 119

Relative data entry 118

Relays 66

Repair 136

Replacing the device fuse..... 140

Requirements for personnel 4

Return..... 4, 140

Rinse water 8

S

Scope of delivery	6
SCS	80
Sensor Check System	80
Sensor connection	21
Sensor data	
Digital sensors	105
Sensor input	61
Service switch	50
Set up 1	
Alarm	71
Calibration	74
Code	63
Current outputs	64
Display	62
Hold	72
Relays	66
Sensor input	61
Temperature	68
Set up 2	
Check systems	80
Chemoclean	99
Controller quick adjustment	90
Controller settings	82
Data log	79
Limit switch	88
Topclean	90
Spare parts	136
System error	121

T

Technical data	145, 148–149, 151
Temperature compensation	68
Medium temperature	68
Troubleshooting	121

U

Use	4
-----------	---

W

Wall mounting	10
Wiring	15
External program start	167



71286654

www.addresses.endress.com
